ARTISAN®
TECHNOLOGY GROUP

Your **definitive** source for quality pre-owned equipment.

Artisan Technology Group
(217) 352-9330 | sales@artisantg.com | artisantg.com

Full-service, independent repair center
with experienced engineers and technicians on staff.

We buy your excess, underutilized, and idle equipment
along with credit for buybacks and trade-ins.

Custom engineering
so your equipment works exactly as you specify.

- Critical and expedited services
- In stock / Ready-to-ship
- Leasing / Rentals / Demos
- ITAR-certified secure asset solutions

Expert team | Trust guarantee | 100% satisfaction

All trademarks, brand names, and brands appearing herein are the property of their respective owners.

Find the *Acromag BusWorks XT1231-000* at our website: ***Click HERE***

BusWorks® XT Series
10/100MB Industrial Ethernet I/O Modules
USB Programmable, Profinet I/O Devices

Model XT1233-000 & XT1243-000
16-Channel Single-Ended Current Input
16-Channel Single-Ended Voltage Input

USER'S MANUAL



ACROMAG INCORPORATED
30765 South Wixom Road
Wixom, MI 48393-2417 U.S.A.

Tel: (248) 295-0880
Fax: (248) 624-9234
email: sales@acromag.com

Copyright 2013, Acromag, Inc., Printed in the USA.
Data and specifications are subject to change without notice.

8500956G

Table of Contents

GETTING STARTED

DESCRIPTION 4
- Key Features 4
- Application 4
- Mechanical Dimensions 5
- DIN Rail Mounting & Removal 5

ELECTRICAL CONNECTIONS 6
- Power Connections 7
- USB Connection 8
- Input Connections 9
- Analog Return Ground Connection 12
- EMI Filter Installation 12
- Earth Ground Connections 13

CONFIGURATION SOFTWARE 13
- Quick Overview 14

TECHNICAL REFERENCE

CONFIGURATION STEP-BY-STEP 16
- Getting Connected 16
- Device/Communication Setup 17
- I/O Configuration/Test 20
- Calibration Page 22
- Network Home Page 23
- How It Works 24
- About Profinet IO 25
- Profinet GSDML File 26
- Profinet Mapping Table 26

TROUBLESHOOTING 28
- Diagnostics Table 28
- Service & Repair Assistance 30

ACCESSORIES 31
- Software Interface Package 31
- USB Isolator 31
- USB A-B Cable 31
- USB A-mini B Cable 31
- DIN Rail Bus Connector Kit 32
- Low EMI Double-Shielded Patch Cable 32

SPECIFICATIONS 33
Model Number 33
Analog Inputs 33
Power 36
USB Interface 37
Ethernet Interface 37
Enclosure & Physical 38
Environmental 39
Agency Approvals 40
Reliability Prediction 41
Configuration Controls 41
REVISION HISTORY 42

All trademarks are the property of their respective owners.

IMPORTANT SAFETY CONSIDERATIONS

You must consider the possible negative effects of power, wiring, component, sensor, or software failure in the design of any type of control or monitoring system. This is very important where property loss or human life is involved. It is important that you perform satisfactory overall system design and it is agreed between you and Acromag, that this is your responsibility.

The information of this manual may change without notice. Acromag makes no warranty of any kind with regard to this material, including, but not limited to, the implied warranties of merchantability and fitness for a particular purpose. Further, Acromag assumes no responsibility for any errors that may appear in this manual and makes no commitment to update, or keep current, the information contained in this manual. No part of this manual may be copied, or reproduced in any form without the prior written consent of Acromag, Inc.

GETTING STARTED

DESCRIPTION

Symbols on equipment:



Means “Refer to User’s Manual (this manual) for additional information”.

The XT1233-000 and XT1243-000 are Profinet network input modules for interface with up to 16 Single-Ended channels of DC current input (XT1233-000), or 16 Single-Ended channels of DC voltage input (XT1243-000). They provide input isolation from network & power. Channels are setup and calibrated, and their operation checked offline, over a USB interface.

Key Features

- **CE Approved, UL/cUL Class I, Division 2.**
- **Designed and Manufactured with High Quality/High Reliability with AS9100 (Aerospace Quality)/ISO9001.**
- **I/O is conveniently configured & pre-checked offline w/ Windows software via a USB connection.**
- **High-Density 22.5mm wide package with pluggable, front-facing terminals.**
- **Dual Isolated 10/100Mbps Ethernet ports w/ Auto-Negotiation offers convenient “daisy chain” network connection which saves switch ports.**
- **Operation & Diagnostic LED indicators aide trouble-shooting.**
- **Bus Power Ready for Clean Wiring along the DIN Rail, or for Redundant Power Connection.**
- **High 1500VAC Isolation between input channels (as a group), the network (including port-to-port), and power.**
- **Input, power, network, and USB ports are all transient protected.**
- **Wide-range DC power input from 12-32V.**
- **Wide ambient temperature operation from -40°C to +70°C.**
- **Thoroughly Tested and Hardened For Harsh Environments.**
- **Withstands High Shock (25G) and Vibration (4G).**
- **Model XT-1233/34-000 is ATEX Certified for Explosive Atmospheres.**
  Ⓔx II 3 G Ex nA IIC T4 Gc -40ºC ≤ Ta ≤ +70ºC
  DEMKO 15 ATEX 1561X


Application

This module is designed for high-density mounting on T-type DIN rails. XT models may be mounted side-by-side on 22.5mm centers and can plug-together for modular expansion with a shared power connection along the DIN rail. These models will interface with any mix of up to 16 single-ended current inputs (Model XT1233-000), or 16 single-ended voltage inputs (Model XT1243-000), and monitor the input values via a 10/100Mbps Ethernet interface using the Profinet IO. Channels are conveniently setup, calibrated, and pre-checked offline via a USB connection to any Windows-based PC (Windows XP and later versions only) running model-specific configuration software. Network communication parameters are setup over the network using a Profinet Configuration tool.

Mechanical Dimensions

Units may be mounted to 35mm "T" type DIN rail (35mm, type EN50022), and side-by-side on 22.5mm (0.9-inch) centers.

WARNING: *IEC Safety Standards may require that this device be mounted within an approved metal enclosure or sub-system, particularly for applications with exposure to voltages greater than or equal to 75VDC or 50VAC.*

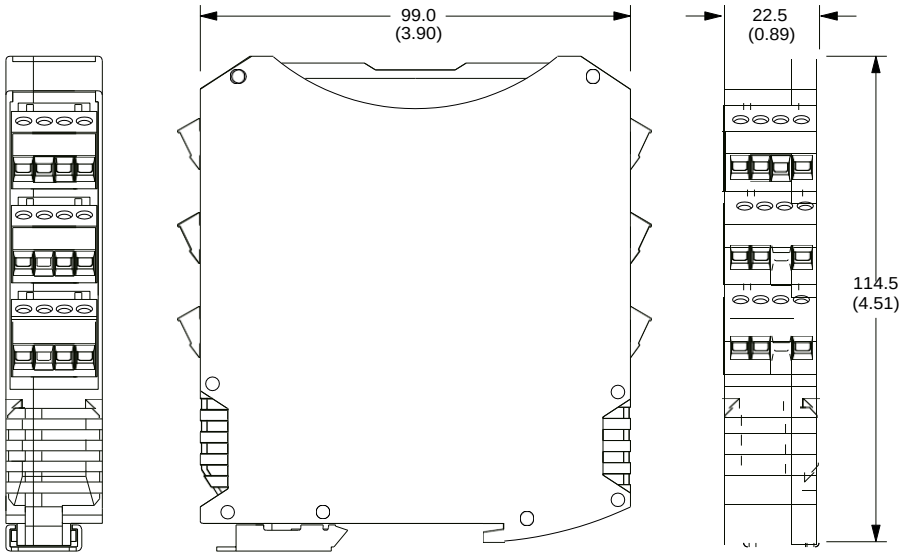


DIMENSIONS ARE IN MILLIMETERS (INCHES)

DIN Rail Mounting & Removal

Refer to the following figure for attaching and removing a unit from the DIN rail. A spring loaded DIN clip is located on the bottom side. The opposite rounded edge at the bottom of the top side allows you to tilt the unit upward to lift it from the rail, while prying the spring clip back with a screwdriver. To attach the module to T-type DIN rail, angle the top of the unit towards the rail and place the top groove of the module over the upper lip of the DIN rail. Firmly push the unit downward towards the rail until it snaps into place. To remove it from the DIN rail, first separate the input terminal blocks from the bottom side of the module to create a clearance to the DIN mounting area. You can use a screwdriver to pry the pluggable terminals out of their sockets. Next, while holding the module in place from above, insert a screwdriver along the bottom side path of the module to the DIN rail clip and use it as a lever to force the DIN rail spring clip down while pulling the bottom of the module outward until it disengages from the rail. Tilt it upward to lift it from the rail.

IMPORTANT: For ambient operation above 55°C, it is recommended that you space units apart to aide cooling. Module is intended to be mounted upright on a horizontal DIN rail, allowing cool air to enter in through the bottom vents and warm air to exhaust out the top vents. Above 55°C, a space of at least 20mm between modules is recommended to aide cooling in this manner.

SERIES XT MODULE DIN RAIL MOUNTING AND REMOVAL

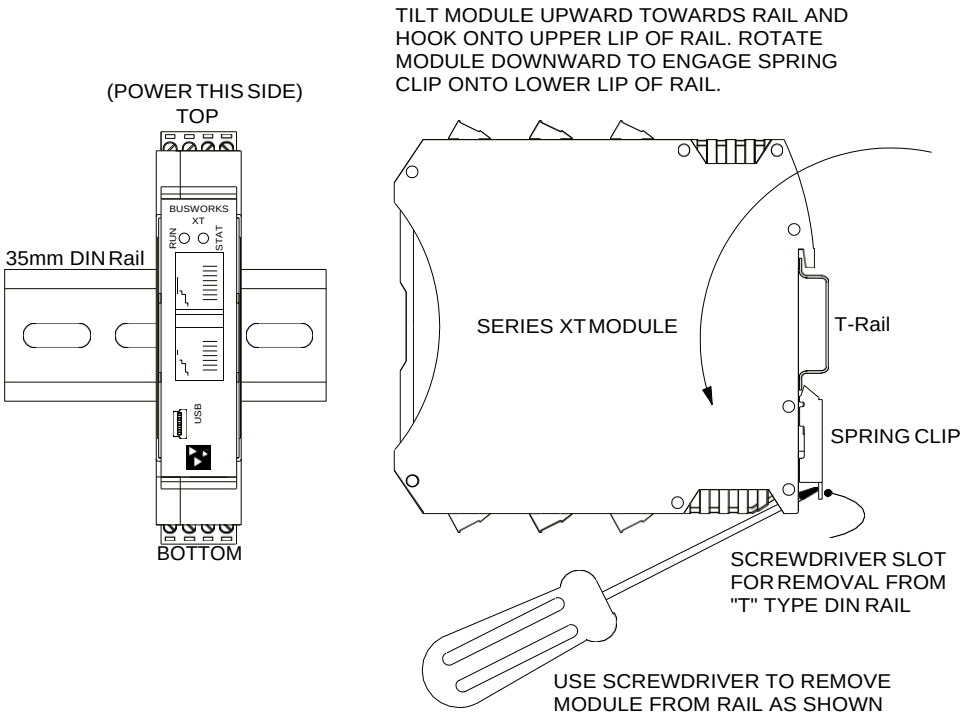

ELECTRICAL CONNECTIONS

WARNING – EXPLOSION HAZARD – Do not disconnect equipment unless power has been removed or the area is known to be non-hazardous.


WARNING – EXPLOSION HAZARD – Substitution of any components may impair suitability for Class I, Division 2.


WARNING – EXPLOSION HAZARD – The area must be known to be non-hazardous before servicing/replacing the unit and before installing.

Wire terminals can accommodate 14–26 AWG (2.08–0.13mm^2) solid or stranded wire with a minimum temperature rating of 85^{o}C. Input wiring may be shielded or unshielded type. Twisted pair input wiring is recommended. Terminals are pluggable and can be removed from their sockets by prying outward from the top with a flat-head screwdriver blade. Strip back wire insulation 0.25-inch on each lead and insert the wire ends into the cage clamp connector of the terminal block. Use a screwdriver to tighten the screw by turning it in a clockwise direction to secure the wire (use 0.5-0.6nM torque). Since common mode voltages can exist on I/O wiring, adequate wire insulation should be used and proper wiring practices followed. As a rule, input wires are normally separated from power and network wiring for safety and isolation, as well as for low noise pickup.

Power Connections

Connect a DC power supply from 12-32V as shown in the drawing below. Observe proper polarity (input power is reverse-polarity protected). Optionally, the unit may be powered (or redundantly powered) via its DIN rail connector (optional terminal required, see below). For supply connections, use 14 AWG wire rated for at least 80°C. Do not exceed 36V DC peak.

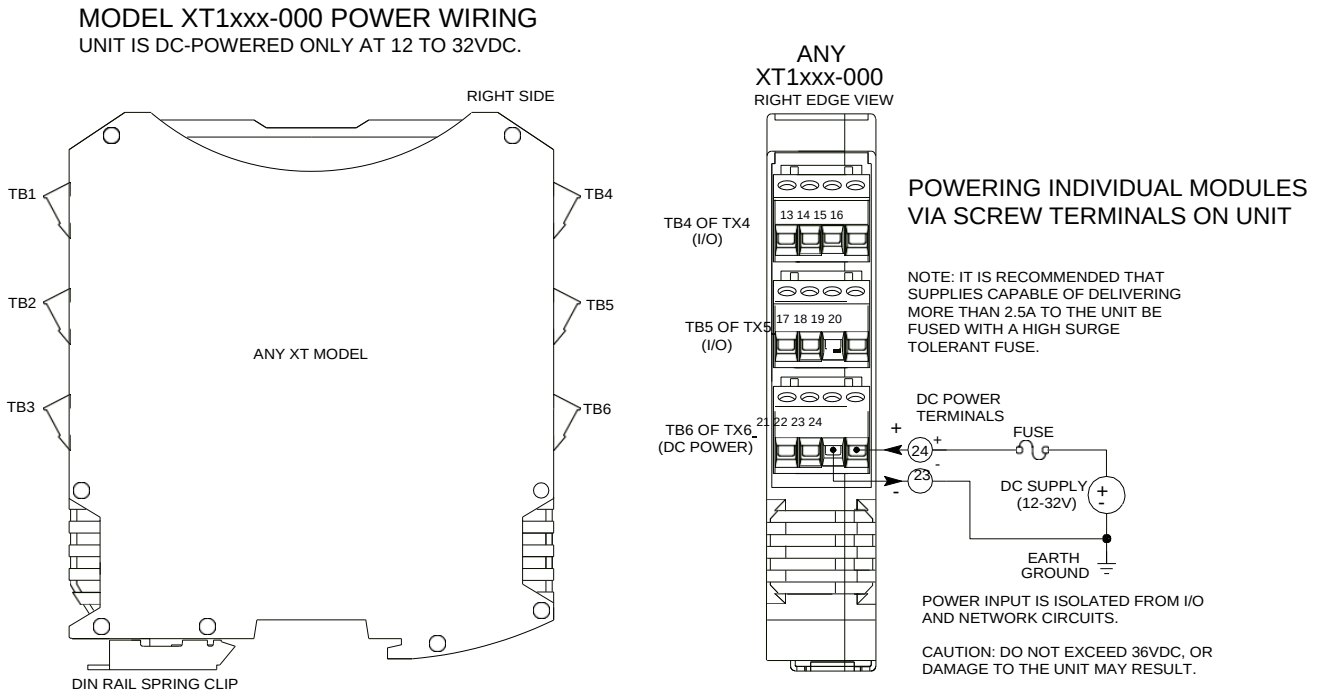

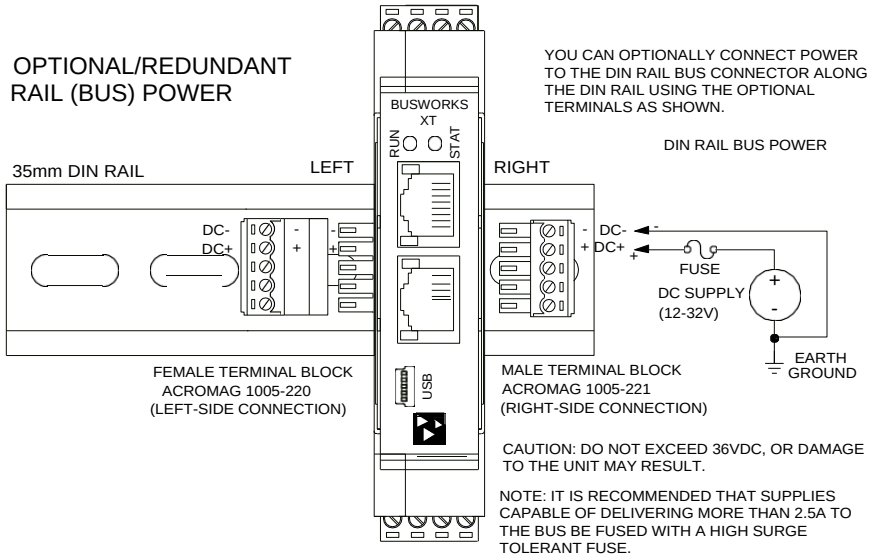


Power Connections…

Note that you can use the bus power connector of the module to interconnect modules by plugging them together and connecting them as a group to a suitable power supply using an optional left or right terminal block, 1005-220 or 1005-221, as shown below.

Important – End Stops: If this module uses the optionally powered (or redundantly powered) via the DIN rail bus for hazardous location installations (Class I, Division 2 or ATEX Zone 2) it must use two end stops (Acromag 1027-222) to secure the terminal block and module (not shown).


XT MODEL OPTIONAL BUS POWER WIRING

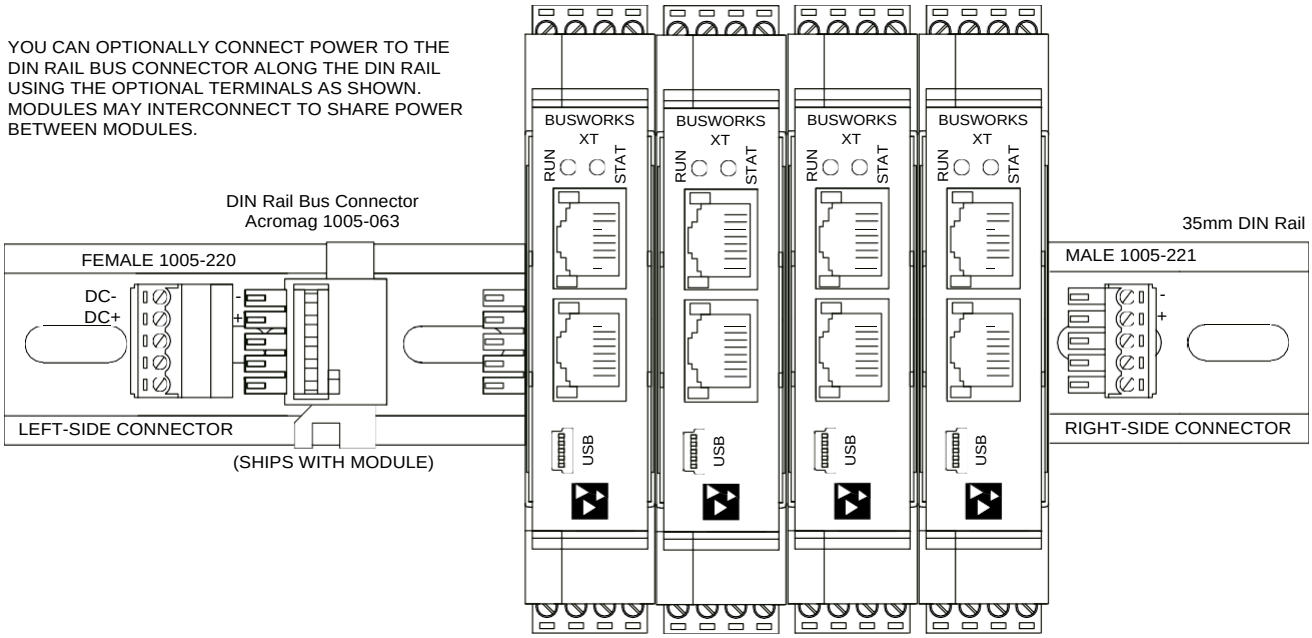

USB Connection

WARNING: The intent of mating USB with this unit is so that its I/O can be conveniently configured and calibrated in a safe area, then installed in the field which may be in a hazardous area. Do not attempt to connect a PC or laptop to this unit while installed in a hazardous area, as USB energy levels could ignite explosive gases or particles in the air.

- **USB Signal Isolation Recommended -** You may use Acromag model USB-ISOLATOR to isolate your USB port, or you can optionally use another USB signal isolator that supports USB Full Speed operation (12Mbps).
- **Reconfiguration of I/O Does Not Require a Network Connection, as it uses a USB connection**. The network communication parameters are reconfigured via a Profinet configuration tool.
- **Connect Unit to Power Before USB** – Unit does not use USB power.

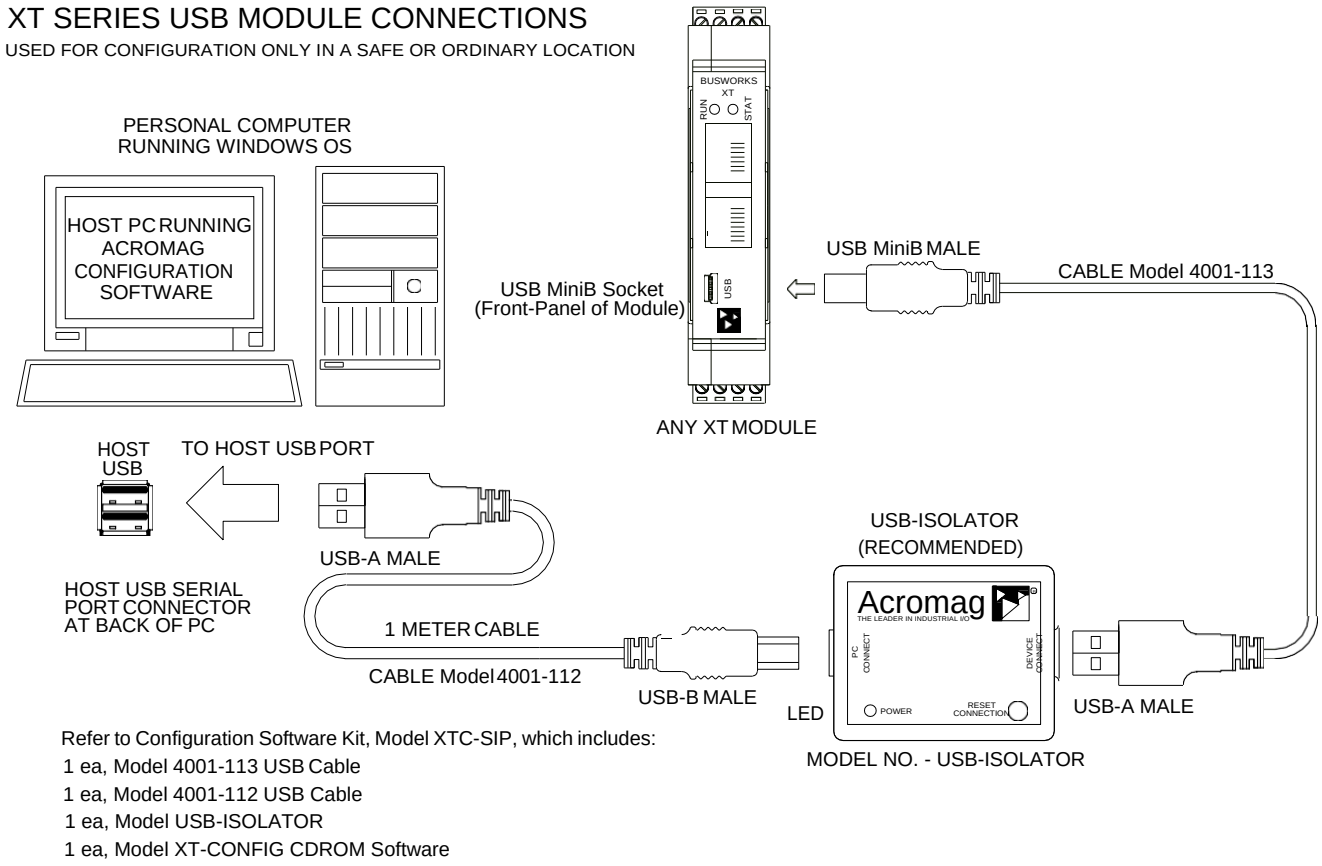


Refer to Configuration Software Kit, Model XTC-SIP, which includes:
1 ea, Model 4001-113 USB Cable
1 ea, Model 4001-112 USB Cable
1 ea, Model USB-ISOLATOR
1 ea, Model XT-CONFIG CDROM Software


Input Connections

These models monitor DC current inputs and DC voltage inputs, in single-ended signal fashion (i.e. each input with respect to a common return connection). The XT1233-000 model has 16 Single-Ended DC current inputs, while the XT1243-000 model has 16 Single-Ended DC voltage inputs. An optional current sensor (Acromag model 5020-350) may be used with the XT1233-000 to additionally monitor AC currents. Observe proper polarity when making input connections. Refer to the following figures to wire the DC current (XT1233), or DC voltage (XT1243) inputs of these models.

Current Input Connections - Model XT1233-000


The **XT1233** model supports up to **16 Single-Ended DC current inputs**. The XT1233 shunts current to a common return through a 27.4Ω resistor, driving voltage through unity-gain buffers to a 16-bit A/D converter with a full-scale bipolar input range of ±1.325V. The ±20mA current shunted through a 27.4Ω resistor drives ±0.548V to the 16-bit A/D converter. The normal convention is that positive current is delivered to the channel positive terminal, and returned at the shared return terminal. Refer to the following figures for example DC current input connections to the XT1233-000 model.

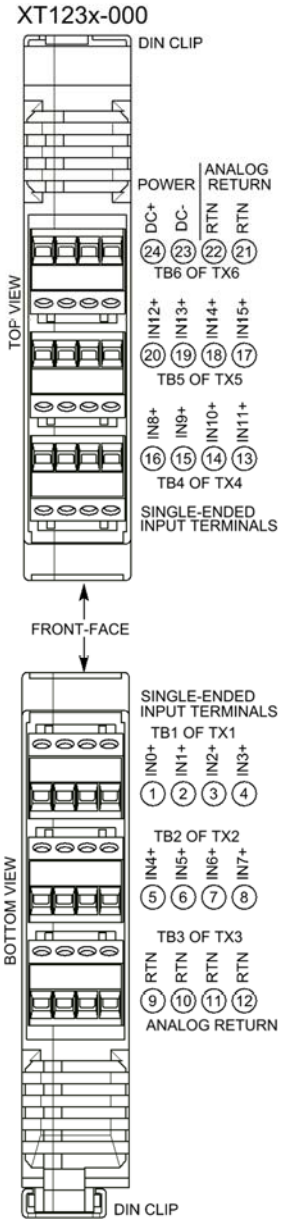


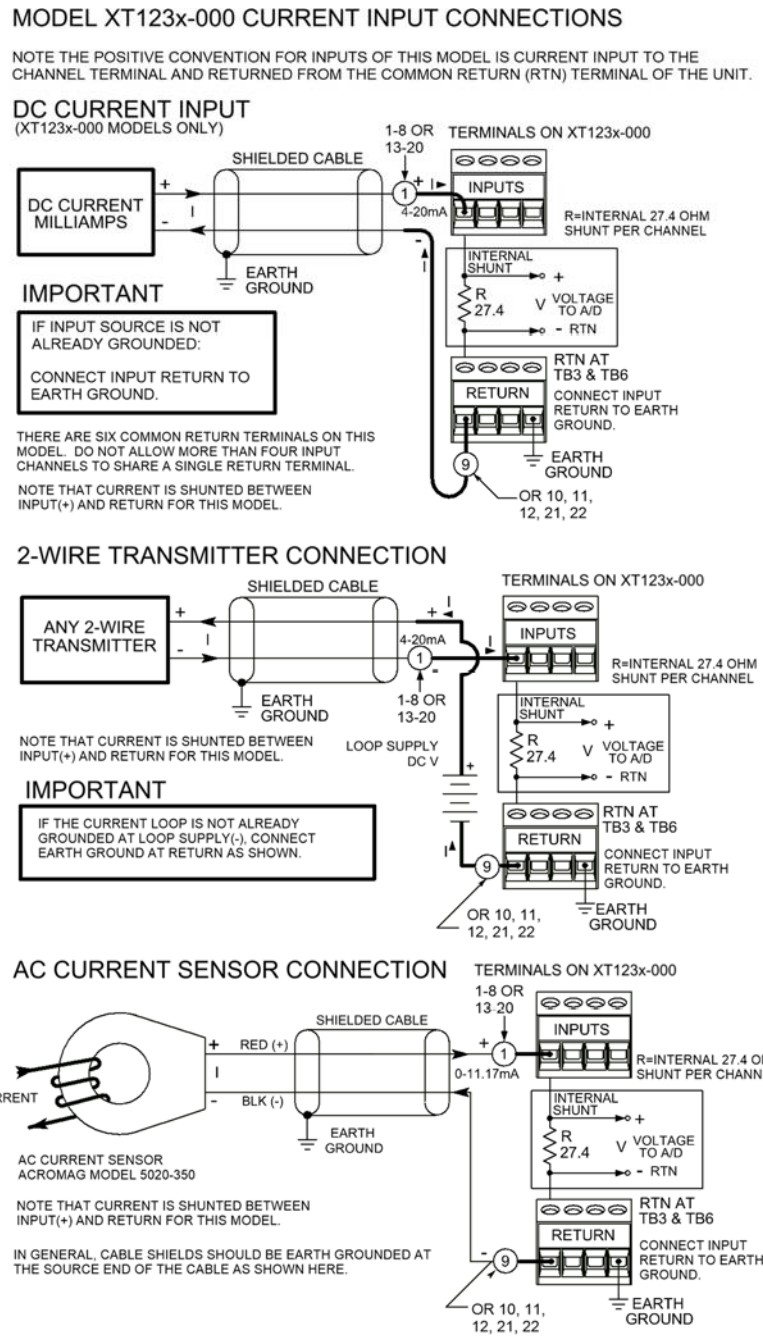

Voltage Input Connections - Model XT1243-000

The **XT1243** model supports up to **16 Single-Ended DC voltage** inputs. You can select input ranges of ±10V, 0-10V, ±5V, or 0-5V. The XT1243 voltage is first resistive divided-down with a 12.1K/105.2K divider and drives unity-gain buffers to a 16-bit A/D converter with a nominal full-scale input range of ±1.325V (bipolar w/±32768). Connect your input voltage to input positive (+) and return (RTN) while observing proper polarity. If the input signal source is floating (not earth grounded), then it is recommended that you also connect one input return terminal to earth ground as shown below. Refer to the following figures for example DC voltage input connections.

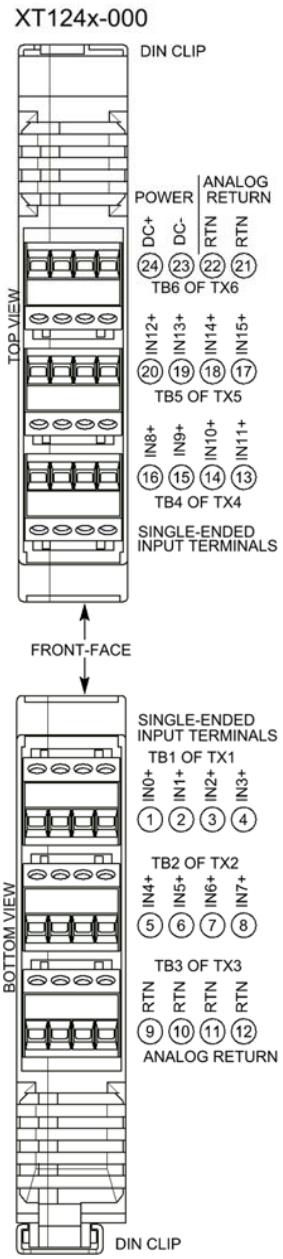

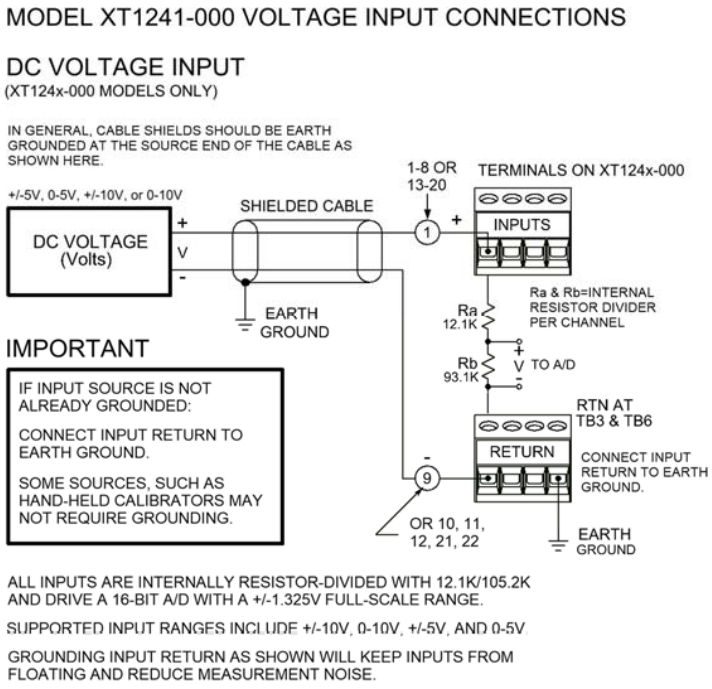


Analog Return Ground Connection

The connection diagrams provided show proper ground connection with input Return earth grounded and this is important for the inputs of this model. If your input measurement is over-range clamped, appears noisy, or unstable, please review your grounding practices. Note this module includes six common input return terminals (RTN) shared between 16 input channels. You only need to earth ground one of these terminals to ground the input circuit, as they are all connected in common.

EMI Filter Installation

For low CE-rated radiated emissions, the use of one or two split/snap-on ferrite cores on all cables or harnesses to/from the device as shown in the drawing on the next page is helpful. These are also helpful for cables connected to Host USB and Ethernet as well. Use Laird 28A2029-0A2 or similar for I/O & Power (Acromag 4001-135), Laird 28A0807-0A2 or similar for Ethernet (Acromag 4001-139), and Laird 28A0350-0B2 or similar for USB cables (Acromag 4001-140). Locate this ferrite by clamping it outside of all I/O cables or wiring harnesses to/from the module (USB, Ethernet, output group, DC power), and as close to the module as possible. While the use of these ferrites is helpful to obtain low CE-rated emissions, it may not be required for your application. Note also that individual cables may share a ferrite, but it is not good practice to combine isolated circuits inside the same ferrite, but rather separate isolated circuits for safety and greater noise immunity.

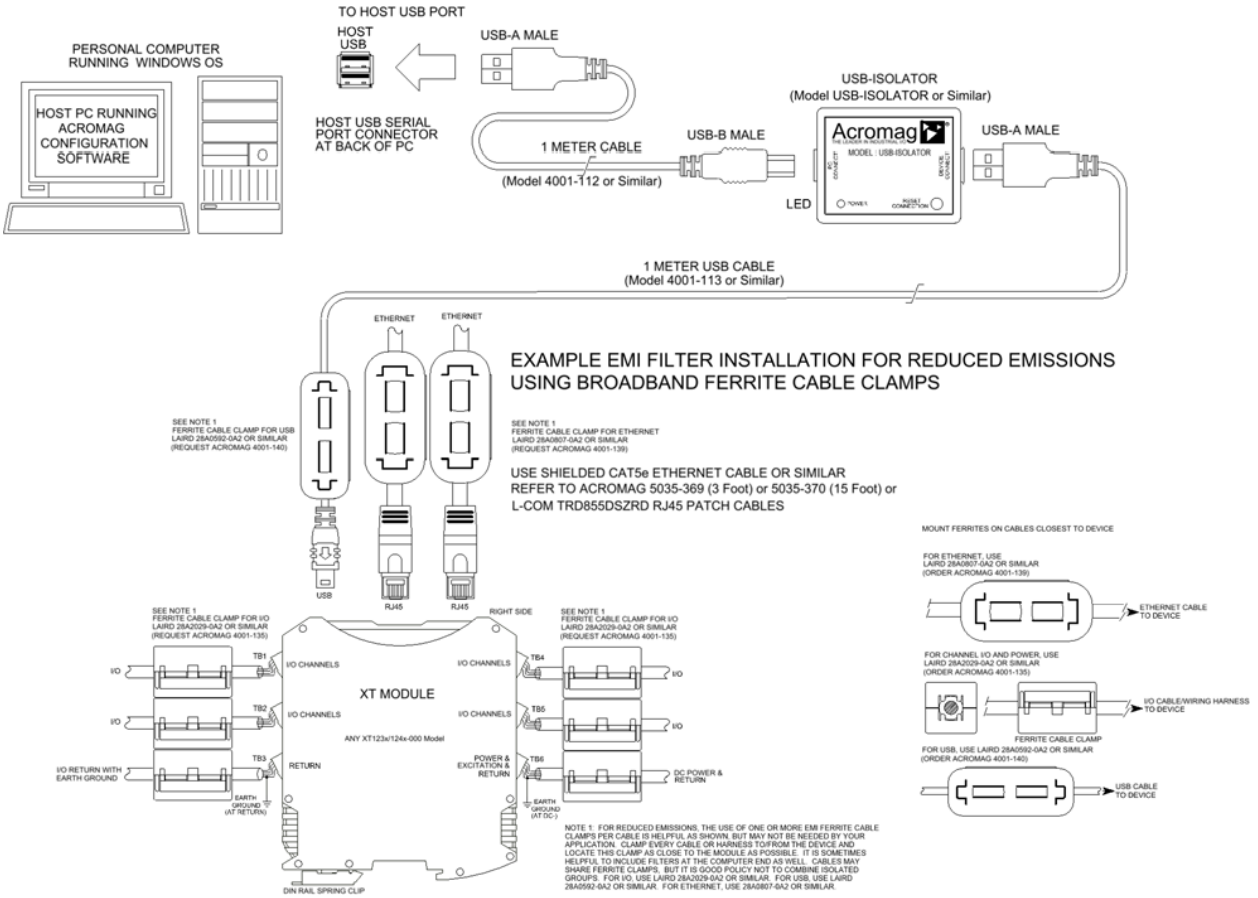

Earth Ground Connections

The unit housing is plastic and does not require an earth ground connection itself. If the module is mounted in a metal housing, an earth ground wire connection to the metal housing's ground terminal (green screw) is usually required using suitable wire per applicable codes. Circuits wired to power, I/O, and the network should be earth grounded as reflected in the connection diagrams. In general, at least one input return terminal (RTN) should be earth grounded, and earth ground should also be included at the DC minus terminal of the power supply. These ground connections are recommended for best results and help protect the unit by giving it a low impedance path to ground for shunting destructive transient energy. See the Electrical Connections Drawings for input, power, and network ground connections.

Note: A USB isolator is recommended when connected to a grounded Personal Computer for configuration purposes. This will avoid a potential ground loop that can occur if your input signal is already earth grounded, as a PC commonly earth grounds its USB port and this makes contact with both the USB signal and shield ground, which this module holds in common to its input circuit return.


CONFIGURATION SOFTWARE

Get the USB Configuration Software for Your Model


While this is an Ethernet network input module, it can only be configured and calibrated via its Configuration Software over a USB connection to a Windows-based PC or laptop. USB saves you the trouble of having to already know its IP address setting, or having to change the address setting of your network interface card to an address within its address domain in order to communicate with it. USB software is contained in a zip file that can be downloaded free of charge from our web site at www.acromag.com. Look for the software zip file 9500465 (XT install shield shell program) in the Documents and Downloads page for your XT product. Initially, you will have to answer a few questions to open a user account and download this file to your computer. This zip file will extract to a model-specific executable file XT12xxConfig.exe, which installs in an Acromag subdirectory off the Program Files directory of your PC. The software is compatible with XP or later versions of the Windows operating system. Note that you must have administrator rights to download and install this software onto your PC or laptop. Once you have installed the software, be sure to navigate to the *Program Files\Acromag* subdirectory and select the correct *modelconfig.exe* software for your particular module family. This same software is also included on a CDROM bundled with the Configuration Kit XT-SIP (see Accessories), but downloading it from the web will help to ensure that your copy is the most up to date available. The particular *model*Config.exe software for this unit supports eleven other model variations—six models with 8 differential current or voltage inputs, plus six models with 16 single-ended current or voltage inputs.

Quick Overview

After booting the Configuration software for this model, the initial Device/Communication Setup page will appear. This screen is used to selectively connect to units over USB, to configure its input parameters. Network parameters are configured using a Profinet configuration tool. Once you select a device and click **[Open]** to connect to an XT1233-000 or XT1243-00 model, your screen will look similar to the following:

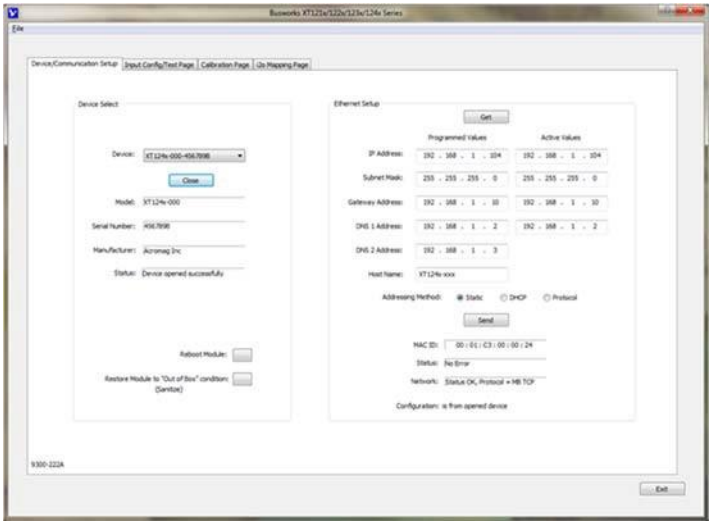

If you click on the I/O Config/Test Page tab, the following screen will appear:

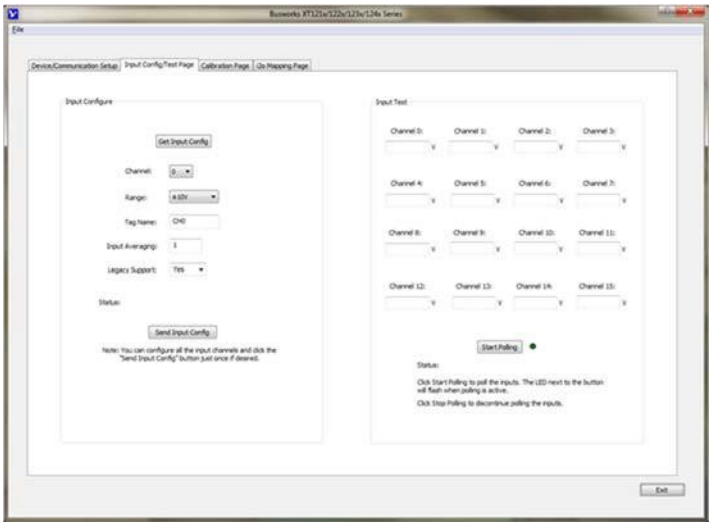

For a more detailed configuration procedure, see Configuration Step-by-Step of the Technical Reference on page 16.

Device Select (First Connect to the Unit Here)

- Select from connected modules and Open communication with them.
- Display the Model, Serial Number, and Manufacturer of the connected module and report the status of the connection.
- Reboot a module to force a system reset to the power-up state.
- Restore a module to its initial programmed "out-of-box" state.

Ethernet Setup (Modbus & Ethernet/IP Models)
(Profinet units do not allow these parameters to be set via this software, only read back)

- Retrieve the connected modules current network configuration with the **[Get]** function.

Network parameters for Profinet models can only be set on the network via a Profinet Configuration tool.

There are two other screens that can be selected by clicking their tabs, I/O Config/Test, and Calibration.

A short description of the controls of the I/O Config/Test page shown at left follows:

I/O Configure (Channel-by-Channel)

- Retrieve the connected module's current channel configuration with **[Get Input Config]**.
- Set the channel 0-15 to setup.
- Choose an input range for the selected channel.
- Apply a tag name (up to 8 characters) to the input channel for reference purposes over USB.
- Set input averaging from 1-200 samples.
- Set Legacy Support to "No" for bipolar/unipolar input normalization to ±30000/0-30000, or "Yes" for ±20000/0-20000 (same as older legacy units).
- View the status of your USB configuration message.
- Send your channel configuration to the connected unit over USB.

Input Test


After making I/O configuration changes, you can use the I/O Test controls to verify operation of your inputs.

- Start/Stop polling the input channels 0-15.
- Display the current reading of each input 0-15.

Quick Overview…

Once you've configured your unit's inputs, you are ready to install it in the field and setup its network parameters using a Profinet configuration tool, as the unit has already been factory calibrated.

If you need to calibrate the inputs, you can click on the Calibration Page tab and the following screen will appear:

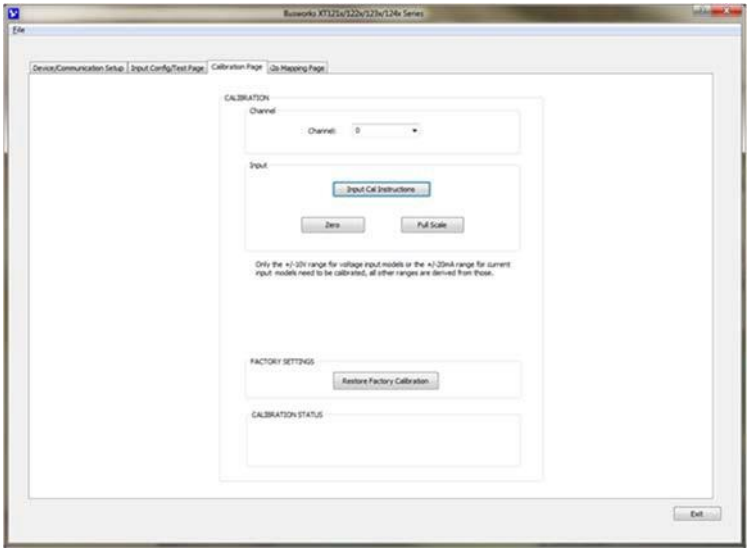

HELP – You can press F1 for Help on a selected or highlighted field or control. You can also click the [?] button in the upper-right hand corner of the screen and then click to point to a field or control to get a Help message pertaining to the item you pointed to.

For a more detailed configuration procedure, see Configuration Step-by-Step of the Technical Reference on page 16.

Calibration

If you encounter an error that is out of specification, you can click the **Calibration Page** tab to display the Calibration control page as shown at left.

IMPORTANT: This unit has already had its input channels factory calibrated with high precision. Attempts to recalibrate the input channels could degrade their performance if not done properly, or done using lower grade equipment. Consider your decision to recalibrate carefully.

Before you attempt to calibrate an input, be sure to set the Input Range to calibrate from the previous "I/O Config/Test" page. Then select your channel to calibrate here and initiate calibration by clicking **[Input Cal Instructions]** and follow the on-screen prompts.


- Click Input **[Zero]** and you will be prompted to precisely input the min value of your selected input range at the input channel, then click the **[OK]** button and follow the prompts.
- Click Input **[Full-Scale]** and you will be prompted to input the full-scale value of your selected input range at the channel, then click the **[OK]** button and follow the prompts.
- Use **[Restore Factory Calibration]** to restore the module's original factory calibration.

TECHNICAL REFERENCE

CONFIGURATION STEP-BY-STEP

Getting Connected

This section will walk you through the Connection-Configuration process step-by-step. But before you attempt to reconfigure this module, please make the following electrical connections.

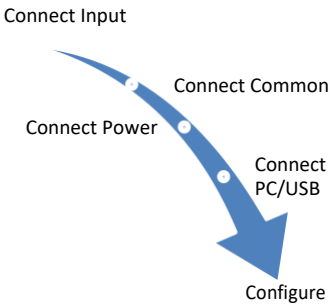

1. **Connect Inputs:** Refer to Input Connections at the front of this manual and connect your input(s) as required for your application. Inputs of this model are single-ended and share a common return. Do not allow inputs to float—be sure to ground return if the input signal is not otherwise grounded.

2. **Connect Analog Return to Ground:** If your input signal is not already grounded, you should connect earth ground to analog input return (RTN) at one point. Doing this will keep the input circuit from floating. Failure to ground your input return could increase measurement noise. Earth ground applied here also allows the input filters to shunt potentially harmful transient energy to ground by providing a low impedance path to ground for the input filters, helping to protect the input circuit from transient damage.

3. **Connect Power:** You need to connect power from 12-32V to power this module. The current required will vary with the voltage level (refer to Specifications). Your supply must be capable of providing at least twice the maximum rated current indicated for your voltage level. You can choose to connect to Power via terminals on the unit, or via optional terminals that connect to the module's bus connector along the DIN rail (See Power Connections). Supplies capable of delivering greater than 2.5A should be fused with a surge-tolerant (slow-blow) fuse.

4. **Connect to PC via USB:** Refer to USB Connections of page 9 and connect the module to your PC or laptop using the USB isolator and cables provided in Configuration Kit XT-SIP.

   Now that you have made your connections and applied power, you can execute the XT12XXConfig.exe software to begin configuration of your unit (software is compatible with XP or later versions of the Windows operating system). Note that this same software is used for twelve different models, including 3 different models of XT123x-000 with 16 single-ended current inputs, and 3 different models of XT124x-000 with 16 single-ended voltage inputs.


   IMPORTANT: Allow the unit to fully power-up and establish its Ethernet connection before attempting to open USB communications with the unit using the XT12xxconfig.exe software (wait ~30 seconds after powering-it up to give it time to initialize).

Note that you do not connect your Profinet module to an Ethernet network in order to configure its I/O, only its network communication parameters. Its I/O is configured offline by connecting to USB with a host PC running model-specific configuration software. Its network parameters are configured using a Profinet configuration tool.


Device/Communication Setup

Note that you should already have power connected to the XT123/XT124 at this point, as this model does not utilize USB power and you will not be able to configure, calibrate, or test the unit over USB without also having power applied.

After executing the Acromag Configuration software for this model, the screen shown below will appear, if you have not already connected to your transmitter via USB (note the Device Select fields are blank under these conditions).

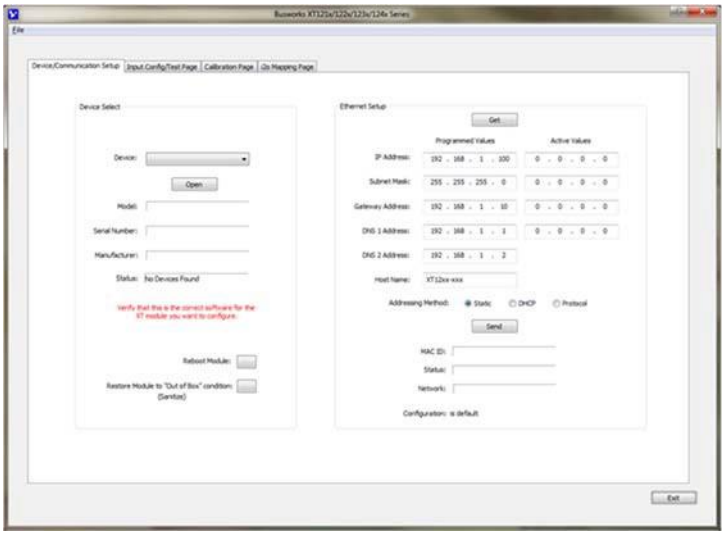

Once you have selected a device, click the **[Open]** button to open communication with the unit and the screen will fill out similar to the following (the selected unit's Model, Serial Number, Manufacturer, and a USB connection status message will be displayed as shown in the screen below:

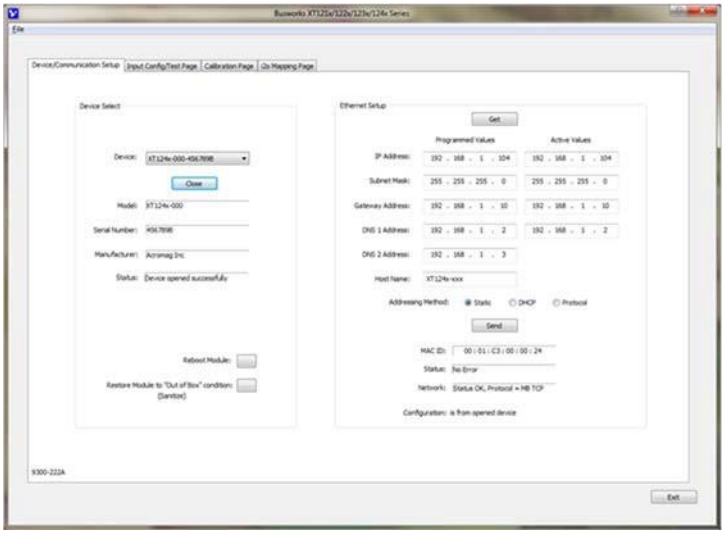

The Device/Communication Setup screen is split into 2 parts: Device Select & Ethernet Setup as follows:

Device Select

Connect your PC to the unit via USB, and the unit's model-serial information will appear in the Device field as shown in the second screen at left. If you happen to be connected to more than one unit via a USB hub, you can use the Device scroll field to select another unit, using the serial information suffix of the Device Model number to discern one unit from another.

Once you have selected a device, click the **[Open]** button to open communication with the unit.

After clicking [Open], the selected unit's Model, Serial, Manufacturer, and a connection status message will be displayed as shown in the second screen at left. *The i2o Mapping Page tab also disappears, as i2o is not an available option for Profinet or Ethernet/IP models.*

TIP: Always Close a connection with one device before selecting another device.

You can use the **[Reboot Module]** button to force a reset of the unit by clicking on it, an effect equivalent to a power-on reset.

You can use the **[Restore Module]** button to restore a module to its initial "out-of-box" configuration.


Ethernet Setup (Read Only for Profinet Models)

Profinet models will not be able to set their Ethernet parameters using this software over USB, as Profinet models require an online Profinet configuration tool.

Use **[Get]** to retrieve the current Ethernet setup of the connected module (sometimes the Active Values fields will indicate zeros and you must click [Get] to retrieve the actual active values).

Although Profinet models do not allow Ethernet parameters to be set via this software, their functionality is defined below for reference purposes:

Device/Communication Setup…

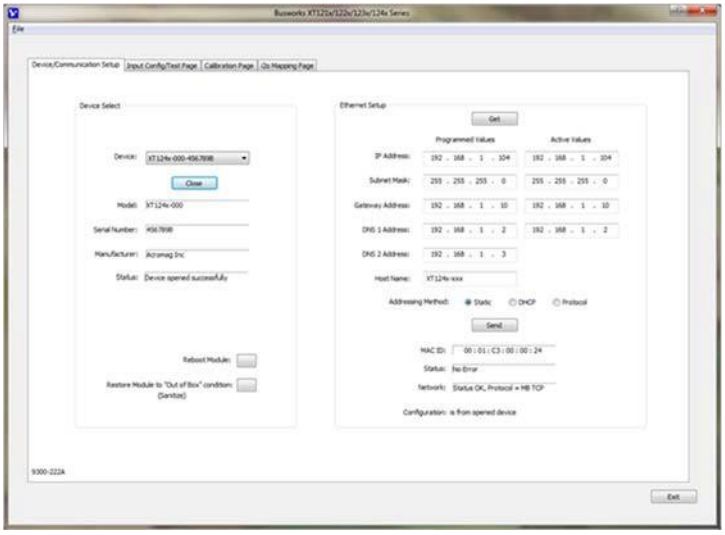

The Internet or world-wide web is actually a large network made up of many smaller networks (sub-networks) linked together by gateways or routers. The gateway or router serves as an access point to/from a particular sub-network. For example, your ISP provides DSL modems or cable modems which connect your local hardware to the Internet and often serve as gateways. The gateway address is the address of this gateway or router in the same subnet as the host, and is used as the bridge to connect to various other sub-networks with different sub-network addresses and address masks, that collectively connect together to make up the Internet. Data packets sent over the Internet contain both the sender's Internet address and the receiver's address. A packet is first sent to a gateway computer that understands its own domain or group of host addresses. The gateway reads the destination address of the packet, and if it is outside of its own domain, it forwards the packet on to an adjacent gateway that again reads the destination address. Then that gateway will forward the message on, if the address is not within its domain. Eventually, one gateway recognizes the packet as belonging to a host within its domain. Finding a match, that gateway forwards the packet directly to the host whose address is specified. Rather than continually passing a packet from gateway to gateway, some networks will use a default gateway which is the address of another node on the same network that the software uses when an IP address does not match any other routes in the routing table (address domain) of the primary gateway.

Ethernet Setup…continued

An **IP Address** (Internet Protocol Address) is a unique identification number for any host (this module) on any TCP/IP network (including the internet). It uniquely defines one host from all other computers (hosts) on the Internet. The IP address is made up of four octets (8 bits), each octet having a value between 0-255 (00H-FFH). It is expressed here in decimal form, with a period between octets.


The **Subnet Mask** is used to subdivide the host portion of the IP address into two or more subnets. The subnet mask will flag the bits of the IP address that belong to the network address, and the remaining bits that correspond to the host/node portion of the address. The unique subnet to which an IP address refers to is recovered by performing a bitwise AND operation between the IP address and the mask itself, the result being the subnet address.

Gateway Address refers to the IP Address of the gateway this module is to cross, if your local area network happens to be isolated or segmented by a gateway. Typically, it is assigned the first host address in the subnet address space. If a gateway is not present, then this field should contain an unused address within the host subnet address range.

NOTE: Fortunately, this model uses USB to setup its network configuration parameters, allowing you to instead change its IP address to an address compatible with your own PC network without having to network connect to it first. This saves you from having to consult with your network administrator to either temporarily change your PC's TCP/IP configuration (see TCP/IP Properties of Network Configuration in Windows), or perhaps having to create a separate private network using a second network adapter installed in your PC. The necessary steps would vary with your operating system, but can get quite involved.

A DNS server relates symbolic names to actual numeric IP addresses, while the DHCP server is responsible for dynamically passing out IP addresses. The **DNS 1 Address** refers to the IP address of the first Domain Name Server used on this network. The **DNS 2 Address** refers to the IP address of the secondary Domain Name Server used on this network.

Device/Communication Setup…

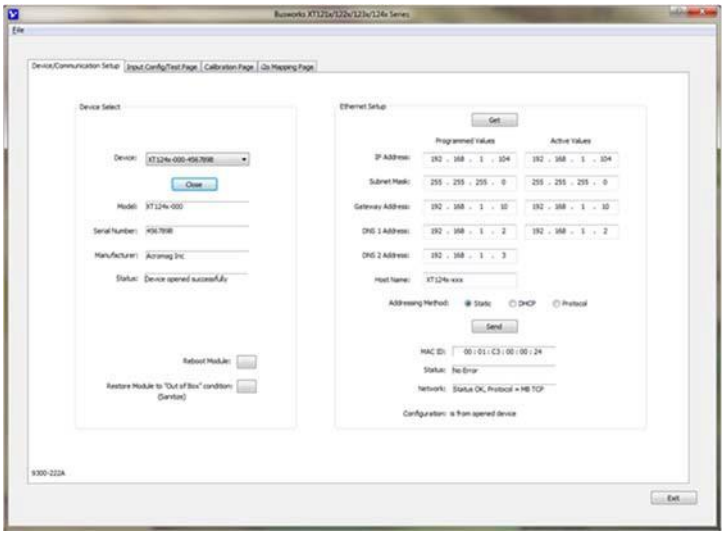

You can click the **[Exit]** button in the lower right hand part of this screen to exit the Configuration Software, or simply click on another tab to access another page before exiting this software.

Ethernet Setup…continued

The **Host Name** is the name to be assigned to this host (this module on the network), if its address happens to be assigned dynamically using DHCP.

The **Addressing Method** refers to how this network module will obtain its IP address when connected to its network.

Static addressing is as the name implies—*static*, and represents a unique fixed IP Address generally assigned by your service provider or system administrator. The default address assigned to this module is 192.168.1.100 and static (refer to product side label).

DHCP (Dynamic Host Configuration Protocol) refers to a protocol for assigning dynamic IP addresses to devices on a network. With dynamic addressing, a device can have a different IP address every time it connects to the network. In some systems, it can even change while it is still connected.

The Protocol addressing method allows the application protocol specific to the model to set the IP address. This is only an option for Ethernet/IP and is required for Profinet models. It is not an option for Modbus TCP/IP models. In the Protocol method, the TCP/IP object of the particular protocol sets the address. Profinet requires protocol addressing and has its own method for accomplishing address assignment using this method.

By default, the module is setup to use **Static IP Addressing and a default Static IP Address of 192.168.1.100**. You can optionally choose to have the IP address assigned dynamically via DHCP, but this will additionally require that you specify a valid Host Name to retrieve the address from. Choosing Protocol gives the application protocol permission to assign the address and is required for Profinet models.


You can click the **[Send]** button to write your Ethernet Setup parameters to the unit once you are done making your selections (Modbus TCP/IP & Ethernet/IP models only). This completes any changes made on this page.

The Status field will indicate the status of your sent parameters over USB after clicking [Send]. The Network field will indicate the current network connection status, as well as the protocol used for this network. The Configuration field will indicate whether the viewed configuration is from an open device, or a default configuration.

You can click the **[Exit]** button in the lower right hand part of this screen to exit the Configuration Software, or simply click on another tab to access another page before exiting this software.

I/O Configuration/Test

You can click the **"I/O Config/Test Page"** page tab to begin configuring the unit, and/or optionally test its operation. The I/O Config/Test screen for this model is shown below:

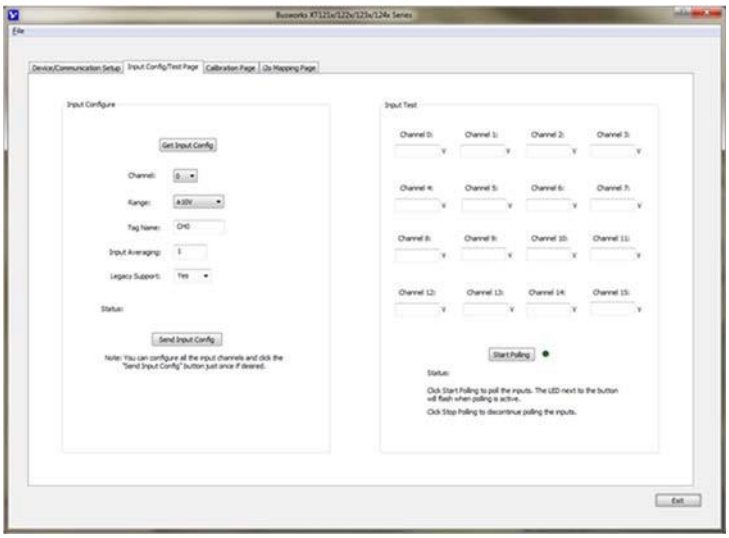

I/O Configure

If you are connected to a module over USB, the initial I/O Config/Test screen represents the current configuration of the connected module before making changes.

Get the Input Configuration…
If you have loaded the configuration from a saved file, or if you have made changes to any fields on this page, you can always click the **[Get Input Config]** button at the top of the screen to retrieve the connected module's current channel configuration (all channels). Otherwise, the connected module's current configuration was loaded automatically when you selected the tab for this page.


Note that if you make any changes to the selections indicated, the only way to preserve your changes is to write them to the device by clicking the **[Send Input Config]** button after completing your selections, or to save them to a file by clicking **"File"** in the upper left-hand corner of the screen.

Select the Channel…
This software supports models having 8 and 16 channels, channels numbered 0-7, and/or 0-15, according to the model. This model has 16 Single-Ended input channels and you can use this software to configure each channel individually. You could choose to configure the channels selectively, then click **[Send Input Config]** to write the channel configuration to the unit, or more simply make changes to many channels and click **[Send Input Config]** one time to write all the channel configurations to the unit at once.

Select the Range…
Use the "Range" field to select your input range. For the XT1233-000 model, you can select DC current ranges of ±20mA, 0-20mA, 4-20mA, and 0-11.17mA. For the XT1243-000 model, you can select DC voltage ranges of ±10V, ±5V, 0-10V, and 0-5V. Internally, the 16-bit A/D has a fixed range of ±1.325V (±32768).

Set a Tag Name (Optional, up to 8 Characters)….
You can give this input channel a name to document its purpose if desired. This is not used by the firmware or software and just serves as a convenient label for discerning the input function or its application over USB.

I/O Configuration/Test…

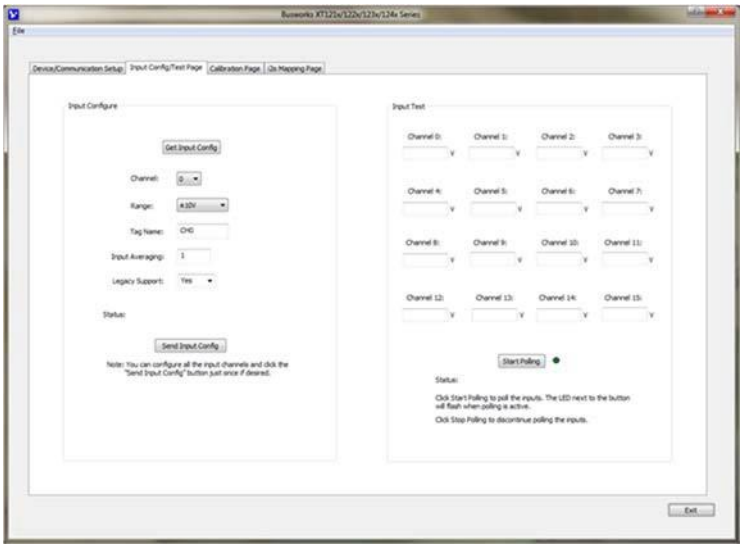

HELP – You can press **[F1]** for Help on a selected or highlighted field or control. You can also click the **[?]** button in the upper-right hand corner of the screen and click to point to a field or control to get a Help message pertaining to the item you pointed to.

Set Input Averaging…
(This is a Global Setting, Not Per Channel):

Use this field to set the integer number of input samples to average over before updating the input values/readings. Set this number from 1 to 200. Note that higher averaging levels result in lower average noise, but with slower I/O response times. Selecting 1 designates that no averaging will be performed.

Status…

This field displays status messages relative to sending and receiving configuration parameters to/from the module via USB.

Send Input Configuration and Read Status…

Once you have made your configuration selections, click the **[Send Input Config]** button to write them to the module. Do this one time after you have setup all the input channels individually. You can read the USB status of your sent message to the unit in the "Status" field just above this button. Alternately, you could click **"File"** in the upper left hand corner of the screen to save the settings you made to a file on your PC, for reference later.

Input Test


At this point, you can pretest channel operation by clicking on the **[Start Polling]** button of the I/O Test section of the I/O Config/Test page to trigger the software to periodically read the inputs (updates about once per second) and display channel values in the fields below their channel designators. Note the simulated lamp next to the button flashes slowly each time it samples the input. Click **[Stop Polling]** to stop polling the inputs before moving onto the next page.

Start Polling Button (Toggle Start/Stop): Click this button to Start/Stop periodic polling of the input channels. The channel value is indicated and updated about once per second.

TIP: Be sure to Stop polling a module before moving onto another page. Note that you will always have to restart polling if you come back to this page and want to poll the inputs.

Calibration Page

Once you've configured your unit, you are ready to install it in the field, as the unit has already been factory calibrated. If you later encounter error that is out of specification, you can choose to click the **Calibration Page** tab to display the Calibration control page shown below:

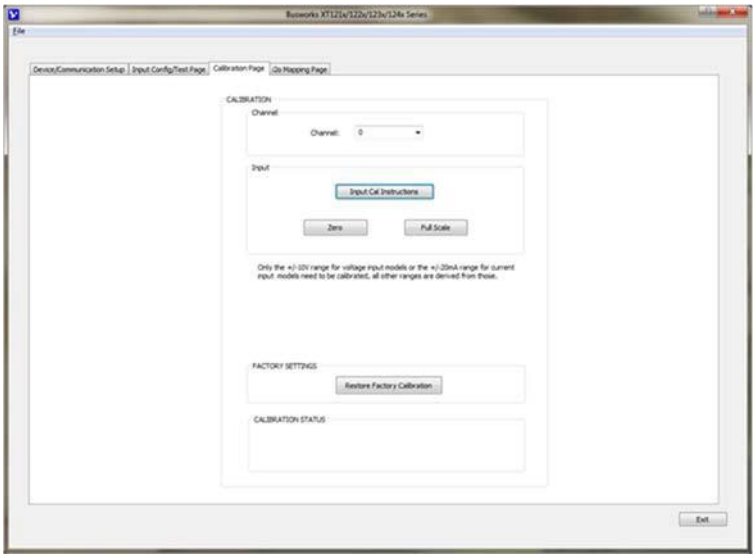

CAUTION-Input Calibration: Driving input levels outside of the nominal input range of the unit will not be acceptable for calibration of zero or full-scale. Since input levels cannot be validated by the software during field calibration, driving incorrect signal levels to the unit will produce an undesired output response.

IMPORTANT: This unit has already had its input channels factory calibrated with a high level of precision. Attempts to recalibrate input channels could degrade their performance if not done properly, or done using lower grade equipment. Consider your decision to recalibrate carefully.

Calibration of this model is a simple process initiated by clicking the **[Input Cal Instructions]** button to begin, then following the on-screen prompts. Note that the current and voltage ranges of these models are sub-ranges of ±20mA (XT123x) and ±10V (XT124x), and are indirectly calibrated by calibrating ±20mA or ±10V.

CALIBRATION – Input

*Before attempting to recalibrate an input channel, first set the Input Range to calibrate from the "I/O Config/Test" page. Additionally, make sure you write your range selection to the unit by clicking the **[Send Input Config]** button of that page.*


Use the Calibration Channel scroll field to select the particular channel to calibrate. This model has sixteen single-ended input channels numbered 0 to 15 (i.e. 16 channels measure their input with respect to a common grounded return).

After setting your input parameters, and selecting a channel to calibrate on the I/O Config/Test Page, click the **[Input Cal Instructions]** button to begin input calibration and enable the Input **[Zero]** and **[Full-Scale]** buttons of the Calibration Page.

Click the Input **[Zero]** button and you will be prompted to input the minimum value of your selected input range at the input channel. If you have a voltage input model, this will be 0, -5V or -10V. Current input models may choose -20mA, 0mA, or 4mA. Once you input zero precisely, click the **[OK]** button and follow the on-screen prompts to complete zero calibration.

Click the Input **[Full-Scale]** button and you will be prompted to input the full-scale value of your selected input range at the channel. For voltage models, this will be 5V or 10V, depending on the input range. For current input models, this will be 11.17mA or 20mA, depending on the input range. Once you input full-scale precisely, click the **[OK]** button and follow the on-screen prompts to complete full-scale calibration.

Factory Settings

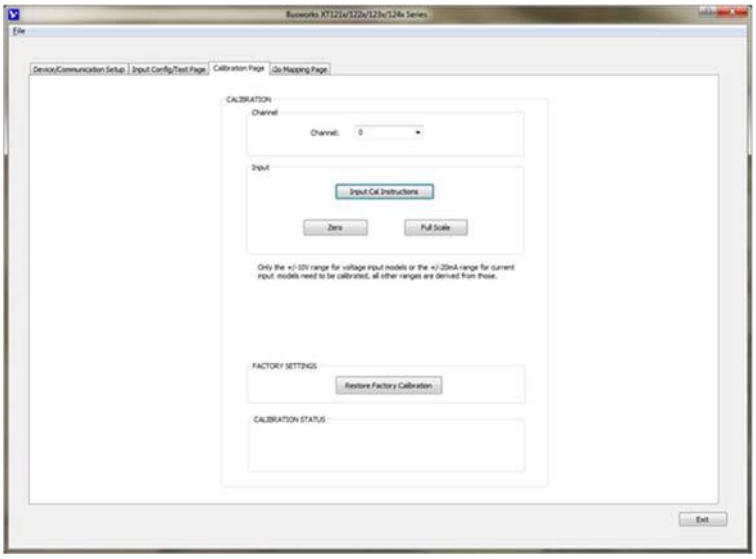

Use the FACTORY SETTINGS **[Restore Factory Calibration]** button to restore the module's original factory calibration if you think you made an error during recalibration, degraded its performance, or the input reading appears erratic.


You could optionally use the **[Restore to "Out of Box" Condition]** button of the Device/ Communication Setup Page to return the unit to its original factory configuration settings. This other function does not restore calibration, but only configuration. Alternatively, that button can be used as a sanitation tool to restore a unit to its initial configuration when decommissioning it.

CALIBRATION STATUS

This field displays calibration status messages relative to USB calibration messages like "No Error", "Transfer Error", and "Timeout Error" during calibration. If you encounter a Transfer or Timeout Error, you may have to repeat the calibration process and/or reboot this software.

Network Home Page



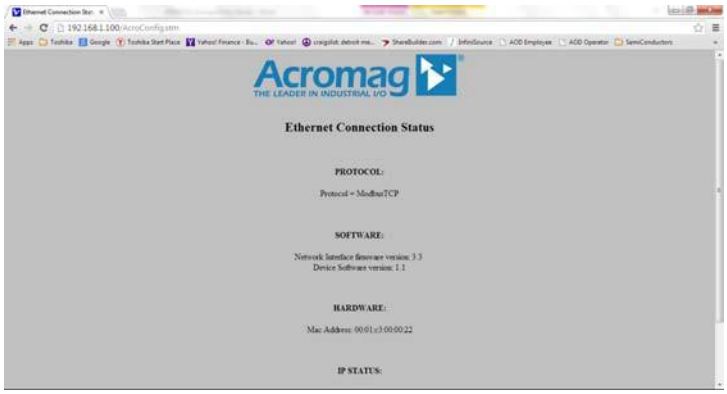


After configuring your unit for network communication via its USB port, you can identify the unit on the Ethernet network using a web browser directed to its IP address (you set this address on the Device/Communication Setup page of the USB Configuration Software for the unit, the default IP address is 192.168.1.100). This will access the home page of the unit similar to the first screen shown at left.

If you can view this page, this is useful for verifying your network connection to the unit.

You can click the "Communication Parameters" link of the Home Page to access the Ethernet Connection Status page shown in the second screen at left, which reviews the unit's network communication parameters that are set over a USB connection to the device (scroll down this page to review all the communication parameter settings).

BLOCK DIAGRAM

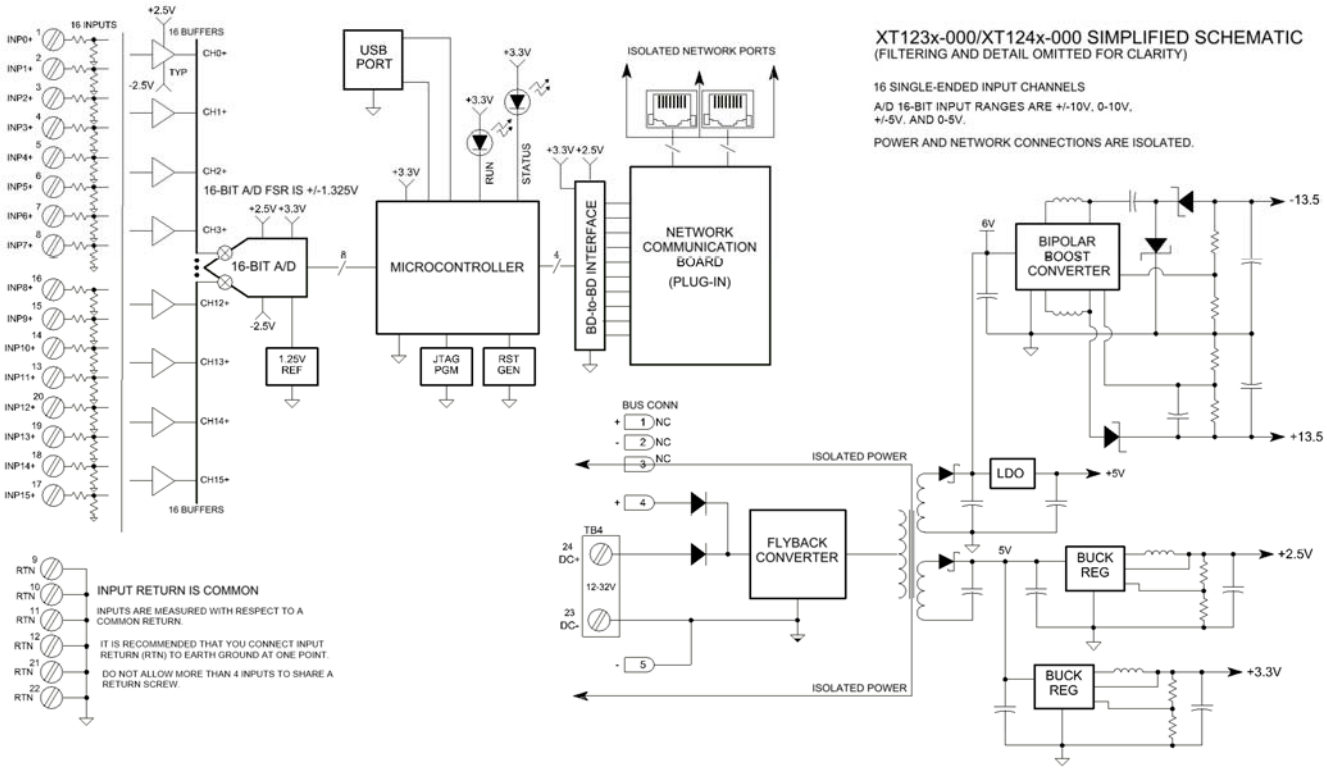

How It Works

Key Points of Operation

- Unit is DC Powered
- Inputs & USB are Isolated from the network and power.
- Inputs are Single-Ended and share common.
- Inputs use 16-bit conversion.
- Input return is common with USB ground.

This model has sixteen single-ended input channels. It utilizes sixteen unity gain input buffers to 16 A/D inputs, which are separately multiplexed to a precision 16-bit A/D converter, under control of a 32-bit microcontroller. Inputs share 6 common return screws on the unit. A network interface specific to Profinet is handled by a separate controller on a mating communication board, serial-UART linked to the input board. Power for the input and network circuits is provided via an isolated flyback converter on the input board that operates from 12-32V. The unit is setup for I/O operation via a USB connection between a host PC and the microcontroller of the input board. The host PC runs model specific configuration software for the XT module. The unit is setup for network communication via a Profinet configuration tool. Refer to the block diagram above to gain a better understanding of how this model works.

The inputs & USB, network ports (each), and power circuits are isolated from each other. The USB port ground is common to the input circuit return. The USB port ground of most PC's is also common to the USB cable shield and earth ground. Inputs could be grounded or ungrounded. For this reason, it is recommended that USB signals be isolated when connected to a PC to prevent a ground loop from occurring between the PC earth ground and a grounded input return, which could have a negative effect on the input measurement for severe ground loop currents.

About Profinet IO

You can obtain more information on Profinet at the Profibus & Profinet International (PI) web site www.profinet.com/pi or www.profibus.com. You can also learn more about Profinet at the All Things Profinet web site www.allthingsprofinet.com.

Profinet is an open Ethernet standard for industrial communication, but with enhancements tailored for realtime communication and industrial automation applications. In particular, Profinet attempts to address the needs of factory and processs automation applications, safety applications, and drive technology for clock-synchronized motion control applications, providing good realtime performance, improved determinism, advanced configuration capability, diagnostic capability, and alarm handling features. Profinet is standardized in IEC 61158 and IEC 61784, and Profinet products are required to be certified by Profibus & Profinet International (PI), ensuring world-wide compatibility. Profinet IO is comprised of standard Ethernet mixed with IT protocols, including the transport and application layer protocol (TCP/IP), especially selected for industrial automation applications. In this way, Profinet offers scalable performance with protocols providing three different data channels: TCP/IP for non realtime application data, Real Time (RT) for realtime transfer of critical process data, and Isochronous Real Time (IRT) for motion control applications.

Profinet IO follows a Provider/Consumer model for data exchange and operates similar to Profibus. This device operates as an IO-Device on Profinet IO networks. A plant Profinet system has at least one IO-Controller and one or more IO-Devices, and may optionally utilize an IO-Supervisor. Thus, Profinet IO networks recognize three device classes as follows:

IO-Device (This Module): This is a distributed I/O field device that connects to 1 or more IO-Controllers via Profinet IO. It is comparable to the slave devices defined by Profibus. It functions as the provider of Input data and the consumer of Output data.

IO-Controller (PLC): Several IO-Devices are connected to an IO-Controller. This IO Controller is typically the programmable logic controller (PLC) on which the automation program runs. Its function is comparable to a Class 1 Master in Profibus. The IO-Controller provides output data to the configured IO devices and is the consumer of the input data of I/O devices.

IO Supervisor (PC or HMI): This can be a programming device, Personal Computer (PC) w/software, or a Human Machine Interface (HMI) device, and is used for commissioning or for diagnostic purposes. It is comparable to a Class 2 master in Profibus. IO-Supervisors are usually integrated only temporarily for commissioning or troubleshooting purposes on a Profinet network.

You may also obtain a copy of the Profinet standard from the Profinet web site at www.profibus.com. You can get the GSDML file for this model from the CDROM shipped with your unit, or you may download it from our web site at www.acromag.com, or from the Profinet web site at www.profibus.com.

Profinet GSDML File

SIMATIC is an acronym for **SI**emens and Auto**MATIC**, and is a registered trademark of Siemens Corporation. It refers to an automation system that they developed for machine control. Because every automation system needs a program to control a machine, you need software to create a program. Step7 is one version of SIMATIC software used to create automation programs. Step7 runs on your PC and can be used to program Programmable Logic Controllers (PLC).

For all Profinet devices, the process of configuration is based on electronic device datasheets (GSD files), required for each device, and provided by the device manufacturer. These files define the electronics of the device, as well as its relevant communication parameters.

During the setup phase of a Profinet network, a Profinet IO Controller must be programmed with a special Profinet Configuration tool, such as Step7 from Siemens. Profinet IO devices (like this module) are also configured using a Profinet configuration tool which either acts as an IO Controller (like a Siemens PLC), or an IO Supervisor (a Profinet programming device, PC w/software, or an HMI).

The IO Controller or Supervisor uses a type of GSD file similar to the GSD files of Profibus devices, but XML based and containing more information than Profibus GSD files. These files contain a complete electronic description of the device and all of its relevant communication parameters.

GSDML (Generic Station Description Markup Language) refers to the file that describes the implementation of a Profinet device to another device on a Profinet network. It is a combinational acronym taken from its language XML (eXtensible Markup Language) and its function GSD (General Station Description).

For this device, the file is **GSDML-V2.30-Acromag-XT1233-xxxxxxxx.xml**, where xxxxxxxx = YYYYMMDD of the revision (YearMonthDay). V2.30 deals with the version of the GSDML schematic that the file was based on.

Profinet Mapping Table

The XT1233-000 & XT1243 models uses 16 WORD addresses for its 16 channels of Input data with 1 channel occupying each 16-bit data word address as follows:

XT1233-000 XT1243-000	NAME	DATA TYPE	BIPOLAR/UNIPOLAR RANGE INPUT DATA FORMAT
INPUT	AI Channel 0	Unsigned 16-bit	±30000/0-30000 ±20000/0-20000 (w/Legacy)
INPUT	AI Channel 1	Unsigned 16-bit	±30000/0-30000 ±20000/0-20000 (w/Legacy)
INPUT	AI Channel 2	Unsigned 16-bit	±30000/0-30000 ±20000/0-20000 (w/Legacy)
INPUT	AI Channel 3	Unsigned 16-bit	±30000/0-30000 ±20000/0-20000 (w/Legacy)
INPUT	AI Channel 4	Unsigned 16-bit	±30000/0-30000 ±20000/0-20000 (w/Legacy)
INPUT	AI Channel 5	Unsigned 16-bit	±30000/0-30000 ±20000/0-20000 (w/Legacy)
INPUT	AI Channel 6	Unsigned 16-bit	±30000/0-30000 ±20000/0-20000 (w/Legacy)
INPUT	AI Channel 7	Unsigned 16-bit	±30000/0-30000 ±20000/0-20000 (w/Legacy)

Profinet Mapping Table…

XT1233-000 XT1243-000	NAME	DATA TYPE	BIPOLAR/UNIPOLAR RANGE INPUT DATA FORMAT
INPUT	AI Channel 8	Unsigned 16-bit	±30000/0-30000 ±20000/0-20000 (w/Legacy)
INPUT	AI Channel 9	Unsigned 16-bit	±30000/0-30000 ±20000/0-20000 (w/Legacy)
INPUT	AI Channel 10	Unsigned 16-bit	±30000/0-30000 ±20000/0-20000 (w/Legacy)
INPUT	AI Channel 11	Unsigned 16-bit	±30000/0-30000 ±20000/0-20000 (w/Legacy)
INPUT	AI Channel 12	Unsigned 16-bit	±30000/0-30000 ±20000/0-20000 (w/Legacy)
INPUT	AI Channel 13	Unsigned 16-bit	±30000/0-30000 ±20000/0-20000 (w/Legacy)
INPUT	AI Channel 14	Unsigned 16-bit	±30000/0-30000 ±20000/0-20000 (w/Legacy)
INPUT	AI Channel 15	Unsigned 16-bit	±30000/0-30000 ±20000/0-20000 (w/Legacy)
INPUT (Produced)	Heart Beat Counter	Unsigned 16-bit	Integer incrementer from 0-65535 with wrap-around back to 0. Increments by 1 for every host to network data transfer to help indicate if fresh data is present relative to the last data transfer, or if the unit has halted for some reason.

TROUBLESHOOTING

Diagnostics Table

Before attempting repair or replacement, be sure that all installation and configuration procedures have been followed and that the unit is wired properly. Verify that 12-32V power is applied to the unit.

If your problem still exists after checking your wiring, power, and reviewing this information, or if other evidence points to another problem with the unit, an effective and convenient fault diagnosis method is to exchange the questionable unit with a known good unit.

Acromag's Application Engineers can provide further technical assistance if required. Repair services are also available from Acromag.

POSSIBLE CAUSE	POSSIBLE FIX
Green RUN LED does not light…	
Internal +3.3V rail has failed.	Return module for repair.
Green RUN LED flashes continuously…	
A network link has not been established.	Check your cable and switch/hub connections. Once a link is established, the green Run LED should not continue to blink but remain ON. If it continues to blink, then the cable/connection is bad or the firmware may have been corrupted.
Unit was not connected to network upon power-up, or network cable is bad.	The RUN LED will continue to blink as the unit initially hunts for a network link. Connect a network cable to the unit to complete initialization and stop the blinking. Note this only occurs for initial network communication following power-up.
Unit failed to boot firmware (Internal Firmware Failure).	A continuously flashing green Run LED can signify the unit has failed to initialize and may require repair, if you are sure you have a good network connection and proper power voltage. Return module to Acromag for repair/reprogramming.
Unit Fails to Start-up or Initialize…	
Input power voltage below 12V, or input supply is current-limited below twice the unit's current draw?	Check your power voltage and make sure that it is at least 12V and of sufficient capacity (select a current capacity at least 2x the maximum current draw of the unit).
Cannot Communicate With Module Over Network…	
Power ON at Module?	*Check power. Is Green Run LED ON?*
Using Wrong IP Address	You could either change the IP address of the module, or your host PC network card so that they both reside in the same address domain. The easiest solution is to connect to the unit via USB and change the IP address setting of the module.
Many Communication Errors…	
Is Cable segment longer than 100M?	The maximum distance between two nodes on an Ethernet network is limited to 100 meters using approved cable.
Correct Cable Type	Shielded CAT-5/5E cable, equivalent or better, is recommended.
Missing Earth Ground Connection?	Connect earth ground to power minus terminal at TB6-23.

Diagnostics Table…

POSSIBLE CAUSE	POSSIBLE FIX
Communication To Unit is Lost…	
Was communication interrupted by severe interference or shock?	Reset the unit by cycling power to it.
Adding another unit to network slows web page interaction considerably…	
Does each unit have a unique MAC address? *All units are normally shipped with a unique MAC address assigned from the factory. An error in shipment could release a unit with a default MAC address of 52:4F:42:45:52:54.*	Go to the Network Configuration Page of the USB Configuration Software and verify that each unit has a unique MAC address installed. This should always be the case. If you have 2 units with same MAC address, this will slow down communications considerably and you must contact the factory for MAC reassignment.
USB Software Fails to Detect Module…	
Bad USB Connection	Recheck USB Cable Connection
USB has not enumerated the device.	Use the reset button on the Acromag USB isolator to trigger renumeration of the module, or simply unplug and replug the USB cable to the module.
Communication or power was lost while USB was connected and the configuration software was running.	Close the current connection with the software, then select and re-open the module for communication (or simply exit the Configuration software and reboot it).
Cannot Communicate with Module via USB…	
A missing USB Isolator could cause a ground loop between a grounded input signal and earth ground at the connected Personal Computer's USB port.	Without a USB isolator, a ground loop is created between a grounded input signal source and earth ground of the PC USB port. For this reason, and for increased safety and noise immunity, it's best to connect to USB via a USB isolator. Use an isolator like the Acromag USB-ISOLATOR. Otherwise, use a battery powered laptop to configure the module which does not normally earth ground its USB port.
Input reading Erratic, Not operational, or Intermittent when Connected to USB…	
Unit fails to operate or exhibits an output shift…	
Missing USB isolation with grounded I/O signal source.	Even though the I/O is isolated from the network and power, if your input signal is already earth grounded, then connecting USB to the module may drive a ground loop between your input return and earth ground at the PC. Use USB signal isolation, or alternatively, you can connect to a battery-powered laptop/PC, which does not earth ground its USB connection.

Diagnostics Table…

POSSIBLE CAUSE	POSSIBLE FIX
Input Polarity is Wrong…	
Are your input terminals reversed?	Observe proper polarity for voltage inputs. Current can be input to the input (+) or input return terminals if a non-polarized range is selected (the ±20mA range).
Inputs Appear Noisy or Unstable…	
Have you grounded your inputs?	Connect one port return (RTN) terminal to earth ground if the input signal source is not already grounded.
Have you tried averaging? Is averaging set to 1? (This is a global channel setting, not per channel)	You can use the configuration software to set input averaging from 1-200 samples. A value of 1 is equivalent to no averaging. Higher averaging will help to minimize noise, but will increase the response time.
Status field of software screen indicates "Data Transfer Error", "Unknown Protocol" or "Timeout Error"…	
USB connection was opened before unit had completed its power-on initialization and established its network connection.	Wait ~30 seconds after powering-up unit before opening a USB connection via the configuration software. Turn power off to the unit, close the USB configuration software, repower the unit, then reboot the USB configuration software after the unit has completed power-on initialization and established its network connection.

Service & Repair Assistance

This unit contains solid-state components and requires no maintenance, except for periodic cleaning and module configuration parameter (zero and full-scale) verification. The enclosure is not meant to be opened for access and can be damaged easily if snapped apart. Thus, it is highly recommended that a non-functioning module be returned to Acromag for repair or replacement. Acromag has automated test equipment that thoroughly checks and calibrates the performance of each module, and can restore firmware. Please refer to Acromag's Service Policy and Warranty Bulletins, or contact Acromag for complete details on how to obtain repair or replacement.

ACCESSORIES

Software Interface Package



Software Interface Package/Configuration Kit – Order XT-SIP

- USB Signal Isolator
- USB A-B Cable 4001-112
- USB A-mini B Cable 4001-113
- Configuration Software CDROM 5041-094

This kit contains all the essential elements for configuring XT network modules. Isolation is recommended for USB port connections to these models and will block potential ground loops between your PC and grounded input signals. A software CDROM is included that contains the Windows software used to program the unit (you can optionally download this software from www.acromag.com).

USB Isolator



USB Isolator – Order USB-ISOLATOR

- USB Signal Isolator
- USB A-B Cable 4001-112
- Instructions 8500-900

This kit contains a USB isolator and a 1M USB A-B cable for connection to a PC. This isolator and cable are also included in XT-SIP (see above).

USB A-B Cable



USB A-B Cable – Order 4001-112

USB A-B Cable 4001-112

This is a 1 meter, USB A-B replacement cable for connection between your PC and the USB isolator. It is normally included with the XT-SIP Software Interface Package XT-SIP and also with the isolator model USB-ISOLATOR.

USB A-mini B Cable




USB A-mini B Cable – Order 4001-113

- USB A-mini B Cable 4001-113

This is a 1 meter, USB A-miniB replacement cable for connection between the USB isolator and any ST, TT or XT module. It is normally included in XT-SIP.

Note that software for all XT Series models is available free of charge, online at www.acromag.com.

DIN Rail Bus Connector Kit

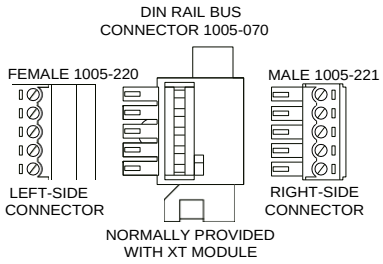

Bus Connector Kit for DIN Rail Bus Connection to Power, Model XTBUS-KIT

This kit contains one each of the following terminals

- DIN Rail Bus Connector 1005-070 for 22.5mm XT Modules.
- Left Side terminal block, female connector 1005-220.
- Right Side terminal block, male connector 1005-221.
- Two End Stops for 35 mm DIN Rails 1027-222 (not shown).

This module was shipped with the first item included in this kit, DIN Rail Bus Connector 1005-070, and this kit offers a spare. Left and right side terminal blocks that mate directly to the bus connector are included in this kit. These terminals are used to optionally (or redundantly) drive power to the modules via their DIN rail bus connector. This allows modules to neatly and conveniently share connections to Power. Two end stops 1027-222, used to secure the terminal block and module for hazardous location installations.

Low EMI Double-Shielded Patch Cable



Ethernet Patch Cable, 3 feet long, Model 5035-369
Ethernet Patch Cable, 15 feet long, Model 5035-370

This cable is used to connect a module to your network switch (like an Acromag 900EN-S005 or equivalent Ethernet switch), and is double-shielded for lower emissions and increased RFI resistance. It has been tested to lower radiated emissions of this product. It has a red, low-smoke, zero halogen jacket that bundles four pairs of 26AWG stranded cable. It uses a 100% foil shield beneath a 60% braided outer shield and includes an RJ45 plug at each end. It is electrically equivalent to L-Com TRD855DSZRD cable and can be obtained in other lengths directly from L-Com (http://www.l-com.com).

Double-shielded CAT5e or better cable is recommended for very noisy environments or in the presence of strong electrical fields. You may obtain shielded CAT-5e cable in other lengths and colors as required for your application from other vendors including L-com Connectivity Products, www.L-com.com, Pro-Link, www.prolink-cables.com, Regal, www.regalusa.com, and Lumberg, www.lumbergusa.com. The recommended L-com cable was used for CE Testing of this model.

SPECIFICATIONS

Model Number

XT1233-000 (16 Current Inputs)
XT1243-000 (16 Voltage Inputs)

Analog Input Module
Profinet Support
16 Single-Ended Input Channels
DC Powered
CE Approved
Includes UL/cUL Class I, Division 2 approvals

The XT1233-000 model denotes a 16 single-ended input channel module for DC current (as opposed to the eight channel XT1213 differential current model). The XT1243-000 model is a 16 single-ended input channel module for DC voltage (as opposed to the eight channel XT1223 differential voltage model). Single-ended refers to measuring the input signal relative to a common grounded return. These models operate over Ethernet using Profinet. Their I/O is setup and calibrated offline using USB. Their network parameters are setup using a Profinet configuration tool. They represent additional members of the Acromag DIN-Rail mounted, "Busworks" family, in the XT Series. The trailing "-000" model suffix denotes DC powered w/ CE & UL/cUL Class I, Division 2 Approvals.

Reconfiguration of the I/O for any XT model will require use of the XT-SIP configuration kit, ordered separately (see Accessories section).

Models are mounted on standard "T" Type DIN rail and include plug-in terminals. Power and excitation can be optionally (or redundantly) bussed along the DIN rail (see Power & Excitation Connections).

Analog Inputs

All input ranges are supported with a nominal bipolar and differential full-scale A/D range of ±1.325V for 16-bit bipolar conversion (±32768). XT1243 voltage inputs are first resistive-divided (12.1K/100.6K), then unity-gain buffered prior to the A/D (divider factor is 0.115019x). For XT1243 models, you may select DC voltage ranges of ±5V, ±10V, 0-5V, or 0-10V, on a per channel basis. Current inputs are shunted through 27.4Ω resistors to a common return in XT1233 models and the unit accepts current ranges of ±20mA, 0-20mA, 0-11.17mA, and 4-20mA, such that ±20mA DC drives ±0.548V full-scale through unity-gain buffers to the A/D. All selectable input ranges are normalized to ±30000 for ±100% of range, or optionally to ±20000 for ±100% of range (w/ legacy support). Positive current or voltage is delivered to the (+) input terminal and returned at the common return (RTN) terminal.

Unit must be wired and configured for the intended input type and range (see Connections section for details). The following paragraphs summarize this model's input types, ranges, and applicable specifications:

DC Current (XT1233 Only): Configurable for ±20mA, 0 to 20mA, 4-20mA, and 0-11.17mA DC nominal input ranges. A precision 27.4Ω (0.125W) current sink resistor converts the input current to a voltage that is processed by the A/D converter. XT1233 units utilize the ±1.325V A/D range with ±20mA DC driving ±0.548V full-scale to the A/D. An optional external sensor is required to monitor AC current signals (Acromag Model 5020-350). The AC sensor drives 0 to 11.17mA DC to the module (see Table 1 below for scaling to AC current).
DC Voltage (XT1243 Only): Bipolar DC voltage ranges of ±10V, 0-10V, ±5V, and 0-5V are driven to the A/D through resistive dividers (0.115019x factor) and unity-gain buffers. The A/D has a native 16-bit nominal bipolar range of ±1.325V. You may select DC input voltage ranges of ±5V, ±10V, 0-5V, or 0-10V, on a per channel basis.

Analog Inputs…

Input Overvoltage Protection: Bipolar Transient Voltage Suppressers (TVS), 5.6V clamp level typical (XT1233), or 18V clamp level typical (XT1243). Inputs also include current-limited (series resistance) diode clamps to the ±2.5V rails.

Optional AC Current Sensor (Model 5020-350, for AC Current Input to XT1233): The 5020-350 sensor can be connected to any of the input terminals of this model for AC current sensing, and is a toroidal instrument transformer that converts the sinusoidal 50-60Hz AC current signal into a low level DC milliampere signal of 0 to 11.17mA. The input AC current range is a function of the number of turns placed through the toroid as shown in Table 2 below. This sensor is isolated and requires no calibration or adjustment. When used with the XT1233 module, it also facilitates current input isolation channel-to-channel, and redundant current input isolation with respect to the network and power of this transmitter.

The output wires of this sensor are polarized with red as plus (+) and black as minus (-). Normally these output wires are attached to one end of a user supplied cable, while the other end connects to the current input terminals of this module, similar to that shown below.

MODEL XT123x-000 WIRING TO AC CURRENT SENSOR 5020-350

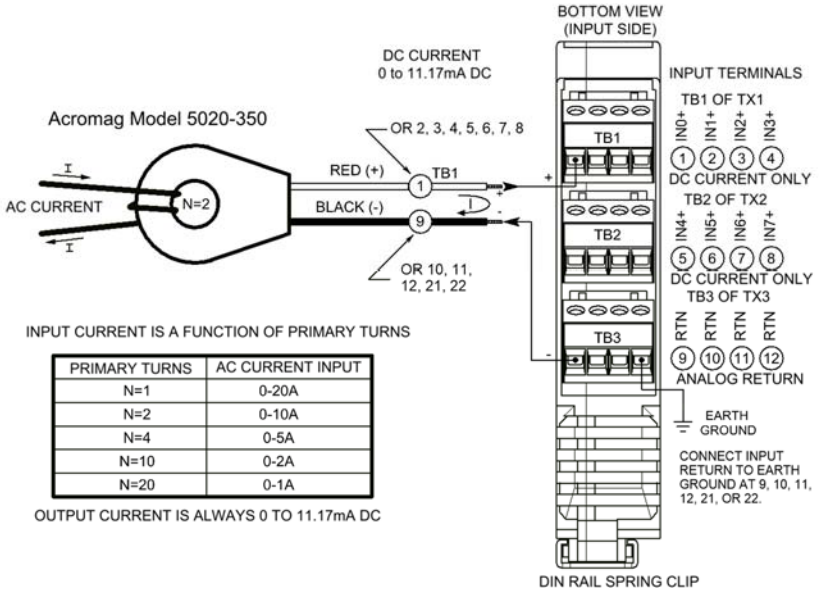


Table 2: Optional AC Current Sensor Turns & Range		
AC Current Input Range	**Primary Turns**	**Sensor Output (Red/Black Wires)**
0 to 20A AC	1	0 to 11.17mA DC
0 to 10A AC	2	"
0 to 5A AC	4	"
0 to 2A AC	10	"
0 to 1A AC	20	"

AC Input Burden: A function of the wire gauge resistance used for primary turns (the current carrying wire being monitored).

Analog Inputs…

AC Current Sensor to Transmitter Wiring Distance: 400 feet maximum for 18 gauge wire. Other wire gauges can be used as long as the resistance of both wires is less than 5Ω.

AC Input Overload: The AC current sensor will withstand overload conditions as follows:

- 20 times full scale for 0.01 seconds.
- 10 times full scale for 0.1 seconds.
- 5 times full scale for 1.0 second.

Input Resolution (Minimum Discernible Change): Unit has a fundamental 16-bit A/D input range of ±1.325V, which defines 1 lsb equal to 2.65V/65536, or 40.436uV/bit. That is, the A/D of this model divides the input signal range into a number of parts that can be calculated by subtraction using the expression for A/D counts as (Vin_eff/1.325)*32768 for its bipolar ±1.325V A/D full-scale input range with 16 bit corresponding to ±32768 counts. Vin_eff is the effective DC input voltage of this model after the input voltage divider (0.115019x on XT124x voltage units), or the current input shunted through 27.4Ω on XT123x models (0.548V @20mA into 27.4Ω for XT1233 Models). The resultant raw A/D count is then normalized using a bipolar conversion scheme of ±30000 (bipolar ranges), or ±20000 (bipolar ranges w/legacy support), each corresponding to ±100% of input range. That is, -100%, 0% and +100% are represented by decimal values –30000, 0, and 30000, respectively, or -20000, 0, 20000 respectively (w/legacy support). The effective input resolution for a given range is normally the lowest resolution of either the A/D conversion, or its normalized value. For this model, the effective resolution is dominated by that of the A/D converter (shaded values below). An indication of nominal input resolution is expressed as the number of parts between the input range low and high endpoints shown in the table below.

Input Resolution for XT123x-000 Input Ranges[1]

RANGE Into 27.4Ω	±20mA (±0.548V)	0-20mA (0-0.548V)	4-20mA (0.1096-0.548V)	0-11.17mA (0-0.30606V)
Raw A/D	±13552 (1 part in 27104)	0-13552	2710-13552 (1 part in 10842)	0-7569
Resolution	1.476uA/bit			
PPM	36.9ppm	73.8ppm	92.2ppm	132.1ppm
Normalized	±30000	0-30000	0-30000	0-30000

Normalized Resolution for XT124x Input Ranges[1]

RANGE	±10V	±5V	0-10V	0-5V
Raw A/D	±28445 (1 part in 56890)	±14222 (1 part in 28444)	0-28445	0-14222
Resolution	351.6uV/bit			
PPM	17.6ppm	35.2ppm	35.2ppm	70.3ppm
Normalized	±30000	±30000	0-30000	0-30000

[1]XT123x current inputs use a 27.4Ω shunt resistor to drive ±0.548V at ±20mA to a 16-bit ±1.325V input A/D. XT124x voltage ranges are coupled to the A/D after a 12.1K/100.6K resistive voltage divider (0.12028x). All input ranges are normalized to ±30000 for ±100%, and 0-30000 for 0-100% (or ±20000 for ±100%, and 0-20000 for 0-100% with legacy support enabled).

Analog Inputs…

Input Accuracy: Better than ±0.05% of span typical, ±0.1% maximum. This includes the effects of repeatability, terminal point conformity, and linearization, but does not include sensor error.
Input Measurement Temperature Drift: Better than ±50ppm/°C (±0.0050%/°C).
Input Update/Conversion Rate: Your response time will vary as averaging is increased. The fastest response time with no averaging (averaging set to 1) is less than 1ms typical for both models.
Input Reference Test Conditions: ±20mA (XT123x) or ±5V (XT124x) input; ambient temperature = 25°C; 24VDC supply.
Input Impedance: 105.2KΩ minimum (XT124x input divider), or 27.4Ω (XT123x shunt resistor).
Input Over Voltage Protection: Bipolar Transient Voltage Suppressors (TVS), with a clamp level approximately 24V (XT124x), or 7.5V (XT123x). This is followed by series resistance (voltage divider) current-limited clamping diodes to the ±2.5V rails at each input lead, then unity-gain input buffers.
Input Calibration: Inputs can be calibrated manually by driving the input channel with a precision reference current or voltage signal source.
Input Analog to Digital Converter (A/D): A 16-bit delta-sigma converter, Texas Instruments ADS1158IRTC, connected in bipolar mode with a 1.25V reference, yielding a 16-bit A/D input range of ±1.325V corresponding to a count of ±32768.
Input Filter: Normal mode filtering fixed per input type.
Input Filter Bandwidth: -3dB at 25KHz, typical, no averaging.
Input Noise Rejection (Common Mode): Better than -110dB @ 60Hz, typical with 100Ω input unbalance.
Input Cable Length: I/O port interface cables should not exceed 30m in length for rated performance.

Power

Power Supply (Connect at TB6 terminals 24 & 23, and/or via the DIN Rail Bus): 12-32V DC SELV (Safety Extra Low Voltage), 2.8W max. Observe proper polarity. Reverse voltage protection is included. Unit can be redundantly powered by connecting power to both the power terminals on the unit at TB6 and DIN rail bus at TB7 (these inputs are diode-coupled to the same point in the circuit). Current draw varies with power voltage as follows.

SUPPLY	XT123x/124x-000 CURRENT
12V	207mA Typical / 228mA Max
15V	163mA Typical / 180mA Max
24V	103mA Typical / 113mA Max
32V	77mA Typical / 85mA Max

CAUTION: Terminal voltage at or above 12V minimum must be maintained to the unit during operation. Do not exceed 36VDC peak to avoid damage to the unit.
Power Supply Effect: Less than ±0.001% of output span effect per volt DC change.

USB Interface

IMPORTANT – USB Isolation is Recommended: The inputs of these modules are isolated from each network port and DC power, but the input return is also common to its USB connection.



Most Personal computers (except DC powered laptops) connect their USB signal and shield ground to earth ground. Without a USB isolator, an earth grounded USB connection could drive a ground loop with any earth ground also applied at its input return, which might interfere with operation. For this reason, we recommend that you always use a USB isolator when making a USB connection to prevent a potential ground loop from negatively affecting performance. Otherwise, in the absence of USB isolation, a battery powered laptop could be used to connect to the unit, as the laptop does not normally connect to earth ground.

Unit includes a mini USB-B socket for temporary connection to a PC or laptop for the purpose of I/O setup, reconfiguration, and trouble-shooting. However, USB isolation is recommended when connecting to a unit that may also be connected to grounded I/O signals, because the USB connection often provides its own earth ground. Note that this model does not utilize power from USB and must already have DC power connected to it when connecting to USB.

CAUTION: Do not attempt to connect USB in a hazardous environment. Module should be setup and configured in a safe environment only.

Data Rate: USB 2.0 compatible, up to full-speed at 12Mbps.

Cable Length/Connection Distance: 5.0 meters maximum.

Driver: No special drivers required. Uses the built-in USB Human Interface Device (HID) drivers of the Windows Operating System (Windows XP or later versions only).

USB Connector: 5-pin, Mini USB B-type socket, Hirose UX60-MB-5S8.

PIN	DEFINITION
1	+5V Power (Transient protected, but not used by this model)
2	Differential Data (+)
3	Differential Data (-)
4	NC – Not Connected
5[1]	Power Ground (Connects to Signal Ground via ferrite bead)
SHLD[1]	Signal Ground (Connects directly to Signal Ground)

[1]**Note:** Most Host Personal Computers (except battery powered laptops) will connect earth ground to the USB shield and signal ground.

Transient Protection: Unit adds transient voltage protection to USB power and data lines when connected, but the unit does not use USB power.

USB Cable Length/Connection Distance: 5.0 meters maximum.

Ethernet Interface

Connector: Dual, shielded RJ-45 sockets, 8-pin, 10BaseT/100BaseTX. The metal shield circuit of the network connectors is isolated and capacitively coupled to the input power minus terminal via an isolation capacitor.

Network-to-Network Isolation: Network ports are additionally isolated from each other and will withstand a 1000VAC dielectric strength test for 1 minute without breakdown.

Wiring: Unit includes auto-crossover for MDI or MDI-X cables.

Protocol: Profinet w/USB Configuration of I/O parameters.

IP Address: Default mode static IP address is 192.168.1.100.

Port: Up to 10 sockets supported, uses port 502 (reserved for Modbus).

Data Rate: Auto-sensed, 10Mbps or 100Mbps.

Duplex: Auto-negotiated, Full or Half Duplex.

Compliance: IEEE 802.3, 802.3u, 802.3x.

Ethernet Interface…

Communication Distance: The distance between two devices on an Ethernet network is generally limited to 100 meters using recommended copper cable. Distances may be extended using hubs, switches, or fiber optic transmission. However, the total round trip delay time must not exceed 512 bit times for Ethernet collision detection to work properly.
Port Status Indicator: Yellow LED of the network connector indicates network activity--Ethernet connection is busy and traffic is present.
Address: The module IP address can be preset (static) by the user via a Profinet configuration tool. At startup, it can be loaded from internal non-volatile memory, or it can be automatically acquired via a network server using DHCP (Dynamic Host Configuration Protocol).

Before you can communicate with any module over Ethernet, you must set your network interface to a valid IP address in the address domain of the module. The network parameters for this model are set via a Profinet configuration tool.

Enclosure & Physical

General purpose plastic enclosure for mounting on 35mm “T-type” DIN rail.
Dimensions: Width = 22.5mm (0.9 inches), Length = 114.5mm (4.51 inches), Depth = 99.0mm (3.90 inches). Refer to Mechanical Dimensions drawing.
I/O Connectors: Removable plug-in type terminal blocks rated for 12A/250V; AWG #26-12, stranded or solid copper wire.
Program Connector: USB Mini B-type, 5-pin. See USB Interface.
Case Material: Self-extinguishing polyamide, UL94 V-0 rated, color light gray. General purpose NEMA Type 1 enclosure.
Circuit Board: Military grade fire-retardant epoxy glass per IPC-4101/98.
DIN-Rail Mounting: Unit is normally mounted to 35x15mm, T-type DIN rails. Refer to the DIN Rail Mounting & Removal section for more details.
Shipping Weight: 0.5 pounds (0.22 Kg) packed.
IMPORTANT: For ambient operation above 55°C, space units apart to aide cooling. Module is intended to be mounted upright on a horizontal DIN rail, allowing cool air to enter in through the bottom vents and warm air to exhaust out the top vents. Above 55°C, a space of at least 20mm between modules is recommended to aide cooling in this manner.

Environmental

These limits represent the minimum requirements of the applicable standard, but this product has typically been tested to comply with higher standards in some cases.

Operating Temperature: -40°C to +70°C (-40°F to +158°F).

Storage Temperature: -40°C to +85°C (-40°F to +185°F).

Relative Humidity: 5 to 95%, non-condensing.

Isolation: Input channels and USB (as a group), network (two ports), and power circuits are all isolated from each other for common-mode voltages up to 250VAC, or 354V DC off DC power ground, on a continuous basis (will withstand 1500VAC dielectric strength test for one minute without breakdown). This complies with test requirements of ANSI/ISA-82.01-1988 for voltage rating specified. The network ports will withstand a 1000VAC dielectric strength test port-to-port for one minute without breakdown.

Installation Category: Suitable for installation in a Pollution Degree 2 environment with an Installation Category (Over-voltage Category) II rating per IEC 1010-1 (1990).

Shock & Vibration Immunity: Conforms to: IEC 60068-2-6: 10-500 Hz, 4G, 2 Hours/axis, for sinusoidal vibration; IEC 60068-2-64: 10-500 Hz, 4G-rms, 2 Hours/axis , for random vibration, and IEC 60068-2-27: 25G, 11ms half-sine, 18 shocks at 6 orientations, for mechanical shock.

Electromagnetic Compatibility (EMC)

Minimum Immunity per BS EN 61000-6-2:

1) Electrostatic Discharge Immunity (ESD), per IEC 61000-4-2.
2) Radiated Field Immunity (RFI), per IEC 61000-4-4.
3) Electrical Fast Transient Immunity (EFT), per IEC 61000-4-4.
4) Surge Immunity, per IEC 61000-4-5.
5) Conducted RF Immunity (CRFI), per IEC 61000-4-6.

This is a Class A Product with Emissions per BS EN 61000-6-4:

1) Enclosure Port, per CISPR 16.
2) Low Voltage AC Mains Port, per CISPR 16.
3) Telecom / Network Port, per CISPR 22.

WARNING: This is a Class A product. In a domestic environment, this product may cause radio interference in which the user may be required to take adequate measures. Refer to the EMI Filter Installation drawing in the Electrical Connections section of this manual to install ferrite cable clamps that help to reduce radiated emissions. The use of low EMI double-shielded Ethernet cable is also helpful in curbing emissions.

Agency Approvals

Electromagnetic Compatibility (EMC): CE marked, per EMC Directive 2004/108/EC. Consult Factory.

Safety Approvals: UL Listed (USA & Canada). Hazardous Locations – Class I, Division 2, Groups A, B, C, D Hazardous Location or Nonhazardous Locations only. These devices are open-type devices that are to be installed in an enclosure suitable for the environment. Consult Factory.

ATEX Certified: Model XT1233/43-000 is ATEX Certified for Explosive Atmospheres per ATEX Directive 94/9/EC which complies with standards BS EN 60079-0:2012 & BS EN 60079-15:2010.

Ex II 3 G Ex nA IIC T4 Gc -40°C ≤ Ta ≤ +70°C

DEMKO 15 ATEX 1561X

X = Special Conditions

1) The equipment shall only be used in an area of not more than pollution degree 2, as defined in EN 60664-1.
2) The equipment shall be installed in an enclosure that provides a degree of protection not less than IP 54 and only accessible with the use of a tool in accordance with EN 60079-15.
3) Transient protection shall be provided that is set at a level not exceeding 140 % of the peak rated voltage value at the supply terminals to the equipment.

Reliability Prediction

Reliability Prediction
MTBF (Mean Time Between Failure): MTBF in hours using MIL-HDBK-217F, FN2. *Per MIL-HDBK-217, Ground Benign, Controlled, G_BG_C*

XT1233-000	MTBF (Hours)	MTBF (Years)	Failure Rate (FIT)
25°C	463,547 hrs	52.9 years	2,157
40°C	345,200 hrs	39.4 years	2,897
XT1243-000	**MTBF (Hours)**	**MTBF (Years)**	**Failure Rate (FIT)**
25°C	458,991 hrs	52.4 years	2,179
40°C	338,846 hrs	38.7 years	2,951

Configuration Controls

Software Configuration of I/O is Only via USB
Although this module normally operates using Profinet over Ethernet, its I/O can only be setup and calibrated offline via USB. Its network communication parameters are set online using a Profinet configuration tool. Its behavior as a 16 Channel analog input module is determined via a temporary USB connection to a host computer or laptop running a Windows-compatible configuration software program specific to the model. This software provides the framework for digital control of all channel configuration & calibration parameters, and this information is stored in non-volatile memory.

LED Indicators:
RUN (Green) – Located at front panel. Constant ON if power is on and unit is OK. Flashes ON/OFF during initialization & network connection. If flashing continuously it could indicate a network cable issue, or a possible firmware issue.
ST (Yellow) – Located at front panel. Turns ON if any input signal is over/under range.
ACT (Yellow) – Located on RJ45 port connector itself. Indicates Ethernet activity--the Ethernet connection is busy and traffic is present.

Refer to Configuration Step-by-Step in the Technical Reference section of this manual for detailed information on available software control of this model.

REVISION HISTORY

Release Date	Version	EGR/DOC	Description of Revision
15-APR-14	A	BC/ARP	Initial Acromag “A” Release.
05-AUG-14	B	BC/AP	Updated Release, remove i2o logos (Modbus only), added module spacing recommendations.
10-SEP-14	C	CAP/ARP	Added UL Mark (removed pending) per ECO #14H030.
13-OCT-14	D	BC/ARP	Added MTBF Data.
15-OCT-2015	E	CAP/MJO	Added ATEX symbols / statements.
22-AUG-2016	F	CAP/MJO	Corrected “Circuit board” specification.
13 NOV 2017	G	FJM/ARP	Reference Configuration Software without the revision.

Artisan Technology Group is an independent supplier of quality pre-owned equipment

Gold-standard solutions

Extend the life of your critical industrial, commercial, and military systems with our superior service and support.

We buy equipment

Planning to upgrade your current equipment? Have surplus equipment taking up shelf space? We'll give it a new home.

Learn more!

Visit us at **artisantg.com** for more info on price quotes, drivers, technical specifications, manuals, and documentation.

Artisan Scientific Corporation dba Artisan Technology Group is not an affiliate, representative, or authorized distributor for any manufacturer listed herein.

We're here to make your life easier. How can we help you today?

(217) 352-9330 | sales@artisantg.com | artisantg.com

ARTISAN® TECHNOLOGY GROUP