



Artisan Technology Group is your source for quality new and certified-used/pre-owned equipment

- FAST SHIPPING AND DELIVERY
- TENS OF THOUSANDS OF IN-STOCK ITEMS
- EQUIPMENT DEMOS
- HUNDREDS OF MANUFACTURERS SUPPORTED
- LEASING/MONTHLY RENTALS
- ITAR CERTIFIED SECURE ASSET SOLUTIONS

SERVICE CENTER REPAIRS

Experienced engineers and technicians on staff at our full-service, in-house repair center

*InstraView*SM REMOTE INSPECTION

Remotely inspect equipment before purchasing with our interactive website at www.instraview.com ↗

WE BUY USED EQUIPMENT

Sell your excess, underutilized, and idle used equipment. We also offer credit for buy-backs and trade-ins. www.artisanng.com/WeBuyEquipment ↗

LOOKING FOR MORE INFORMATION?


Visit us on the web at www.artisanng.com ↗ for more information on price quotations, drivers, technical specifications, manuals, and documentation

Contact us: (888) 88-SOURCE | sales@artisanng.com | www.artisanng.com

3500/92 Communication Gateway

Bently Nevada™ Asset Condition Monitoring

Description



The 3500/92 Communication Gateway module provides extensive communication capabilities of all rack monitored values and statuses for integration with process control and other automation systems using both Ethernet TCP/IP and serial (RS232/RS422/RS485) communications capabilities. It also permits Ethernet communications with 3500 Rack Configuration Software and Data Acquisition Software.

Supported protocols include:

- Modicon® Modbus® protocol (via serial communications)
- Modbus/TCP protocol (a variant of serial Modbus used for TCP/IP Ethernet communications)
- Proprietary Bently Nevada protocol (for communication with 3500 Rack Configuration and Data Acquisition Software packages)

The Ethernet connection to the 3500/92 is an RJ45 connection for 10BASE-T star configuration Ethernet networks.

The 3500/92 supports the communication interfaces, communication protocols, and other features from the original 3500/90 with the exception of the primary value Modbus registers. The 3500/92 now has a Configurable Modbus Register Utility, which can provide the same functionality originally addressed by the primary value Modbus registers.



Specifications and Ordering Information
Part Number 141542-01
Rev. D (03/07)

Page 1 of 8

Specifications

Inputs

Power Consumption

5.0 watts typical with ModbusRS232/ RS422 I/O Module

5.6 watts typical with Modbus RS485 I/O Module

Data Types:

Collects data from other modules in the rack, such as current proportional values with time stamp, module statuses, and current alarm statuses, via a high speed internal network.

Exact data types returned depend on module type and channel configuration.

Update Time: The data collection rate depends on rack configuration but will not exceed 1 second for all modules in the 3500 rack.

Outputs

Front Panel LEDs

OK LED:

Indicates when the 3500/92 is operating properly.

TX/RX LED:

Indicates when the 3500/92 is communicating with other modules in the 3500 rack.

Protocols

BNC Host Protocol:

Communication with 3500 Configuration Software and 3500 Data Acquisition and Display Software over Ethernet TCP/IP.

Modbus®:

Based on AEG Modicon PI-MBUS-300 Reference Manual. Uses Remote Terminal Unit (RTU) transmission mode. Modbus is a registered trademark of Modicon, Inc.

Ethernet

Communication Link:

Ethernet, 10Mbps, and conforms to IEEE802.3.

Protocol:

Ethernet TCP/IP frame and Modbus/TCP.

Connection:

RJ-45 (telephone jack style) for 10BASE-T Ethernet cabling.

Environmental Limits

Main Module

Operating Temperature:

-30 °C to +65 °C
(-22 °F to +150 °F).

Storage Temperature:

-40 °C to +85 °C
(-40 °F to +185 °F).

Humidity:

95%, non-condensing.

I/O Module

Operating Temperature:

0 °C to +65 °C
(+32 °F to +150 °F).

Storage Temperature:

-40 °C to +85 °C
(-40 °F to +185 °F).

Humidity:

Specifications and Ordering Information
Part Number 141542-01
Rev. D (03/07)

95%, noncondensing.

CE Mark Directives

EMC Directives:

Certificate of
Conformity:
134036

EN50081-2:

Radiated Emissions

EN 55011, Class A

Conducted Emissions

EN 55011, Class A

EN50082-2:

Electrostatic Discharge

EN 61000-4-2, Criteria B

Radiated Susceptibility

ENV 50140, Criteria A

Conducted Susceptibility

ENV 50141, Criteria A

Electrical Fast Transient

EN 61000-4-4, Criteria B

Surge Capability

EN 61000-4-5, Criteria B

Magnetic Field

EN 61000-4-8, Criteria A

Power Supply Dip

EN 61000-4-11, Criteria B

Radio Telephone

ENV 50204, Criteria B

Low Voltage Directives:

Certificate of
Conformity:
136669

EN 61010-1

Safety Requirements

Hazardous Area Approvals

CSA/NRTL/C

Approval Option (01)

Class I, Div 2

Groups A, B, C, D

T4 @ Ta = -20 °C to +65 °C

(-4 °F to +150 °F)

Certification
Number

CSA 150268-1002151 (LR 26744)

Physical

Main Board

Dimensions (Height x Width x Depth):

241 mm x 24.4 mm x 242 mm

(9.50 in x 0.96 in x 9.52 in).

Weight:

0.82 kg (1.8 lb.).

I/O Modules

Dimensions (Height x Width x Depth):

241 mm x 24.4 mm x 99.1 mm

(9.50 in x 0.96 in x 3.90 in).

Weight:

0.44 kg (0.96 lb.).

Rack Space Requirements

Monitor Module:

1 full-height front slot.

I/O Modules:

1 full-height rear slot.

Ordering Information The 3500/92 Communication Gateway

3500/92-AXX-BXX-CXX

A: I/O Module Type

01 ModbusRS232/RS422 I/O Module

02 ModbusRS485 I/O Module

03 Ethernet/RS232 Modbus/I/O
Module

04 Ethernet/RS485 Modbus/I/O
Module

Specifications and Ordering Information
Part Number 141542-01
Rev. D (03/07)

B: Memory Type
 01 Low Memory
 C: Agency Approval Option
 00 None
 01 CSA/NRTL/C

Spares

138629-01
 3500/92 Manual

04425545
 Grounding Wrist Strap (single use)

137495-01
 Firmware IC (Odd bank)

137494-01
 Firmware IC (Even bank)

136180-01
 3500/92 Communication Gateway Module.

125736-01
 ModbusRS232/RS422 I/O Module.

133323-01
 ModbusRS485 I/O Module.

136188-01
 Ethernet/RS232 Modbus/O Module

136188-02
 Ethernet/RS485 Modbus/O Module

Accessories

139036-01
 9-pin D-SUB "Y"

Serial Converters

02230411
 RS232 to RS422 Converter
 110 Vac.

02230412
 RS232 to RS422 Converter
 220 Vac.

Ethernet Hubs

164466-01
 Network Accessories Datasheet

Ethernet Transceivers

02200260
 15-Pin AUI male to Fiber Optic Cable (10BASE-FL) with ST connection

02200261
 15-Pin AUI male to Thinnet (10BASE2)

Ethernet Cabling

02175190
 Standard 10 BASE-T Shielded Category 5 Cable with RJ-45 connectors
 6 ft. Length

02175191
 10 ft. Length

02175192
 25 ft. Length

Standard 10BASE-T Shielded Category 5 Cable with RJ-45 connectors

138131-AXXX
 A: Length (in ft.) up to 320 ft in length.

| | |
|------------|------------------------|
| 006 | 6 feet (1.8 meters) |
| 010 | 10 feet (3 meters) |
| 025 | 25 feet (7.3 meters) |
| 040 | 40 feet (12 meters) |
| 050 | 50 feet (15 meters) |
| 075 | 75 feet (22.5 meters) |
| 085 | 85 feet (25.5 meters) |
| 100 | 100 feet (30.5 meters) |
| 120 | 120 feet (36.6 meters) |
| 150 | 150 feet (44.8 meters) |
| 200 | 200 feet (61 meters) |
| 250 | 250 feet (75 meters) |
| 320 | 320 feet (98 meters) |

Note: Standard lengths for 10BASE-T cabling are shown above. Specific lengths can be ordered through Custom Products and are available as shown below.

Specifications and Ordering Information
 Part Number 141542-01
 Rev. D (03/07)

30 ft. - 100 ft. in 5ft. increments only

100ft. - 320 ft. in 10ft. increments only

Fiber-optic cable (10BASE-FL)

137451-AXXXX

A: Length (in ft.) up to 6500 ft (2000 m) in length

10 ft - 500 ft. in 10 ft increments only

500 ft. - 6500 ft. in 100 ft increments only

Serial Cabling (RS232): RS232 Cable, Host to 3500/92

130419-AXXXX-BXX

A: Cable Length

0010 10 feet (3 meters)
0025 25 feet (7.5 meters)
0050 50 feet (15 meters)
0100 100 feet (30.5 meters)

B: Assembly Instructions

01 Not Assembled
02 Assembled

RS232 Cable, Honeywell PLCG to 3500/92

130420 - AXXXX-BXX

Option Descriptions

A: Cable Length

0010 10 feet (3 meters)
0025 25 feet (7.5 meters)
0050 50 feet (15 meters)
0100 100 feet (30.5 meters)

B: Assembly Instructions

01 Not Assembled
02 Assembled

130119-01 RS232 Cable, Host Computer to RS232/RS422 Converter

Serial Cabling (RS422/RS485):

RS422 Cables can be used for rack-to-rack connections when using ModbusRS485 I/O Modules. The final rack-to-host connection is application specific and may require a custom cable.

RS422 PVC Insulated Cable, RS232/RS422 Converter to 3500/92

130530 - AXXXX-BXX

A: Cable Length

0010 10 feet (3 meters)
0025 25 feet (7.5 meters)
0050 50 feet (15 meters)
0100 100 feet (30.5 meters)
0250 250 feet (75 meters)
0500 500 feet (150 meters)

B: Assembly Instructions

01 Not Assembled
02 Assembled

RS422 PVC Insulated Cable, 3500/92 to 3500/92

129665-AXXXX-BXX

A: Cable Length

0010 10 feet (3 meters)
0025 25 feet (7.5 meters)
0050 50 feet (15 meters)
0100 100 feet (30.5 meters)
0250 250 feet (75 meters)
0500 500 feet (150 meters)

B: Assembly Instructions

01 Not Assembled
02 Assembled

RS422 Teflon Insulated Cable, RS232/RS422 Converter to 3500/92

131109 - AXXXX-BXX

Option Descriptions

A: Cable Length

0010 10 feet (3 meters)
0025 25 feet (7.5 meters)
0050 50 feet (15 meters)
0100 100 feet (30.5 meters)
0250 250 feet (75 meters)
0500 500 feet (150 meters)

B: Assembly Instructions

01 Not Assembled
02 Assembled

131108 - AXXXX-BXX

A: Cable Length

0010 10 feet (3 meters)
0025 25 feet (7.5 meters)
0050 50 feet (15 meters)
0100 100 feet (30.5 meters)
0250 250 feet (75 meters)
0500 500 feet (150 meters)

B: Assembly Instructions

Specifications and Ordering Information
Part Number 141542-01
Rev. D (03/07)

- 01 Not Assembled
- 02 Assembled

RS422/RS485 Extension Cable

130531 - AXX - BXX

Used with Cables 130530, 129665, 131109, and 131108 for lengths greater than 500 feet (152 meters).

Standard length is 500 feet (152 meters).

A: Assembly Instructions


- 01 Not Assembled
- 02 Assembled

B: Insulation

- 01 PVC Insulated
- 02 Teflon® Insulated

Note: The total RS485 cable run can be up to 4000 feet (1220 meters). The total RS422 cable run can be up to 4000 feet (1220 meters) between each rack

Graphs and Figures

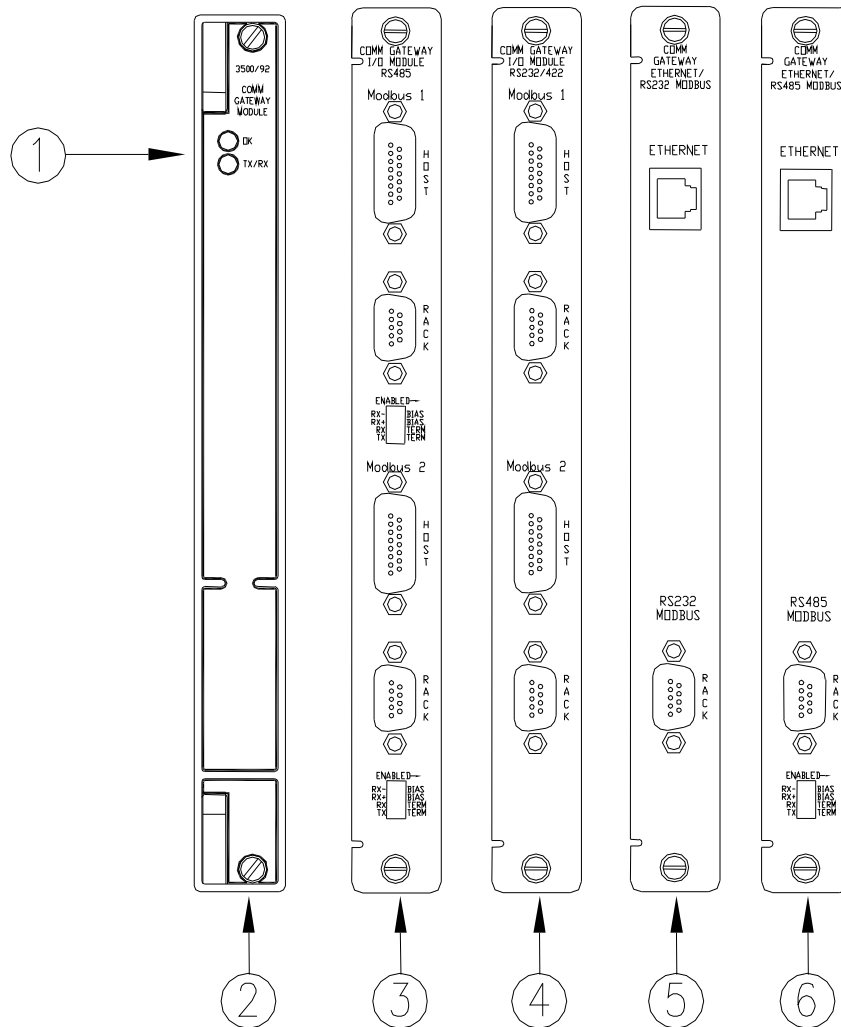

- 1) Status LEDs
- 2) Comm Gateway Module
- 3) RS485 I/O Module
- 4) RS232/422 I/O Module
- 5) Ethernet/RS232 I/O Module
- 6) Ethernet/RS485 I/O Module

Figure 1: Front and rear views of the Communication Gateway

Copyright 1999. Bently Nevada, LLC.
1631 Bently Parkway South, Minden, Nevada USA 89423
Phone: 775.782.3611 Fax: 775.215.2873
www.ge-energy.com/bently
All rights reserved.

Bently Nevada is a trademark of General Electric Company.
Modbus is a trademark of Modbus-IDA.
Modicon is a trademark of Schneider Electric.
Teflon is a registered trademark of DuPont.



Artisan Technology Group is your source for quality new and certified-used/pre-owned equipment

- FAST SHIPPING AND DELIVERY
- TENS OF THOUSANDS OF IN-STOCK ITEMS
- EQUIPMENT DEMOS
- HUNDREDS OF MANUFACTURERS SUPPORTED
- LEASING/MONTHLY RENTALS
- ITAR CERTIFIED SECURE ASSET SOLUTIONS

SERVICE CENTER REPAIRS

Experienced engineers and technicians on staff at our full-service, in-house repair center

*InstraView*SM REMOTE INSPECTION

Remotely inspect equipment before purchasing with our interactive website at www.instraview.com ↗

WE BUY USED EQUIPMENT

Sell your excess, underutilized, and idle used equipment. We also offer credit for buy-backs and trade-ins. www.artisanng.com/WeBuyEquipment ↗

LOOKING FOR MORE INFORMATION?

Visit us on the web at www.artisanng.com ↗ for more information on price quotations, drivers, technical specifications, manuals, and documentation

Contact us: (888) 88-SOURCE | sales@artisanng.com | www.artisanng.com