



Artisan Scientific

QUALITY INSTRUMENTATION ... GUARANTEED

Looking for more information?

Visit us on the web at <http://www.artisan-scientific.com> for more information:

- Price Quotations
- Drivers
- Technical Specifications, Manuals and Documentation

Artisan Scientific is Your Source for Quality New and Certified-Used/Pre-owned Equipment

- Tens of Thousands of In-Stock Items
- Hundreds of Manufacturers Supported
- Fast Shipping and Delivery
- Leasing / Monthly Rentals
- Equipment Demos
- Consignment

Service Center Repairs

Experienced Engineers and Technicians on staff in our State-of-the-art Full-Service In-House Service Center Facility

InstraView™ Remote Inspection

Remotely inspect equipment before purchasing with our Innovative InstraView™ website at <http://www.instraview.com>

We buy used equipment! We also offer credit for Buy-Backs and Trade-Ins

Sell your excess, underutilized, and idle used equipment. Contact one of our Customer Service Representatives today!


Talk to a live person: 888-88-SOURCE (888-887-6872) | Contact us by email: sales@artisan-scientific.com | Visit our website: <http://www.artisan-scientific.com>

3300/30, 3300/35 Six-Channel Temperature Monitors

Bently Nevada™ Asset Condition Monitoring

Description

The 3300/30 and 3300/35 Six-Channel Temperature Monitors provide six independent channels of on-line temperature monitoring. Each monitor is suitable for virtually all types of temperature measurements. The monitors accept inputs from up to six thermocouples (3300/30 TC Monitor) or resistance temperature detectors (3300/35 RTD Monitor), which are supplied separately.

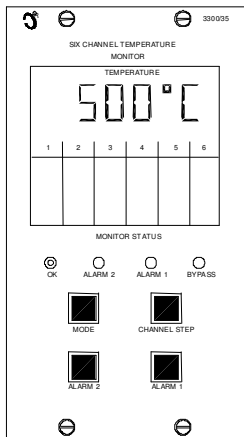

imagination at work

Specifications and Ordering Information
Part Number 141503-01
Rev. H (08/07)

Page 1 of 8

Specifications

Inputs

Transducer

3300/30

TC Monitor:

Accepts up to six grounded or non-grounded tip thermocouple signals; the following thermocouple types and their associated ranges are user-programmable per monitor:

Type J (500°C, 1000°F)

Type K (500°C, 1000°F)

Type T (250°C, 500°F)

Type E (250°C, 500°F)

3300/35

RTD Monitor:

Accepts up to six RTD signals. Any of the following RTD sensors and their associated ranges are user-programmable per monitor:

3-wire 100 Ω platinum ($\alpha = 0.00385$) (500°C /1000°F).

3-wire 100 Ω platinum ($\alpha = 0.00392$) (500°C /1000°F).

3-wire 120 Ω nickel (150°C/300°F).

3-wire 10 Ω copper (100°C/200°F).

4-wire 100 Ω platinum ($\alpha = 0.00385$) (500°C/1000°F).

4-wire 100 Ω platinum ($\alpha = 0.00392$) (500°C/1000°F).

4-wire 120 Ω nickel (150°C/300°F).

4-wire 10 Ω copper (100°C/200°F).

Changing from a platinum or nickel RTD to a copper RTD requires monitor recalibration. Changing is performed by plug-in jumpers.

Note: 3- or 4-wire input is an option which can be easily changed in the field. 2-wire detectors can be connected to either 3- or 4-wire input modules, using proper wiring techniques.

Power:

Nominal consumption 4 watts.

Signal Conditioning

Monitor Range:

Monitor full-scale operating range is selected by user upon ordering. The monitor is factory calibrated when ordered in a system. When spare monitors or power supplies are installed, the monitor should be checked and recalibrated as needed. Ranges allowing recorder output and computer interface signals to be proportional to the input signal, can be subsequently (re)programmed by user in the field.

Display Accuracy:

Within $\pm 1^\circ\text{C}$ (1.8°F) maximum when tenths digit is displayed. $\pm 1.5^\circ\text{C}$ (2.7°F) when tenths digit is not displayed. Specified at ambient temperature of $+25^\circ\text{C}$ ($+77^\circ\text{F}$).

Outputs

Recorder:

User-programmable for +4 to +20 mA, 0 to -10 Vdc or +1 to +5 Vdc. Voltage or current outputs are proportional to programmed monitor full-scale. Individual recorder outputs are provided for each channel. Monitor operation is unaffected by short circuits on recorder outputs.

Recorder accuracy (in addition to signal conditioning accuracy):

All specified at +25°C (+77° F).

+4 to +20 mA: ±1.8% of signal, ±0.09 mA offset.

+1 to +5 Vdc: ± 2.2% of signal, ±10 mV offset.

0 to -10 Vdc: ± 2.2% of signal, ±15 mV offset.

Output Impedance (voltage outputs):

100 Ω. Minimum load resistance is 10 k Ω.

Voltage Compliance (current outputs):

0 to +12 Vdc range across load. Load resistance is 0 to 600 Ω when using +4 to +20 mA option.

Alarms

Alarm Setpoints:

All alarms (Alarm 1 and Alarm 2, per channel) are digitally adjustable from 0 to +500°C (0 to +1000°F) and can be set with 1 digit resolution to desired level. Once set, alarms are repeatable within ±1°C (1.8°F). Alarm 1 is over-alarm, Alarm 2 can be user-programmed for either over- or under-alarm.

Relay Modules

Location:

One alarm relay module can be installed behind each monitor. At least one relay module must be ordered with each 3300 System.

Displays

Meter:

One common, 7 segment numerical, 4 digit with decimal point, non-multiplexing Liquid Crystal Display (LCD). LCD annunciates HIGH READ and OVER or UNDER Alarm. LCD also displays error codes and status (OK, Alarm 1, Alarm 2, Bypass, First Out) per channel.

Resolution:

0.1 or 1, user-programmable.

LED Indicators

OK:

One constant ON green LED per monitor indicates OK condition of all six transducers. Constant OFF green LED indicates one (or more) channel(s) in a NOT OK condition. OK LED flashing at 5 Hz indicates error code(s) stored in memory.

Alarm:

Two LEDs indicate alarm status (individually for Alarm 1 and Alarm 2). Flashing alarm LED indicates rack First Out (independent for Alarm 1 and Alarm 2).

Bypass:

Red LED indicates status of Alarm 2 Bypass and Rack/Channel Bypass functions.

Controls

Front Panel:

Four switches (Alarm 1, Alarm 2, Mode, Step) control display. LCD indicates value measured, dependent on MODE selected (SCAN or HIGH READ). Switch actuation allows LCD to indicate Alarm 1 setpoint level or Alarm 2 setpoint level. Switch actuation does not interrupt other monitoring functions. Flashing LCD indicates channel in ADJUST mode or presence of stored error

codes. Transducer NOT OK for viewed channel flashes four dashes.

Internal:

Switches behind monitor front panel control Alarm 2 Bypass, Channels 1 to 6 Bypass and Channels 1 to 6 Alarm setpoint adjust. Two terminal pins provided behind front panel to execute user-invoked self-test. Adjustments are made from front of monitor without powering down monitor or rack.

Environmental Limits

Operating

Temperature:

0°C to +65°C (+32°F to +150°F).

Storage

Temperature:

-40°C to +85°C (-40°F to +185°F).

Relative

Humidity:

To 95%, non-condensing.

CE Mark Directives

EMC Directive

Certificate of Conformity: 158710

Low Voltage

Directive

Certificate of Conformity: 135300

Hazardous Area Approvals

CSA/NRTL/C

Class I, Div 2

Groups A, B, C, D


T4 @ Ta = +65 °C

Certification

Number

150368 – 1002151 (LR 26744)

ATEX

 II 3 G

EEx nC[L] IIC

T4 @ Ta = -20°C to +60°C

When installed per document number 132577-01.

*Certification
Number*

BN26744C-55A

Physical

Space

Requirements:

Two rack positions (any positions except 1 and 2, which are reserved for the Power Supply and System Monitor, respectively).

Weight:

2.8 kg (6.2 lbs.).

Ordering Information

For spares, order the complete catalog number as described below. This includes a front panel assembly, monitor PWAs with sheet metal, and appropriate relay module. This unit is optioned, tested and ready to install in your system. Spare relay modules can be ordered separately.

Six-Channel Temperature TC Input Monitor

3300/30 -AXX-BXX-CXX-DXX-EXX

Note: Full-scale Range and Transducer Input Options must be compatible. Refer to Specification \ Inputs section for ranges of transducer types

A: Full-scale Range Option

- 01** 0-200°F
- 02** 0-300°F
- 03** 0-400°F
- 04** 0-500°F
- 05** 0-1000°F
- 11** 0-100°C
- 12** 0-150°C
- 13** 0-200°C
- 14** 0-250°C
- 15** 0-500°C

B: Transducer Input Option

Specifications and Ordering Information

Part Number 141503-01

Rev. H (08/07)

- 01 Type J
- 02 Type K
- 03 Type T
- 04 Type E

C: Alarm Relay Option

- 00 No Relays
- 01 Epoxy-sealed
- 02 Hermetically-sealed
- 04 Spare Monitor-No SIM/SIRM

Notes:

1. At least one relay module must be ordered with each 3300 System. If one common relay module per system has been ordered, all monitors of this type must be jumper programmed at the factory to activate a relay bus by ordering a Special Configuration Kit (SCK). Contact your nearest Bently Nevada office for information.
2. Agency approval places limitations on the relay module. Refer to the Relay Module data sheet for information.

D: Agency Approval Option

- 00 Not required
- 01 CSA/NRTL/C
- 02 ATEX self certification

Note: ATEX approval requires the monitor rack be installed in a weatherproof housing.

E: Safety Barrier Option

- 00 None
- 01 External
- 02 Internal

Spare Relay Module Assemblies

(Order the option in parenthesis for ATEX approved spares)

82364-01(02)

No Relays

82365-01(02)

Dual Epoxy Relays

82366-01(02)

Dual Hermetic Relays

82367-01(02)

TC Input Module

102566-01(03)

TC Input Module, Internal Barriers

Notes:

1. Grounded tip Thermocouples cannot be used with Intrinsic Safety Barriers.
2. External Safety Barriers must be ordered separately.

Six-Channel Temperature RTD Input Monitor

3300/35 -AXX-BXX-CXX-DXX-EXX

Note: Full-scale Range and Transducer Input Options must be compatible. Refer to Specification/ Inputs section for ranges of transducer types.

A: Full-scale Range Option

- 01 0-200°F

- 02 0-300°F
- 03 0-400°F
- 04 0-500°F
- 05 0-1000°F
- 11 0-100°C
- 12 0-150°C
- 13 0-200°C
- 14 0-250°C
- 15 0-500°C

B: Transducer Input Option

- 01 100 Ω platinum (0.00392) (3-wire)
- 02 100 Ω platinum (0.00385) (3-wire)
- 03 120 Ω nickel (3-wire)
- 04 10 Ω copper (3-wire)
- 05 100 Ω platinum (0.00392) (4-wire)
- 06 100 Ω platinum (0.00385) (4-wire)
- 07 120 Ω nickel (4-wire)
- 08 10 Ω copper (4-wire)

Note: Platinum RTD's with 0.00385 alphas are the worldwide industrial standard and are recommended for all applications.

C: Alarm Relay Option

- 00 No Relays
- 01 Epoxy-sealed
- 02 Hermetically-sealed
- 04 Spare Monitor-No SIM/SIRM

Notes:

1. At least one relay module must be ordered with each 3300 System. If one common relay module per system has been ordered, all monitors of this type must be jumper programmed at the factory to activate a relay bus by ordering a Special Configuration Kit (SCK). Contact your nearest Bently Nevada office for information.
2. Agency approval places limitations on the relay module. Refer to the Relay Module data sheet for information.

D: Agency Approval Option

- 00 Not required
- 01 CSA/NRTL/C
- 02 ATEX self certification

Note: ATEX approval requires the monitor rack be installed in a weatherproof housing.

E: Safety Barriers

- 00 None
- 01 External
- 02 Internal

Spare Relay Module Assembly

(Order the option in parenthesis for ATEX approved spares)

82364-01(02)

No Relays

82365-01(02)

Dual Epoxy Relays

82366-01(02)

Dual Hermetic Relays

+1 to + 5 Vdc

0 to -10 Vdc

82368-01(02)

3-Wire Input Module

**Alarm 2 Relay
Voting Option**

OR voting for relay drive¹

AND voting for relay drive²

82369-01(02)

4-Wire Input Module

Note:

1. OR voting allows Channels 1-6 to drive the Alarm 2 Relay.
2. Bently Nevada recommends the use of redundant transducers with AND Alarm 2 voting logic in those installations where the Alarm 2 relay is connected to a machine shutdown device.

102566-02(04)

3 or 4 Wire Input Module, Int Bar

Notes:

1. External Safety Barriers must be ordered separately.
2. Internal safety barriers are not available for use with 4-wire RTD's (a 4-wire system can be changed to 3-wire by using the jumpers).

K Mode Option

Nonlatching

Latching

**Recorder drive
on NOT OK
Option**

Downscale

Upscale

Note: NOT OK signal drives the recorder and the computer interface output up or downscale; monitor indicates NOT OK and Bypass in this condition.

Field-programmable Options

These options are field-programmable via plug-in jumpers. **Bold text** indicates options as shipped from the factory.

**Rack First Out
Option**

Disabled

Enabled

**Monitor First
Out Option**

Enabled

Disabled

**Alarm Time
Delay Option**

1 second

3 seconds

6 seconds

**Alarm 1 Reset
Option**

Latching

Nonlatching

**Alarm 2 Reset
Option**

Latching

Nonlatching

**Recorder
Outputs Option**

+4 to +20 mA

**Tenth (0.1) Digit
Option**

Disabled

Enabled

**Alarm 1 Relay
Mode Option**

Normally de-energized

Normally energized

**Alarm 2 Relay
Mode Option**

Normally de-energized

Normally energized

Accessories

External Barrier, RTD

02245003

02200406

Surge Protector, TC

02200408


Surge Protector, 3 & 4 wire RTD

02245005

External Barrier, TC

Field wiring diagrams

3300/30, 3300/35 Six-Channel Temperature Monitors

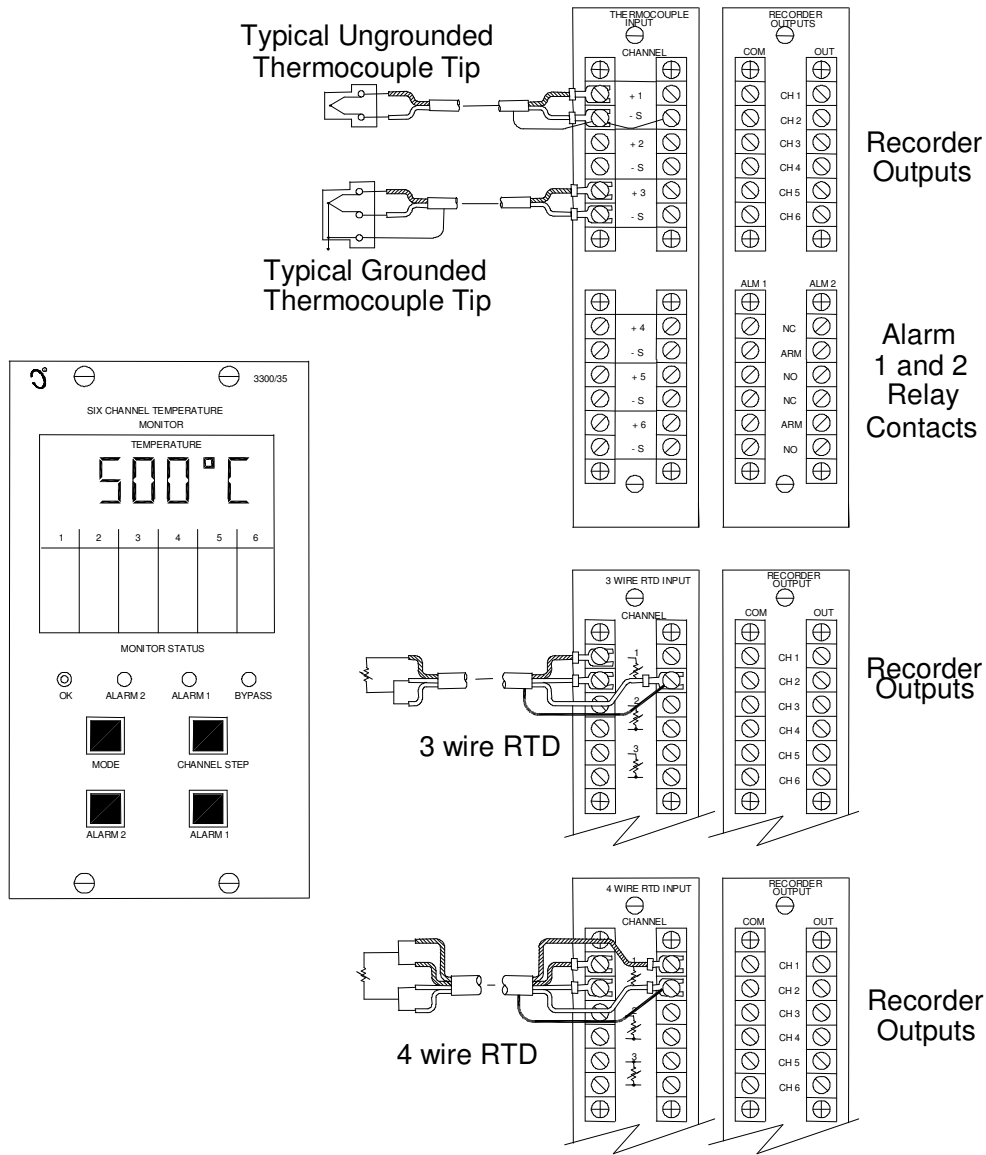

Field wiring diagram for the 3300/30 Six-Channel Temperature TC Monitor (top) and 3300/35 Six-Channel Temperature RTD Monitor (bottom).

Bently Nevada is a trademark of General Electric Company.

Copyright 1999 Bently Nevada LLC.
 1631 Bently Parkway South, Minden, Nevada USA 89423
 Phone: 775.782.3611 Fax: 775.215.2873
www.ge-energy.com/bently
 All rights reserved.

Specifications and Ordering Information
 Part Number 141503-01
 Rev. H (08/07)



Artisan Scientific

QUALITY INSTRUMENTATION ... GUARANTEED

Looking for more information?

Visit us on the web at <http://www.artisan-scientific.com> for more information:

- Price Quotations
- Drivers
- Technical Specifications, Manuals and Documentation

Artisan Scientific is Your Source for Quality New and Certified-Used/Pre-owned Equipment

- Tens of Thousands of In-Stock Items
- Hundreds of Manufacturers Supported
- Fast Shipping and Delivery
- Leasing / Monthly Rentals
- Equipment Demos
- Consignment

Service Center Repairs

Experienced Engineers and Technicians on staff in our State-of-the-art Full-Service In-House Service Center Facility

InstraView™ Remote Inspection

Remotely inspect equipment before purchasing with our Innovative InstraView™ website at <http://www.instraview.com>

We buy used equipment! We also offer credit for Buy-Backs and Trade-Ins

Sell your excess, underutilized, and idle used equipment. Contact one of our Customer Service Representatives today!

Talk to a live person: 888-88-SOURCE (888-887-6872) | Contact us by email: sales@artisan-scientific.com | Visit our website: <http://www.artisan-scientific.com>