

ARTISAN®
TECHNOLOGY GROUP

Your **definitive** source for quality pre-owned equipment.

Artisan Technology Group
(217) 352-9330 | sales@artisantg.com | artisantg.com

Full-service, independent repair center
with experienced engineers and technicians on staff.

We buy your excess, underutilized, and idle equipment
along with credit for buybacks and trade-ins.

Custom engineering
so your equipment works exactly as you specify.

- Critical and expedited services
- In stock / Ready-to-ship
- Leasing / Rentals / Demos
- ITAR-certified secure asset solutions

Expert team | Trust guarantee | 100% satisfaction

All trademarks, brand names, and brands appearing herein are the property of their respective owners.


Visit our website - *Click HERE*


BA00082D/06/EN/17.16
71315813


Valid as of software version
V 1.04.00 (device software)


Operating Instructions
Proline Promag 10
HART

Electromagnetic flowmeter

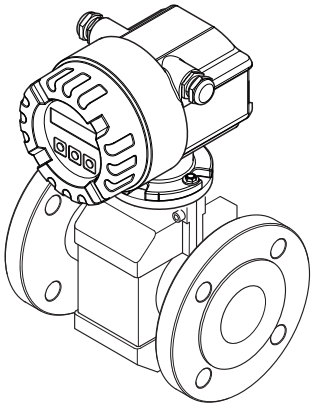

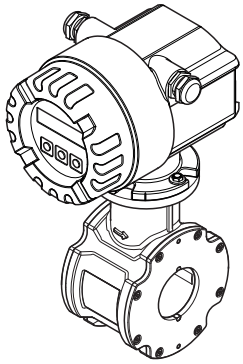

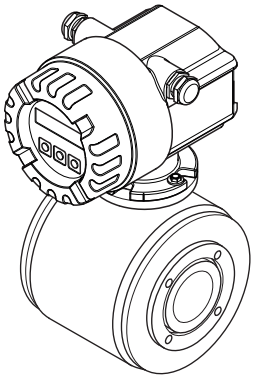

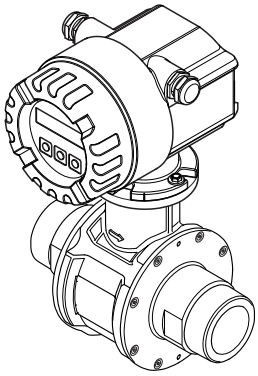

Endress+Hauser
People for Process Automation

Endress+Hauser

People for Process Automation

Table of contents

1 Safety instructions 4
1.1 Designated use 4
1.2 Installation, commissioning and operation 4
1.3 Operational safety 4
1.4 Return 5
1.5 Notes on safety conventions and icons 5

2 Identification 6
2.1 Device designation 6
2.2 Certificates and approvals 8
2.3 Registered trademarks 8

3 Installation 9
3.1 Incoming acceptance, transport and storage 9
3.2 Mounting requirements 11
3.3 Installation instructions 20
3.4 Post-installation check 43

4 Wiring 44
4.1 Connecting the remote version 44
4.2 Connecting the measuring unit 50
4.3 Potential equalization 52
4.4 Degree of protection 55
4.5 Post-connection check 56

5 Operation 57
5.1 Display and operating elements 57
5.2 Brief operating instructions on the function matrix 58
5.3 Displaying error messages 60
5.4 Communication 61

6 Commissioning 68
6.1 Function check 68
6.2 Switching on the measuring device 68
6.3 Brief commissioning guide 68
6.4 Commissioning after installing a new electronics board 69
6.5 Empty-pipe/full-pipe adjustment 70

7 Maintenance 71
7.1 Exterior cleaning 71
7.2 Seals 71

8 Accessories 72
8.1 Device-specific accessories 72
8.2 Measuring principle-specific accessories 72
8.3 Communication-specific accessories 73
8.4 Service-specific accessories 73

9 Troubleshooting 75
9.1 Troubleshooting instructions 75
9.2 System error messages 76
9.3 Process error messages 77
9.4 Process errors without messages 78
9.5 Response of outputs to errors 79
9.6 Spare parts 80
9.7 Return 84
9.8 Disposal 84
9.9 Software history 84

10 Technical data 85
10.1 Application 85
10.2 Function and system design 85
10.3 Input 85
10.4 Output 85
10.5 Power supply 86
10.6 Performance characteristics 87
10.7 Installation 87
10.8 Environment 87
10.9 Process 88
10.10 Mechanical construction 94
10.11 Operability 106
10.12 Certificates and approvals 106
10.13 Ordering information 108
10.14 Accessories 108
10.15 Documentation 108

11 Appendix 109
11.1 Illustration of the function matrix 109
11.2 Group SYSTEM UNITS 110
11.3 Group OPERATION 112
11.4 USER INTERFACE 113
11.5 Group TOTALIZER 114
11.6 Group CURRENT OUTPUT 115
11.7 Group PULSE/STATUS OUTPUT 117
11.8 Group COMMUNICATION 122
11.9 Group PROCESS PARAMETER 123
11.10 Group SYSTEM PARAMETER 125
11.11 Group SENSOR DATA 128
11.12 Group SUPERVISION 130
11.13 Group SIMULATION SYSTEM 132
11.14 Group SENSOR VERSION 132
11.15 Group AMPLIFIER VERSION 132
11.16 Factory settings 133

Index 136

1 Safety instructions

1.1 Designated use

The measuring device described in this Operating Manual is to be used only for measuring the flow rate of conductive fluids in closed pipes.

Most liquids can be measured as of a minimum conductivity of 50 µS/cm.

Examples:
- Acids, alkalis
- Drinking water, wastewater, sewage sludge
- Milk, beer, wine, mineral water, etc.

Resulting from incorrect use or from use other than that designated the operational safety of the measuring devices can be suspended. The manufacturer accepts no liability for damages being produced from this.

1.2 Installation, commissioning and operation

Please note the following:
- Installation, connection to the electricity supply, commissioning and maintenance of the device must be carried out by trained, qualified specialists authorized to perform such work by the facility's owner-operator. The specialist must have read and understood this Operating Manual and must follow the instructions it contains.
- The device must be operated by persons authorized and trained by the facility's owner-operator. Strict compliance with the instructions in the Operating Manual is mandatory.
- With regard to special fluids, including fluids used for cleaning, Endress+Hauser will be happy to assist in clarifying the corrosion-resistant properties of wetted materials. However, minor changes in temperature, concentration or in the degree of contamination in the process may result in variations in corrosion resistance. For this reason, Endress+Hauser does not accept any responsibility with regard to the corrosion resistance of wetted materials in a specific application.
  The user is responsible for the choice of suitable wetted materials in the process.
- If welding work is performed on the piping system, do not ground the welding appliance through the Promag flowmeter.
- The installer must ensure that the measuring system is correctly wired in accordance with the wiring diagrams. The transmitter must be grounded apart from when special protective measures are taken (e.g. galvanically isolated SELV or PELV power supply)
- Invariably, local regulations governing the opening and repair of electrical devices apply.

1.3 Operational safety

Please note the following:
- Measuring systems for use in hazardous environments are accompanied by separate Ex documentation, which is an integral part of this Operating Manual. Strict compliance with the installation instructions and ratings as stated in this supplementary documentation is mandatory. The symbol on the front of this Ex documentation indicates the approval and the certification body (e.g. Ⓔx Europe, FM USA, CSA Canada).
- The measuring device complies with the general safety requirements in accordance with EN 61010-1, the EMC requirements of IEC/EN 61326 and NAMUR Recommendations NE 21 and NE 43.
- Depending on the application, the seals of the process connections of the Promag H sensor require periodic replacement.
- When hot fluid passes through the measuring tube, the surface temperature of the housing increases. In the case of the sensor, in particular, users should expect temperatures that can be close to the fluid temperature. If the temperature of the fluid is high, implement sufficient measures to prevent burning or scalding.

- The manufacturer reserves the right to modify technical data without prior notice. Your Endress+Hauser distributor will supply you with current information and updates to these Operating Instructions.

1.4 Return

The measuring device must be returned if repairs or a factory calibration are required, or if the wrong measuring device has been ordered or delivered. According to legal regulations, Endress+Hauser, as an ISO-certified company, is required to follow certain procedures when handling returned products that are in contact with medium.
To ensure swift, safe and professional device returns, please read the return procedures and conditions on the Endress+Hauser website at www.services.endress.com/return-material

1.5 Notes on safety conventions and icons

The devices are designed to meet state-of-the-art safety requirements, have been tested, and left the factory in a condition in which they are safe to operate. The devices comply with the applicable standards and regulations in accordance with EN 61010-1 "Safety requirements for electrical equipment for measurement, control and laboratory use".
The devices can, however, be a source of danger if used incorrectly or for anything other than the designated use. Consequently, always pay particular attention to the safety instructions indicated in this Operating Manual by the following icons:



Warning!
"Warning" indicates an action or procedure which, if not performed correctly, can result in injury or a safety hazard. Comply strictly with the instructions and proceed with care.



Caution!
"Caution" indicates an action or procedure which, if not performed correctly, can result in incorrect operation or destruction of the device. Comply strictly with the instructions.



Note!
"Note" indicates an action or procedure which, if not performed correctly, can have an indirect effect on operation or trigger an unexpected response on the part of the device.

2 Identification

2.1 Device designation

The flow measuring system consists of the following components:

- Promag 10 transmitter
- Promag D/E/H/L/P/W sensor

In the *compact version*, the transmitter and sensor form a single mechanical unit; in the *remote version* they are installed separately.

2.1.1 Nameplate of the transmitter

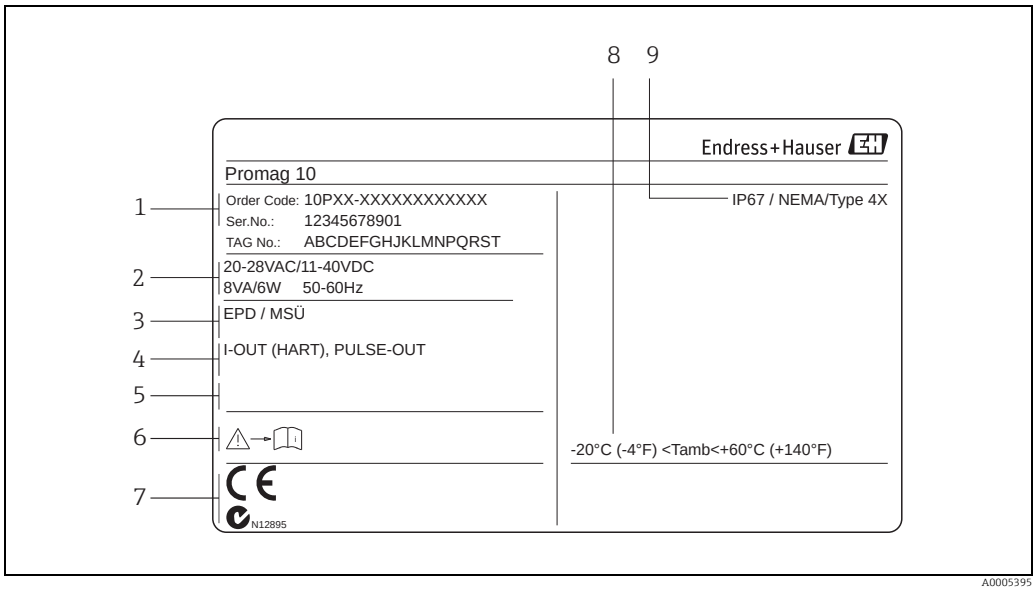


Fig. 1: Nameplate specifications for the "Promag 10" transmitter (example)

1 *Ordering code/serial number: See the specifications on the order confirmation for the meanings of the individual letters and digits.*
2 *Power supply, frequency, power consumption*
3 *Additional information:*
EPD/MSÜ: with Empty Pipe Detection
4 *Outputs available:*
I-OUT (HART): with current output (HART)
PULSE-OUT: with pulse/status output
5 *Reserved for information on special products*
6 *Observe device documentation*
7 *Reserved for additional information on device version (approvals, certificates)*
8 *Permitted ambient temperature range*
9 *Degree of protection*

2.1.2 Nameplate of the sensor

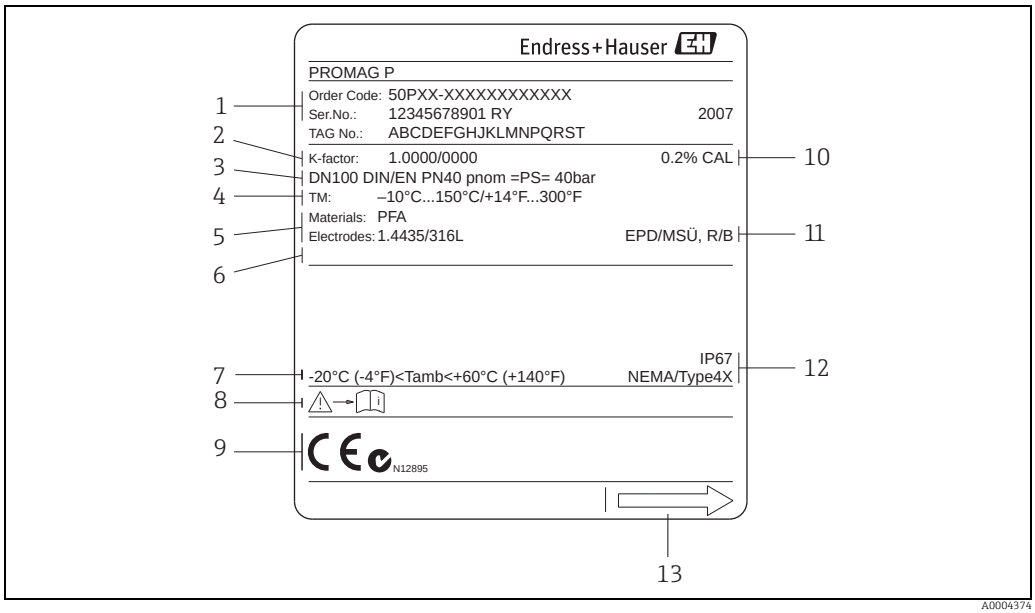


Fig. 2: Nameplate specifications for the "Promag" sensor (example)

1 *Ordering code/serial number: See the specifications on the order confirmation for the meanings of the individual letters and digits.*
2 *Calibration factor with zero point*
3 *Nominal diameter/Pressure rating*
4 *Fluid temperature range*
5 *Materials: lining/measuring electrodes*
6 *Reserved for information on special products*
7 *Permitted ambient temperature range*
8 *Observe device documentation*
9 *Reserved for additional information on device version (approvals, certificates)*
10 *Calibration tolerance*
11 *Additional information (examples):*
- *EPD/MSÜ: with Empty Pipe Detection electrode*
- *R/B: with reference electrode*

12 *Degree of protection*
13 *Flow direction*

2.1.3 Nameplate, connections

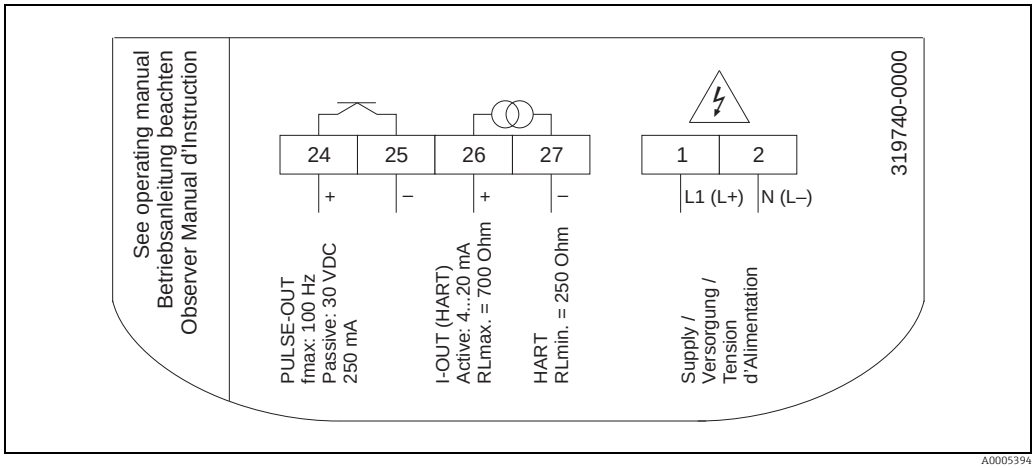


Fig. 3: Nameplate specifications for transmitter (example)

2.2 Certificates and approvals

The devices are designed to meet state-of-the-art safety requirements in accordance with sound engineering practice. They have been tested and left the factory in a condition in which they are safe to operate.

The devices comply with the applicable standards and regulations in accordance with EN 61010-1 "Safety requirements for electrical equipment for measurement, control and laboratory use" and with the EMC requirements of IEC/EN 61326.

The measuring system described in this Operating Manual is therefore in conformity with the statutory requirements of the EC Directives. Endress+Hauser confirms successful testing of the device by affixing to it the CE mark.

The measuring system meets the EMC requirements of the "Australian Communications and Media Authority (ACMA)".

2.3 Registered trademarks

KALREZ® and VITON®
Registered trademarks of E.I. Du Pont de Nemours & Co., Wilmington, USA

TRI-CLAMP®
Registered trademark of Ladish & Co., Inc., Kenosha, USA

HART®
Registered trademark of the HART Communication Foundation, Austin, USA

Applicator®, FieldCare®, Fieldcheck®
Registered or registration-pending trademarks of the Endress+Hauser Group

3 Installation

3.1 Incoming acceptance, transport and storage

3.1.1 Incoming acceptance

On receipt of the goods, check the following:
- Check the packaging and the contents for damage.
- Check the shipment, make sure nothing is missing and that the scope of supply matches your order.

3.1.2 Transport

The following instructions apply to unpacking and to transporting the device to its final location:
- Transport the devices in the containers in which they are delivered.
- Do not remove the protective plates or caps on the process connections until you are ready to install the device. This is particularly important in the case of sensors with PTFE linings.

Special notes on flanged devices

Caution!
- The wooden covers mounted on the flanges from the factory protect the linings on the flanges during storage and transportation. In case of Promag L they are additionally used to hold the lap joint flanges in place. Do not remove these covers until **immediately before** the device in the pipe.
- Do not lift flanged devices by the transmitter housing, or the connection housing in the case of the remote version.

Transporting flanged devices DN ≤ 300 (12")

Use webbing slings slung round the two process connections.
Do not use chains, as they could damage the housing.

Warning!
Risk of injury if the measuring device slips. The center of gravity of the assembled measuring device might be higher than the points around which the slings are slung.
At all times, therefore, make sure that the device does not unexpectedly turn around its axis or slip.

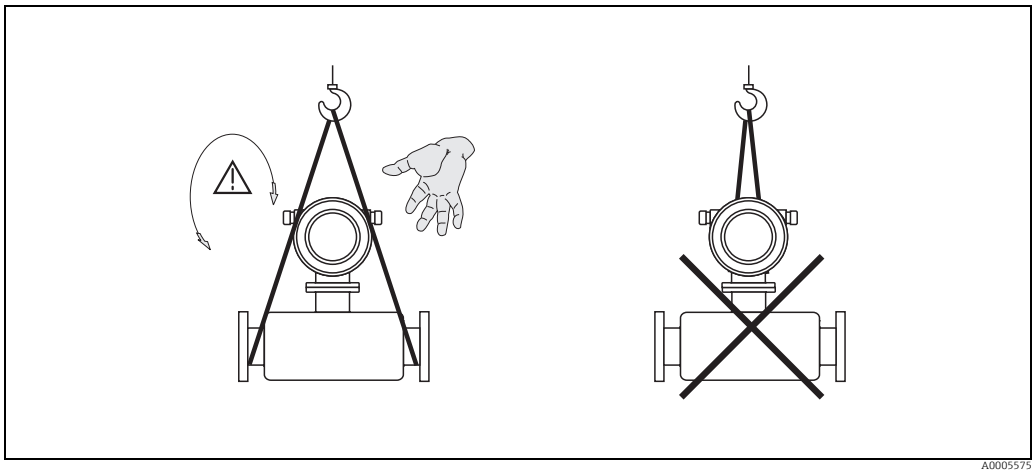


Fig. 4: Transporting sensors with DN ≤ 300 (12")

Transporting flanged devices DN ≥ 350 (14")

Use only the metal eyes on the flanges for transporting the device, lifting it and positioning the sensor in the piping.

Caution!
Do not attempt to lift the sensor with the tines of a fork-lift truck beneath the metal casing. This would buckle the casing and damage the internal magnetic coils.

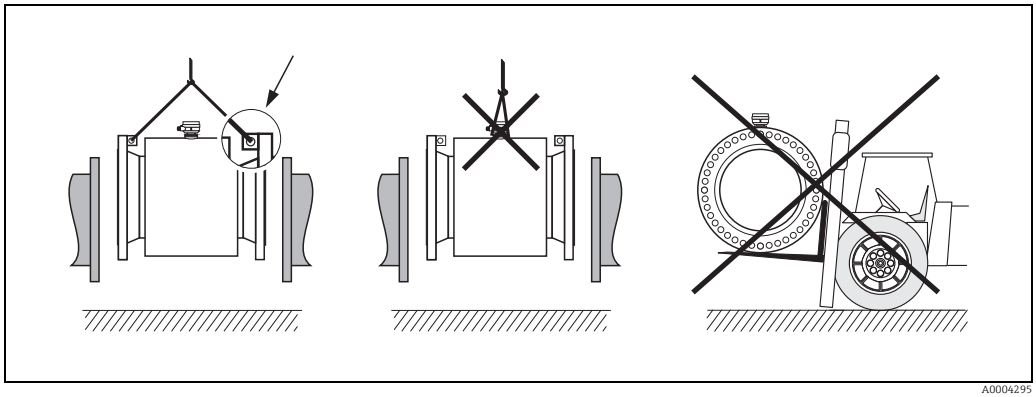


Fig. 5: Transporting sensors with DN ≥ 350 (14")

3.1.3 Storage

Please note the following:
- Pack the measuring device in such a way as to protect it reliably against impact for storage (and transportation). The original packaging provides optimum protection.
- The storage temperature corresponds to the operating temperature range of the measuring transmitter and the appropriate measuring sensors → 87.
- Do not remove the protective plates or caps on the process connections until you are ready to install the device. This is particularly important in the case of sensors with PTFE linings.
- The measuring device must be protected against direct sunlight during storage in order to avoid unacceptably high surface temperatures.
- Choose a storage location where moisture does not collect in the measuring device. This will help prevent fungus and bacteria infestation which can damage the liner.

3.2 Mounting requirements

3.2.1 Dimensions

The dimensions and installation lengths of the sensor and transmitter can be found in the "Technical Information" for the device in question. This document can be downloaded as a PDF file from www.endress.com. A list of the "Technical Information" documents available is provided in the "Documentation" section on → 108.

3.2.2 Mounting location

Entrained air or gas bubble formation in the measuring tube can result in an increase in measuring errors.
Avoid the following locations:
- Highest point of a pipeline. Risk of air accumulating!
- Directly upstream from a free pipe outlet in a vertical pipeline.

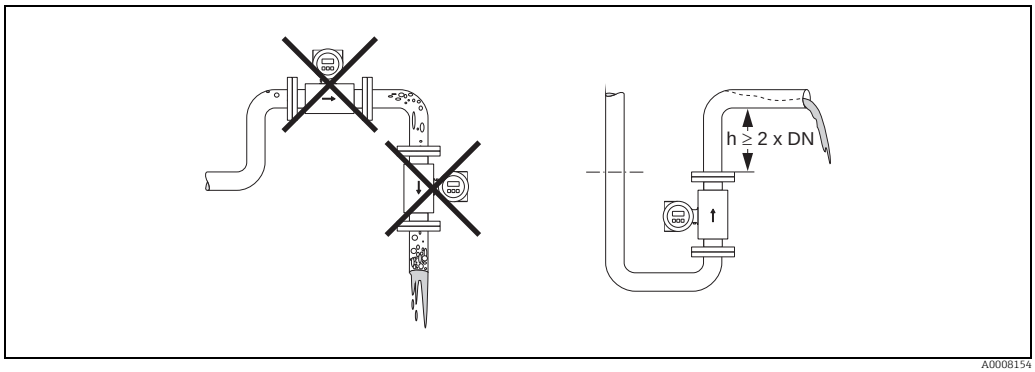


Fig. 6: Mounting location

Installation of pumps

Do **not** install the sensor on the intake side of a pump. This precaution is to avoid low pressure and the consequent risk of damage to the lining of the measuring tube. Information on the lining's resistance to partial vacuum can be found on → 91.

It might be necessary to install pulse dampers in systems incorporating reciprocating, diaphragm or peristaltic pumps. Information on the measuring system's resistance to vibration and shock can be found on → 88.

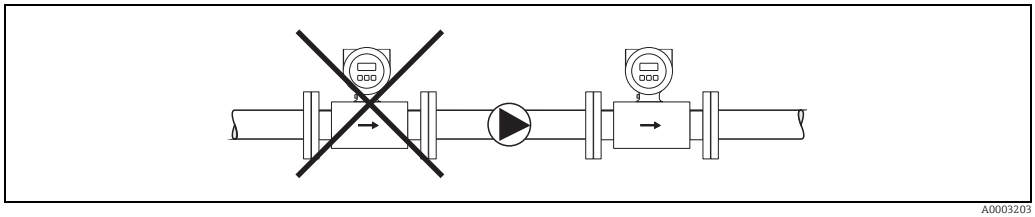


Fig. 7: Installation of pumps

Partially filled pipes

Partially filled pipes with gradients necessitate a drain-type configuration.
The Empty Pipe Detection function (EPD → 70) offers additional protection by detecting empty or partially filled pipes.

Caution!
Risk of solids accumulating. Do not install the sensor at the lowest point in the drain. It is advisable to install a cleaning valve.

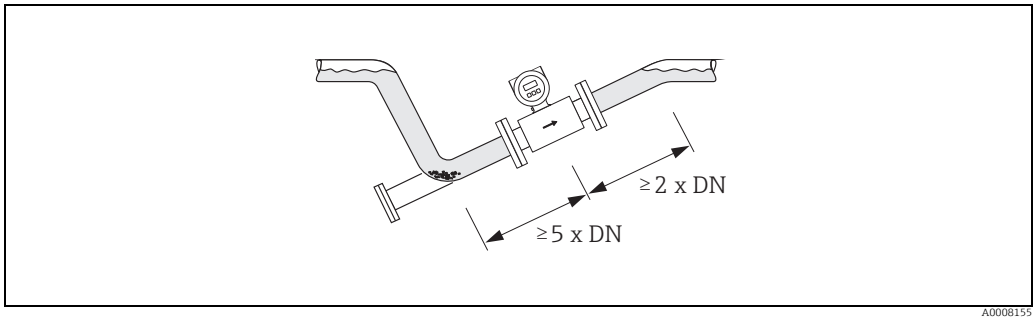


Fig. 8: Installation in a partially filled pipe

Down pipes

Install a siphon or a vent valve downstream of the sensor in down pipes whose length h ≥ 5 m (16.4 ft). This precaution is to avoid low pressure and the consequent risk of damage to the lining of the measuring tube.
This measure also prevents the system losing prime, which could cause air pockets.
Information on the lining's resistance to partial vacuum can be found on → 91.

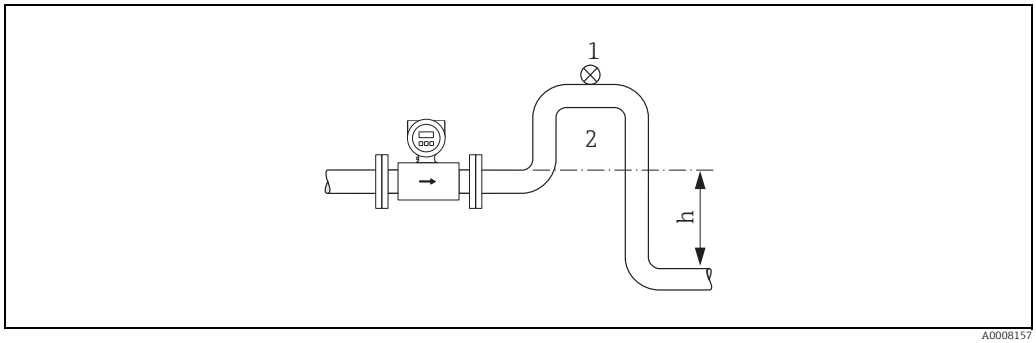


Fig. 9: Measures for installation in a down pipe

1 Vent valve
2 Pipe siphon
h Length of down pipe

3.2.3 Orientation

An optimum orientation position helps avoid gas and air accumulations and deposits in the measuring tube. However, Promag offers the additional Empty Pipe Detection (EPD) function to ensure the detection of partially filled measuring tubes, e.g. in the case of degassing fluids or varying process pressure.

Vertical orientation

This is the ideal orientation for self-emptying piping systems and for use in conjunction with Empty Pipe Detection.

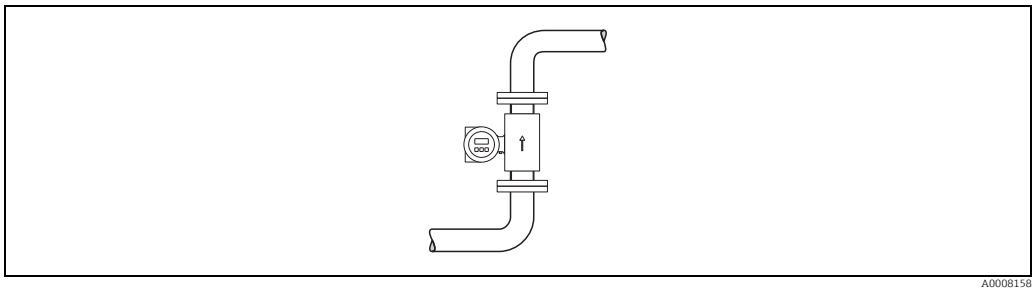


Fig. 10: Vertical orientation

Horizontal orientation

The measuring electrode plane should be horizontal. This prevents brief insulation of the two measuring electrodes by entrained air bubbles.

Caution!
Empty Pipe Detection functions correctly only when the measuring device is installed horizontally and the transmitter housing is facing upward (→ 10). Otherwise there is no guarantee that Empty Pipe Detection will respond if the measuring tube is only partially filled or empty.

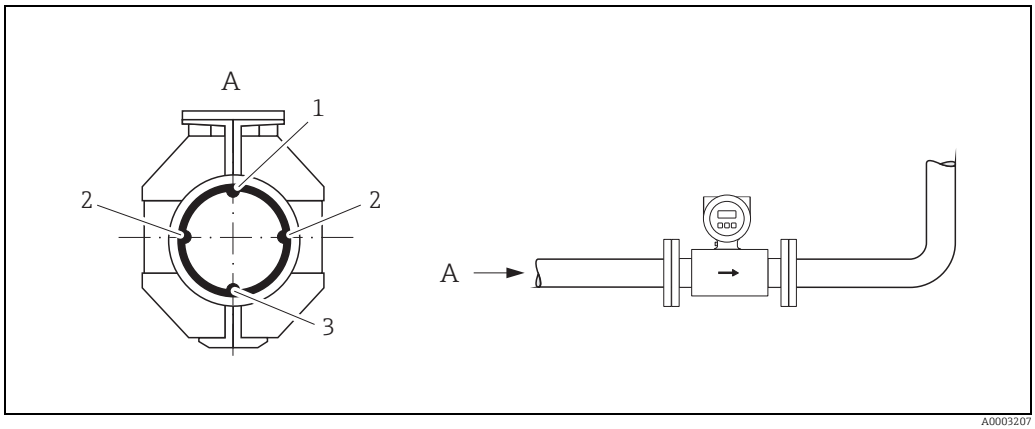


Fig. 11: Horizontal orientation

1 EPD electrode for the detection of empty pipes (not with Promag D and Promag H (DN 2 to 8 / 1/12 to 3/8"))
2 Measuring electrodes for signal detection
3 Reference electrode for the potential equalization (not with Promag D and H)

Inlet and outlet run

If possible, install the sensor upstream from fittings such as valves, T-pieces, elbows, etc.

The following inlet and outlet runs must be observed in order to meet accuracy specifications:
- Inlet run: ≥ 5 × DN
- Outlet run: ≥ 2 × DN

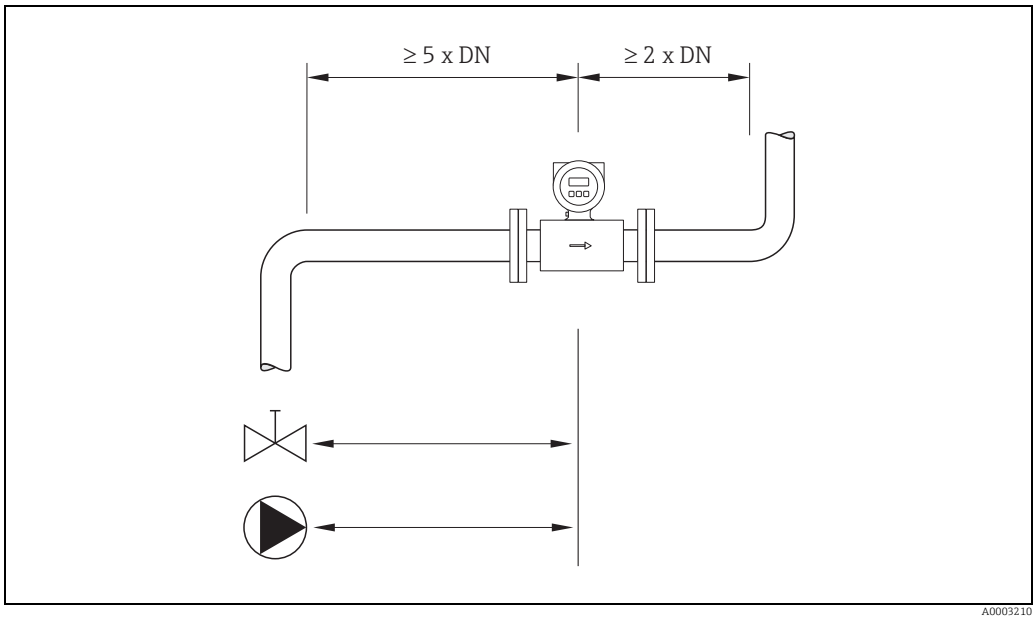


Fig. 12: Inlet and outlet runs

3.2.4 Vibrations

Secure the piping and the sensor if vibration is severe.

Caution!
If vibrations are too severe, we recommend the sensor and transmitter be mounted separately. Information on resistance to vibration and shock can be found on → 88.

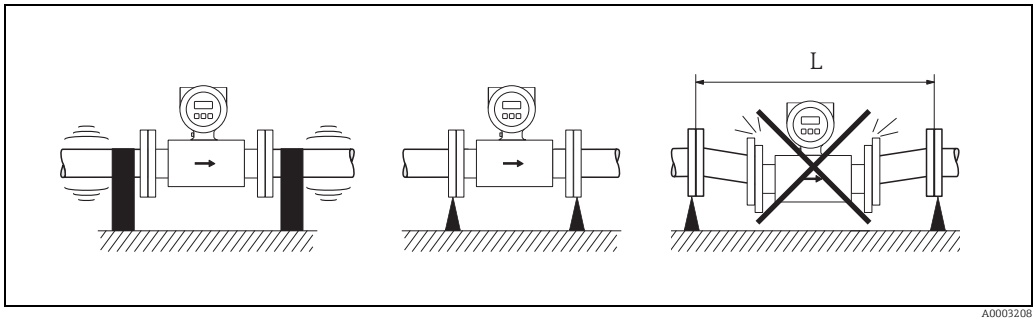


Fig. 13: Measures to prevent vibration of the device (L > 10 m (32.8 ft))

3.2.5 Foundations, supports

If the nominal diameter is DN ≥ 350 (14"), mount the sensor on a foundation of adequate load-bearing strength.

Caution!
Risk of damage.
Do not support the weight of the sensor on the metal casing: the casing would buckle and damage the internal magnetic coils.

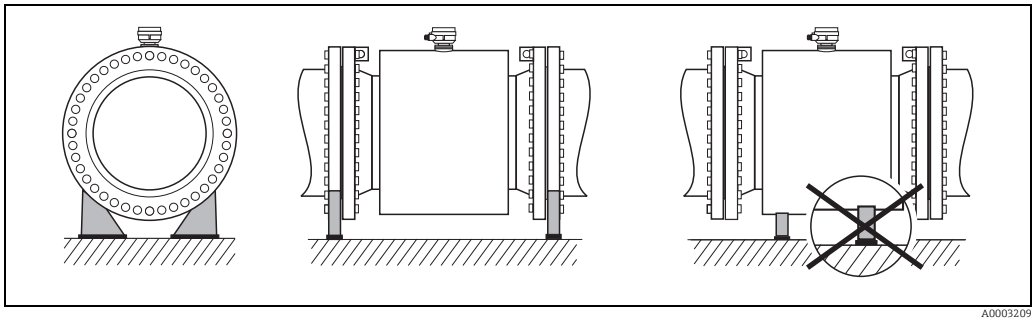


Fig. 14: Correct support for large nominal diameters (DN ≥ 350 / 14")

3.2.6 Adapters

Suitable adapters to DIN EN 545 (double-flange reducers) can be used to install the sensor in larger-diameter pipes.
The resultant increase in the rate of flow improves measuring accuracy with very slow-moving fluids. The nomogram shown here can be used to calculate the pressure loss caused by reducers and expanders.

Note!
- The nomogram only applies to liquids of viscosity similar to water.
- For Promag D with threaded connection adapters can not be used
- For Promag H the selection of a pipe with larger diameter for high viscosities of the fluid may be considered to reduce the pressure loss.

1. Calculate the ratio of the diameters d/D.
2. From the nomogram read off the pressure loss as a function of flow velocity (*downstream* from the reduction) and the d/D ratio.

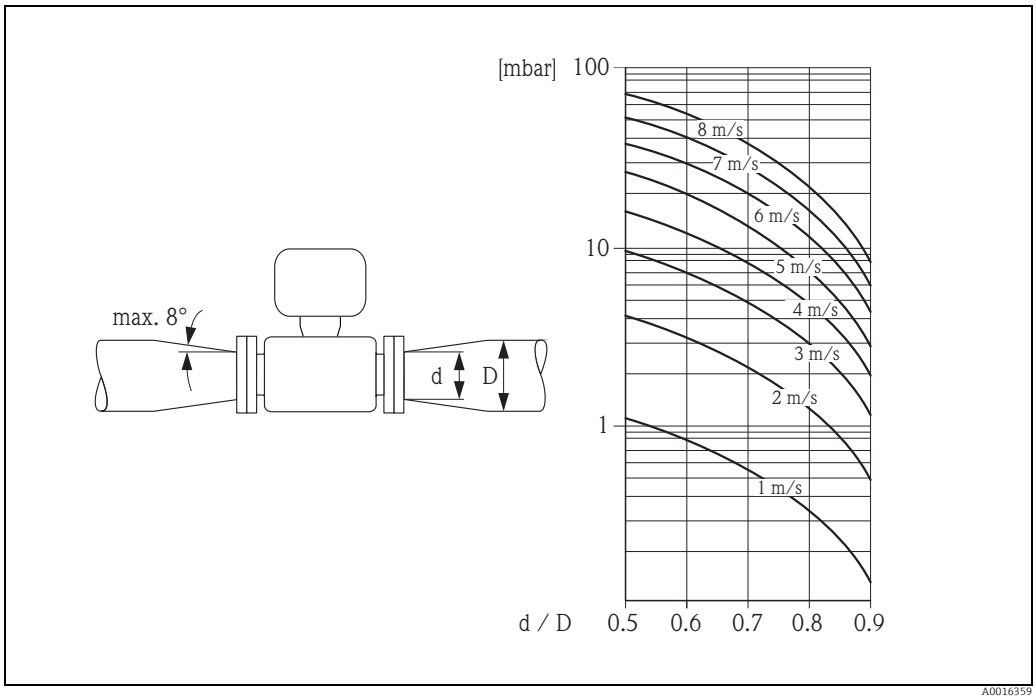


Fig. 15: Pressure loss due to adapters

3.2.7 Nominal diameter and flow rate

The diameter of the pipe and the flow rate determine the nominal diameter of the sensor. The optimum velocity of flow is between 2 and 3 m/s (6.5 to 9.8 ft/s)

The velocity of flow (v), moreover, has to be matched to the physical properties of the fluid:
- v < 2 m/s (6.5 ft/s): for abrasive fluids
- v > 2 m/s (6.5 ft/s): for fluids producing buildup

Note!
- Flow velocity can be increased, if necessary, by reducing the nominal diameter of the sensor (→ 🖹 15).
- For Promag H the selection of a pipe with nominal diameter > DN 8 (⅜") for fluids with high levels of solids may be considered, to improve the stability of the signal and cleanability due to larger electrodes.

Recommended flow (SI units)

Nominal diameter [mm]	Promag D	Promag E/P	Promag H	Promag L	Promag W
	Min./max. full scale value (v ≈ 0.3 or 10 m/s) in [dm³/min]				
2	–	–	0.06 to 1.8	–	–
4	–	–	0.25 to 7	–	–
8	–	–	1 to 30	–	–
15	–	4 to 100	4 to 100	–	–
25	9 to 300	9 to 300	9 to 300	9 to 300	9 to 300
32	–	15 to 500	–	15 to 500	15 to 500
40	25 to 700	25 to 700	25 to 700	25 to 700	25 to 700
50	35 to 1100	35 to 1100	35 to 1100	35 to 1100	35 to 1100
65	60 to 2000	60 to 2000	60 to 2000	60 to 2000	60 to 2000
80	90 to 3000	90 to 3000	90 to 3000	90 to 3000	90 to 3000
100	145 to 4700	145 to 4700	145 to 4700	145 to 4700	145 to 4700
125	–	220 to 7500	–	220 to 7500	220 to 7500

Nominal diameter	Promag D	Promag E/P	Promag H	Promag L	Promag W
[mm]	Min./max. full scale value (v ≈ 0.3 or 10 m/s) in [m³/h]				
150	–	20 to 600	–	20 to 600	20 to 600
200	–	35 to 1100	–	35 to 1100	35 to 1100
250	–	55 to 1700	–	55 to 1700	55 to 1700
300	–	80 to 2400	–	80 to 2400	80 to 2400
350	–	110 to 3300	–	110 to 3300	110 to 3300
375	–	–	–	140 to 4200	140 to 4200
400	–	140 to 4200	–	140 to 4200	140 to 4200
450	–	180 to 5400	–	180 to 5400	180 to 5400
500	–	220 to 6600	–	220 to 6600	220 to 6600
600	–	310 to 9600	–	310 to 9600	310 to 9600
700	–	–	–	420 to 13500	420 to 13500
750	–	–	–	480 to 15200	480 to 15200
800	–	–	–	550 to 18000	550 to 18000
900	–	–	–	690 to 22500	690 to 22500
1000	–	–	–	850 to 28000	850 to 28000
1050	–	–	–	950 to 40000	950 to 40000
1200	–	–	–	1250 to 40000	1250 to 40000
1400	–	–	–	–	1700 to 55000
1600	–	–	–	–	2200 to 70000
1800	–	–	–	–	2800 to 90000
2000	–	–	–	–	3400 to 110000

Recommended flow (US units)

Nominal diameter	Promag D	Promag E/P	Promag H	Promag L	Promag W
[inch]	Min./max. full scale value (v ≈ 0.3 or 10 m/s) in [gal/min]				
1/12"	–	–	0.015 to 0.5	–	–
1/8"	–	–	0.07 to 2	–	–
8"	–	–	0.25 to 8	–	–
½"	–	1.0 to 27	1.0 to 27	–	–
1"	2.5 to 80	2.5 to 80	2.5 to 80	2.5 to 80	2.5 to 80
1 ¼"	–	4 to 130	–	–	4 to 130
1 ½"	7 to 190	7 to 190	7 to 190	7 to 190	7 to 190
2"	10 to 300	10 to 300	10 to 300	10 to 300	10 to 300
2 ½"	16 to 500	16 to 500	16 to 500	16 to 500	16 to 500
3"	24 to 800	24 to 800	24 to 800	24 to 800	24 to 800
4"	40 to 1250	40 to 1250	40 to 1250	40 to 1250	40 to 1250
5"	–	60 to 1950	–	60 to 1950	60 to 1950
6"	–	90 to 2650	–	90 to 2650	90 to 2650
8"	–	155 to 4850	–	155 to 4850	155 to 4850
10"	–	250 to 7500	–	250 to 7500	250 to 7500
12"	–	350 to 10600	–	350 to 10600	350 to 10600
14"	–	500 to 15000	–	500 to 15000	500 to 15000
15"	–	–	–	600 to 19000	600 to 19000
16"	–	600 to 19000	–	600 to 19000	600 to 19000
18"	–	800 to 24000	–	800 to 24000	800 to 24000
20"	–	1000 to 30000	–	1000 to 30000	1000 to 30000
24"	–	1400 to 44000	–	1400 to 44000	1400 to 44000

Nominal diameter	Promag D	Promag E/P	Promag H	Promag L	Promag W
[inch]	Min./max. full scale value (v ≈ 0.3 or 10 m/s) in [gal/min]				
28"	–	–	–	1900 to 60000	1900 to 60000
30"	–	–	–	2150 to 67000	2150 to 67000
32"	–	–	–	2450 to 80000	2450 to 80000
36"	–	–	–	3100 to 100000	3100 to 100000
40"	–	–	–	3800 to 125000	3800 to 125000
42"	–	–	–	4200 to 135000	4200 to 135000
48"	–	–	–	5500 to 175000	5500 to 175000

Nominal diameter	Promag D	Promag E/P	Promag H	Promag L	Promag W
[inch]	Min./max. full scale value (v ≈ 0.3 or 10 m/s) in [Mgal/d]				
54"	–	–	–	–	9 to 300
60"	–	–	–	–	12 to 380
66"	–	–	–	–	14 to 500
72"	–	–	–	–	16 to 570
78"	–	–	–	–	18 to 650

3.2.8 Length of connecting cable

In order to ensure measuring accuracy, comply with the following instructions when installing the remote version:

- Fix cable run or lay in armored conduit. Cable movements can falsify the measuring signal especially in the case of low fluid conductivities.
- Route the cable well clear of electrical machines and switching elements.
- Ensure potential equalization between sensor and transmitter, if necessary.
- The permitted connecting cable length L_{max} is determined by the fluid conductivity (→ 16). A minimum conductivity of 50 µS/cm is needed for all fluids.
- The maximum connecting cable length is 10 m (33 ft) when empty pipe detection (EPD → 70) is switched on.

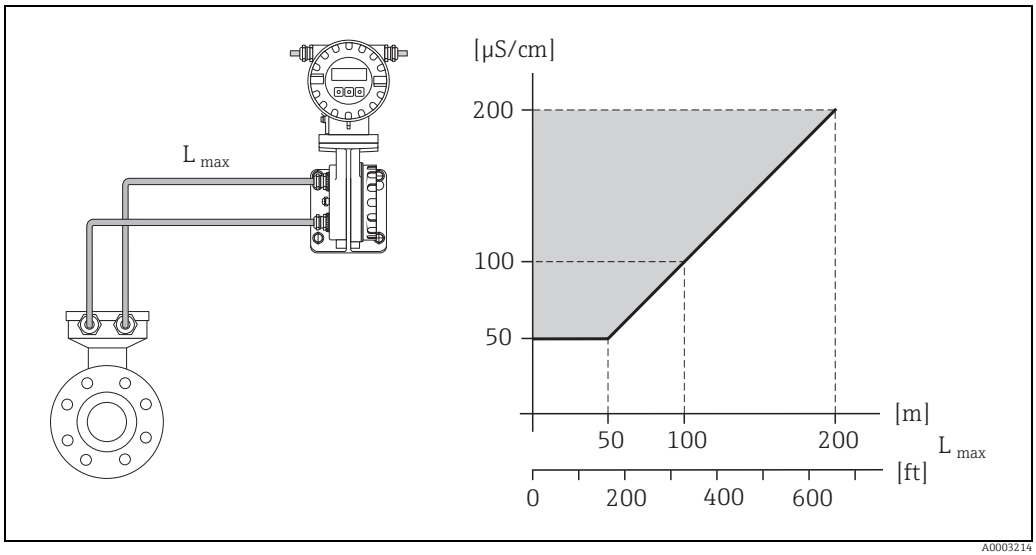


Fig. 16: Permissible cable length for the remote version

Area shaded gray = permitted range
L_{max} = connecting cable length in [m]
Fluid conductivity in [µS/cm]

3.2.9 Special mounting instructions

Temporary use in water for sensor Promag L

A remote version in IP67, type 6 is optionally available for temporary use in water up to 168 hours at ≤ 3 m (10 ft) or, in exceptional cases, for use up to 48 hours at ≤ 10 m (30 ft).

Compared to the degree of protection of standard version IP67, type 4X enclosure, the version IP67, type 6 enclosure was designed to withstand short-term or temporary submergence (e.g. flooding).

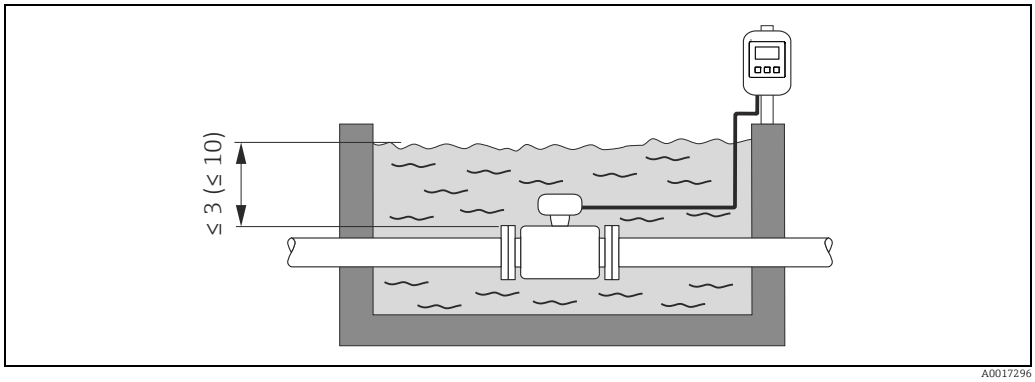


Abb. 17: Temporary use in water. Engineering unit mm (ft)

3.3 Installation instructions

3.3.1 Installing the Promag D sensor as wafer version

The sensor is installed between the pipe flanges with a mounting kit. The device is centered using recesses on the sensor (→ 🖹 21).

Note!
A mounting kit consisting of mounting bolts, seals, nuts and washers can be ordered separately (→ 🖹 72). Centering sleeves are provided with the device if they are required for the installation.

Caution!
When installing the transmitter in the pipe, observe the necessary torques (→ 🖹 22).

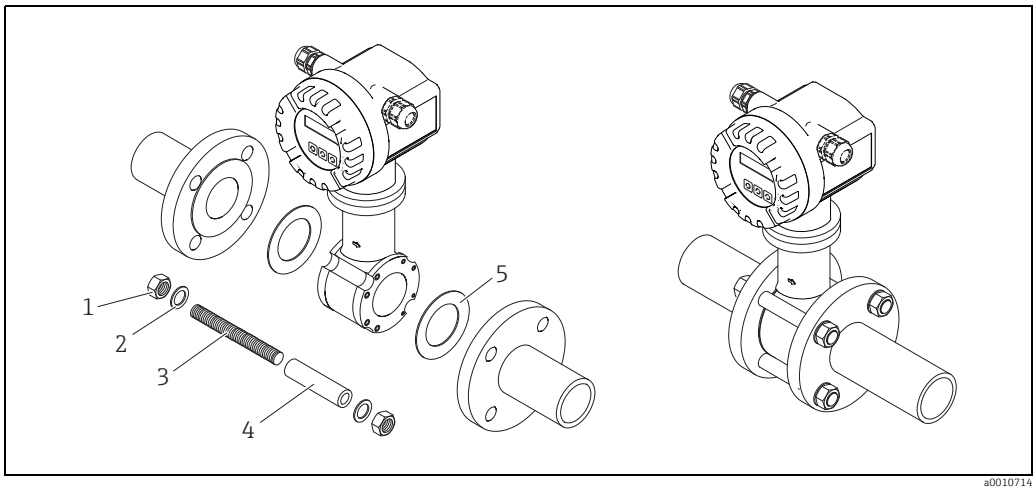


Fig. 18: Mounting the sensor Promag D as wafer version

1 Nut
2 Washer
3 Mounting bolt
4 Centering sleeve
5 Seal

Seals















When installing the sensor make sure that the seals used do not project into the pipe cross-section.

Caution!
Risk of short circuit! Do not use electrically conductive sealing compounds such as graphite! An electrically conductive layer could form on the inside of the measuring tube and short-circuit the measuring signal.

Note!
Use seals with a hardness rating of 70° Shore A.

Arrangement of the mounting bolts and centering sleeves

The device is centered using recesses on the sensor. The arrangement of the mounting bolts and the use of the centering sleeves supplied depend on the nominal diameter, the flange standard und the pitch circle diameter.

	Process connection		
	EN (DIN)	ASME	JIS
DN 25 to 40 (1 to 1 ½")	 A0010896	 A0010824	 A0010896
DN 50 (2")	 A0010897	 A0010825	 A0010825
DN 65 (–)	 A0012170	– – – – – – – – – – – – – – – –	 A0012171
DN 80 (3")	 A0010898	 A0010827	 A0010826
DN 100 (4")	 A0012168	 A0012168	 A0012169

1 = Mounting bolts with centering sleeves
2 = EN (DIN) flanges: 4-hole → with centering sleeves
3 = EN (DIN) flanges: 8-hole → without centering sleeves

Screw tightening torques (Promag D as wafer version)

Please note the following:
- The tightening torques listed below are for lubricated threads only.
- Always tighten the screws uniformly and in diagonally opposite sequence.
- Overtightening the screws will deform the sealing faces or damage the seals.
- The tightening torques listed below apply only to pipes not subjected to tensile stress.

The tightening torques apply to situations where an EPDM soft material flat seal (e.g. 70° Shore A) is used.

Promag D as wafer version tightening torques, mounting bolts and centering sleeves for EN (DIN) PN 16

Nominal diameter [mm]	Mounting bolts [mm]	Centering sleeve length [mm]	Tightening torque [Nm] with a process flange with a	
			smooth seal face	raised face
25	4 × M12 × 145	54	19	19
40	4 × M16 × 170	68	33	33
50	4 × M16 × 185	82	41	41
65[1]	4 × M16 × 200	92	44	44
65″	8 × M16 × 200	– ≥	29	29
80	8 × M16 × 225	116	36	36
100	8 × M16 × 260	147	40	40

≠ EN (DIN) flanges: 4-hole → with centering sleeves
″ EN (DIN) flanges: 8-hole → without centering sleeves
≥ A centering sleeve is not required. The device is centered directly via the sensor housing.

Promag D as wafer version tightening torques, mounting bolts and centering sleeves for JIS 10 K

Nominal diameter [mm]	Mounting bolts [mm]	Centering sleeve length [mm]	Tightening torque [Nm] with a process flange with a	
			smooth seal face	raised face
25	4 × M16 × 170	54	24	24
40	4 × M16 × 170	68	32	25
50	4 × M16 × 185	– *	38	30
65	4 × M16 × 200	– *	42	42
80	8 × M16 × 225	– *	36	28
100	8 × M16 × 260	– *	39	37

* A centering sleeve is not required. The device is centered directly via the sensor housing.

Promag D as wafer version tightening torques, mounting bolts and centering sleeves for ASME Class 150

Nominal diameter [inch]	Mounting bolts [inch]	Centering sleeve length [inch]	Tightening torque [lbf · ft] with a process flange with a	
			smooth seal face	raised face
1"	4 × UNC ½ " × 5.70"	– *	14	7
1 ½"	4 × UNC ½ " × 6.50"	– *	21	14
2"	4 × UNC 5/8" × 7.50"	– *	30	27
3"	4 × UNC 5/8" × 9.25"	– *	31	31
4"	8 × UNC 5/8" × 10.4"	5.79	28	28

* A centering sleeve is not required. The device is centered directly via the sensor housing.

3.3.2 Installing the Promag D sensor with threaded connection

The sensor can be installed into the pipe with common threaded connections.

Caution!
When installing the transmitter in the pipe, observe the necessary torques (→ 22).

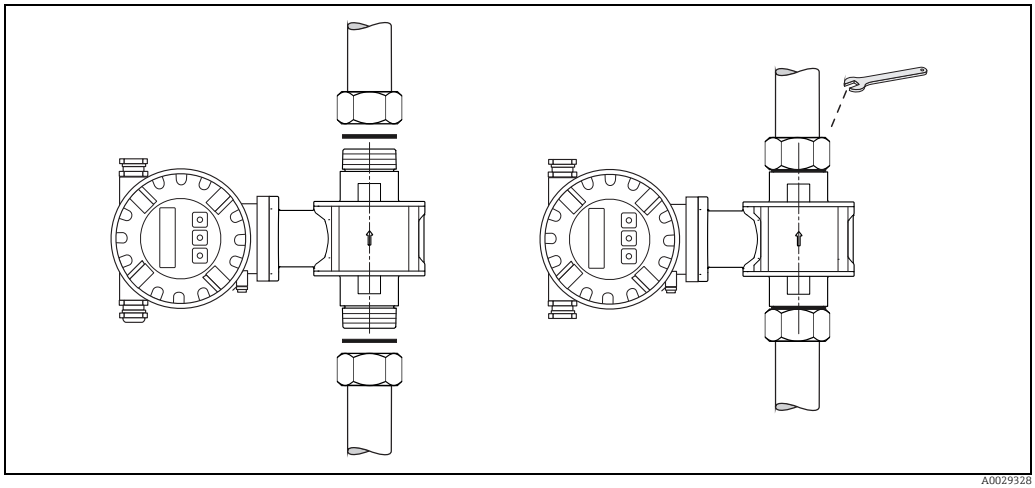


Abb. 19: Installing the Promag D sensor with threaded connection

Seals

The purchaser is responsible for the choice of the seals. Common seals can be used for the threaded connections.

Caution!
Risk of short circuit! Do not use electrically conductive sealing compounds such as graphite! An electrically conductive layer could form on the inside of the measuring tube and short-circuit the measuring signal.

Screw tightening torques (Promag D with threaded connection)

The tightening torques listed below are for lubricated threads only.

*Promag D with threaded connection tightening torques **for EN (DIN) PN16***

Nominal diameter [mm]	Threaded connection	Width across flat [mm/inch]	Max. tightening torque [Nm]
25	G 1"	28/1.1	20
40	G 1 ½"	50/1.97	50
50	G 2"	60/2.36	90
The purchaser is responsible for the choice of the seals			

*Promag D with threaded connection tightening torques **for ANSI Class 150***

Nominal diameter [in]	Threaded connection	Width across flat [mm/inch]	Max. tightening torque [Nm]
1"	NPT 1"	28/1.1	20
1 ½"	NPT 1 ½"	50/1.97	50
2"	NPT 2"	60/2.36	90
The purchaser is responsible for the choice of the seals			

3.3.3 Installing the Promag E sensor

Caution!
- The protective covers mounted on the two sensor flanges guard the PTFE, which is turned over the flanges. Consequently, do not remove these covers until **immediately before** the sensor is installed in the pipe.
- The covers must remain in place while the device is in storage.
- Make sure that the lining is not damaged or removed from the flanges.

Note!
Bolts, nuts, seals, etc. are not included in the scope of supply and must be supplied by the customer.

The sensor is designed for installation between the two piping flanges.
- Observe in any case the necessary screw tightening torques on → 📄 25
- If grounding disks are used, follow the mounting instructions which will be enclosed with the shipment

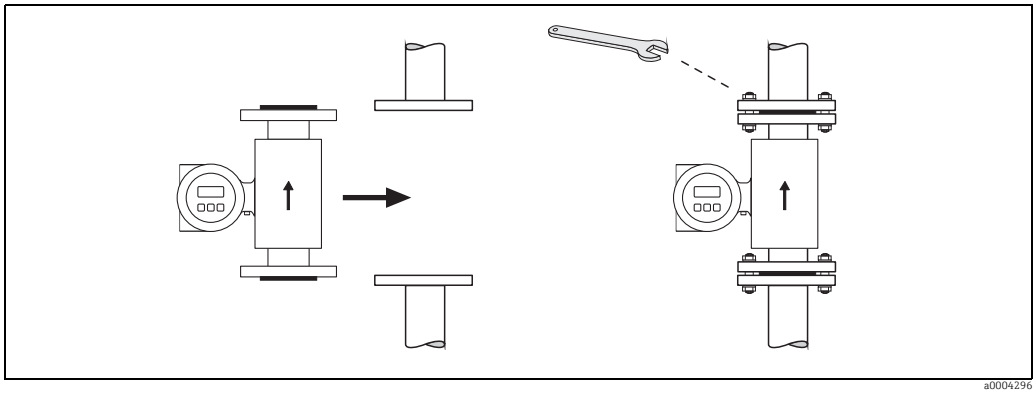


Fig. 20: Installing the Promag E sensor

Seals

Comply with the following instructions when installing seals:
- PTFE lining → **No** seals are required!
- For DIN flanges, use only seals according to EN 1514-1.
- Make sure that the seals do not protrude into the piping cross-section.

Caution!
Risk of short circuit! Do not use electrically conductive sealing compounds such as graphite! An electrically conductive layer could form on the inside of the measuring tube and short-circuit the measuring signal.

Ground cable

- If necessary, special ground cables for potential equalization can be ordered as an accessory (→ 📄 72).
- Information on potential equalization and detailed mounting instructions for the use of ground cables can be found on → 📄 52

Tightening torques for threaded fasteners (Promag E)

Please note the following:
- The tightening torques listed below are for lubricated threads only.
- Always tighten the screws uniformly and in diagonally opposite sequence.
- Overtightening the screws will deform the sealing faces or damage the seals.
- The tightening torques listed below apply only to pipes not subjected to tensile stress.

Tightening torques for:
- EN (DIN) → 🖹 25
- ASME → 🖹 26
- JIS → 🖹 26

Promag E tightening torques for EN (DIN)

Nominal diameter [mm]	EN (DIN) Pressure rating [bar]	Threaded fasteners	Max. tightening torque [Nm]
15	PN 40	4 × M 12	11
25	PN 40	4 × M 12	26
32	PN 40	4 × M 16	41
40	PN 40	4 × M 16	52
50	PN 40	4 × M 16	65
65 [1)]	PN 16	8 × M 16	43
80	PN 16	8 × M 16	53
100	PN 16	8 × M 16	57
125	PN 16	8 × M 16	75
150	PN 16	8 × M 20	99
200	PN 10	8 × M 20	141
200	PN 16	12 × M 20	94
250	PN 10	12 × M 20	110
250	PN 16	12 × M 24	131
300	PN 10	12 × M 20	125
300	PN 16	12 × M 24	179
350	PN 6	12 × M 20	200
350	PN 10	16 × M 20	188
350	PN 16	16 × M 24	254
400	PN 6	16 × M 20	166
400	PN 10	16 × M 24	260
400	PN 16	16 × M 27	330
450	PN 6	16 × M 20	202
450	PN 10	20 × M 24	235
450	PN 16	20 × M 27	300
500	PN 6	20 × M 20	176
500	PN 10	20 × M 24	265
500	PN 16	20 × M 30	448
600	PN 6	20 × M 24	242
600	PN 10	20 × M 27	345
600 [1)]	PN 16	20 × M 33	658

[1)] Designed acc. to EN 1092-1 (not to DIN 2501)

Promag E tightening torques for ASME

Nominal diameter		ASME Pressure rating	Threaded fasteners	Max. tightening torque PTFE	
[mm]	[inch]	[lbs]		[Nm]	[lbf · ft]
15	½"	Class 150	4 × ½"	6	4
25	1"	Class 150	4 × ½"	11	8
40	1 ½"	Class 150	4 × ½"	24	18
50	2"	Class 150	4 × 5/8"	47	35
80	3"	Class 150	4 × 5/8"	79	58
100	4"	Class 150	8 × 5/8"	56	41
150	6"	Class 150	8 × ¾"	106	78
200	8"	Class 150	8 × ¾"	143	105
250	10"	Class 150	12 × 7/8"	135	100
300	12"	Class 150	12 × 7/8"	178	131
350	14"	Class 150	12 × 1"	260	192
400	16"	Class 150	16 × 1"	246	181
450	18"	Class 150	16 × 1 ⅛"	371	274
500	20"	Class 150	20 × 1 ⅛"	341	252
600	24"	Class 150	20 × 1 ¼"	477	352

Promag E tightening torques for JIS

Nominal diameter [mm]	JIS Pressure rating	Threaded fasteners	Max. tightening torque [Nm] PTFE
15	20K	4 × M 12	16
25	20K	4 × M 16	32
32	20K	4 × M 16	38
40	20K	4 × M 16	41
50	10K	4 × M 16	54
65	10K	4 × M 16	74
80	10K	8 × M 16	38
100	10K	8 × M 16	47
125	10K	8 × M 20	80
150	10K	8 × M 20	99
200	10K	12 × M 20	82
250	10K	12 × M 22	133
300	10K	16 × M 22	99

3.3.4 Installing the Promag H sensor

The sensor is supplied to order, with or without pre-installed process connections. Pre-installed process connections are secured to the sensor with 4 or 6 hex-head threaded fasteners.

Caution!
The sensor might require support or additional attachments, depending on the application and the length of the piping run. When plastic process connections are used, the sensor must be additionally supported mechanically. A wall-mounting kit can be ordered separately from Endress+Hauser as an accessory (→ 72).

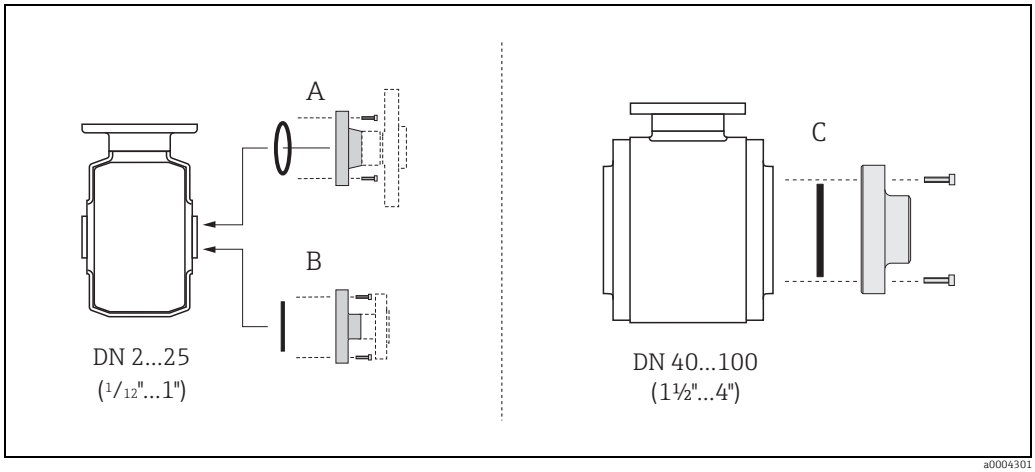


Fig. 21: Promag H process connections (DN 2 to 25 / 1/12 to 1", DN 40 to 100 / 1½ to 4")

A = DN 2 to 25 / process connections with O-ring
- *Flanges (EN (DIN), ASME, JIS),*
- *External thread*

B = DN 2 to 25 / process connections with aseptic gasket seal
- *Weld nipples (EN 10357 (DIN 11850), ODT/SMS)*
- *Tri-Clamp L14AM7*
- *Coupling (DIN 11851, DIN 11864-1, SMS 1145 (only DN 25)*
- *Flange DIN 11864-2*

C = DN 40 to 100 / process connections with aseptic gasket seal
- *Weld nipples (EN 10357 (DIN 11850), ODT/SMS)*
- *Tri-Clamp L14AM7*
- *Coupling (DIN 11851, DIN 11864-1, SMS 1145)*
- *Flange DIN 11864-2*

Seals

When installing the process connections, make sure that the seals are clean and correctly centered.

Caution!
- With metal process connections, you must fully tighten the screws. The process connection forms a metallic connection with the sensor, which ensures a defined compression of the seal.
- With plastic process connections, note the max. torques for lubricated threads (7 Nm / 5.2 lbf ft). With plastic flanges, always use seals between connection and counter flange.
- The seals must be replaced periodically, depending on the application, particularly in the case of gasket seals (aseptic version)!
  The period between changes depends on the frequency of cleaning cycles, the cleaning temperature and the fluid temperature. Replacement seals can be ordered as accessories → 72.

Welding the transmitter into the piping (weld nipples)

Caution!
Risk of destroying the measuring electronics. Make sure that the welding machine is *not* grounded via the sensor or the transmitter.

1. Tack-weld the sensor into the pipe. A suitable welding jig can be ordered separately as an accessory (→ 72).
2. Loosen the screws on the process connection flange and remove the sensor, complete with the seal, from the pipe.
3. Weld the process connection to the pipe.
4. Reinstall the sensor in the pipe. Make sure that everything is clean and that the seal is correctly seated.

Note!
- If thin-walled foodstuffs pipes are not welded correctly, the heat could damage the installed seal. It is therefore advisable to remove the sensor and the seal prior to welding.
- The pipe has to be spread approximately 8 mm to permit disassembly.

Cleaning with pigs

If pigs are used for cleaning, it is essential to take the inside diameters of the measuring tube and process connection into account. All the dimensions and lengths of the sensor and transmitter are provided in the separate documentation "Technical Documentation".

3.3.5 Installing the Promag L sensor

Caution!
- The protective covers mounted on the two sensor flanges (DN 25 to 300 / 1 to 12") are used to hold the lap joint flanges in place and to protect the PTFE liner during transportation. Consequently, do not remove these covers until immediately before the sensor is installed in the pipe.
- The covers must remain in place while the device is in storage.
- Make sure that the lining is not damaged or removed from the flanges.

Note!
Bolts, nuts, seals, etc. are not included in the scope of supply and must be supplied by the customer.

The sensor is designed for installation between the two piping flanges.
- Observe in any case the necessary screw tightening torques on → 30
- If grounding disks are used, follow the mounting instructions which will be enclosed with the shipment
- To comply with the device specification, a concentrical installation in the measuring section is required

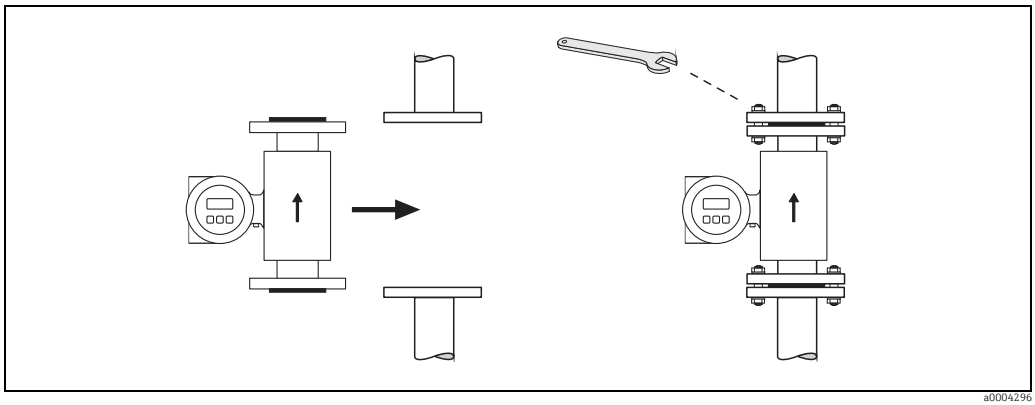


Fig. 22: Installing the Promag L sensor

Seals

Comply with the following instructions when installing seals:
- Hard rubber lining → additional seals are **always** necessary.
- Polyurethane lining → **no** seals are required.
- PTFE lining → **no** seals are required.
- For DIN flanges, use only seals according to EN 1514-1.
- Make sure that the seals do not protrude into the piping cross-section.

Caution!
Risk of short circuit!
Do not use electrically conductive sealing compounds such as graphite! An electrically conductive layer could form on the inside of the measuring tube and short-circuit the measuring signal.

Ground cable

- If necessary, special ground cables for potential equalization can be ordered as an accessory (→ 72).
- Information on potential equalization and detailed mounting instructions for the use of ground cables can be found on → 52.

Screw tightening torques (Promag L)

Please note the following:
- The tightening torques listed below are for lubricated threads only.
- Always tighten the screws uniformly and in diagonally opposite sequence.
- Overtightening the screws will deform the sealing faces or damage the seals.
- The tightening torques listed below apply only to pipes not subjected to tensile stress.

Promag L tightening torques for EN (DIN)

Nominal diameter [mm]	EN (DIN) Pressure rating [bar]	Threaded fasteners	Max. tightening torque		
			Hard rubber [Nm]	Polyurethane [Nm]	PTFE [Nm]
25	PN 10/16	4 × M 12	-	6	11
32	PN 10/16	4 × M 16	-	16	27
40	PN 10/16	4 × M 16	-	16	29
50	PN 10/16	4 × M 16	-	15	40
65*	PN 10/16	8 × M 16	-	10	22
80	PN 10/16	8 × M 16	-	15	30
100	PN 10/16	8 × M 16	-	20	42
125	PN 10/16	8 × M 16	-	30	55
150	PN 10/16	8 × M 20	-	50	90
200	PN 16	12 × M 20	-	65	87
250	PN 16	12 × M 24	-	126	151
300	PN 16	12 × M 24	-	139	177
350	PN 6	12 × M 20	111	120	-
350	PN 10	16 × M 20	112	118	-
400	PN 6	16 × M 20	90	98	-
400	PN 10	16 × M 24	151	167	-
450	PN 6	16 × M 20	112	126	-
450	PN 10	20 × M 24	153	133	-
500	PN 6	20 × M 20	119	123	-
500	PN 10	20 × M 24	155	171	-
600	PN 6	20 × M 24	139	147	-
600	PN 10	20 × M 27	206	219	-
700	PN 6	24 × M 24	148	139	-
700	PN 10	24 × M 27	246	246	-
800	PN 6	24 × M 27	206	182	-
800	PN 10	24 × M 30	331	316	-
900	PN 6	24 × M 27	230	637	-
900	PN 10	28 × M 30	316	307	-
1000	PN 6	28 × M 27	218	208	-
1000	PN 10	28 × M 33	402	405	-
1200	PN 6	32 × M 30	319	299	-
1200	PN 10	32 × M 36	564	568	-

* Designed acc. to EN 1092-1 (not to DIN 2501)

Promag L tightening torques for ASME

Nominal diameter		ASME Pressure rating	Threaded fasteners	Max. tightening torque					
				Hard rubber		Polyurethane		PTFE	
[mm]	[inch]	[lbs]		[Nm]	[lbf · ft]	[Nm]	[lbf · ft]	[Nm]	[lbf · ft]
25	1"	Class 150	4 × 5/8"	-	-	5	4	14	13
40	1 ½"	Class 150	8 × 5/8"	-	-	10	17	21	15
50	2"	Class 150	4 × 5/8"	-	-	15	11	40	29
80	3"	Class 150	4 × 5/8"	-	-	25	18	65	48
100	4"	Class 150	8 × 5/8"	-	-	20	15	44	32
150	6"	Class 150	8 × ¾"	-	-	45	33	90	66
200	8"	Class 150	8 × ¾"	-	-	65	48	87	64
250	10"	Class 150	12 × 7/8"	-	-	126	93	151	112
300	12"	Class 150	12 × 7/8"	-	-	146	108	177	131
350	14"	Class 150	12 × 1"	135	100	158	117	-	-
400	16"	Class 150	16 × 1"	128	94	150	111	-	-
450	18"	Class 150	16 × 1 ⅛"	204	150	234	173	-	-
500	20"	Class 150	20 × 1 ⅛"	183	135	217	160	-	-
600	24"	Class 150	20 × 1 ¼"	268	198	307	226	-	-

Promag L tightening torques for AWWA

Nominal diameter		AWWA Pressure rating	Threaded fasteners	Max. tightening torque					
				Hart rubber		Polyurethane		PTFE	
[mm]	[inch]			[Nm]	[lbf · ft]	[Nm]	[lbf · ft]	[Nm]	[lbf · ft]
700	28"	Class D	28 × 1 ¼"	247	182	292	215	-	-
750	30"	Class D	28 × 1 ¼"	287	212	302	223	-	-
800	32"	Class D	28 × 1 ½"	394	291	422	311	-	-
900	36"	Class D	32 × 1 ½"	419	309	430	317	-	-
1000	40"	Class D	36 × 1 ½"	420	310	477	352	-	-
1050	42"	Class D	36 × 1 ½"	528	389	518	382	-	-
1200	48"	Class D	44 × 1 ½"	552	407	531	392	-	-

Promag L tightening torques for AS 2129

Nominal diameter	AS 2129 Pressure rating	Threaded fasteners	Max. tightening torque		
			Hard rubber	Polyurethane	PTFE
[mm]			[Nm]	[Nm]	[Nm]
350	Table E	12 × M 24	203	-	-
400	Table E	12 × M 24	226	-	-
450	Table E	16 × M 24	226	-	-
500	Table E	16 × M 24	271	-	-
600	Table E	16 × M 30	439	-	-
700	Table E	20 × M 30	355	-	-
750	Table E	20 × M 30	559	-	-
800	Table E	20 × M 30	631	-	-
900	Table E	24 × M 30	627	-	-
1000	Table E	24 × M 30	634	-	-
1200	Table E	32 × M 30	727	-	-

Promag L tightening torques for AS 4087

Nominal diameter [mm]	AS 4087 Pressure rating	Threaded fasteners	Max. tightening torque		
			Hard rubber [Nm]	Polyurethane [Nm]	PTFE [Nm]
350	PN 16	12 × M 24	203	-	-
375	PN 16	12 × M 24	137	-	-
400	PN 16	12 × M 24	226	-	-
450	PN 16	12 × M 24	301	-	-
500	PN 16	16 × M 24	271	-	-
600	PN 16	16 × M 27	393	-	-
700	PN 16	20 × M 27	330	-	-
750	PN 16	20 × M 30	529	-	-
800	PN 16	20 × M 33	631	-	-
900	PN 16	24 × M 33	627	-	-
1000	PN 16	24 × M 33	595	-	-
1200	PN 16	32 × M 33	703	-	-

3.3.6 Installing the Promag P sensor

Caution!
- The protective covers mounted on the two sensor flanges guard the PTFE, which is turned over the flanges. Consequently, do not remove these covers until **immediately before** the sensor is installed in the pipe.
- The covers must remain in place while the device is in storage.
- Make sure that the lining is not damaged or removed from the flanges.

Note!
Bolts, nuts, seals, etc. are not included in the scope of supply and must be supplied by the customer.

The sensor is designed for installation between the two piping flanges.
- Observe in any case the necessary screw tightening torques on → 33
- If grounding disks are used, follow the mounting instructions which will be enclosed with the shipment

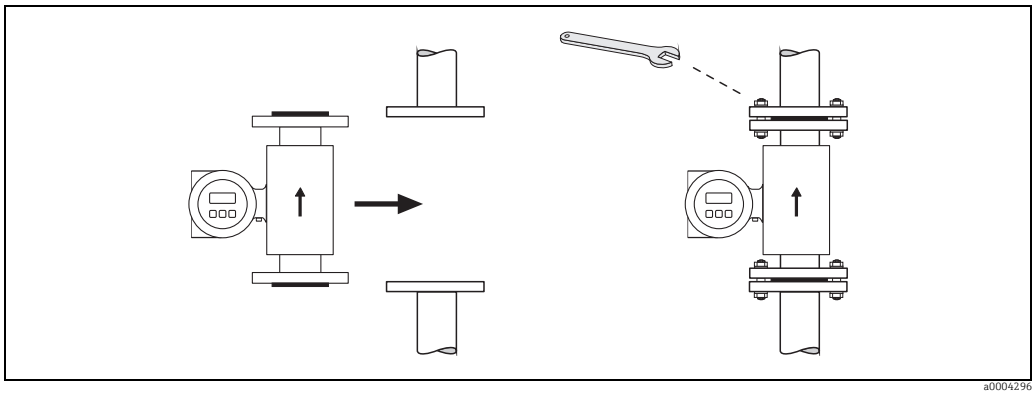


Fig. 23: Installing the Promag P sensor

Seals

Comply with the following instructions when installing seals:
- PTFE lining → **No** seals are required!
- For DIN flanges, use only seals according to EN 1514-1.
- Make sure that the seals do not protrude into the piping cross-section.

Caution!
Risk of short circuit! Do not use electrically conductive sealing compounds such as graphite! An electrically conductive layer could form on the inside of the measuring tube and short-circuit the measuring signal.

Ground cable

- If necessary, special ground cables for potential equalization can be ordered as an accessory (→ 72).
- Information on potential equalization and detailed mounting instructions for the use of ground cables can be found on → 52

Tightening torques for threaded fasteners (Promag P)

Please note the following:
- The tightening torques listed below are for lubricated threads only.
- Always tighten the screws uniformly and in diagonally opposite sequence.
- Overtightening the screws will deform the sealing faces or damage the seals.
- The tightening torques listed below apply only to pipes not subjected to tensile stress.

Tightening torques for:
- EN (DIN) → 34
- ASME → 34
- JIS → 35
- AS 2129 → 35
- AS 4087 → 35

Promag P tightening torques for EN (DIN)

Nominal diameter [mm]	EN (DIN) Pressure rating [bar]	Threaded fasteners	Max. tightening torque [Nm]
25	PN 40	4 × M 12	26
32	PN 40	4 × M 16	41
40	PN 40	4 × M 16	52
50	PN 40	4 × M 16	65
65 *	PN 16	8 × M 16	43
65	PN 40	8 × M 16	43
80	PN 16	8 × M 16	53
80	PN 40	8 × M 16	53
100	PN 16	8 × M 16	57
100	PN 40	8 × M 20	78
125	PN 16	8 × M 16	75
125	PN 40	8 × M 24	111
150	PN 16	8 × M 20	99
150	PN 40	8 × M 24	136
200	PN 10	8 × M 20	141
200	PN 16	12 × M 20	94
200	PN 25	12 × M 24	138
250	PN 10	12 × M 20	110
250	PN 16	12 × M 24	131
250	PN 25	12 × M 27	200
300	PN 10	12 × M 20	125
300	PN 16	12 × M 24	179
300	PN 25	16 × M 27	204
350	PN 10	16 × M 20	188
350	PN 16	16 × M 24	254
350	PN 25	16 × M 30	380
400	PN 10	16 × M 24	260
400	PN 16	16 × M 27	330
400	PN 25	16 × M 33	488
450	PN 10	20 × M 24	235
450	PN 16	20 × M 27	300
450	PN 25	20 × M 33	385
500	PN 10	20 × M 24	265
500	PN 16	20 × M 30	448
500	PN 25	20 × M 33	533
600	PN 10	20 × M 27	345
600 *	PN 16	20 × M 33	658
600	PN 25	20 × M 36	731
* Designed acc. to EN 1092-1 (not to DIN 2501)			

Promag P tightening torques for ASME

Nominal diameter		ASME Pressure rating	Threaded fasteners	Max. tightening torque PTFE	
[mm]	[inch]	[lbs]		[Nm]	[lbf · ft]
25	1"	Class 150	4 × ½"	11	8
25	1"	Class 300	4 × 5/8"	14	10
40	1 ½"	Class 150	4 × ½"	24	18
40	1 ½"	Class 300	4 × ¾"	34	25
50	2"	Class 150	4 × 5/8"	47	35

Nominal diameter		ASME Pressure rating	Threaded fasteners	Max. tightening torque PTFE	
[mm]	[inch]	[lbs]		[Nm]	[lbf · ft]
50	2"	Class 300	8 × 5/8"	23	17
80	3"	Class 150	4 × 5/8"	79	58
80	3"	Class 300	8 × ¾"	47	35
100	4"	Class 150	8 × 5/8"	56	41
100	4"	Class 300	8 × ¾"	67	49
150	6"	Class 150	8 × ¾"	106	78
150	6"	Class 300	12 × ¾"	73	54
200	8"	Class 150	8 × ¾"	143	105
250	10"	Class 150	12 × 7/8"	135	100
300	12"	Class 150	12 × 7/8"	178	131
350	14"	Class 150	12 × 1"	260	192
400	16"	Class 150	16 × 1"	246	181
450	18"	Class 150	16 × 1 ⅛"	371	274
500	20"	Class 150	20 × 1 ⅛"	341	252
600	24"	Class 150	20 × 1 ¼"	477	352

Promag P tightening torques for JIS

Nominal diameter [mm]	JIS Pressure rating	Threaded fasteners	Max. tightening torque [Nm] PTFE
25	10K	4 × M 16	32
25	20K	4 × M 16	32
32	10K	4 × M 16	38
32	20K	4 × M 16	38
40	10K	4 × M 16	41
40	20K	4 × M 16	41
50	10K	4 × M 16	54
50	20K	8 × M 16	27
65	10K	4 × M 16	74
65	20K	8 × M 16	37
80	10K	8 × M 16	38
80	20K	8 × M 20	57
100	10K	8 × M 16	47
100	20K	8 × M 20	75
125	10K	8 × M 20	80
125	20K	8 × M 22	121
150	10K	8 × M 20	99
150	20K	12 × M 22	108
200	10K	12 × M 20	82
200	20K	12 × M 22	121
250	10K	12 × M 22	133
250	20K	12 × M 24	212
300	10K	16 × M 22	99
300	20K	16 × M 24	183

Promag P tightening torques for AS 2129

Nominal diameter [mm]	AS 2129 Pressure rating	Threaded fasteners	Max. tightening torque [Nm] PTFE
25	Table E	4 × M 12	21
50	Table E	4 × M 16	42

Promag P tightening torques for AS 4087

Nominal diameter [mm]	AS 4087 Pressure rating	Threaded fasteners	Max. tightening torque [Nm] PTFE
50	PN 16	4 × M 16	42

3.3.7 Installing the Promag W sensor

Note!
Bolts, nuts, seals, etc. are not included in the scope of supply and must be supplied by the customer.

The sensor is designed for installation between the two piping flanges.
- Observe in any case the necessary screw tightening torques on → 36
- If grounding disks are used, follow the mounting instructions which will be enclosed with the shipment

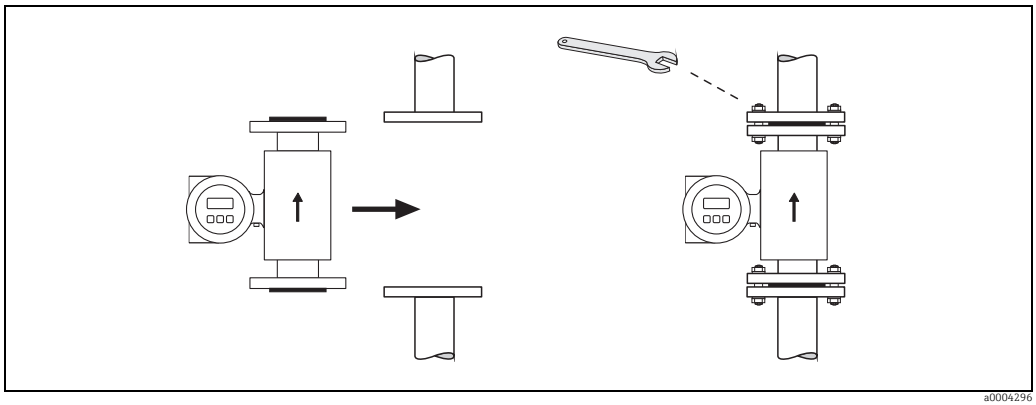


Fig. 24: Installing the Promag W sensor

Seals

Comply with the following instructions when installing seals:
- Hard rubber lining → additional seals are **always** necessary.
- Polyurethane lining → **no** seals are required.
- For DIN flanges, use only seals according to EN 1514-1.
- Make sure that the seals do not protrude into the piping cross-section.

Caution!
Risk of short circuit!
Do not use electrically conductive sealing compounds such as graphite! An electrically conductive layer could form on the inside of the measuring tube and short-circuit the measuring signal.

Ground cable

- If necessary, special ground cables for potential equalization can be ordered as an accessory (→ 72).
- Information on potential equalization and detailed mounting instructions for the use of ground cables can be found on → 52

Screw tightening torques (Promag W)

Please note the following:
- The tightening torques listed below are for lubricated threads only.
- Always tighten the screws uniformly and in diagonally opposite sequence.
- Overtightening the screws will deform the sealing faces or damage the seals.
- The tightening torques listed below apply only to pipes not subjected to tensile stress.

Tightening torques for:
- EN (DIN)→ 🖹 37
- JIS→ 🖹 39
- ASME→ 🖹 38
- AWWA → 🖹 39
- AS 2129 → 🖹 40
- AS 4087 → 🖹 40

Promag W tightening torques for EN (DIN)

Nominal diameter [mm]	EN (DIN) Pressure rating [bar]	Threaded fasteners	Max. tightening torque [Nm]	
			Hard rubber	Polyurethane
25	PN 40	4 × M 12	-	15
32	PN 40	4 × M 16	-	24
40	PN 40	4 × M 16	-	31
50	PN 40	4 × M 16	48	40
65*	PN 16	8 × M 16	32	27
65	PN 40	8 × M 16	32	27
80	PN 16	8 × M 16	40	34
80	PN 40	8 × M 16	40	34
100	PN 16	8 × M 16	43	36
100	PN 40	8 × M 20	59	50
125	PN 16	8 × M 16	56	48
125	PN 40	8 × M 24	83	71
150	PN 16	8 × M 20	74	63
150	PN 40	8 × M 24	104	88
200	PN 10	8 × M 20	106	91
200	PN 16	12 × M 20	70	61
200	PN 25	12 × M 24	104	92
250	PN 10	12 × M 20	82	71
250	PN 16	12 × M 24	98	85
250	PN 25	12 × M 27	150	134
300	PN 10	12 × M 20	94	81
300	PN 16	12 × M 24	134	118
300	PN 25	16 × M 27	153	138
350	PN 6	12 × M 20	111	120
350	PN 10	16 × M 20	112	118
350	PN 16	16 × M 24	152	165
350	PN 25	16 × M 30	227	252
400	PN 6	16 × M 20	90	98
400	PN 10	16 × M 24	151	167
400	PN 16	16 × M 27	193	215
400	PN 25	16 × M 33	289	326
450	PN 6	16 × M 20	112	126
450	PN 10	20 × M 24	153	133
450	PN 16	20 × M 27	198	196
450	PN 25	20 × M 33	256	253
500	PN 6	20 × M 20	119	123
500	PN 10	20 × M 24	155	171
500	PN 16	20 × M 30	275	300
500	PN 25	20 × M 33	317	360
600	PN 6	20 × M 24	139	147
600	PN 10	20 × M 27	206	219
600 *	PN 16	20 × M 33	415	443
600	PN 25	20 × M 36	431	516
700	PN 6	24 × M 24	148	139
700	PN 10	24 × M 27	246	246
700	PN 16	24 × M 33	278	318

Nominal diameter [mm]	EN (DIN) Pressure rating [bar]	Threaded fasteners	Max. tightening torque [Nm]	
			Hard rubber	Polyurethane
700	PN 25	24 × M 39	449	507
800	PN 6	24 × M 27	206	182
800	PN 10	24 × M 30	331	316
800	PN 16	24 × M 36	369	385
800	PN 25	24 × M 45	664	721
900	PN 6	24 × M 27	230	637
900	PN 10	28 × M 30	316	307
900	PN 16	28 × M 36	353	398
900	PN 25	28 × M 45	690	716
1000	PN 6	28 × M 27	218	208
1000	PN 10	28 × M 33	402	405
1000	PN 16	28 × M 39	502	518
1000	PN 25	28 × M 52	970	971
1200	PN 6	32 × M 30	319	299
1200	PN 10	32 × M 36	564	568
1200	PN 16	32 × M 45	701	753
1400	PN 6	36 × M 33	430	398
1400	PN 10	36 × M 39	654	618
1400	PN 16	36 × M 45	729	762
1600	PN 6	40 × M 33	440	417
1600	PN 10	40 × M 45	946	893
1600	PN 16	40 × M 52	1007	1100
1800	PN 6	44 × M 36	547	521
1800	PN 10	44 × M 45	961	895
1800	PN 16	44 × M 52	1108	1003
2000	PN 6	48 × M 39	629	605
2000	PN 10	48 × M 45	1047	1092
2000	PN 16	48 × M 56	1324	1261
* Designed acc. to EN 1092-1 (not to DIN 2501)				

Promag W tightening torques for ASME

Nominal diameter		ASME Pressure rating [lbs]	Threaded fasteners	Max. tightening torque			
				Hard rubber		Polyurethane	
[mm]	[inch]			[Nm]	[lbf · ft]	[Nm]	[lbf · ft]
25	1"	Class 150	4 × ½"	-	-	7	5
25	1"	Class 300	4 × 5/8"	-	-	8	6
40	1 ½"	Class 150	4 × ½"	-	-	10	7
40	1 ½"	Class 300	4 × ¾"	-	-	15	11
50	2"	Class 150	4 × 5/8"	35	26	22	16
50	2"	Class 300	8 × 5/8"	18	13	11	8
80	3"	Class 150	4 × 5/8"	60	44	43	32
80	3"	Class 300	8 × ¾"	38	28	26	19
100	4"	Class 150	8 × 5/8"	42	31	31	23
100	4"	Class 300	8 × ¾"	58	43	40	30
150	6"	Class 150	8 × ¾"	79	58	59	44
150	6"	Class 300	12 × ¾"	70	52	51	38
200	8"	Class 150	8 × ¾"	107	79	80	59
250	10"	Class 150	12 × 7/8"	101	74	75	55
300	12"	Class 150	12 × 7/8"	133	98	103	76
350	14"	Class 150	12 × 1"	135	100	158	117
400	16"	Class 150	16 × 1"	128	94	150	111
450	18"	Class 150	16 × 1 ⅛"	204	150	234	173
500	20"	Class 150	20 × 1 ⅛"	183	135	217	160
600	24"	Class 150	20 × 1 ¼"	268	198	307	226

Promag W tightening torques for JIS

Nominal diameter [mm]	JIS Pressure rating	Threaded fasteners	Max. tightening torque [Nm]	
			Hard rubber	Polyurethane
25	10K	4 × M 16	-	19
25	20K	4 × M 16	-	19
32	10K	4 × M 16	-	22
32	20K	4 × M 16	-	22
40	10K	4 × M 16	-	24
40	20K	4 × M 16	-	24
50	10K	4 × M 16	40	33
50	20K	8 × M 16	20	17
65	10K	4 × M 16	55	45
65	20K	8 × M 16	28	23
80	10K	8 × M 16	29	23
80	20K	8 × M 20	42	35
100	10K	8 × M 16	35	29
100	20K	8 × M 20	56	48
125	10K	8 × M 20	60	51
125	20K	8 × M 22	91	79
150	10K	8 × M 20	75	63
150	20K	12 × M 22	81	72
200	10K	12 × M 20	61	52
200	20K	12 × M 22	91	80
250	10K	12 × M 22	100	87
250	20K	12 × M 24	159	144
300	10K	16 × M 22	74	63
300	20K	16 × M 24	138	124

Promag W tightening torques for AWWA

Nominal diameter		AWWA Pressure rating	Threaded fasteners	Max. tightening torque			
				Hard rubber		Polyurethane	
[mm]	[inch]			[Nm]	[lbf · ft]	[Nm]	[lbf · ft]
700	28"	Class D	28 × 1 ¼"	247	182	292	215
750	30"	Class D	28 × 1 ¼"	287	212	302	223
800	32"	Class D	28 × 1 ½"	394	291	422	311
900	36"	Class D	32 × 1 ½"	419	309	430	317
1000	40"	Class D	36 × 1 ½"	420	310	477	352
1050	42"	Class D	36 × 1 ½"	528	389	518	382
1200	48"	Class D	44 × 1 ½"	552	407	531	392
1350	54"	Class D	44 × 1 ¾"	730	538	633	467
1500	60"	Class D	52 × 1 ¾"	758	559	832	614
1650	66"	Class D	52 × 1 ¾"	946	698	955	704
1800	72"	Class D	60 × 1 ¾"	975	719	1087	802
2000	78"	Class D	64 × 2"	853	629	786	580

Promag W tightening torques for AS 2129

Nominal diameter [mm]	AS 2129 Pressure rating	Threaded fasteners	Max. tightening torque [Nm] Hard rubber
50	Table E	4 × M 16	32
80	Table E	4 × M 16	49
100	Table E	8 × M 16	38
150	Table E	8 × M 20	64
200	Table E	8 × M 20	96
250	Table E	12 × M 20	98
300	Table E	12 × M 24	123
350	Table E	12 × M 24	203
400	Table E	12 × M 24	226
450	Table E	16 × M 24	226
500	Table E	16 × M 24	271
600	Table E	16 × M 30	439
700	Table E	20 × M 30	355
750	Table E	20 × M 30	559
800	Table E	20 × M 30	631
900	Table E	24 × M 30	627
1000	Table E	24 × M 30	634
1200	Table E	32 × M 30	727

Promag W tightening torques for AS 4087

Nominal diameter [mm]	AS 4087 Pressure rating	Threaded fasteners	Max. tightening torque [Nm] Hard rubber
50	Table E	4 × M 16	32
80	PN 16	4 × M 16	49
100	PN 16	4 × M 16	76
150	PN 16	8 × M 20	52
200	PN 16	8 × M 20	77
250	PN 16	8 × M 20	147
300	PN 16	12 × M 24	103
350	PN 16	12 × M 24	203
375	PN 16	12 × M 24	137
400	PN 16	12 × M 24	226
450	PN 16	12 × M 24	301
500	PN 16	16 × M 24	271
600	PN 16	16 × M 27	393
700	PN 16	20 × M 27	330
750	PN 16	20 × M 30	529
800	PN 16	20 × M 33	631
900	PN 16	24 × M 33	627
1000	PN 16	24 × M 33	595
1200	PN 16	32 × M 33	703

3.3.8 Turning the transmitter housing

1. Loosen the two securing screws.
2. Turn the bayonet lock as far as it will go.
3. Carefully lift the transmitter housing:
   – Promag D: approx. 10 mm (0.39 in) above the securing screws
   – Promag E/H/L/P/W: to the stop
4. Turn the transmitter housing to the desired position:
   – Promag D: max. 180° clockwise or max. 180° counterclockwise
   – Promag E/H/L/P/W: max. 280° clockwise or max. 20° counterclockwise
5. Lower the housing into position and re-engage the bayonet catch.
6. Retighten the two securing screws.

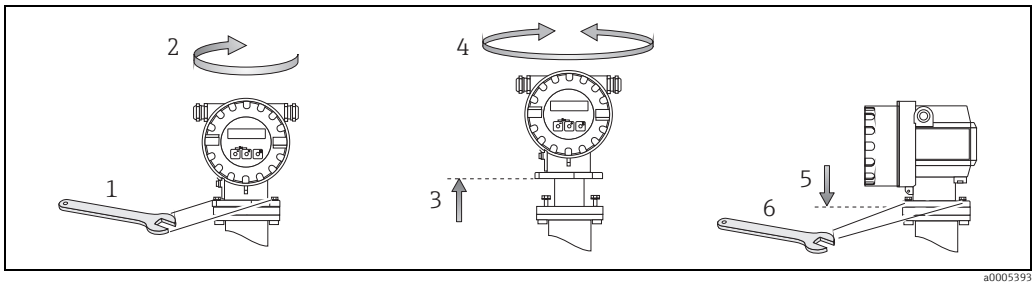


Fig. 25: Turning the transmitter housing

3.3.9 Turning the onsite display

1. Unscrew cover of the electronics compartment from the transmitter housing.
2. Remove the display module from the transmitter retaining rails.
3. Turn the display to the desired position (max. 4 × 45° in each direction).
4. Fit the display back onto the retaining rails.
5. Screw the cover of the electronics compartment firmly back onto the transmitter housing.

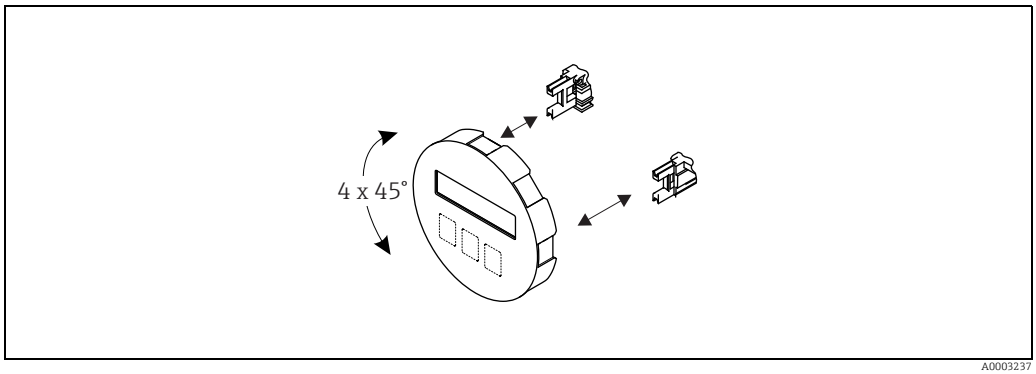


Fig. 26: Turning the local display

3.3.10 Mounting the transmitter (remote version)

The transmitter can be mounted in the following ways:
- Wall mounting
- Pipe mounting (with separate mounting kit, accessories → 72)

The transmitter and the sensor must be mounted separate in the following circumstances:
- Poor accessibility
- Lack of space
- Extreme fluid/ambient temperatures (temperature ranges → 87)
- Severe vibration (> 2 g/2 h per day; 10 to 100 Hz)

Caution!
- The ambient temperature range -20 to +60 °C (−4 to +140 °F) may not be exceeded at the mounting location. Avoid direct sunlight.
- If the device is mounted to a warm pipe, make sure that the housing temperature does not exceed +60 °C (+140 °F), which is the maximum permissible temperature.

Mount the transmitter as illustrated in → 27.

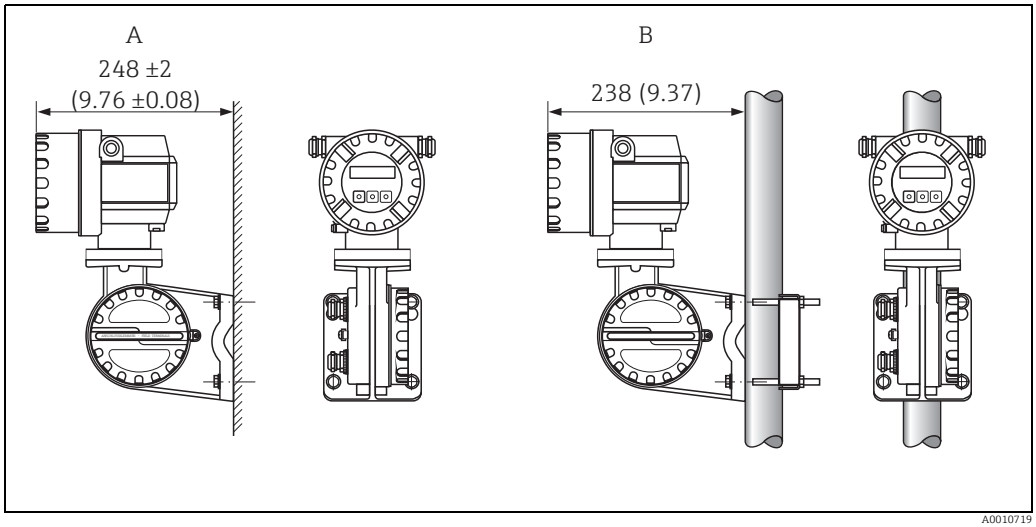


Fig. 27: Mounting the transmitter (remote version). Engineering unit mm (in)

A Direct wall mounting
B Pipe mounting

3.4 Post-installation check

Perform the following checks after installing the measuring device in the pipe:

Device condition and specifications	Notes
Is the device damaged (visual inspection)?	–
Does the device correspond to specifications at the measuring point, including process temperature and pressure, ambient temperature, minimum fluid conductivity, measuring range, etc.?	→ 🖹 88
Installation	**Notes**
Does the arrow on the sensor nameplate match the actual direction of flow through the pipe?	–
Is the position of the measuring electrode plane correct?	→ 🖹 13
Is the position of the empty pipe detection electrode correct?	→ 🖹 13
Were all screws tightened to the specified torques when the sensor was installed?	Promag D → 🖹 22 Promag E → 🖹 25 Promag L → 🖹 30 Promag P → 🖹 33 Promag W → 🖹 36
Were the correct seals used (type, material, installation)?	Promag D → 🖹 20 Promag E → 🖹 24 Promag H → 🖹 27 Promag L→ 🖹 29 Promag P → 🖹 33 Promag W → 🖹 36
Are the measuring point number and labeling correct (visual inspection)?	–
Process environment / process conditions	**Notes**
Were the inlet and outlet runs respected?	Inlet run ≥ 5 × DN Outlet run ≥ 2 × DN
Is the measuring device protected against moisture and direct sunlight?	–
Is the sensor adequately protected against vibration (attachment, support)?	Acceleration up to 2 g by analogy with IEC 600 68-2-8

4 Wiring

Warning!
When using remote versions, only sensors and transmitters with the same serial number can be connected up. Measuring errors can occur if the devices are not connected in this way.

Note!
The device does not have an internal circuit breaker. For this reason, assign the device a switch or power-breaker switch capable of disconnecting the power supply line from the mains.

4.1 Connecting the remote version

4.1.1 Connecting Promag D/E/H/L/P/W

Warning!
- Risk of electric shock! Switch off the power supply before opening the device. Do **not** install or wire the device while it is connected to the power supply. Failure to comply with this precaution can result in irreparable damage to the electronics.
- Risk of electric shock! Connect the protective conductor to the ground terminal on the housing before the power supply is applied.

Caution!
- Only sensors and transmitters with the same serial number can be connected to one another. Communication problems can occur if the devices are not connected in this way.
- Risk of damaging the coil driver. Always switch off the power supply before connecting or disconnecting the coil cable.

Procedure

1. Transmitter: Loosen the securing clamp and remove the cover from the connection compartment (a).
2. Sensor: Remove the cover from the connection housing (b).
3. Feed the signal cable (c) and the coil cable (d) through the appropriate cable entries.

   Caution!
   Route the connecting cables securely (see "Length of connecting cable" → 18).
4. Terminate the signal and coil current cable as indicated in the table:
   Promag D/E/L/P/W → Refer to the table → 47
   Promag H → Refer to the "Cable termination" table → 48
5. Establish the wiring between the sensor and the transmitter.
   The electrical wiring diagram that applies to your device can be found:
   – In the corresponding graphic:
   → 28 (Promag D); → 29 (Promag E/L/P/W); → 30 (Promag H)
   – In the cover of the sensor and transmitter

   Note!
   The cable shields of the Promag H sensor are grounded by means of the strain relief terminals (see also the "Cable termination" table → 48)

   Caution!
   Insulate the shields of cables that are not connected to eliminate the risk of short-circuits with neighboring cable shields inside the connection housing.
6. Transmitter: Secure the cover to the connection compartment (a) and tighten the socket head cap screw of the securing clamp.
7. Sensor: Secure the cover on the connection housing (b).

Promag D

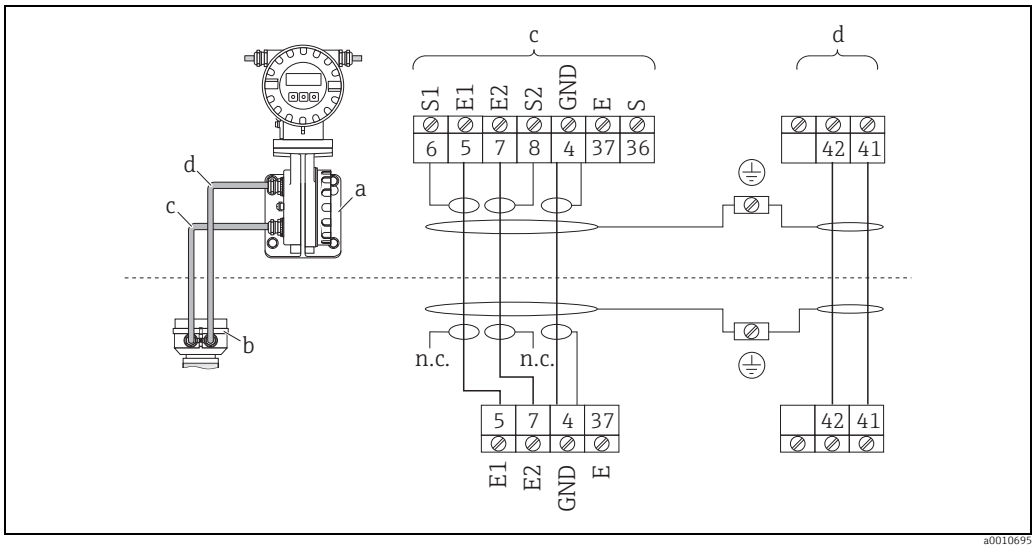


Fig. 28: Connecting the remote version of Promag D

a Wall-mount housing connection compartment
b Cover of the sensor connection housing
c Signal cable
d Coil current cable
n.c. Not connected, insulated cable shields

Wire colors/Terminal No.:
5/6 = braun, 7/8 = white, 4 = green, 37/36 = yellow

Promag E/L/P/W

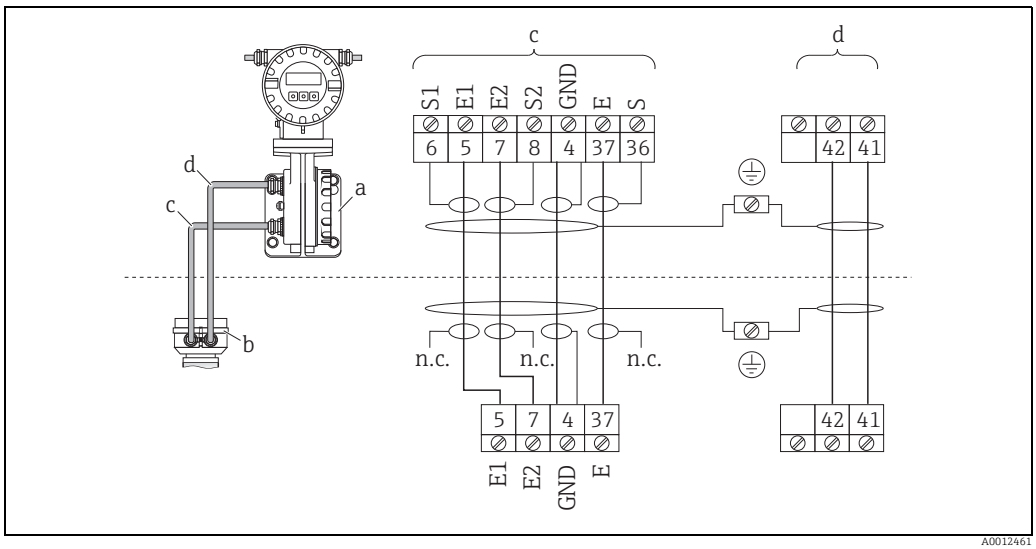


Fig. 29: Connecting the remote version of Promag E/L/P/W

a Wall-mount housing connection compartment
b Cover of the sensor connection housing
c Signal cable
d Coil current cable
n.c. Not connected, insulated cable shields

Wire colors/Terminal No.:
5/6 = braun, 7/8 = white, 4 = green, 37/36 = yellow

Promag H

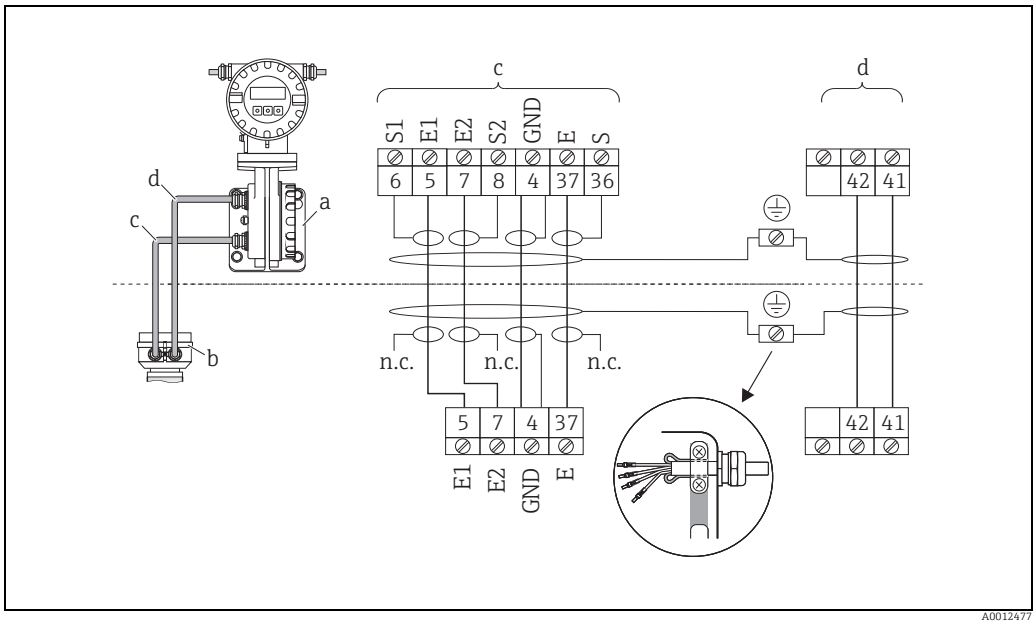


Fig. 30: Connecting the remote version of Promag H

a Wall-mount housing connection compartment
b Cover of the sensor connection housing
c Signal cable
d Coil current cable
n.c. Not connected, insulated cable shields

Wire colors/Terminal No.:
5/6 = braun, 7/8 = white, 4 = green, 37/36 = yellow


Cable termination for the remote version
Promag D/E/L/P/W

Terminate the signal and coil current cables as shown in the figure below (Detail A).
Ferrules must be provided on the fine-wire cores (Detail B: 1 = red ferrules, Ø 1.0 mm; 2 = white ferrules, Ø 0.5 mm).


Caution!
When fitting the connectors, pay attention to the following points:
- *Signal cable* → Make sure that the ferrules do not touch the wire shield on the sensor side.
  Minimum distance = 1 mm (exception "GND" = green cable)
- *Coil current cable* → Insulate one core of the three-core wire at the level of the core reinforcement; you only require two cores for the connection.

TRANSMITTER

Signal cable

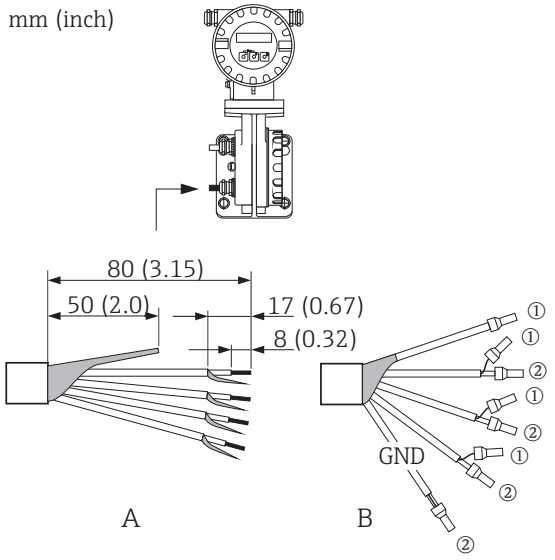


Coil current cable

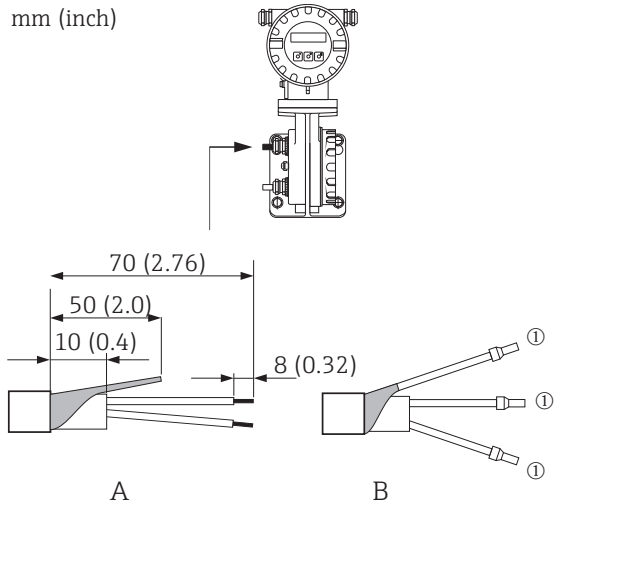


SENSOR

Signal cable

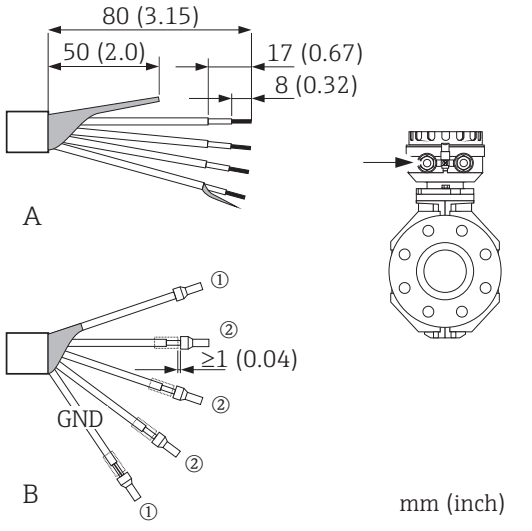

Coil current cable

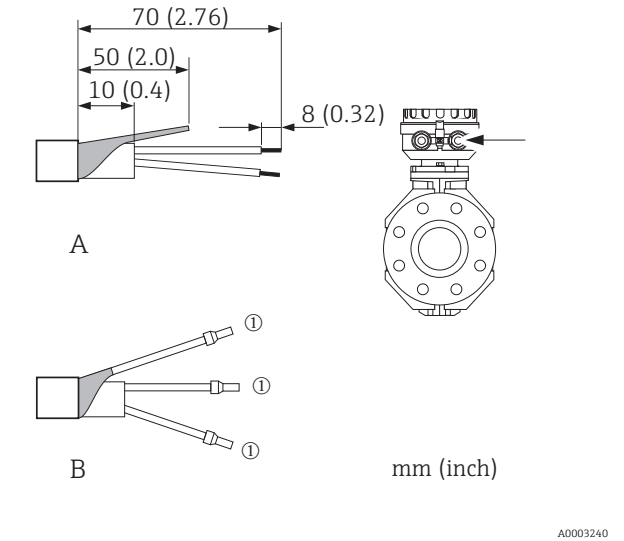


Cable termination for the remote version
Promag H

Terminate the signal and coil current cables as shown in the figure below (Detail A).
Ferrules must be provided on the fine-wire cores (Detail B: 1 = red ferrules, Ø 1.0 mm; 2 = white ferrules, Ø 0.5 mm).


Caution!
When fitting the connectors, pay attention to the following points:
- *Signal cable* → Make sure that the ferrules do not touch the wire shield on the sensor side. Minimum distance = 1 mm (exception "GND" = green cable).
- *Coil current cable* → Insulate one core of the three-core wire at the level of the core reinforcement; you only require two cores for the connection.
- On the sensor side, reverse both cable shields approx. 15 mm over the outer jacket. The strain relief ensures an electrical connection with the connection housing.

TRANSMITTER

Signal cable

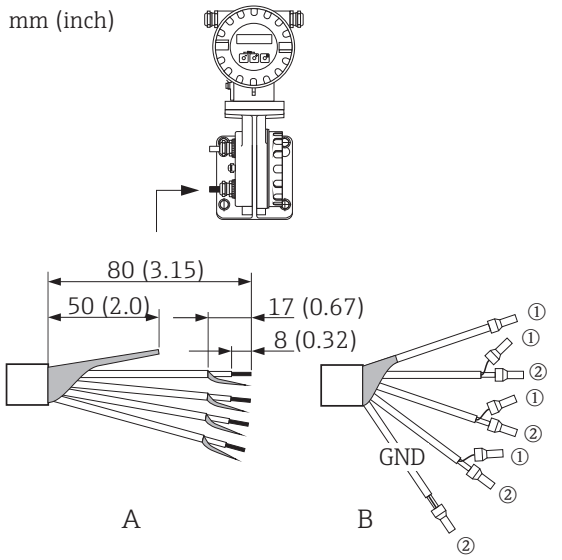


Coil current cable

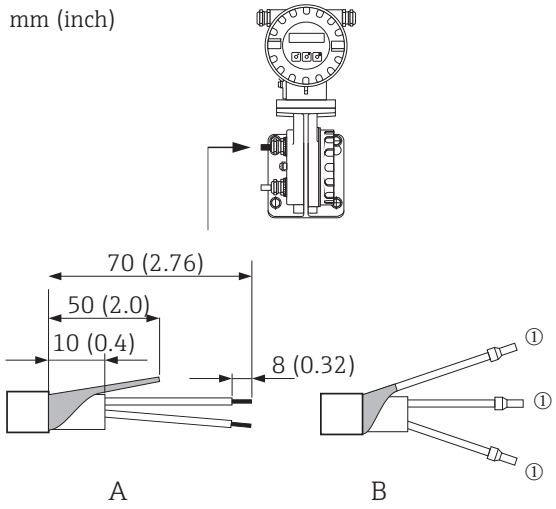


SENSOR

Signal cable

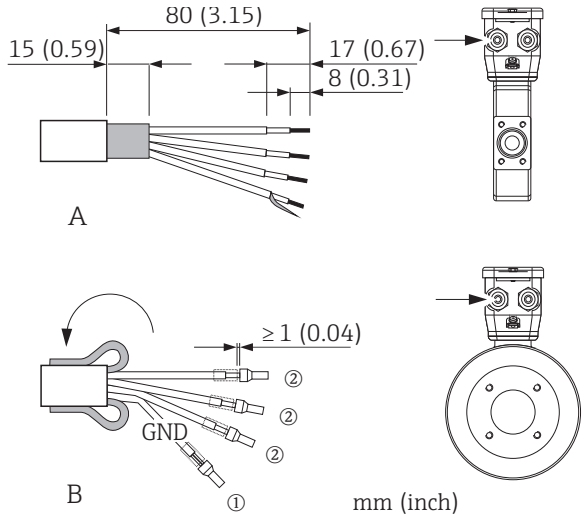

Coil current cable

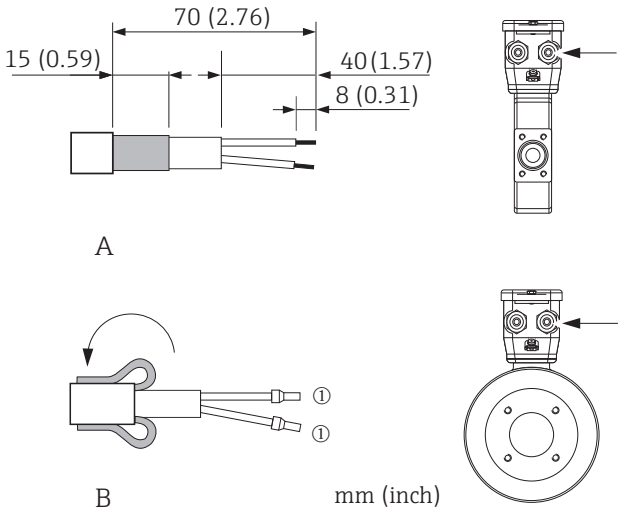

4.1.2 Cable specifications

Electrode cable

- 3 × 0.38 mm² PVC cable with common, braided copper shield (Ø ~ 9.5 mm / 0.37") and individually shielded cores
- With Empty Pipe Detection (EPD): 4 × 0.38 mm² PVC cable with common, braided copper shield (Ø ~ 9.5 mm / 0.37") and individually shielded cores
- Conductor resistance: ≤ 50 Ω/km
- Capacitance: core/shield: ≤ 420 pF/m
- Permanent operating temperature: –20 to +80 °C
- Cable cross-section: max. 2.5 mm²

Coil current cable

- 3 × 0.75 mm² PVC cable with common, braided copper shield (Ø ~9 mm / 0.35")
- Conductor resistance: ≤ 37 Ω/km
- Capacitance: core/core, shield grounded: ≤120 pF/m
- Operating temperature: –20 to +80 °C
- Cable cross-section: max. 2.5 mm²
- Test voltage for cable insulation: ≥1433 V AC r.m.s. 50/60 Hz or ≥2026 V DC

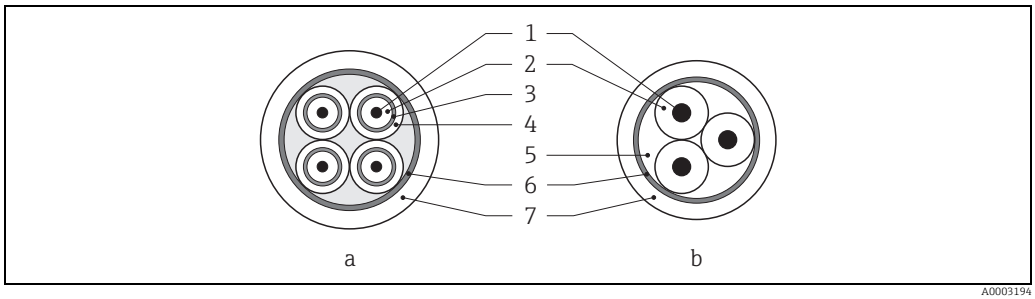


Fig. 31: Cable cross-section

a Signal cable
b Coil current cable

1 Core
2 Core insulation
3 Core shield
4 Core jacket
5 Core reinforcement
6 Cable shield
7 Outer jacket

Operation in zones of severe electrical interference:

The measuring device complies with the general safety requirements in accordance with EN 61010 and the EMC requirements of IEC/EN 61326.

Caution!
Grounding is by means of the ground terminals provided for the purpose inside the connection housing. Ensure that the stripped and twisted lengths of cable shield to the ground terminal are as short as possible.

4.2 Connecting the measuring unit

4.2.1 Transmitter

Warning!
- Risk of electric shock!
  Switch off the power supply before opening the device. **Do not** install or wire the device while it is connected to the power supply. Failure to comply with this precaution can result in irreparable damage to the electronics.
- Risk of electric shock!
  Connect the protective conductor to the ground terminal on the housing before the power supply is applied.
- Compare the specifications on the nameplate with the local supply voltage and frequency. The national regulations governing the installation of electrical equipment also apply.
- The transmitter must be included in the building fuse system.

1. Unscrew cover of the electronics compartment from the transmitter housing.
2. Press the side latches and flip down the cover of the connection compartment.
3. Feed the cable for the power supply and the signal cable through the appropriate cable entries.
4. Remove the terminal connectors from the transmitter housing and connect the cable for the power supply and the signal cable:
   – Wiring diagram → 32
   – Terminal assignment → 51
5. Plug the terminal connectors back into the transmitter housing.

   Note!
   The connectors are coded so you cannot mix them up.
6. Secure the ground cable to the ground terminal.
7. Flip up the cover of the connection compartment.
8. Screw the cover of the electronics compartment firmly onto the transmitter housing.

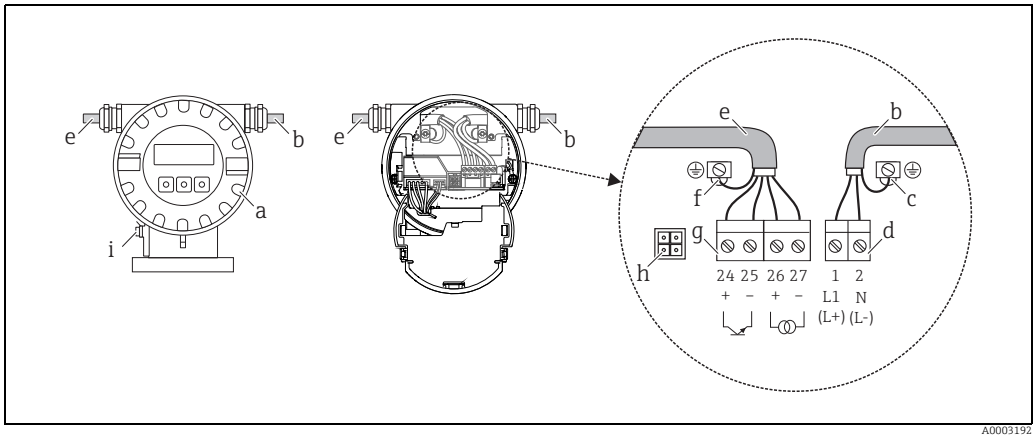


Fig. 32: Connecting the transmitter (aluminum field housing). Cable cross-section: max. 2.5 mm²

a Electronics compartment cover
b Cable for power supply: 85 to 250 V AC, 11 to 40 V DC, 20 to 28 V AC
c Ground terminal for power supply cable
*d Terminal connector for power supply: **No. 1–2** → 51 (terminal assignment)*
e Signal cable
f Ground terminal for signal cable
*g Terminal connector for signal cable: **No. 24–27** → 51 (terminal assignment)*
h Service connector
i Ground terminal for potential equalization

4.2.2 Terminal assignment

Order characteristic for "inputs/outputs"	Terminal No. (outputs/power supply)		
	24 (+) / 25 (–)	26 (+) / 27 (–)	1 (L1/L+) / 2 (N/L–)
A	Pulse output	Current output HART	Power supply

Note!
Functional values of the outputs and power supply → 🖹 85

4.2.3 HART connection

Users have the following connection options at their disposal:
- Direct connection to transmitter by means of terminals 26(+) and 27 (-)
- Connection by means of the 4 to 20 mA circuit.
- The measuring loop's minimum load must be at least 250 Ω.
- After commissioning, make the following settings:
  – CURRENT SPAN function → "4–20 mA HART"
  – Switch HART write protection on or off → 🖹 62

Connection of the HART handheld communicator

See also the documentation issued by the HART Communication Foundation, and in particular HCF LIT 20: "HART, a technical summary".

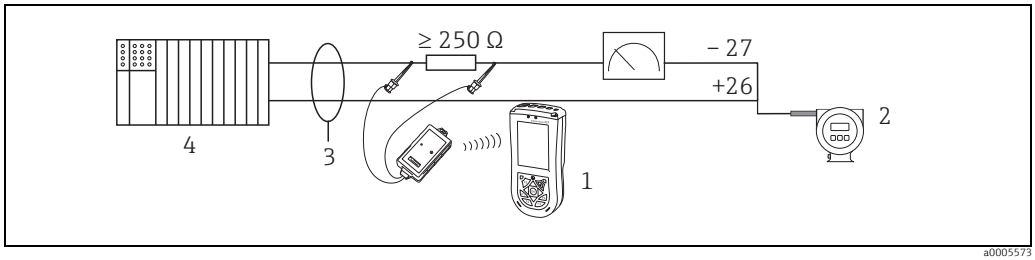


Fig. 33: Electrical connection of HART handheld Field Xpert SFX100

1 HART handheld Field Xpert SFX100
2 Auxiliary energy
3 Shielding
4 Other devices or PLC with passive input

Connection of a PC with an operating software

In order to connect a PC with an operating software (e.g. "FieldCare), a HART modem (e.g. Commubox FXA 195) is needed.

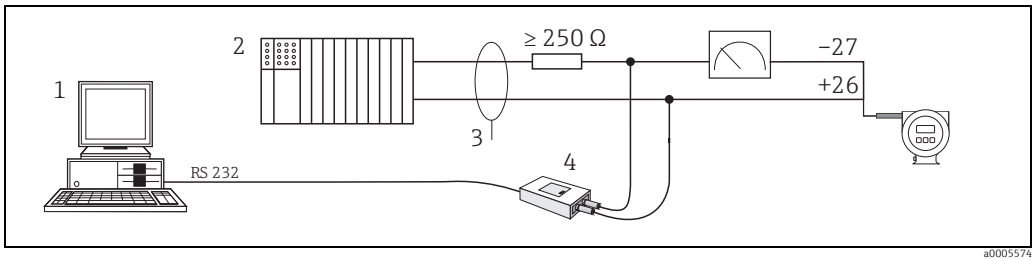


Fig. 34: Electrical connection of a PC with an operating software

1 PC with an operating software
2 Other evaluation devices or PLC with passive input
3 Shield
4 HART modem, e.g. Commubox FXA 195

4.3 Potential equalization

Warning!
The measuring system must be included in the potential equalization.

Perfect measurement is only ensured when the fluid and the sensor have the same electrical potential. This is ensured by the reference electrode integrated in the sensor as standard.

The following should also be taken into consideration for potential equalization:
- Internal grounding concepts in the company
- Operating conditions, such as the material/grounding of the pipes (see Table)

4.3.1 Potential equalization for Promag D

- No reference electrode is integrated!
  For the two ground disks of the sensor an electrical connection to the fluid is always ensured.
- Exampels for connections → 52

4.3.2 Potential equalization for Promag E/L/P/W

- Reference electrode integrated in the sensor as standard
- Exampels for connections → 53


4.3.3 Potential equalization for Promag H

No reference electrode is integrated!
For the metal process connections of the sensor an electrical connection to the fluid is always ensured.



Caution!
If using process connections made of a synthetic material, ground rings have to be used to ensure that potential is equalized (→ 27). The necessary ground rings can be ordered separately from Endress+Hauser as accessories (→ 72).

4.3.4 Exampels for potential equalization connections for Promag D

Standard case

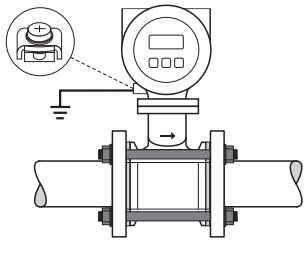
Operating conditions	Potential equalization
When using the measuring device in a: ▪ Metal, grounded pipe ▪ Plastic pipe ▪ Pipe with insulating lining Potential equalization takes place via the ground terminal of the transmitter (standard situation). Note! When installing in metal pipes, we recommend you connect the ground terminal of the transmitter housing with the piping.	 a0010702 *Fig. 35: Via the ground terminal of the transmitter*

Special cases for Promag D as wafer version


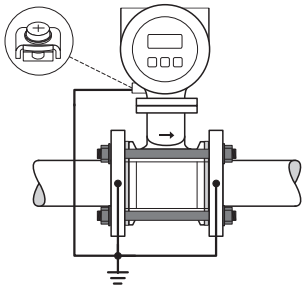

Operating conditions	Potential equalization
When using the measuring device in a: ▪ Metal pipe that is not grounded This connection method also applies in situations where: ▪ Customary potential equalization cannot be ensured ▪ Excessively high equalizing currents can be expected Potential equalization takes place via the ground terminal of the transmitter and the two pipe flanges. Here, the ground cable (copper wire, 6 mm² / 0.0093 in²) is mounted directly on the conductive flange coating with flange screws.	 a0010703 *Fig. 36: Via the ground terminal of the transmitter and the flanges of the pipe*
When using the measuring device in a: ▪ Pipe with a cathodic protection unit The device is installed potential-free in the pipe. Only the two flanges of the pipe are connected with a ground cable (copper wire, 6 mm² / 0.0093 in²). Here, the ground cable is mounted directly on the conductive flange coating with flange screws. Note the following when installing: ▪ The applicable regulations regarding potential-free installation must be observed. ▪ There should be **no** electrically conductive connection between the pipe and the device. ▪ The mounting material must withstand the applicable torques.	 a0010704 *Fig. 37: Potential equalization and cathodic protection* *1 Power supply isolation transformer* *2 Electrically isolated*

4.3.5 Exampels for potential equalization connections for Promag E/L/P/W

Standard case

Operating conditions	Potential equalization
When using the measuring device in a: ▪ Metal, grounded pipe Potential equalization takes place via the ground terminal of the transmitter (standard situation). ✎ Note! When installing in metal pipes, we recommend you connect the ground terminal of the transmitter housing with the piping.	 a0010702 *Fig. 38: Via the ground terminal of the transmitter*

Special cases

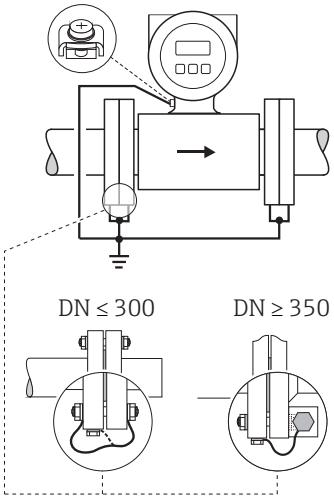Operating conditions	Potential equalization
When using the measuring device in a: ▪ Metal pipe that is not grounded This connection method also applies in situations where: ▪ Customary potential equalization cannot be ensured ▪ Excessively high equalizing currents can be expected Both sensor flanges are connected to the pipe flange by means of a ground cable (copper wire, 6 mm² / 0.0093 in²) and grounded. Connect the transmitter or sensor connection housing, as applicable, to ground potential by means of the ground terminal provided for the purpose. Ground cable installation depends on the nominal diameter: ▪ DN ≤ 300: The ground cable is mounted directly on the conductive flange coating with the flange screws. ▪ DN ≥ 350: The ground cable is mounted directly on the metal transport bracket. Note! The ground cable for flange-to-flange connections can be ordered separately as an accessory from Endress+Hauser.	 *Fig. 39: Via the ground terminal of the transmitter and the flanges of the pipe*
When using the measuring device in a: ▪ Plastic pipe ▪ Pipe with insulating lining This connection method also applies in situations where: ▪ Customary potential equalization cannot be ensured ▪ Excessively high equalizing currents can be expected Potential equalization takes place using additional ground disks, which are connected to the ground terminal via a ground cable (copper wire, min. 6 mm² / 0.0093 in²). When installing the ground disks, please comply with the enclosed Installation Instructions.	 *Fig. 40: Via the ground terminal of the transmitter*
When using the measuring device in a: ▪ Pipe with a cathodic protection unit The device is installed potential-free in the pipe. Only the two flanges of the pipe are connected with a ground cable (copper wire, 6 mm² / 0.0093 in²). Here, the ground cable is mounted directly on the conductive flange coating with flange screws. Note the following when installing: ▪ The applicable regulations regarding potential-free installation must be observed. ▪ There should be **no** electrically conductive connection between the pipe and the device. ▪ The mounting material must withstand the applicable torques.	 *Fig. 41: Potential equalization and cathodic protection* *1 Power supply isolation transformer* *2 Electrically isolated*

4.4 Degree of protection

The devices meet all the requirements of IP 67 degree of protection.

Compliance with the following points is mandatory following installation in the field or servicing in order to ensure that IP 67 protection is maintained:
- The housing seals must be clean and undamaged when inserted into their grooves. The seals must be dried, cleaned or replaced if necessary.
- All threaded fasteners and screw covers must be firmly tightened.
- The cables used for connection must be of the specified outside diameter → 49.
- Firmly tighten the cable entries.
- The cables must loop down before they enter the cable entries ("water trap"). This arrangement prevents moisture penetrating the entry. Always install the measuring device in such a way that the cable entries do not point up.
- Remove all unused cable entries and insert plugs instead.
- Do not remove the grommet from the cable entry.

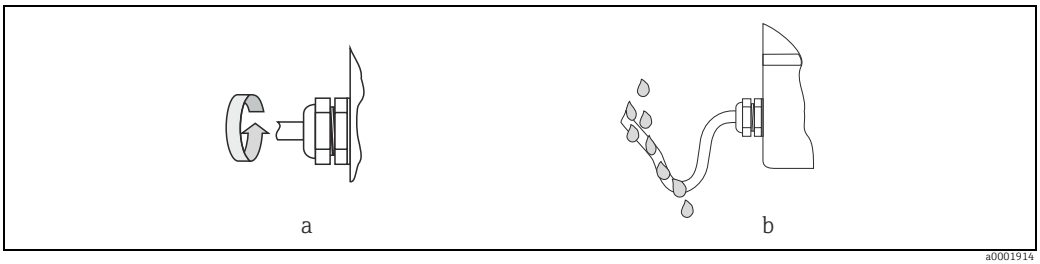


Fig. 42: Installation instructions, cable entries

Caution!
Do not loosen the threaded fasteners of the sensor housing, as otherwise the degree of protection guaranteed by Endress+Hauser no longer applies.

Note!
- The Promag E/L/P/W sensors can be supplied with IP 68 rating (permanent immersion in water to a depth of 3 meters (10 ft)). In this case the transmitter must be installed remote from the sensor.
- The Promag L sensors with IP 68 rating are only available with stainless steel flanges.
- The remote version in IP67, type 6 of Promag L sensors is available for temporary use in water.

4.5 Post-connection check

Perform the following checks after completing electrical installation of the measuring device:

Device condition and specifications	Notes
Are cables or the device damaged (visual inspection)?	–
Electrical connection	**Notes**
Does the supply voltage match the specifications on the nameplate?	▪ 85 to 250 V AC (50 to 60 Hz) ▪ 20 to 28 V AC (50 to 60 Hz), 11 to 40 V DC
Do the cables used comply with the necessary specifications?	→ 🖹 49
Do the cables have adequate strain relief?	–
Is the cable type route completely isolated? Without loops and crossovers?	–
Are the power-supply and signal cables correctly connected?	See the wiring diagram inside the cover of the terminal compartment
Only remote version: Is the flow sensor connected to the matching transmitter electronics?	Check serial number on nameplates of sensor and connected transmitter.
Only remote version: Is the connecting cable between sensor and transmitter connected correctly?	→ 🖹 44
Are all screw terminals firmly tightened?	–
Have the measures for grounding/potential equalization been correctly implemented?	→ 🖹 52
Are all cable entries installed, firmly tightened and correctly sealed? Cables looped as "water traps"?	→ 🖹 55
Are all housing covers installed and firmly tightened?	–

5 Operation

5.1 Display and operating elements

The local display enables you to read all important parameters directly at the measuring point and configure the device.
The display area consists of two lines; this is where measured values are displayed, and/or status variables (partially filled pipe, etc.). The assignment of the display lines in operating mode is specified. The top line displays the volume flow and the bottom line displays the totalizer status.

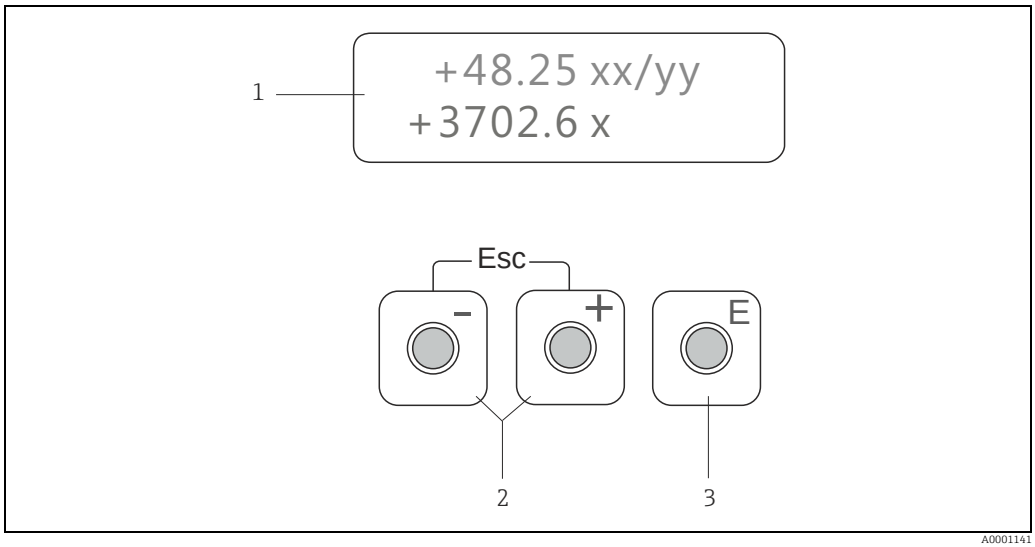


Fig. 43: Display and operating elements

1 Liquid crystal display
The two-line liquid-crystal display shows measured values, dialog texts, error messages and information messages. The display as it appears when normal measuring is in progress is known as the HOME position (operating mode).
- *Upper display line: Shows primary measured values, e.g. volume flow [e.g. in ml/min]*
- *Lower display line: Shows the totalizer status, [e.g. in m^3]*

2 Plus/minus keys
- *Enter numerical values, select parameters*
- *Select different function groups within the function matrix*

Press the +/- keys simultaneously to trigger the following functions:
- *Exit the function matrix step by step → HOME position*
- *Press and hold down +/- keys for longer than 3 seconds → Return directly to HOME position*
- *Cancel data entry*

3 Enter key
- *HOME position → Entry into the function matrix*
- *Save the numerical values you input or settings you change*

5.2 Brief operating instructions on the function matrix

Note!
- See the general notes on → 59.
- Function matrix overview → 109
- Detailed description of all functions → 110 ff.

The function matrix comprises two levels, namely the function groups and the functions of the function groups.
The groups are the highest-level grouping of the control options for the device. A number of functions is assigned to each group. You select a group in order to access the individual functions for operating and configuring the device.

1. HOME position → E → Enter the function matrix
2. Select a function group (e.g. OPERATION)
3. Select a function (e.g. LANGUAGE)
   Change parameter/enter numerical values:
   ± → select or enter enable code, parameters, numerical values
   E → save your entries
4. Exit the function matrix:
   – Press and hold down Esc key (Esc −/+)→ for longer than 3 seconds→ HOME position
   – Repeatedly press Esc key (Esc −/+)→ return step by step to HOME position

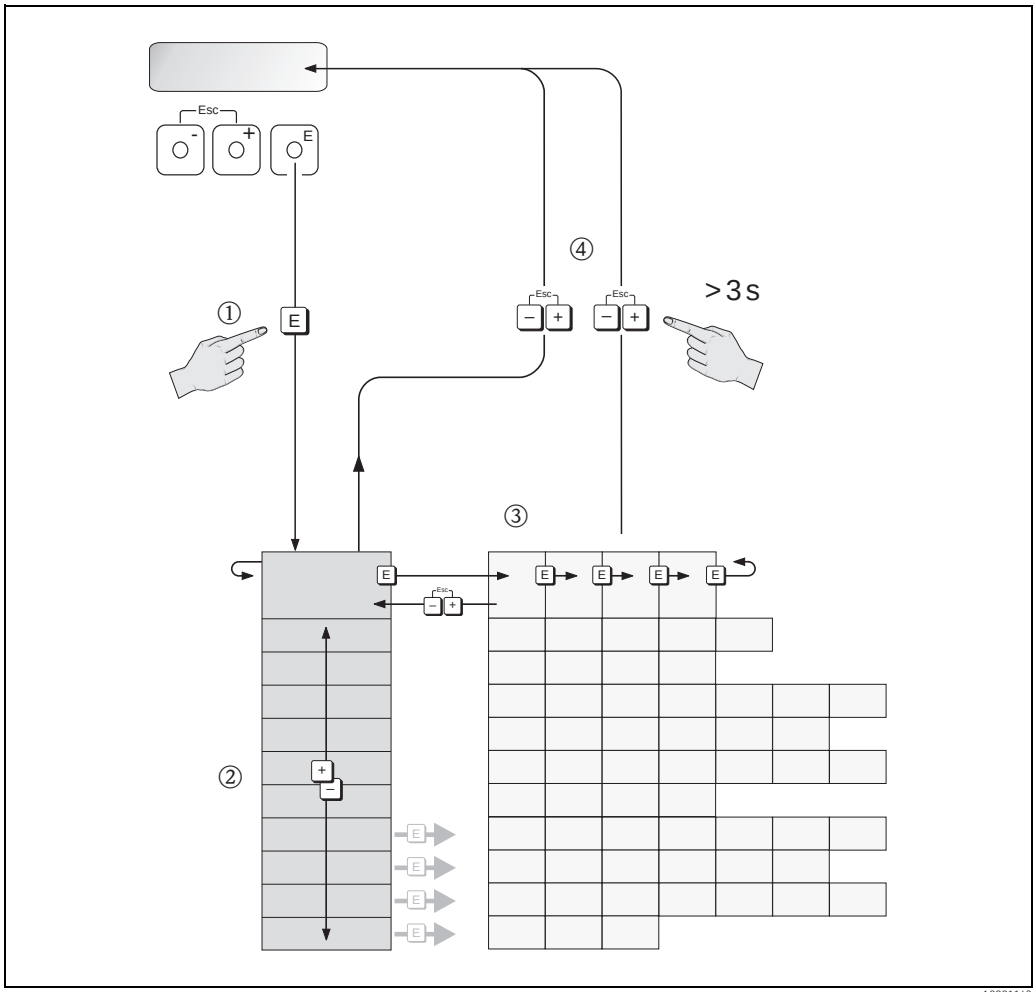


Fig. 44: Selecting functions and configuring parameters (function matrix)

5.2.1 General notes

The brief commissioning guide (→ 68) is adequate for commissioning in most instances. Complex measuring operations on the other hand necessitate additional functions that you can configure as necessary and customize to suit your process parameters. The function matrix, therefore, comprises a multiplicity of additional functions which, for the sake of clarity, are arranged in a number of function groups.

Comply with the following instructions when configuring functions:
- You select functions as described on → 58.
- You can switch off certain functions (OFF). If you do so, related functions in other function groups will no longer be displayed.
- Certain functions prompt you to confirm your data entries.
  Press P to select "SURE [YES]" and press E again to confirm. This saves your setting or starts a function, as applicable.
- Return to the HOME position is automatic if no key is pressed for 5 minutes.

Note!
- The transmitter continues to measure while data entry is in progress, i.e. the current measured values are output via the signal outputs in the normal way.
- If the power supply fails, all preset and configured values remain safely stored in the EEPROM.

5.2.2 Enabling the programming mode

The function matrix can be disabled. Disabling the function matrix rules out the possibility of inadvertent changes to device functions, numerical values or factory settings. A numerical code (factory setting = 10) has to be entered before settings can be changed.
If you use a code of your choice, you exclude the possibility of unauthorized persons accessing data, see ACCESS CODE function → 112.

Comply with the following instructions when entering codes:
- If programming is disabled and the operating elements are pressed in any function, a prompt for the code automatically appears on the display.
- If "0" is specified as the customer's code, programming is always enabled.
- The Endress+Hauser service organization can be of assistance if you mislay your personal code.

Caution!
Changing certain parameters such as all sensor characteristics, for example, influences numerous functions of the entire measuring system, particularly measuring accuracy. Normally, such parameters may not be changed! Please contact Endress+Hauser if you have any questions.

5.2.3 Disabling the programming mode

Programming is disabled if you do not press the operating elements within 60 seconds following automatic return to the HOME position.
You can also disable programming in the "ACCESS CODE" function by entering any number (other than the customer's code).

5.3 Displaying error messages

5.3.1 Type of error

Errors which occur during commissioning or measuring operation are displayed immediately. If two or more system or process errors occur, the error with the highest priority is the one shown on the display.

The measuring system distinguishes between two types of error:
- *System errors* → 📄 *76:*
  This group comprises all device errors, e.g. communication errors, hardware faults, etc.
- *Process errors* → 📄 77:
  This group comprises all application errors, e.g. empty pipe, etc.

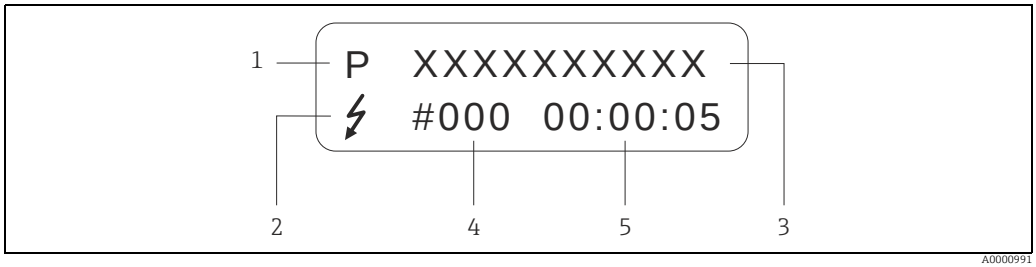


Fig. 45: Error messages on the display (example)

1 Error type:
– P = process error
– S = system error
2 Error message type:
– ϟ = fault message
– ! = notice message
3 Error designation: e.g. EMPTY PIPE = measuring tube is only partly filled or completely empty
4 Error number: e.g. #401
5 Duration of most recent error occurrence (in hours, minutes and seconds)

5.3.2 Error message types

Notice message (!)

- Displayed as → Exclamation mark (!), error type (S: system error, P: process error)
- The error in question has no effect on the outputs of the measuring device.

Fault message (ϟ)

- Displayed as → Lightning flash (ϟ), error type (S: system error, P: process error).
- The error in question has a direct effect on the outputs.
  The response of the individual outputs (failsafe mode) can be defined in the function matrix using the "FAILSAFE MODE" function → 📄 130.

Note!
For security reasons, error messages should be output via the status output.

5.4 Communication

In addition to local operation, the measuring device can be configured and measured values can be obtained by means of the HART protocol. Digital communication takes place using the 4–20 mA current output HART → 🖹 51.

The HART protocol allows the transfer of measuring and device data between the HART master and the field devices for configuration and diagnostics purposes.
The HART master, e.g. a handheld terminal or PC-based operating programs (such as FieldCare), require device description (DD) files which are used to access all the information in a HART device. Information is exclusively transferred using so-called "commands". There are three different command classes:

- *Universal commands:*
  All HART device support and use universal commands.
  The following functionalities are linked to them:
  – Identify HART devices
  – Reading digital measured values (volume flow, totalizer, etc.)
- *Common practice commands:*
  Common practice commands offer functions which are supported and can be executed by most but not all field devices.
- *Device-specific commands:*
  These commands allow access to device-specific functions which are not HART standard. Such commands access individual field device information, amongst other things, such as empty/full pipe calibration values, low flow cutoff settings, etc.



Note!
The device has access to all three command classes. A list of all the "Universal commands" and "Common practice commands" is provided on → 🖹 63.

5.4.1 Operating options

For the complete operation of the measuring device, including device-specific commands, there are DD files available to the user to provide the following operating aids and programs:

Field Xpert HART Communicator

Selecting device functions with a HART Communicator is a process involving a number of menu levels and a special HART function matrix.
The HART manual in the carrying case of the HART Communicator contains more detailed information on the device.

Operating program "FieldCare"

FieldCare is Endress+Hauser's FDT-based plant Asset Management Tool and allows the configuration and diagnosis of intelligent field devices. By using status information, you also have a simple but effective tool for monitoring devices. The Proline flow measuring devices are accessed via a service interface or via the service interface FXA193.

Operating program "SIMATIC PDM" (Siemens)

SIMATIC PDM is a standardized, manufacturer-independent tool for the operation, configuration, maintenance and diagnosis of intelligent field devices.

Operating program "AMS" (Emerson Process Management)

AMS (Asset Management Solutions): program for operating and configuring devices.

5.4.2 Current device description files

The following table illustrates the suitable device description file for the operating tool in question and then indicates where these can be obtained.

HART protocol:

Valid for device software:	1.04.XX	→ Function DEVICE SOFTWARE
Device data HART Manufacturer ID: Device ID:	 11_{hex} (ENDRESS+HAUSER) 56_{hex}	 → Function MANUFACTURER ID → Function DEVICE ID
HART version data:	Device Revision 5/ DD Revision 1	
Software release:	01.2012	

Operating program:	Sources for obtaining device descriptions:
Handheld Field Xpert SFX100	Use update function of handheld terminal
FieldCare / DTM	▪ www.endress.com → Download ▪ CD-ROM (Endress+Hauser order number 56004088) ▪ DVD (Endress+Hauser order number 70100690)
AMS	www.endress.com → Download
SIMATIC PDM	www.endress.com → Download

Tester/simulator:	Sources for obtaining device descriptions:
Fieldcheck	Update by means of FieldCare with the flow device FXA193/291 DTM in the Fieldflash module

Note!
The "Fieldcheck" tester/simulator is used for testing flowmeters in the field. When used in conjunction with the "FieldCare" software package, test results can be imported into a database, printed out and used for official certification. Contact your Endress+Hauser representative for more information.

5.4.3 Device variables

The following device variables are available using the HART protocol:

Code (decimal)	Device variable
0	OFF (not assigned)
1	Volume flow
250	Totalizer

At the factory, the process variables are assigned to the following device variables:
- Primary process variable (PV) → Volume flow
- Second process variable (SV) → Totalizer
- Third process variable (TV) → not assigned
- Fourth process variable (FV) → not assigned

5.4.4 Switching HART write protection on/off

The HART write protection can be switched on and off using the HART WRITE PROTECT device function → 122.

5.4.5 Universal and common practice HART commands

The following table contains all the universal commands supported by the device.

Command No. HART command / Access type		Command data (numeric data in decimal form)	Response data (numeric data in decimal form)
Universal commands			
0	Read unique device identifier Access type = read	none	Device identification delivers information on the device and the manufacturer. It cannot be changed. The response consists of a 12 byte device ID: – Byte 0: fixed value 254 – Byte 1: Manufacturer ID, 17 = E+H – Byte 2: Device type ID, 69 = Promag 10 – Byte 3: Number of preambles – Byte 4: Universal commands rev. no. – Byte 5: Device-specific commands rev. no. – Byte 6: Software revision – Byte 7: Hardware revision – Byte 8: Additional device information – Bytes 9-11: Device identification
1	Read primary process variable Access type = read	none	– Byte 0: HART unit code of the primary process variable – Bytes 1-4: Primary process variable Factory setting: Primary process variable = Volume flow ✎ Note! Manufacturer-specific units are represented using the HART unit code "240".
2	Read the primary process variable as current in mA and percentage of the set measuring range Access type = read	none	– Bytes 0-3: actual current of the primary process variable in mA – Bytes 4-7: % value of the set measuring range Factory setting: Primary process variable = Volume flow
3	Read the primary process variable as current in mA and four dynamic process variables Access type = read	none	24 bytes are sent as a response: – Bytes 0-3: primary process variable current in mA – Byte 4: HART unit code of the primary process variable – Bytes 5-8: Primary process variable – Byte 9: HART unit code of the second process variable – Bytes 10-13: Second process variable – Byte 14: HART unit code of the third process variable – Bytes 15-18: Third process variable – Byte 19: HART unit code of the fourth process variable – Bytes 20-23: Fourth process variable *Factory setting:* ▪ Primary process variable = Volume flow ▪ Second process variable = Totalizer ▪ Third process variable = OFF (not assigned) ▪ Fourth process variable = OFF (not assigned) The assignment of the process variables is fixed and cannot be changed. ✎ Note! Manufacturer-specific units are represented using the HART unit code "240".
6	Set HART shortform address Access type = write	Byte 0: desired address (0 to 15) Factory setting: 0 ✎ Note! With an address >0 (multidrop mode), the current output of the primary process variable is set to 4 mA.	Byte 0: active address

Command No. HART command / Access type		Command data (numeric data in decimal form)	Response data (numeric data in decimal form)
11	Read unique device identification using the TAG (measuring point designation) Access type = read	Bytes 0-5: TAG	Device identification delivers information on the device and the manufacturer. It cannot be changed. The response consists of a 12 byte device ID if the given TAG agrees with the one saved in the device: – Byte 0: fixed value 254 – Byte 1: Manufacturer ID, 17 = E+H – Byte 2: Device type ID, 69 = Promag 10 – Byte 3: Number of preambles – Byte 4: Universal commands rev. no. – Byte 5: Device-specific commands rev. no. – Byte 6: Software revision – Byte 7: Hardware revision – Byte 8: Additional device information – Bytes 9-11: Device identification
12	Read user message Access type = read	none	Bytes 0-24: User message Note! You can write the user message using Command 17.
13	Read TAG, descriptor and date Access type = read	none	– Bytes 0-5: TAG – Bytes 6-17: descriptor – Bytes 18-20: Date Note! You can write the TAG, descriptor and date using Command 18.
14	Read sensor information on primary process variable	none	– Bytes 0-2: Sensor serial number – Byte 3: HART unit code of sensor limits and measuring range of the primary process variable – Bytes 4-7: Upper sensor limit – Bytes 8-11: Lower sensor limit – Bytes 12-15: Minimum span Note! ▪ The data relate to the primary process variable (= volume flow). ▪ Manufacturer-specific units are represented using the HART unit code "240".
15	Read output information of primary process variable Access type = read	none	– Byte 0: Alarm selection ID – Byte 1: Transfer function ID – Byte 2: HART unit code for the set measuring range of the primary process variable – Bytes 3-6: upper range, value for 20 mA – Bytes 7-10: lower range, value for 4 mA – Bytes 11-14: Damping constant in [s] – Byte 15: Write protection ID – Byte 16: OEM dealer ID, 17 = E+H Factory setting: Primary process variable = Volume flow Note! Manufacturer-specific units are represented using the HART unit code "240".
16	Read the device production number Access type = read	none	Bytes 0-2: Production number
17	Write user message Access = write	Save any 32-character text in the device. Bytes 0-23: Desired user message	Displays the current user message in the device: Bytes 0-23: Current user message in the device
18	Write TAG, descriptor and date Access = write	With this parameter, you can store an 8 character TAG, a 16 character descriptor and a date: – Bytes 0-5: TAG – Bytes 6-17: descriptor – Bytes 18-20: Date	Displays the current information in the device: – Bytes 0-5: TAG – Bytes 6-17: descriptor – Bytes 18-20: Date
19	Write the device production number Access = write	Bytes 0-2: Production number	Bytes 0-2: Production number

The following table contains all the common practice commands supported by the device:

Command No. HART command / Access type		Command data (numeric data in decimal form)	Response data (numeric data in decimal form)
Common practice commands			
34	Write damping value for primary process variable Access = write	Bytes 0-3: Damping value of the primary process variable "volume flow" in seconds *Factory setting:* Primary process variable = Current output damping	Displays the current damping value in the device: Bytes 0-3: Damping value in seconds
35	Write measuring range of primary process variable Access = write	Write the desired measuring range: – Byte 0: HART unit code of the primary process variable – Bytes 1-4: upper range, value for 20 mA – Bytes 5-8: lower range, value for 4 mA *Factory setting:* Primary process variable = Volume flow Note! ▪ The start of the measuring range (4 mA) must correspond to the zero flow. ▪ If the HART unit code is not the correct one for the process variable, the device will continue with the last valid unit.	The currently set measuring range is displayed as a response: – Byte 0: HART unit code for the set measuring range of the primary process variable – Bytes 1-4: upper range, value for 20 mA – Bytes 5-8: lower range, value for 4 mA Note! Manufacturer-specific units are represented using the HART unit code "240".
38	Device status reset (configuration changed) Access = write	none Note! It is also possible to execute this HART command when write protection is activated (= ON)!	none
40	Simulate input current of primary process variable Access = write	Simulation of the desired output current of the primary process variable. An entry value of 0 exits the simulation mode: Bytes 0-3: Output current in mA *Factory setting:* Primary process variable = Volume flow Note! You can set the assignment of device variables to process variables using Command 51.	The momentary output current of the primary process variable is displayed as a response: Bytes 0-3: Output current in mA
42	Perform master reset Access = write	none	none
44	Write unit of primary process variable Access = write	Set unit of primary process variable. Only units which are suitable for the process variable are transferred to the device: Byte 0: HART unit code *Factory setting:* Primary process variable = Volume flow Note! ▪ If the written HART unit code is not the correct one for the process variable, the device will continue with the last valid unit. ▪ If you change the unit of the primary process variable, this has a direct impact on the system units.	The current unit code of the primary process variable is displayed as a response: Byte 0: HART unit code Note! Manufacturer-specific units are represented using the HART unit code "240".
48	Read additional device status Access = read	none	The device status is displayed in extended form as the response: Coding: see table → 67.

Command No. HART command / Access type		Command data (numeric data in decimal form)	Response data (numeric data in decimal form)
50	Read assignment of the device variables to the four process variables Access = read	none	Display of the current variable assignment of the process variables: – Byte 0: Device variable code to the primary process variable – Byte 1: Device variable code to the second process variable – Byte 2: Device variable code to the third process variable – Byte 3: Device variable code to the fourth process variable *Factory setting:* ▪ Primary process variable: Code 1 for volume flow ▪ Second process variable: Code 250 for totalizer ▪ Third process variable: Code 0 for OFF (not assigned) ▪ Fourth process variable: Code 0 for OFF (not assigned)
53	Write device variable unit Access = write	This command sets the unit of the given device variables. Only those units which suit the device variable are transferred: – Byte 0: Device variable code – Byte 1: HART unit code *Code of the supported device variables:* See information → 🖹 62 ✎ Note! ▪ If the written unit is not the correct one for the device variable, the device will continue with the last valid unit. ▪ If you change the unit of the device variable, this has a direct impact on the system units.	The current unit of the device variables is displayed in the device as a response: – Byte 0: Device variable code – Byte 1: HART unit code ✎ Note! Manufacturer-specific units are represented using the HART unit code "240".
59	Write number of preambles in response message Access = write	This parameter sets the number of preambles which are inserted in the response messages: Byte 0: Number of preambles (4 to 20)	As a response, the current number of the preambles is displayed in the response message: Byte 0: Number of preambles

5.4.6 Device status and error messages

You can read the extended device status, in this case, current error messages, via Command "48". The command delivers information which is partly coded in bits (see table below).

Note!
- You can find a detailed explanation of the device status and error messages and their elimination on → 67
- Bits and bytes not listed are not assigned.

Byte	Bit	Error No.	Short error description
0	0	001	Serious device error
	1	011	Measuring amplifier has faulty EEPROM
	2	012	Error when accessing data of the measuring amplifier EEPROM
3	3	111	Totalizer checksum error
5	0	321	Coil current of the sensor is outside the tolerance.
7	3	351	Current output: Flow is out of range
8	3	359	Pulse output: The pulse output frequency is out of range
10	7	401	Measuring tube partially filled or empty
11	2	461	EPD calibration not possible because the fluid's conductivity is either too low or too high
	4	463	The EPD calibration values for empty pipe and full pipe are identical, and therefore incorrect.
12	7	501	Amplifier software version is loaded. Currently no other commands are possible.
14	3	601	Positive zero return active
18	3	691	Simulation of response to error (outputs) active
	4	692	Simulation of volume flow active

6 Commissioning

6.1 Function check

Make sure that all final checks have been completed before you start up your measuring point:
- Checklist for "Post-installation check" → 📄 43
- Checklist for "Post-connection check" → 📄 56

6.2 Switching on the measuring device

Once the connection checks have been successfully completed, it is time to switch on the power supply. The device is now operational. The measuring device performs a number of post switch-on self-tests. As this procedure progresses the following sequence of messages appears on the local display:

PROMAG 10 **V 1.XX.XX**

Start-up message

Normal measuring mode commences as soon as start-up completes.
Various measured-value and/or status variables (HOME position) appear on the display.



Note!
If start-up fails, an error message indicating the cause is displayed.

6.3 Brief commissioning guide

HOME position → E → +

Configure display	
UI language	→ 📄 112
Display contrast	→ 📄 113
Number of decimal places	→ 📄 113

Select engineering units	
Volume flow	→ 📄 110
Totalizer	→ 📄 114

Configure outputs			
Current output		*Pulse/status output*	
Current range	→ 📄 115	Operating mode	→ 📄 117
Full scale value	→ 📄 116	Pulse value	→ 📄 117
		Pulse width	→ 📄 117
		or	
		Assign status output	→ 📄 118
		Switch-on point	→ 📄 118

Complex applications The quickest way to find information on configuring additional functions is via the following pages:	
Operating matrix	→ 📄 109
Index	→ 📄 136

For optimum measurement results	
Low flow cut off	→ 📄 123
Empty pipe detection	→ 📄 123

6.4 Commissioning after installing a new electronics board

After startup, the device checks whether a serial number is available. If this is not the case, the following setup is started. Installing a new electronics board → 81.

6.4.1 "Commissioning" setup

Note!
- The setup can no longer be called up once a serial number has been entered and stored. If a parameter is entered incorrectly during the setup, this must be corrected in the relevant function via the function matrix.
- The appropriate information is documented on the nameplate of the sensor and on the inside of the housing cover, → 2 → 7.

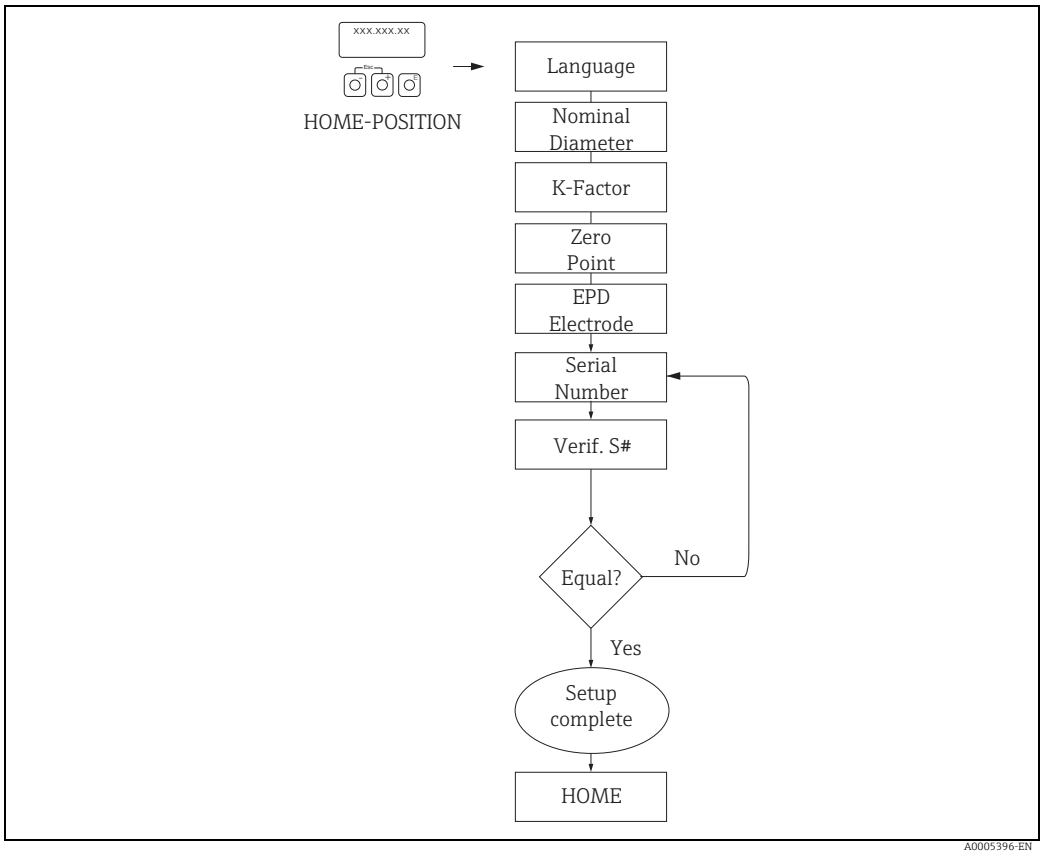


Fig. 46: The "Commissioning" setup starts after installation of a new electronics board if no serial number is present.

6.5 Empty-pipe/full-pipe adjustment

Flow cannot be measured correctly unless the measuring tube is completely full.
This status can be permanently monitored using the Empty Pipe Detection:
EPD = Empty Pipe Detection (with the help of an EPD electrode)

Caution!
More detailed information on empty-pipe and full-pipe adjustment can be found in the description of the functions:
- EPD ADJUSTMENT (carrying out the adjustment) → 124.
- EPD (switching empty pipe detection on and off) → 123

Note!
- The EPD function is not available unless the sensor is fitted with an EPD electrode.
- The devices are already calibrated at the factory with water (approx. 500 µS/cm). If the fluid conductivity differs from this reference, empty-pipe/full-pipe adjustment has to be performed again on site.
- The default setting for EPD when the devices are delivered is OFF; the function has to be activated if required.
- The EPD process error can be output by means of the configurable status output.

6.5.1 Performing empty-pipe and full-pipe adjustment (EPD)

1. Select the appropriate function in the function matrix:
   HOME → E → + →PROCESS PARAMETER → E → + →EPD ADJUSTMENT
2. Empty the piping. The wall of the measuring tube should still be wet with fluid during EPD empty pipe adjustment
3. Start empty-pipe adjustment: Select "EMPTY PIPE ADJUST" and press E to confirm.
4. After empty-pipe adjustment, fill the piping with fluid.
5. Start full-pipe adjustment: Select "FULL PIPE ADJUST" and press E to confirm.
6. Having completed the adjustment, select the setting "OFF" and exit the function by pressing E.
7. Now switch on empty pipe detection in the EPD function by selecting the option "ON".

   Caution!
   The adjustment coefficients must be valid before you can activate the EPD function. If adjustment is incorrect the following messages might appear on the display:
   – FULL = EMPTY
     The adjustment values for empty pipe and full pipe are identical. In cases of this nature you must repeat empty-pipe or full-pipe adjustment!
   – ADJUSTMENT NOT OK
     Adjustment is not possible because the fluid's conductivity is out of range.

7 Maintenance

No special maintenance work is required.

7.1 Exterior cleaning

When cleaning the exterior of measuring devices, always use cleaning agents that do not attack the surface of the housing and the seals.

7.2 Seals

The seals of the Promag H sensor must be replaced periodically, particularly in the case of gasket seals (aseptic version).
The period between changes depends on the frequency of cleaning cycles, the cleaning temperature and the fluid temperature.

Replacement seals (accessories) → 72.

8 Accessories

Various accessories, which can be ordered separately from Endress+Hauser, are available for the transmitter and the sensor. Your Endress+Hauser service organization can provide detailed information on the specific order codes on request.

8.1 Device-specific accessories

Accessory	Description
Proline Promag 10 transmitter	Transmitter for replacement or storage. Use the order code to define the following specifications: ▪ Approvals ▪ Degree of protection/version ▪ Cable for remote version ▪ Cable entry ▪ Display/power supply/operation ▪ Software ▪ Outputs/inputs

8.2 Measuring principle-specific accessories

Accessory	Description
Mounting set for Promag 10 transmitter	Mounting set for aluminum field housing (remote version). Suitable for Pipe mounting
Wall-mounting kit for Promag H	Wall-mounting kit for the Promag H sensor.
Cable for remote version	Coil and signal cables, various lengths.
Mounting kit for Promag D as wafer version	▪ Mounting bolts ▪ Nuts incl. washers ▪ Flange seals ▪ Centering sleeves (if required for the flange)
Set of seals for Promag D as wafer version	Set of seals consisting of two flange seals.
Mounting kit for Promag H	▪ 2 process connections ▪ Threaded fasteners ▪ Seals
Set of seals for Promag H	For regular replacement of the seals of the Promag H sensor.
Welding jig for Promag H	Weld nipple as process connection: welding jig for installation in pipe.
Adapter connection for Promag A, H	Adapter connections for installing a Promag H instead of a Promag 30/33 A or Promag 30/33 H DN 25.
Ground cable for Promag E/L/P/W	Ground cable for potential equalization.
Ground disk for Promag E/L/P/W	Ground disk for potential equalization.
Process display RIA45	Multifunctional 1-channel display unit: ▪ Universal input ▪ Transmitter power supply ▪ Limit relay ▪ Analog output
Process display RIA251	Digital display device for looping into the 4 to 20 mA current loop.
Field display unit RIA16	Digital field display device for looping into the 4 to 20 mA current loop.

Accessory	Description
Application Manager RMM621	Electronic recording, display, balancing, control, saving and event and alarm monitoring of analog and digital input signals. Values and conditions determined are output by means of analog and digital output signals. Remote transmission of alarms, input values and calculated values using a PSTN or GSM modem.

8.3 Communication-specific accessories

Accessory	Description
HART Communicator Field Xpert SFX 100	Handheld terminal for remote configuration and for obtaining measured values via the HART current output (4 to 20 mA). Contact your Endress+Hauser representative for more information.
Fieldgate FXA320	Gateway for remote interrogation of HART sensors and actuators via Web browser: ▪ 2-channel analog input (4 to 20 mA) ▪ 4 binary inputs with event counter function and frequency measurement ▪ Communication via modem, Ethernet or GSM ▪ Visualization via Internet/Intranet in Web browser and/or WAP cellular phone ▪ Limit value monitoring with alarm by e-mail or SMS ▪ Synchronized time stamping of all measured values.
Fieldgate FXA520	Gateway for remote interrogation of HART sensors and actuators via Web browser: ▪ Web server for remote monitoring of up to 30 measuring points ▪ Intrinsically safe version [EEx ia]IIC for applications in hazardous areas ▪ Communication via modem, Ethernet or GSM ▪ Visualization via Internet/Intranet in Web browser and/or WAP cellular phone ▪ Limit value monitoring with alarm by e-mail or SMS ▪ Synchronized time stamping of all measured values ▪ Remote diagnosis and remote configuration of connected HART devices
FXA195	The Commubox FXA195 connects intrinsically safe Smart transmitters with HART protocol to the USB port of a personal computer. This makes the remote operation of the transmitters possible with the aid of configuration programs (e.g. FieldCare). Power is supplied to the Commubox by means of the USB port

8.4 Service-specific accessories

Accessory	Description
Applicator	Software for selecting and planning flowmeters. The Applicator software can be downloaded from the Internet or ordered on CD-ROM for installation on a local PC. Contact your Endress+Hauser representative for more information.
Fieldcheck	Tester/simulator for testing flowmeters in the field. When used in conjunction with the "FieldCare" software package, test results can be imported into a database, printed out and used for official certification. Contact your Endress+Hauser representative for more information.
FieldCare	FieldCare is Endress+Hauser's FDT-based asset management tool. It can configure all intelligent field units in your system and helps you manage them. By using status information, it is also a simple but effective way of checking their status and condition.

Accessory	Description
Memograph M graphic display recorder	The Memograph M graphic display recorder provides information on all the relevant process variables. Measured values are recorded correctly, limit values are monitored and measuring points analyzed. The data are stored in the 256 MB internal memory and also on a DSD card or USB stick. Memograph M boasts a modular design, intuitive operation and a comprehensive security concept. The ReadWin® 2000 PC software is part of the standard package and is used for configuring, visualizing and archiving the data captured. The mathematics channels which are optionally available enable continuous monitoring of specific power consumption, boiler efficiency and other parameters which are important for efficient energy management.
FXA193	Service interface from the device to the PC for operation via FieldCare.

9 Troubleshooting

9.1 Troubleshooting instructions

Always start troubleshooting with the checklist below if faults occur after start-up or during operation. The routine takes you directly to the cause of the problem and the appropriate remedial measures.

Check the display	
No display visible and no output signals present.	1. Check the supply voltage → terminals 1, 2 2. Check the power line fuse → 🖹 83 85 to 250 V AC: TR5 1 A slow-blow / 250 V 11 to 40 V DC / 20 to 28 V AC: TR5 1.6A slow-blow / 250 V 3. Measuring electronics defective → order spare parts → 🖹 80
No display visible, but output signals are present.	1. Check whether the ribbon-cable connector of the display module is correctly plugged into the amplifier board → 🖹 81 2. Display module defective → order spare parts → 🖹 80 3. Measuring electronics defective → order spare parts → 🖹 80
Display texts are in a foreign language.	Switch off power supply. Press and hold down both the OS buttons and switch on the measuring device. The display text will appear in English (default) and is displayed at maximum contrast.
Measured value indicated, but no signal at the current or pulse output.	Electronics board defective → order spare parts → 🖹 80
↓	
Error messages on display	
Errors which occur during commissioning or measuring operation are displayed immediately. Error messages consist of a variety of icons: the meanings of these icons are as follows (example): – Error type: **S** = system error, **P** = process error – Error message type: ϟ = fault message, **!** = notice message – **EMPTY PIPE** = Type of error, e.g. measuring tube is only partly filled or completely empty – **03:00:05** = duration of error occurrence (in hours, minutes and seconds) – **#**401 = error number ☝ Caution! ▪ See the information on → 🖹 60! ▪ The measuring system interprets simulations and positive zero return as system errors, but displays them as notice message only.	
Error number: No. 001 – 399 No. 501 – 699	System error (device error) has occurred → 🖹 76
Error number: No. 401 - 499	Process error (application error) has occurred → 🖹 77
↓	
Other error (without error message)	
Some other error has occurred.	Diagnosis and rectification → 🖹 78

9.2 System error messages

Serious system errors are **always** recognized by the device as "Fault message", and are shown as a lightning flash (ϟ) on the display. Fault messages immediately affect the outputs. Simulations and positive zero return, on the other hand, are only classed and displayed as notice messages.

Caution!
In the event of a serious fault, a flowmeter might have to be returned to the manufacturer for repair. Necessary procedures must be carried out before you return the measuring device to Endress+Hauser → 🖹 5.
Always enclose a duly completed "Declaration of Contamination" form. You will find a master copy of this form at the back of this manual.

Note!
- The error types listed in the following correspond to the factory settings.
- Also observe the information on → 🖹 60

Type	Error message / No.	Cause	Remedy (Replace electronics board → 🖹 81)
S = System error ϟ = Fault message (with an effect on the outputs) ! = Notice message (without an effect on the outputs)			
No. # 0xx→ Hardware error			
S ϟ	CRITICAL FAIL. **# 001**	Serious device error	Replace electronics board.
S ϟ	AMP HW EEPROM **# 011**	Electronics board: Defective EEPROM	Replace electronics board.
S ϟ	AMP SW EEPROM **# 012**	Amplifier: Error accessing EEPROM data.	The EEPROM data blocks in which an error has occurred are displayed in the TROUBLESHOOTING function. Press Enter to acknowledge the errors in question; default values are automatically inserted instead of the errored parameter values. Note! The measuring device has to be restarted if an error has occurred in a totalizer block (see error No. 111 / CHECKSUM TOTAL).
No. # 1xx→ Software error			
S ϟ	GAIN ERROR AMP **# 101**	Impermissible gain deviation compared to reference.	Replace electronics board.
S ϟ	CHECKSUM TOTAL. **# 111**	Totalizer checksum error	1. Restart the measuring device 2. Replace electronics board if necessary.
No. # 3xx→ System limits exceeded			
S ϟ	TOL. COIL CURR. **# 321**	Sensor: Coil current is out of tolerance.	⚠ Warning! Switch off power supply before manipulating the coil current cable, coil current cable connector or measuring electronics boards! Remote version: 1. Check wiring of terminals 4¼2 → 🖹 44 2. Check coil current cable connector. Compact and remote version: Replace measuring electronics boards if necessary
S !	CURRENT RANGE **# 351**	Current output: flow is out of range.	– Change the upper or lower limit setting, as applicable. – Increase or reduce flow, as applicable.

Type	Error message / No.	Cause	Remedy (Replace electronics board → 🖹 81)
S !	RANGE PULSE **# 359**	Pulse output: the pulse output frequency is out of range.	1. Increase the setting for pulse weighting 2. When selecting the pulse width, choose a value that can still be processed by a connected counter (e.g. mechanical counter, PLC etc.). *Determine the pulse width:* – Variant 1: Enter the minimum duration that a pulse must be present at the connected counter to ensure its registration. – Variant 2: Enter the maximum (pulse) frequency as the half "reciprocal value" that a pulse must be present at the connected counter to ensure its registration. Example: The maximum input frequency of the connected counter is 10 Hz. The pulse width to be entered is: 1 / (2 · 10 Hz) = 50 ms 3. Reduce flow.
No. # 5xx→ Application error			
S !	SW.-UPDATE ACT. **# 501**	Electronics board: New software version being loaded, no other commands are possible at present.	Wait until process is completed and restart device.
S !	UP-/DOWNL. ACT. **# 502**	Data are being uploaded or downloaded via FieldCare. ✎ Note! Measuring device configuration is locked during the upload/download.	Wait until uploading/downloading process is finished.
No. # 6xx→ Simulation mode active			
S !	POS. ZERO-RET. **# 601**	Positive zero return active	Switch off positive zero return.
S ϟ	SIM. FAILSAFE **# 691**	Simulation of response to error (outputs) active.	Switch off simulation.
S !	SIM. VOL. FLOW **# 692**	Simulation of volume flow active.	Switch off simulation.

9.3 Process error messages

Process errors are permanently defined as fault messages or notice messages.

Type	Error message / No.	Cause	Remedy / spare part
P = Process error ϟ = Fault message (with an effect on the outputs) ! = Notice message (without an effect on the outputs)			
P !	EMPTY PIPE **# 401**	Measuring tube partially filled or empty	1. Check the process conditions of the plant 2. Fill the measuring tube
P !	ADJ. NOT OK **# 461**	EPD calibration not possible because the fluid's conductivity is either too low or too high.	The EPD function cannot be used with fluids of this nature.
P ϟ	FULL = EMPTY **# 463**	The EPD calibration values for empty pipe and full pipe are identical, therefore incorrect.	Repeat calibration, making sure procedure is correct → 🖹 70.

9.4 Process errors without messages

Symptoms	Rectification
Remark: You may have to change or correct certain settings in functions in the function matrix in order to rectify the fault.	
Flow values are negative, even though the fluid is flowing forwards through the pipe.	1. Remote version: – Switch off the power supply and check the wiring → 🖹 44 – If necessary, reverse the connections at terminals 41 and 42 2. Change the setting in the "INSTALLATION DIRECTION SENSOR" function accordingly
Measured-value reading fluctuates even though flow is steady.	1. Check grounding and potential equalization → 🖹 52 2. Check the fluid for presence of gas bubbles. 3. In the "SYSTEM DAMPING" function → increase the value
Measured-value reading shown on display, even though the fluid is at a standstill and the measuring tube is full.	1. Check grounding and potential equalization → 🖹 52 2. Check the fluid for presence of gas bubbles. 3. Activate the "LOW FLOW CUTOFF" function, i.e. enter or increase the value for the switching point.
Measured-value reading on display, even though measuring tube is empty.	1. Perform empty-pipe/full-pipe adjustment and then switch on Empty Pipe detection → 🖹 70 2. Remote version: Check the terminals of the EPD cable → 🖹 44 3. Fill the measuring tube.
The current output signal is always 4 mA, irrespective of the flow signal at any given time.	1. Select the "BUS ADDRESS" function and change the setting to "0". 2. Value for creepage too high. Reduce the value in the "LOW FLOW CUTOFF" function.
The fault cannot be rectified or some other fault not described above has arisen. In these instances, please contact your Endress+Hauser service organization.	The following options are available for tackling problems of this nature: **Request the services of an Endress+Hauser service technician** If you contact our service organization to have a service technician sent out, please be ready to quote the following information: – Brief description of the fault – Nameplate specifications (→ 🖹 6): order code, serial number **Returning devices to Endress+Hauser** The necessary procedures on → 🖹 5 must be carried out before you return a flowmeter requiring repair or calibration to Endress+Hauser. Always enclose a duly completed "Declaration of Conformity" form with the flowmeter. You will find a master copy of this form at the back of this manual. **Replace transmitter electronics** Components in the measuring electronics defective →order spare parts → 🖹 80

9.5 Response of outputs to errors

Note!
The response of the totalizer, current output, pulse output and status output is defined in the FAILSAFE MODE function (→ 130).

You can use positive zero return to set the signals of the current, pulse and status outputs to their fallback value, for example when measuring has to be interrupted while a pipe is being cleaned. This function takes priority over all other device functions: simulations, for example, are suppressed.

Failsafe mode of outputs and totalizers		
	Process/system error is current	**Positive zero return is activated**
Caution! System or process errors defined as "Notice messages" have no effect whatsoever on the inputs and outputs. See the information on → 60		
Current output	MINIMUM VALUE 4–20 mA (25 mA) → 2 mA 4–20 mA NAMUR →3.5 mA 4–20 mA US → 3.75 mA 4–20 mA (25 mA) HART → 2 mA 4–20 mA HART NAMUR →3.5 mA 4–20 mA HART US → 3.75 mA MAXIMUM VALUE 4–20 mA (25 mA) → 25 mA 4–20 mA NAMUR →22.6 mA 4–20 mA US → 22.6 mA 4–20 mA (25 mA) HART → 25 mA 4–20 mA HART NAMUR →22.6 mA 4–20 mA HART US → 22.6 mA HOLD VALUE Last valid value (preceding occurrence of the fault) is output. ACTUAL VALUE Measured value display on the basis of the current flow measurement. The fault is ignored.	Output signal corresponds to "zero flow"
Pulse output	MIN/MAX VALUE → FALLBACK VALUE Signal output → no pulses HOLD VALUE Last valid value (preceding occurrence of the fault) is output. ACTUAL VALUE Fault is ignored, i.e. normal measured-value output on the basis of ongoing flow measurement.	Output signal corresponds to "zero flow"
Totalizer	MINIMUM/MAXIMUM VALUE → STOP The totalizers are paused until the error is rectified. ACTUAL VALUE The fault is ignored. The totalizer continues to count in accordance with the current flow value.	Totalizer stops
Status output	In the event of a fault or power supply failure: Status output → non-conductive	No effect on status output

9.6 Spare parts

Detailed troubleshooting instructions are provided in the previous sections → 📄 75
The measuring device, moreover, provides additional support in the form of continuous self-diagnosis and error messages.

Fault rectification can entail replacing defective components with tested spare parts. The illustration below shows the available scope of spare parts.

Note!
You can order spare parts directly from your Endress+Hauser service organization by providing the serial number printed on the transmitter's nameplate → 📄 6.

Spare parts are shipped as sets comprising the following parts:
- Spare part
- Additional parts, small items (threaded fasteners, etc.)
- Mounting instructions
- Packaging

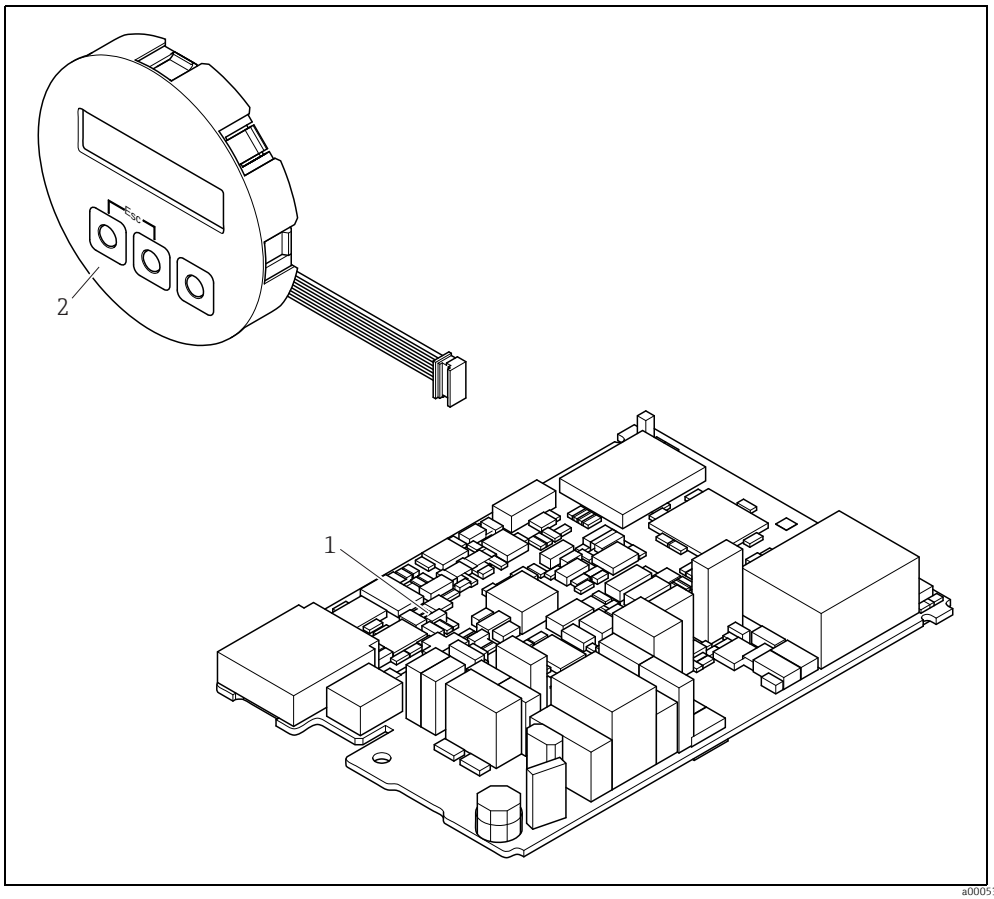


Fig. 47: Spare parts for Promag 10 transmitter

1 Electronics board
2 Display module

9.6.1 Removing and installing printed circuit boards

Field housing: removing and installing electronics boards → 48

Warning!
- Risk of electric shock!
  Exposed components carry dangerous voltages. Make sure that the power supply is switched off before you remove the cover of the electronics compartment.
- Risk of damaging electronic components (ESD protection). Static electricity can damage electronic components or impair their operability. Use a workplace with a grounded working surface purpose-built for electrostatically sensitive devices!
- If you cannot guarantee that the dielectric strength of the device is maintained in the following steps, then an appropriate inspection must be carried out in accordance with the manufacturer's specifications.

Caution!
Use only original Endress+Hauser parts.

Note!
Commissioning a new electronics board: → 69

1. Switch off power supply.
2. Unscrew cover of the electronics compartment from the transmitter housing.
3. Remove the local display (a) from the connection compartment cover.
4. Press the side latches (b) and flip down the cover of the connection compartment.
5. Disconnect the connector of the electrode signal cable (c) and the coil current cable (d).
6. Disconnect the connector for the power supply (e) and the outputs (f).
7. Disconnect the connector of the local display (g).
8. Remove the cover from the connection compartment (h) by loosening the screws.
9. Plug out the ground cable (i) of the electronics board.
10. Pull entire module (plastic retainer and electronics board) out of the housing.
11. Press the side latches (j) slightly outwards and partly push out the electronics board towards the rear from the front.
12. Remove the electronics board from the plastic retainer from the rear.
13. Installation is the reverse of the removal procedure.

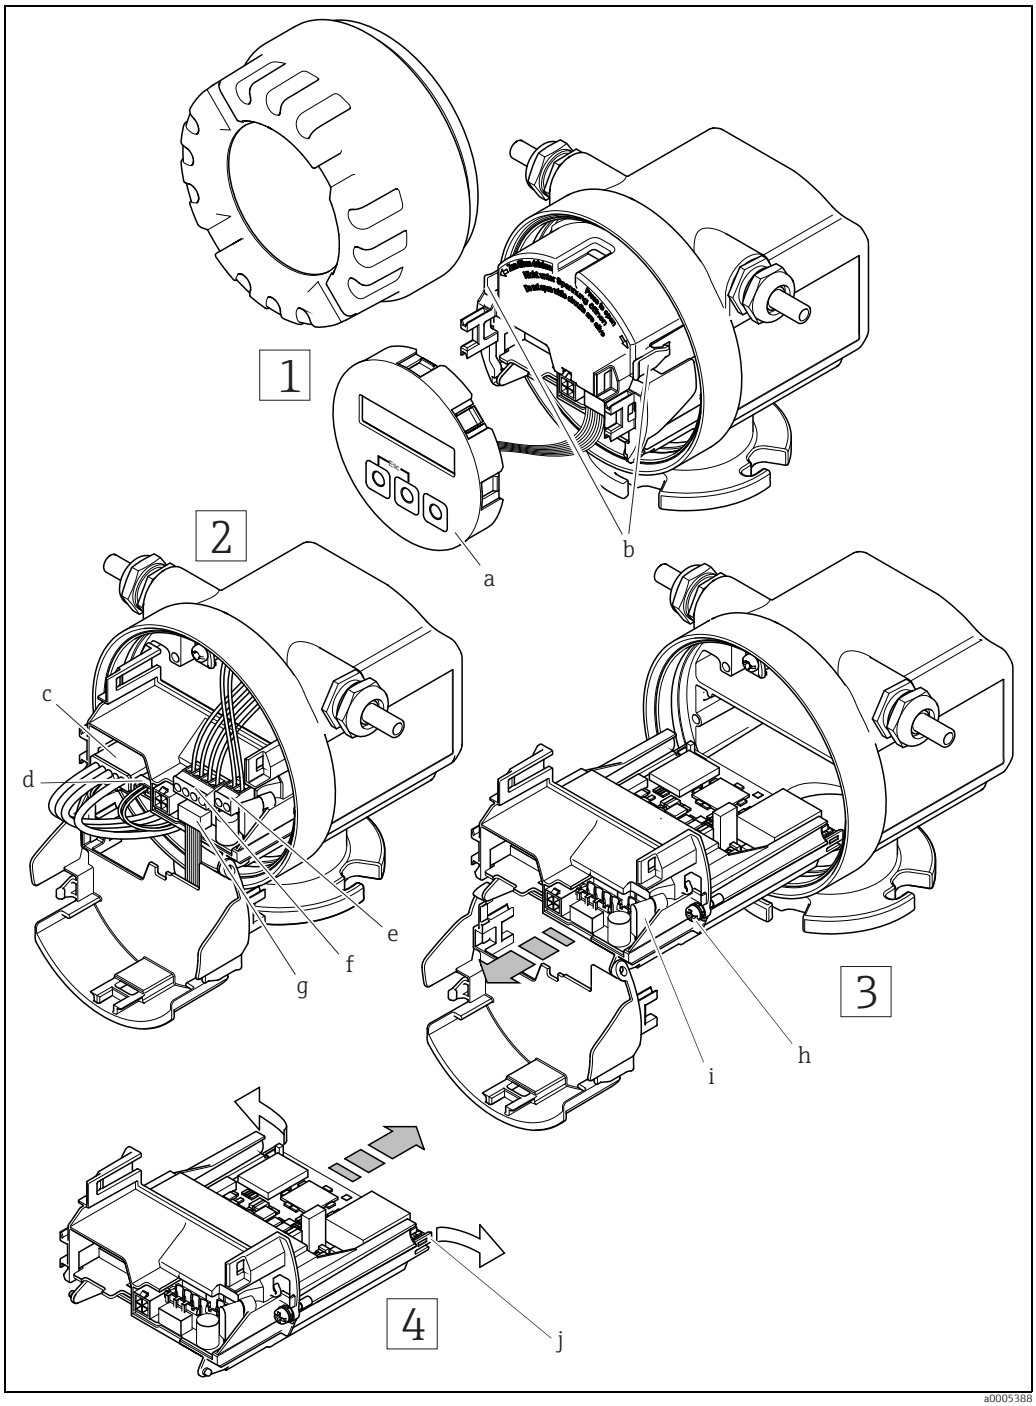


Fig. 48: Field housing: removing and installing printed circuit boards

a Local display
b Latches
c Connector of the electrode signal cable
d Connector of the coil current cable
e Connector for the power supply
f Connector for current output and pulse/status output
g Connector of local display
h Screws of electronics compartment cover
i Connector of the ground cable
j Latches for the electronics board

9.6.2 Replacing the device fuse

Warning!
Risk of electric shock!
Exposed components carry dangerous voltages. Make sure that the power supply is switched off before you remove the cover of the electronics compartment.

The main fuse is located on the electronics board (→ 49).
The procedure for replacing the fuse is as follows:

1. Switch off power supply.
2. Unscrew cover of the electronics compartment from the transmitter housing.
3. Press the side latches and flip down the cover of the connection compartment.
4. Remove the connector for the power supply (a).
5. Replace device fuse (b). Only use the following fuse type.
   Use only fuses of the following type:
   – Power supply 11 to 40 V DC / 20 to 28 V AC → 1.6 A slow-blow / 250 V TR5
   – Power supply 85 to 250 V DC → 1 A slow-blow / 250 V TR5
6. Installation is the reverse of the removal procedure.

Caution!
Use only original Endress+Hauser parts.

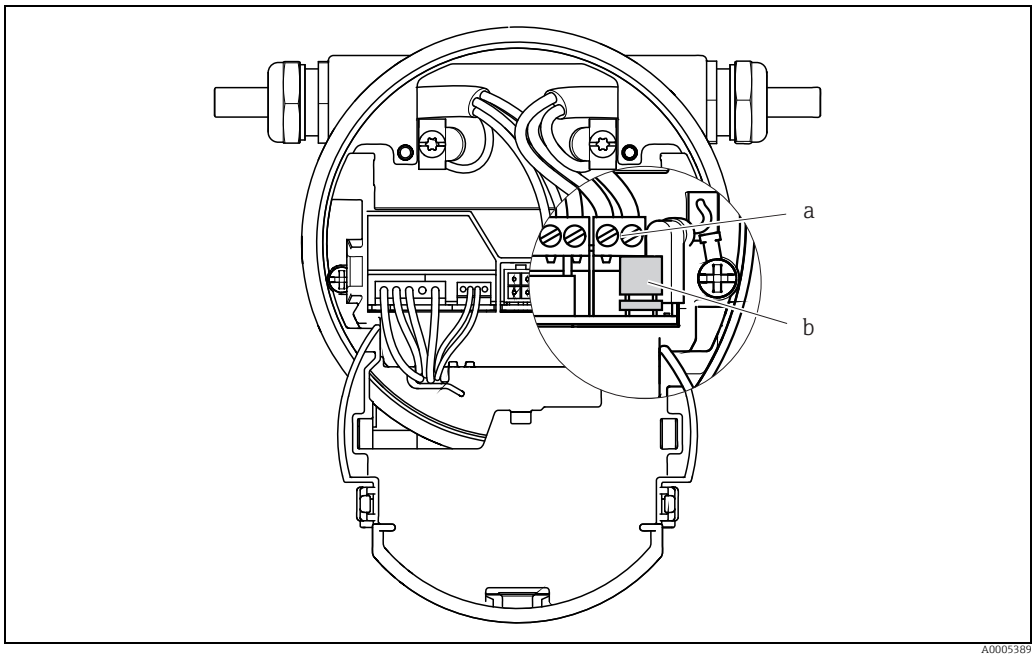


Fig. 49: Replacing the device fuse on the electronics board

a Connector for power supply
b Device fuse

9.7 Return

Caution!
Do not return a measuring device if you are not absolutely certain that all traces of hazardous substances have been removed, e.g. substances which have penetrated crevices or diffused through plastic.
Costs incurred for waste disposal and injury (burns, etc.) due to inadequate cleaning will be charged to the owner-operator.

The following steps must be taken before returning a flow measuring device to Endress+Hauser, e.g. for repair or calibration:
- Always enclose a duly completed "Declaration of contamination" form. Only then can Endress+Hauser transport, examine and repair a returned device.
- Enclose special handling instructions if necessary, for example a safety data sheet as per EC REACH Regulation No. 1907/2006.
- Remove all residues. Pay special attention to the grooves for seals and crevices which could contain residues. This is particularly important if the substance is hazardous to health, e.g. flammable, toxic, caustic, carcinogenic, etc.

Note!
You will find a preprinted "Declaration of contamination" form at the back of these Operating Instructions.

9.8 Disposal

Observe the regulations applicable in your country!

9.9 Software history

Date	Software version	Changes to software	Operating Instructions
03.2016	V 1.04.00	Introduction of a new sensor Promag D with threaded connection	71315813/17.16
01.2012	V 1.04.00	Introduction of new nominal diameters; faster coil current control; calf-values to 2.5	71249469/15.14
11.2009	V 1.03.00	Introduction of Calf history	71106179/12.09 71105338/11.09
06.2009	V 1.02.00	Introduction of Promag L	71095705/06.09
03.2009	V 1.02.00	Introduction of Promag D; introduction of new nominal diameter.	71088674/03.09
10.2004	V 1.02.00	Software modification/extension Function: SELF CHECKING	50104787/05.05
09.2004	V 1.01.01	Software modification; extension of nominal diameter range	50104787/04.03
06.2004	V 1.01.00	Software extension; preparation for uploading/ downloading via ToF Tool - Fieldtool Package	50104787/04.03
08.2003	V 1.00.02	Production-related software modification	50104787/04.03
01.2003	V 1.00.00	Original software. Compatible with: ToF Tool - Fieldtool Package, HART Communicator DXR 275 (from OS 4.6) with Rev. 1, DD 1.	50104787/04.03

Note!
Uploads or downloads between the individual software versions are only possible with a special service software.

10 Technical data

10.1 Application

→ 🖹 4

10.2 Function and system design

Measuring principle

Electromagnetic flow measurement on the basis of Faraday's Law.

Measuring system

→ 🖹 6

10.3 Input

Measured variable

Flow velocity (proportional to induced voltage)

Measuring range

Typically v = 0.01 to 10 m/s (0.033 to 33 ft/s) with the specified accuracy

Operable flow range

Over 1000 : 1

10.4 Output

Output signal

Current output

- Galvanically isolated
- Active: 4 to 20 mA, R_L <700 Ω (for HART: RL ≥ 250 Ω)
- Full scale value adjustable
- Temperature coefficient: typ. 2 µA/°C, resolution: 1.5 µA

Pulse/status output:

- Galvanically isolated
- Passive: 30 V DC / 250 mA
- Open collector
- Can be configured as:
  - Pulse output
    Pulse value and pulse polarity can be selected, max. pulse width adjustable (5 to 2000 ms), pulse frequency max. 100 Hz
  - Status output
    For example, can be configured for error messages, empty pipe detection, flow recognition, limit value

Signal on alarm

Current output

Failsafe mode can be selected (e.g. in accordance with NAMUR Recommendation NE 43) → 🖹 130

Pulse output

Failsafe mode can be selected → 🖹 130

	Status output "Not conductive" in the event of fault or power supply failure
Load	See "Output signal"
Low flow cut off	Low flow cut off, switch-on point can be selected as required
Galvanic isolation	All circuits for inputs, outputs, and power supply are galvanically isolated from each other.

10.5 Power supply

Terminal assignment	→ 🖹 51
Supply voltage	▪ 20 to 28 V AC, 45 to 65 Hz ▪ 85 to 250 V AC, 45 to 65 Hz ▪ 11 to 40 V DC
Power consumption	**Power consumption** ▪ 20 to 28 V AC: <8 VA (incl. sensor) ▪ 85 to 250 V AC: <12 VA (incl. sensor) ▪ 11 to 40 V DC: <6 W (incl. sensor) **Switch-on current:** ▪ Max. 3.3 A (<5 ms) for 24 V DC ▪ Max. 5.5 A (<5 ms) for 28 V DC ▪ Max. 16 A (<5 ms) for 250 V DC
Power supply failure	Lasting min. ½ cycle frequency: EEPROM saves measuring system data
Electrical connections	→ 🖹 44
Potential equalization	→ 🖹 52
Cable entry	**Power supply and signal cables (inputs/outputs):** ▪ Cable entry M20 × 1.5 (8 to 12 mm/0.31 to 0.47 inch) ▪ Threads for cable entries ½" NPT, G ½" **Connecting cable for remote version:** ▪ Cable entry M20 × 1.5 (8 to 12 mm/0.31 to 0.47 inch) ▪ Threads for cable entries ½" NPT, G ½"
Cable specifications	→ 🖹 49

10.6 Performance characteristics

Reference operating conditions

- Error limits following DIN EN 29104, future ISO 20456
- Water, typically +4 to +35°C (+39 to +95 °F); 2 to 6 bar (29 to 87 psi)
- Specification as per calibration protocol ± 5°C (± 41 °F) and ± 2 bar (± 29 psi)
- Data on the measured error based on accredited calibration rigs traced back to ISO 17025

Maximum measured error

- Current output: plus typically ± 5 µA
- Pulse output: ± 0.5% o.r. ± 2 mm/s (o.r. = of reading)

Fluctuations in the supply voltage do not have any effect within the specified range.

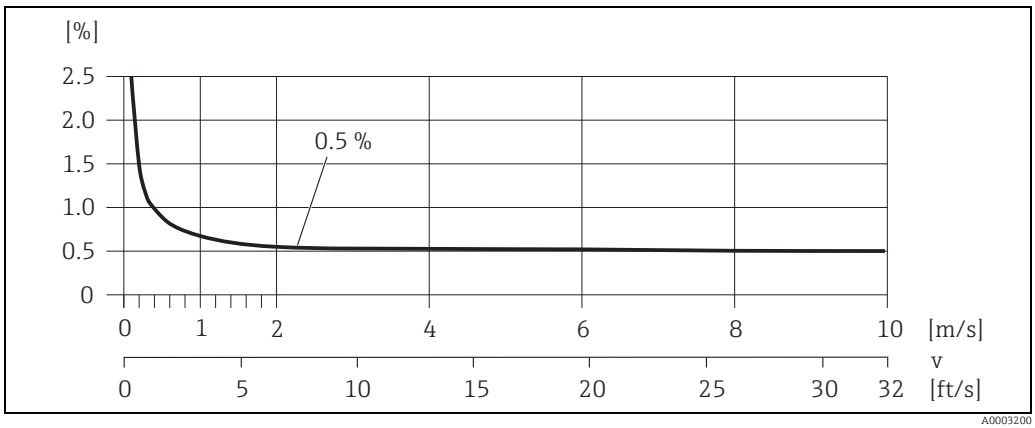


Fig. 50: Max. measured error in % of reading

Repeatability

Max. ± 0.2% o.r. ± 2 mm/s (o.r. = of reading)

10.7 Installation

"Mounting requirements" (→ 11)

10.8 Environment

Ambient temperature range

- Transmitter: −20 to +60 °C (−4 to +140 °F)

Note!
At ambient temperatures below −20 (−4 °F) the readability of the display may be impaired.

- Sensor (flange material carbon steel): −10 to +60 °C (+14 to +140 °F)

Caution!
- The permitted temperature range of the measuring tube lining may not be undershot or overshot (→ "Operating conditions: Process" →"Medium temperature range").
- Install the device in a shady location. Avoid direct sunlight, particularly in warm climatic regions.
- The transmitter must be mounted separate from the sensor if both the ambient and fluid temperatures are high.

Storage temperature

The storage temperature corresponds to the operating temperature range of the measuring transmitter and the appropriate measuring sensors.

Caution!
- The measuring device must be protected against direct sunlight during storage in order to avoid unacceptably high surface temperatures.
- A storage location must be selected where moisture does not collect in the measuring device. This will help prevent fungus and bacteria infestation which can damage the liner.

Degree of protection

- Standard: IP 67 (NEMA 4X) for transmitter and sensor.
- Optional: IP 68 (NEMA 6P) for sensor Promag E/L/P/W in remote version. Promag L is only available with stainless steel flanges.

Shock and vibration resistance

Acceleration up to 2 g following IEC 600 68-2-6

CIP cleaning

Caution!
The maximum fluid temperature permitted for the device may not be exceeded.

CIP cleaning is possible:
Promag E (100 °C / 212 °F), Promag H/P

CIP cleaning is not possible:
Promag D/L/W

SIP cleaning

Caution!
The maximum fluid temperature permitted for the device may not be exceeded.

SIP cleaning is possible:
Promag H

SIP cleaning is not possible:
Promag D/E/L/P/W

Electromagnetic compatibility (EMC)

- As per IEC/EN 61326 and NAMUR Recommendation NE 21
- Emission: to limit value for industry EN 55011

10.9 Process

Medium temperature range

The permissible temperature depends on the lining of the measuring tube

Promag D

0 to +60 °C (+32 to +140 °F) for polyamide

Promag E

−10 to +110 °C (+14 to +230 °F) for PTFE,
Restrictions → see the following diagram

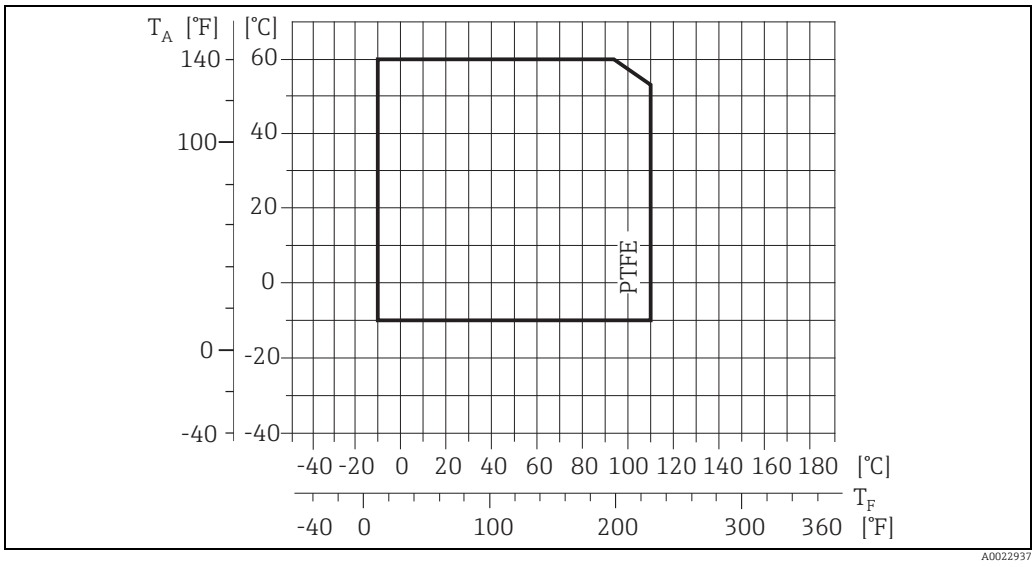


Fig. 51: Compact and remote version Promag E (T_A = ambient temperature; T_F = fluid temperature)

Promag H

Sensor:
- DN 2 to 25 (1/12 to 1"): −20 to +150 °C (−4 to +302 °F)
- DN 40 to 100 (1 ½ to 4"): −20 to +150 °C (−4 to +302 °F)

Seals:
- EPDM/Viton (FKM)/Kalrez: −20 to +150 °C (−4 to +302 °F)

Promag L

- 0 to +80 °C (+32 to +176 °F) for hard rubber (DN 350 to 2400 / 14 to 90")
- −20 to +50 °C (−4 to +122 °F) for polyurethane (DN 25 to 1200 / 1 to 48")
- −20 to +90 °C (−4 to +194 °F) for PTFE (DN 25 to 300 / 1 to 12")

Promag P

−40 to +130 °C (−40 to +266 °F) for PTFE (DN 25 to 600 / 1 to 24"),
Restrictions → see the following diagram

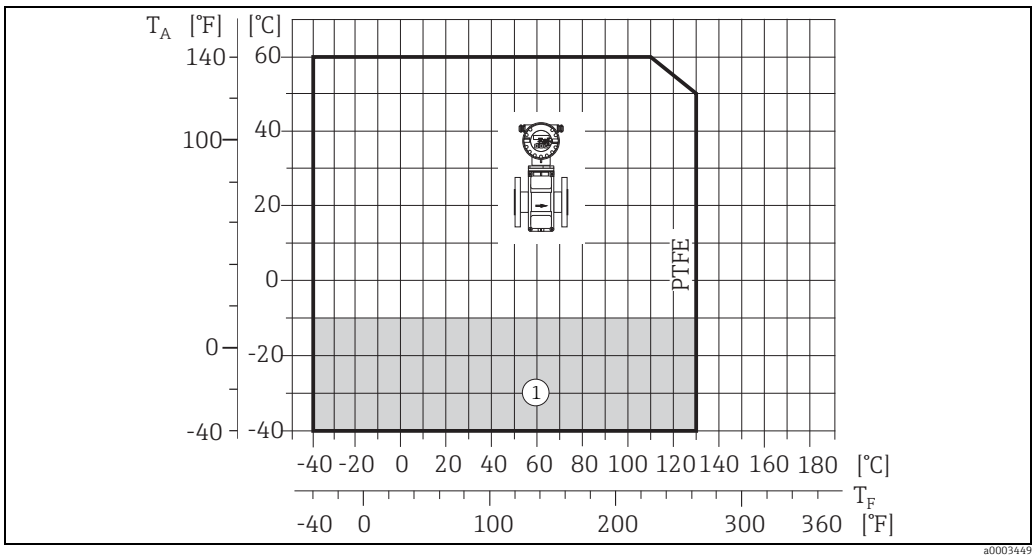


Fig. 52: Compact version Promag P with PTFE-lining

T_A = ambient temperature; T_F = fluid temperature
A = light gray area →temperature range from −10 to −40 °C (−14 to −40 °F) valid for stainless steel version only

Promag W

- 0 to +80 °C (+32 to +176 °F) for hard rubber (DN 65 to 2000 / 2 ½ to 78")
- −20 to +50 °C (−4 to +122 °F) for polyurethane (DN 25 to 1000 / 1 to 48")

Conductivity

The minimum conductivity is ≥ 50 µS/cm

Note!
Note that in the case of the remote version, the requisite minimum conductivity is also influenced by the length of the connecting cable → 🖹 18

Pressure-temperature ratings

An overview of the pressure-temperature ratings for the process connections are to be found in the "Technical Information" documents of the device in question.

Medium pressure range (nominal pressure)

Promag D

- EN 1092-1 (DIN 2501)
  - PN 16
- ASME B 16.5
  - Class 150
- JIS B2220
  - 10 K
- DIN ISO 228 (G" external thread)
  - PN 16
- ANSI/ASME B1.20 (NPT" external thread)
  - Class 150

Promag E

- EN 1092-1 (DIN 2501)
  - PN 10 (DN 200 to 600 / 8 to 24")
  - PN 16 (DN 65 to 600 / 3 to 24")
  - PN 40 (DN 15 to 150 / ½ to 2")
- ASME B 16.5
  - Class 150 (½ to 24")
- JIS B2220
  - 10 K (DN 50 to 300 / 2 to 12")
  - 20 K (DN 15 to 40 / ½ to 1½")

Promag H

The permissible nominal pressure depends on the process connection and the seal:
- PN 40, Class 150, 20 K → Couplings, flanges (with O-ring seal)
- PN 16 → Welding nipple, couplings, clamp, flange (with aseptic gasket seal)

Promag L

- EN 1092-1 (DIN 2501)
  - PN 6 (DN 350 to 2400 / 14 to 90")
  - PN 10 (DN 200 to 2400 / 8 to 90")
  - PN 16 (DN 25 to 300 / 1 to 12")
- EN 1092-1, lap joint flange, stampel plate
  - PN 10 (DN 25 to 300 / 1 to 12")
- ASME B16.5
  - Class 150 (1 to 24")
- AWWA
  - Class D (28 to 90")
- AS2129
  - Table E (350 to 1200 / 14 to 48")
- AS4087
  - PN 16 (350 to 1200 / 14 to 48")

Promag P

- EN 1092-1 (DIN 2501)
  - PN 10 (DN 200 to 600 / 8 to 24")
  - PN 16 (DN 65 to 600 / 3 to 24")
  - PN 25 (DN 200 to 600 / 8 to 24")
  - PN 40 (DN 25 to 150 / 1 to 6")
- ASME B 16.5
  - Class 150 (1 to 24")
  - Class 300 (1 to 6")
- JIS B2220
  - 10 K (DN 50 to 300 / 2 to 12")
  - 20 K (DN 25 to 300 / 1 to 12")
- AS 2129
  - Table E (DN 25 / 1"), 50 / 2")
- AS 4087
  - PN 16 (DN 50 / 2")

Promag W

- EN 1092-1 (DIN 2501)
  - PN 6 (DN 350 to 2000 / 14 to 84")
  - PN 10 (DN 200 to 2000 / 8 to 84")
  - PN 16 (DN 65 to 2000 / 3 to 84")
  - PN 25 (DN 200 to 1000 / 8 to 40")
  - PN 40 (DN 25 to 150 / 1 to 6")
- ASME B 16.5
  - Class 150 (1 to 24")
  - Class 300 (1 to 6")
- AWWA
  - Class D (28 to 78")
- JIS B2220
  - 10 K (DN 50 to 300 / 2 to 12")
  - 20 K (DN 25 to 300 / 1 to 12")
- AS 2129
  - Table E (DN 80 / 3", 100 / 4", 150 to 1200 / 6 to 48")
- AS 4087
  - PN 16 (DN 80 / 3", 100 / 4", 150 to 1200 / 6 to 48")

Pressure tightness

Promag D

Measuring tube: 0 mbar abs (0 psi abs) with a fluid temperature of ≤60 °C (140 °F)

Promag E (Measuring tube lining: PTFE)

Nominal diameter		Resistance of measuring tube lining to partial vacuum Limit values for abs. pressure [mbar] ([psi]) at various fluid temperatures							
		25 °C		80 °C		100 °C		110 °C	
		77 °F		176 °F		212 °F		230 °F	
[mm]	[inch]	[mbar]	[psi]			[mbar]	[psi]	[mbar]	[psi]
15	½"	0	0	0	0	0	0	100	1.45
25	1"	0	0	0	0	0	0	100	1.45
32	–	0	0	0	0	0	0	100	1.45
40	1 ½"	0	0	0	0	0	0	100	1.45
50	2"	0	0	0	0	0	0	100	1.45
65	–	0	0	*	*	40	0.58	130	1.89
80	3"	0	0	*	*	40	0.58	130	1.89
100	4"	0	0	*	*	135	1.96	170	2.47

Nominal diameter		Resistance of measuring tube lining to partial vacuum Limit values for abs. pressure [mbar] ([psi]) at various fluid temperatures							
		25 °C		80 °C		100 °C		110 °C	
		77 °F		176 °F		212 °F		230 °F	
[mm]	[inch]	[mbar]	[psi]			[mbar]	[psi]	[mbar]	[psi]
125	–	135	1.96	*	*	240	3.48	385	5.58
150	6"	135	1.96	*	*	240	3.48	385	5.58
200	8"	200	2.90	*	*	290	4.21	410	5.95
250	10"	330	4.79	*	*	400	5.80	530	7.69
300	12"	400	5.80	*	*	500	7.25	630	9.14
350	14"	470	6.82	*	*	600	8.70	730	10.59
400	16"	540	7.83	*	*	670	9.72	800	11.60
450	18"	Partial vacuum is impermissible!							
500	20"								
600	24"								
* No value can be quoted.									

Promag H (Measuring tube lining: PFA)

Nominal diameter		Resistance of measuring tube lining to partial vacuum Limit values for abs. pressure [mbar] ([psi]) at various fluid temperatures					
		25 °C	80 °C	100 °C	130 °C	150 °C	180 °C
[mm]	[inch]	77 °F	176 °F	212 °F	266 °F	302 °F	356 °F
2 to 100	1/12 to 4"	0	0	0	0	0	0

Promag L (Measuring tube lining: Polyurethane, Hard rubber)

Nominal diameter		Measuring tube lining	Resistance of measuring tube lining to partial vacuum Limit values for abs. pressure [mbar] ([psi]) at various fluid temperatures		
			25 °C	50 °C	80 °C
[mm]	[inch]		77 °F	122 °F	176 °F
25 to 1200	1 to 48"	25 to 1200	1 to 48"	0	–
350 to 2400	14 to 90"	Hard rubber	0	0	0

Promag L (Measuring tube lining: PTFE)

Nominal diameter		Resistance of measuring tube lining to partial vacuum Limit values for abs. pressure [mbar] ([psi]) at various fluid temperatures			
		25 °C		90 °C	
		77 °F		194 °F	
[mm]	[inch]	[mbar]	[psi]	[mbar]	[psi]
25	1"	0	0	0	0
32	–	0	0	0	0
40	1 ½"	0	0	0	0
50	2"	0	0	0	0
65	–	0	0	40	0.58
80	3"	0	0	40	0.58
100	4"	0	0	135	1.96
125	–	135	1.96	240	3.48
150	6"	135	1.96	240	3.48
200	8"	200	2.90	290	4.21
250	10"	330	4.79	400	5.80

Nominal diameter		Resistance of measuring tube lining to partial vacuum Limit values for abs. pressure [mbar] ([psi]) at various fluid temperatures			
		25 °C		90 °C	
		77 °F		194 °F	
[mm]	[inch]	[mbar]	[psi]	[mbar]	[psi]
300	12"	400	5.80	500	7.25

Promag P (Measuring tube lining: PTFE)

Nominal diameter		Resistance of measuring tube lining to partial vacuum Limit values for abs. pressure [mbar] ([psi]) at various fluid temperatures									
		25 °C		80 °C		100 °C		130 °C		150 °C	180 °C
		77 °F		176 °F		212 °F		266 °F		302 °F	356 °F
[mm]	[inch]	[mbar]	[psi]			[mbar]	[psi]	[mbar]	[psi]		
25	1"	0	0	0	0	0	0	100	1.45	–	–
32	–	0	0	0	0	0	0	100	1.45	–	–
40	1 ½"	0	0	0	0	0	0	100	1.45	–	–
50	2"	0	0	0	0	0	0	100	1.45	–	–
65	–	0	0	*	*	40	0.58	130	1.89	–	–
80	3"	0	0	*	*	40	0.58	130	1.89	–	–
100	4"	0	0	*	*	135	1.96	170	2.47	–	–
125	–	135	1.96	*	*	240	3.48	385	5.58	–	–
150	6"	135	1.96	*	*	240	3.48	385	5.58	–	–
200	8"	200	2.90	*	*	290	4.21	410	5.95	–	–
250	10"	330	4.79	*	*	400	5.80	530	7.69	–	–
300	12"	400	5.80	*	*	500	7.25	630	9.14	–	–
350	14"	470	6.82	*	*	600	8.70	730	10.59	–	–
400	16"	540	7.83	*	*	670	9.72	800	11.60	–	–
450	18"	Partial vacuum is impermissible!									
500	20"										
600	24"										
* No value can be quoted.											

Promag W

Nominal diameter		Measuring tube lining	Resistance of measuring tube lining to partial vacuum Limit values for abs. pressure [mbar] ([psi]) at various fluid temperatures						
			25 °C	50 °C	80 °C	100 °C	130 °C	150 °C	180 °C
[mm]	[inch]		77 °F	122 °F	176 °F	212 °F	266 °F	302 °F	356 °F
25 to 1200	1 to 40"	Polyurethane	0	0	–	–	–	–	–
50 to 2000	2 to 78"	Hard rubber	0	0	0	–	–	–	–

Limiting flow

→ 🖹 16

Pressure loss

- No pressure loss if the sensor is installed in a pipe with the same nominal diameter.
- Pressure losses for configurations incorporating adapters according to DIN EN 545 (see "Adapters" → 🖹 15)

Vibrations

→ 🖹 14

10.10 Mechanical construction

Design, dimensions

The dimensions and installation lengths of the sensor and transmitter can be found in the "Technical Information" for the device in question. This document can be downloaded as a PDF file from www.endress.com. A list of the "Technical Information" documents available is provided in the "Documentation" section on → 🖹 108.

Weight (SI units)

Promag D

Weight data in kg				
Nominal diameter		Compact version	Remote version (without cable)	
[mm]	[inch]		Sensor	Transmitter
25	1"	2.9	2.5	3.1
40	1 ½"	3.5	3.1	3.1
50	2"	4.3	3.9	3.1
65	2 ½"	5.1	4.7	3.1
80	3"	6.1	5.7	3.1
100	4"	8.8	8.4	3.1
Transmitter Promag (compact version): 1.8 kg (Weight data valid without packaging material)				

Promag E

Weight data in kg							
Nominal diameter		Compact version					
		EN (DIN)				ASME	JIS
[mm]	[inch]	PN 6	PN 10	PN 16	PN 40	Class 150	10K
15	½"	–	–	–	6.5	6.5	6.5
25	1"	–	–	–	7.3	7.3	7.3
32	–	–	–	–	8.0	–	7.3
40	1½"	–	–	–	9.4	9.4	8.3
50	2"	–	–	–	10.6	10.6	9.3
65	–	–	–	12.0	–	–	11.1
80	3"	–	–	14.0	–	14.0	12.5
100	4"	–	–	16.0	–	16.0	14.7
125	–	–	–	21.5	–	–	21.0
150	6"	–	–	25.5	–	25.5	24.5
200	8"	–	45.0	46.0	–	45.0	41.9
250	10"	–	65.0	70.0	–	75.0	69.4
300	12"	–	70.0	81.0	–	110.0	72.3
350	14"	77.4	88.4	99.4	–	137.4	–
400	16"	89.4	104.4	120.4	–	168.4	–
450	18"	99.4	112.4	133.4	–	191.4	–
500	20"	114.4	132.4	182.4	–	228.4	–
600	24"	155.4	162.4	260.4	–	302.4	–

- Transmitter (compact version): 1.8 kg
- Weight data without packaging material

Weight data in kg								
Nominal diameter		Remote version (without cable)						
		Sensor						Transmitter
		EN (DIN)				ASME	JIS	
[mm]	[inch]	PN 6	PN 10	PN 16	PN 40	Class 150	10K	Wall-mount housing
15	½"	–	–	–	4.5	4.5	4.5	6.0
25	1"	–	–	–	5.3	5.3	5.3	
32	–	–	–	–	6.0	–	5.3	
40	1½"	–	–	–	7.4	7.4	6.3	
50	2"	–	–	–	8.6	8.6	7.3	
65	–	–	–	10.0	–	–	9.1	
80	3"	–	–	12.0	–	12.0	10.5	
100	4"	–	–	14.0	–	14.0	12.7	
125	–	–	–	19.5	–	–	19.0	
150	6"	–	–	23.5	–	23.5	22.5	
200	8"	–	43.0	44.0	–	43.0	39.9	
250	10"	–	63.0	68.0	–	73.0	67.4	
300	12"	–	68.0	79.0	–	108.0	70.3	
350	14"	73.1	84.1	95.1	–	133.1		
400	16"	85.1	100.1	116.1	–	164.1		
450	18"	95.1	108.1	129.1	–	187.1		
500	20"	110.1	128.1	178.1	–	224.1		
600	24"	158.1	158.1	256.1	–	298.1		

- Transmitter (remote version): 3.1 kg
- Weight data without packaging material

Promag H

Weight data in kg				
Nominal diameter		Compact version	Remote version (without cable)	
[mm]	[inch]	DIN	Sensor	Transmitter
2	1/12"	3.6	2	3.1
4	1/8"	3.6	2	3.1
8	3/8"	3.6	2	3.1
15	½"	3.7	1.9	3.1
25	1"	3.9	2.8	3.1
40	1 ½"	4.9	4.5	3.1
50	2"	7.4	7.0	3.1
65	2 ½"	7.9	7.5	3.1
80	3"	17.4	17.0	3.1
100	4"	16.9	16.5	3.1
Transmitter Promag (compact version): 1.8 (Weight data valid for standard pressure ratings and without packaging material)				

Promag L

Weight data in kg												
Nominal diameter		Compact version (including transmitter)[1]										
[mm]	[inch]	EN (DIN)						ASME/ AWWA		AS		
25	1"	PN 6	–	PN 10	–	PN 16	7.3	ASME / Class 150	7.9	PN 16	–	Tabelle E	–
32	1 ¼"		–		–		8.0		–		–		–
40	1 ½"		–		–		9.0		7.5		–		–
50	2"		–		–		9.4		7.6		–		–
65	2 ½"		–		–		10.4		–		–		–
80	3"		–		–		12.4		12.8		–		–
100	4"		–		–		14.4		16.1		–		–
125	5"		–		–		15.9		–		–		–
150	6"		–		–		23.9		24.4		–		–
200	8"		–		43.4		44.9		49.6		–		–
250	10"		–		63.4		70.7		75.1		–		–
300	12"		–		68.4		85.8		100		–		–
350	14"		77.4		88.4		103		137		99.4		99.4
375	15"		–		–		–		–		105		–
400	16"		89.4		104		124		168		120		120
450	18"		99.4		112		139		191		133		143
500	20"		114		132		174		228		182		182
600	24"		155		162		303		302		260		260
700	28"		190		240		288	AWWA / Class D	266		367		346
750	30"		–		–		–		318		445		433
800	32"		240		315		364		383		503		493
900	36"		308		393		456		470		702		690
1000	40"		359		468		579		587		759		761
1050	42"		–		–		–		670		–		–
1200	48"		529		717		866		901		–		1237
–	54"		–		–		–		1273		–		–
1400	–		784		1114		1274		–		–		–
–	60"		–		–		–		1594		–		–
1600	–		1058		1624		1872		–		–		–
1650	66"		–		–		–		2131		–		–
1800	72"		1418		2107		2409		2568		–		–
2000	78"		1877		2630		2997		3113		–		–
–	84"		–		–		–		3755		–		–
2200	–		2512		3422		–		–		–		–
–	90"		–		–		–		4797		–		–
2400	–		2996		4094		–		–		–		–
Transmitter Promag (compact version): 3.1 kg (Weight data valid without packaging material)													

1) Lap joint flanges / welded flanges DN > 300 (12")

Weight data in kg

Nominal diameter		Remote version (sensor plus sensor housing without cable)[1]											
[mm]	[inch]	EN (DIN)						ASME/ AWWA		AS			
25	1"	PN 6	–	PN 10	–	PN 16	5.3	ASME / Class 150	5.9	PN 16	–	Tabelle E	–
32	1 ¼"		–		–		6.0		–		–		–
40	1 ½"		–		–		7.0		5.5		–		–
50	2"		–		–		7.4		5.6		–		–
65	2 ½"		–		–		8.4		–		–		–
80	3"		–		–		10.4		10.8		–		–
100	4"		–		–		12.4		14.1		–		–
125	5"		–		–		13.9		–		–		–
150	6"		–		–		21.9		22.4		–		–
200	8"		–		41.4		42.9		47.6		–		–
250	10"		–		61.4		68.7		73.1		–		–
300	12"		–		66.4		83.8		98		–		–
350	14"		75.4		86.4		103		135		97.4		97.4
375	15"		–		102		–		–		103		–
400	16"		87.4		102		124		166		118		118
450	18"		97.4		110		139		189		131		141
500	20"		112		130		174		226		180		180
600	24"		153		160		303		300		258		258
700	28"		188		238		288	AWWA / Class D	264		365		344
750	30"		–		–		–		316		443		431
800	32"		238		313		364		381		501		491
900	36"		306		391		456		468		700		688
1000	40"		357		466		579		585		757		759
1050	42"		–		–		–		668		–		–
1200	48"		527		715		866		899				1235
–	54"		–		–		–		1271		–		–
1400	–		782		1112		1274		–		–		–
–	60"		–		–		–		1592		–		–
1600	–		1056		1622		1872		–		–		–
1650	66"		–		–		–		2129		–		–
1800	72"		1416		2105		2409		2566		–		–
2000	78"		1875		2628		2997		3111		–		–
–	84"		–		–		–		3753		–		–
2200	–		2510		3420		–		–		–		–
–	90"		–		–		–		4795		–		–
2400	–		2994		4092		–		–		–		–

Transmitter Promag (remote version): 3.4 kg
(Weight data valid without packaging material)

1) Lap joint flanges / welded flanges DN > 300 (12")

Weight data in kg						
Nominal diameter		Compact version[1)]		Remote version (without cable)1)		
[mm]	[inch]	EN (DIN)		Sensor EN (DIN)		Transmitter
25	1"	PN 10	5.8	PN 10	3.8	4.2
32	1 ¼"		5.4		3.4	4.2
40	1 ½"		6.3		4.7	4.2
50	2"		5.4		3.4	4.2
65	2 ½"		6.2		4.2	4.2
80	3"		7.2		5.2	4.2
100	4"		9.7		7.7	4.2
125	5"		13.2		11.2	4.2
150	6"		17.2		15.2	4.2
200	8"		35.7		33.7	4.2
250	10"		54.2		52.2	4.2
300	12"		55.2		53.2	4.2
Transmitter Promag (compact version): 1.8 kg (Weight data valid for standard pressure ratings and without packaging material)						

1) Lap joint flanges, stamped plate

Promag P

Weight data in kg														
Nominal diameter		Compact version						Remote version (without cable)						
								Sensor						Trans-mitter
[mm]	[inch]	EN (DIN) / AS*		JIS		ASME/ AWWA		EN (DIN) / AS*		JIS		ASME/ AWWA		
25	1"	PN 40	5.7	10K	5.7	Class 150	5.7	PN 40	5.3	10K	5.3	Class 150	5.3	3.1
32	1 ¼"		6.4		5.7		–		6.0		5.3		–	3.1
40	1 ½"		7.8		6.7		7.8		7.4		6.3		7.4	3.1
50	2"		9.0		7.7		9.0		8.6		7.3		8.6	3.1
65	2 ½"	PN 16	10.4		9.5		–	PN 16	10.0		9.1		–	3.1
80	3"		12.4		10.9		12.4		12.0		10.5		12.0	3.1
100	4"		14.4		13.1		14.4		14.0		12.7		14.0	3.1
125	5"		19.9		19.4		–		19.5		19.0		–	3.1
150	6"		23.9		22.9		23.9		23.5		22.5		23.5	3.1
200	8"	PN 10	43.4		40.3		43.4	PN 10	43		39.9		43	3.1
250	10"		63.4		67.8		73.4		63		67.4		73	3.1
300	12"		68.4		70.7		108.4		68		70.3		108	3.1
350	14"		113.4				172.4		113				173	3.1
400	16"		133.4				203.4		133				203	3.1
450	18"		173.4				253.4		173				253	3.1
500	20"		173.4				283.4		173				283	3.1
600	24"		233.4				403.4		233				403	3.1
Transmitter Promag (compact version): 1.8 kg (Weight data valid for standard pressure ratings and without packaging material) * Flanges according to AS are only available for DN 25 and 50.														

Promag W

Weight data in kg

Nominal diameter		Compact version						Remote version (without cable)						
								Sensor						Trans-mitter
[mm]	[inch]	EN (DIN) / AS*		JIS		ASME/ AWWA		EN (DIN) / AS*		JIS		ASME/ AWWA		
25	1"	PN 40	5.7	10K	5.7	Class 150	5.7	PN 40	5.3	10K	5.3	Class 150	5.3	3.1
32	1 ¼"		6.4		5.7		–		6.0		5.3		–	3.1
40	1 ½"		7.8		6.7		7.8		7.4		6.3		7.4	3.1
50	2"		9.0		7.7		9.0		8.6		7.3		8.6	3.1
65	2 ½"	PN 16	10.4		9.5		–	PN 16	10.0		9.1		–	3.1
80	3"		12.4		10.9		12.4		12.0		10.5		12.0	3.1
100	4"		14.4		13.1		14.4		14.0		12.7		14.0	3.1
125	5"		19.9		19.4		–		19.5		19.0		–	3.1
150	6"		23.9		22.9		23.9		23.5		22.5		23.5	3.1
200	8"	PN 10	43.4		40.3		43.4	PN 10	43		39.9		43	3.1
250	10"		63.4		67.8		73.4		63		67.4		73	3.1
300	12"		68.4		70.7		108.4		68		70.3		108	3.1
350	14"		113.4				172.4		113				173	3.1
400	16"		133.4				203.4		133				203	3.1
450	18"		173.4				253.4		173				253	3.1
500	20"		173.4				283.4		173				283	3.1
600	24"		233.4				403.4		233				403	3.1
700	28"		353.4			Class D	398.4		353			Class D	398	3.1
–	30"		–				458.4		–				458	3.1
800	32"		433.4				548.4		433				548	3.1
900	36"		573.4				798.4		573				798	3.1
1000	40"		698.4				898.4		698				898	3.1
–	42"	PN 6	–				1098.4	PN 6	–				1098	3.1
1200	48"		848.4				1398.4		848				1398	3.1
–	54"		–				2198.4		–				2198	3.1
1400	–		1298.4				–		1298				–	3.1
–	60"		–				2698.4		–				2698	3.1
1600	–		1698.4				–		1698				–	3.1
–	66"		–				3698.4		–				3698	3.1
1800	72"		2198.4				4098.4		2198				4098	3.1
–	78"		–				4598.4		–				4598	3.1
2000	–		2798.4				–		2798				–	3.1

Transmitter Promag (compact version): 1.8 kg
(Weight data valid for standard pressure ratings and without packaging material)
*Flanges according to AS are only available for DN 80, 100, 150 to 400, 500 and 600

Weight (US units)

Promag D

Weight data in lbs				
Nominal diameter		Compact version	Remote version (without cable)	
[mm]	[inch]		Sensor	Transformer
25	1"	6	6	7
40	1 ½"	8	7	7
50	2"	9	9	7
80	3"	13	13	7
100	4"	19	19	7
Transmitter Promag (compact version): 3.9 lbs (Weight data valid without packaging material)				

Promag E

Weight data in lbs				
Nominal diameter		Compact version	Remote version (without cable)	
			Sensor	Transmitter
		ASME	ASME	
[mm]	[inch]	Class 150	Class 150	Wall-mount housing
15	½"	14.3	9.92	13.2
25	1"	16.1	11.7	
40	1½"	20.7	16.3	
50	2"	23.4	19.0	
80	3"	30.9	26.5	
100	4"	35.3	30.9	
150	6"	56.2	51.8	
200	8"	99.2	94.8	
250	10"	165.4	161.0	
300	12"	242.6	238.1	
350	14"	303.0	293.5	
400	16"	371.3	361.8	
450	18"	422.0	412.6	
500	20"	503.6	494.1	
600	24"	666.8	657.3	

- Transmitter: 4.0 lbs (compact version); 6.8 lbs (remote version)
- Weight data without packaging material

Promag H

Weight data in lbs				
Nominal diameter		Compact version	Remote version (without cable)	
[mm]	[inch]		Sensor	Transformer
2	1/12"	8	4	7
4	1/8"	8	4	7
8	3/8"	8	4	7
15	½"	8	4	7
25	1"	9	6	7
40	1 ½"	11	10	7
50	2"	16	15	7
65	2 ½"	17	17	7
80	3"	38	37	7
100	4"	37	36	7
Transmitter Promag (compact version): 3.9 lbs (Weight data valid for standard pressure ratings and without packaging material)				

Promag L (ASME/AWWA)

Weight data in lbs					
Nominal diameter		Compact version[1]		Remote version1)	
[mm]	[inch]	ASME/AWWA		ASME/AWWA	
25	1"	ASME / Class 150	17.4	ASME / Class 150	13
32	1 ¼"		–		–
40	1 ½"		16.5		12.1
50	2"		16.8		12.3
65	2 ½"		–		–
80	3"		28.2		23.8
100	4"		35.5		31.1
125	5"		–		–
150	6"		53.8		49.4
200	8"		109		105
250	10"		166		161
300	12"		221		216
350	14"		302		298
375	15"		–		–
400	16"		370		366
450	18"		421		417
500	20"		503		498
600	24"		666		662
700	28"	AWWA / Class D	587	AWWA / Class D	582
750	30"		701		697
800	32"		845		840
900	36"		1036		1032
1000	40"		1294		1290
1050	42"		1477		1473
1200	48"		1987		1982
–	54"		2807		2803
1400	–		–		–
–	60"		3515		3510
1600	–		–		–
1650	66"		4699		4694
1800	72"		5662		5658
2000	78"		6864		6860
–	84"		8280		8275
2200	–		–		–
–	90"		10577		10573
2400	–		–		–
Transmitter Promag (compact version): 4.0 lbs Transmitter Promag (remote version): 6.8 lbs (Weight data valid without packaging material)					

1) Lap joint flanges / welded flanges DN > 300 (12")

Promag P (ASME/AWWA)

Weight data in lbs						
Nominal diameter		Compact version		Remote version (without cable)		
[mm]	[inch]			Sensor		Transformer
25	1"	Class 150	13	Class 150	12	7
40	1 ½"		17		16	7
50	2"		20		19	7
80	3"		27		26	7
100	4"		32		31	7
150	6"		53		52	7
200	8"		96		95	7
250	10"		162		161	7
300	12"		239		238	7
350	14"		380		381	7
400	16"		448		448	7
450	18"		559		558	7
500	20"		625		624	7
600	24"		889		889	7
Transmitter Promag (compact version): 3.9 lbs (Weight data valid for standard pressure ratings and without packaging material)						

Promag W (ASME/AWWA)

Weight data in lbs						
Nominal diameter		Compact version		Remote version (without cable)		
[mm]	[inch]			Sensor		Transformer
25	1"	Class 150	13	Class 150	12	7
40	1 ½"		17		16	7
50	2"		20		19	7
80	3"		27		26	7
100	4"		32		31	7
150	6"		53		52	7
200	8"		96		95	7
250	10"		162		161	7
300	12"		239		238	7
350	14"		380		381	7
400	16"		448		448	7
450	18"		559		558	7
500	20"		625		624	7
600	24"		889		889	7
700	28"	Class D	878	Class D	878	7
–	30"		1011		1010	7
800	32"		1209		1208	7
900	36"		1760		1760	7
1000	40"		1981		1980	7
–	42"		2422		2421	7
1200	48"		3083		3083	7
–	54"		4847		4847	7
–	60"		5950		5949	7
–	66"		8155		8154	7
1800	72"		9037		9036	7
–	78"		10139		10139	7
Transmitter Promag (compact version): 3.9 lbs (Weight data valid for standard pressure ratings and without packaging material)						

Material

Promag D

- Transmitter housing: powder-coated die-cast aluminum
- Sensor housing: powder-coated die-cast aluminum
- Measuring tube: polyamide, O-rings EPDM
  (Drinking water approvals: WRAS BS 6920, ACS, NSF 61, KTW/W270)
- Electrodes: 1.4435 (316L)
- Ground disks Promag D as wafer version: 1.4301 (304)
- Ground disks Promag D with threaded connection: 1.4301 (304)

Promag E

- Transmitter housing: powder-coated die-cast aluminum
- Sensor housing
  – DN 15 to 300 (½ to 12"): powder-coated die-cast aluminum
  – DN 350 to 600 (14 to 24"): with protective lacquering
- Measuring tube
  – DN ≤ 300 (12"): stainless steel 1.4301 (304) or 1.4306 (304L) (with Al/Zn protective coating)
  – DN ≥ 350 (14"): stainless steel 1.4301 (304) or 1.4306 (304L) (with protective lacquering)
- Electrodes: 1.4435 (316L), Alloy C22
- Flanges (with protective lacquering)
  – EN 1092-1 (DIN2501): RSt37-2 (S235JRG2); Alloy C22; Fe 410W B
  – ASME: A105
  – JIS: RSt37-2 (S235JRG2); HII
- Seals: to DIN EN 1514-1
- Ground disks: 1.4435 (316L) or Alloy C22

Promag H

- Transmitter housing: powder-coated die-cast aluminum
- Window material: glass or polycarbonate
- Sensor housing: stainless steel 1.4301 (304)
- Wall mounting kit: stainless steel 1.4301 (304)
- Measuring tube: stainless steel 1.4301 (304)
- Liner: PFA (USP Class VI, FDA 21 CFR 177.1550, 3A)
- Electrodes: 11.4435 (316L) (optional: Alloy C22)
- Flanges: connections generally made of 1.4404 (316L)
- Seals
  – DN 2 to 25: O-ring (EPDM, Viton, Kalrez), gasket seal (EPDM*, Viton, Silicone*)
  – DN 40 to 100: gasket seal (EPDM*, Silicone*)
  * = USP Class VI, FDA 21 CFR 177.2600, 3A
- Ground rings: 1.4435 (316L) (optional: Alloy C22)

Promag L

- Transmitter housing:
  - Compact housing: powder-coated die-cast aluminum
  - Wall-mounted housing: powder-coated die-cast aluminum
- Sensor housing
  - DN 25 to 300 (1 to 12"): powder-coated die-cast aluminum
  - DN 350 to 1200 (14 to 48"): with protective lacquering
- Measuring tube:
  - DN £ 300 (12"); stainless steel 1.4301 (304) or 1.4306 (304L)
  - DN ³ 350 (14"); stainless steel 202 or 304
- Electrodes: 1.4435 (316L), Alloy C22
- Flange
  - EN 1092-1 (DIN 2501): DN ≤ 300: 1.4306; 1.4307; 1.4301 (304); 1.0038 (S235JRG2)
  - EN 1092-1 (DIN 2501): DN ≥ 350: A105; 1.0038 (S235JRG2)
  - AWWA: A181/A105; 1.0425 (316L) (P265GH); 1.0044 (S275JR)
  - AS 2129: A105; 1.0345 (P235GH); 1.0425 (316L) (P265GH); 1.0038 (S235JRG2); FE 410 WB
  - AS 4087: A105; 1.0425 (316L) (P265GH); 1.0044 (S275JR)
- Seals: to DIN EN 1514-1
- Ground disks: 11.4435 (316L) or Alloy C22

Promag P/W

- Transmitter housing: powder-coated die-cast aluminum
- Sensor housing
  - DN 25 to 300: powder-coated die-cast aluminum
  - DN 350 to 2000: with protective lacquering
- Measuring tube
  - DN ≤ 300: stainless steel 1.4301 (304) or 1.4306 (304L)
    (Flange material: carbon steel with Al/Zn protective coating)
  - DN ≥ 350: stainless steel 1.4301 (304) or 1.4306 (304)
    (Flange material: carbon steel with protective lacquering)
- Electrodes: 1.4435 (316L), Alloy C22
- Flange
  - EN 1092-1 (DIN2501): RSt37-2 (S235JRG2); Alloy C22; FE 410 WB
    (DN ≤ 300: with Al/Zn protective coating; DN ≥ 350 with protective lacquering)
  - ASME: A105
    (DN ≤ 300 with Al/Zn protective coating; DN ≥ 350 with protective lacquering)
  - AWWA (only Promag W): 1.0425 (with protective lacquering)
  - JIS: RSt37-2 (S235JRG2); HII; 1.0425
    (DN ≤ 300 with Al/Zn protective coating; DN ≥ 350 with protective lacquering)
  - AS 2129
    - (DN 25, 80, 100, 150 to 1200) A105 or RSt37-2 (S235JRG2)
    - (DN 50, 80, 350, 400, 500) A105 or St44-2 (S275JR)
      (DN ≤ 300 with Al/Zn protective coating; DN ≥ 350 with protective lacquering)
  - AS 4087: A105 or St44-2 (S275JR)
    (DN ≤ 300 with Al/Zn protective coating; DN ≥ 350 with protective lacquering)
- Seals: to DIN EN 1514-1
- Ground disks: 1.4435 (316L) or Alloy C22

Fitted electrodes

Promag D

- 2 measuring electrodes for signal detection

Promag E/L/P/W

- 2 measuring electrodes for signal detection
- 1 EPD electrode for empty pipe detection
- 1 reference electrode for potential equalization

Promag H

- 2 measuring electrodes for signal detection
- 1 EPD electrode for empty pipe detection, not for DN 2 to 8 ($^{1}/_{12}$ to ½")

Process connections

Promag D as wafer version

The wafer version is compatible with the following process connections:

- EN 1092-1 (DIN 2501)
- ASME B16.5
- JIS B2220

Promag D with threaded connection

- DIN ISO 228, G" external thread
- ANSI/ASME B1.20, NPT" external thread

Promag E

Flange connection:
- EN 1092-1 (DIN 2501), DN ≤ 300 (12") form A, DN ≥ 350 (14") form B (Dimensions to DIN 2501, DN 65 PN 16 and DN 600 (24") PN 16 exclusively to EN 1092-1)
- ASME B16.5
- JIS B2220

Promag H

With O-ring:
- Flange EN (DIN), ASME, JIS
- External thread

With gasket seal:
- Weld nipple EN 10357 (DIN 11850), ODT/SMS
- TriClamp L14 AM7
- Threaded joint DIN 11851, DIN 11864-1, SMS 1145
- Flange DIN 11864-2

Promag L

Flange connection:
- EN 1092-1 (DIN 2501)
  - DN ≤300 (12") = form A
  - DN ≥ 350 (14") = form B
- ASME B16.5
- AWWA C207
- AS

Promag P/W

Flange connections:
- EN 1092-1 (DIN 2501)
  - DN ≤ 300 = form A
  - DN ≥ 350 = flat face
  - DN 65 PN 16 and DN 600 PN 16 only as per EN 1092-1
- ASME
- AWWA (only Promag W)
- JIS
- AS

Surface roughness

All data relate to parts in contact with fluid.
- Electrodes stainless steel 1.4435 (316L), Alloy C22, 2.4602 (UNS N06022): 0.3 to 0.5 µm (11.8 to 19.7 µin)
- Liner with PFA: ≤ 0.4 µm (15.7 µin)
- Process connection made of stainless-steel (Promag H):
  - with O-ring seal: ≤ 1.6 µm (63 µin)
  - with aseptic gasket seal: ≤ 0.8 µm (31.5 µin)
  - optional: ≤ 0.38 µm (15 µin)

10.11 Operability

Local display

Display elements
- Liquid crystal display: unilluminated, two-line, 16 characters per line
- Display (operating mode) preconfigured: volume flow and totalizer status
- 1 totalizer

Note!
At ambient temperatures below −20 (−4 °F) the readability of the display may be impaired.

Operating elements

Local operation with three keys (⊟ ⊞ Ⓔ)

Remote operation

Operation via HART protocol and FieldCare

10.12 Certificates and approvals

CE mark

The measuring system is in conformity with the statutory requirements of the EC Directives. Endress+Hauser confirms successful testing of the device by affixing to it the CE mark.

C-tick mark

The measuring system meets the EMC requirements of the Australian Communications and Media Authority (ACMA)

Ex approval

Information about currently available Ex versions (ATEX, FM, CSA, IECEx, NEPSI etc.) can be supplied by your Endress+Hauser Sales Center on request. All explosion protection data are given in a separate documentation which is available upon request.

Sanitary compatibility

Promag D/E/L/P/W

No applicable approvals or certification

Promag H

- 3A authorization and EHEDG-certified
- Seals: in conformity with FDA (except Kalrez seals)

Drinking water approval

Promag D/L/W

- WRAS BS 6920
- ACS
- NSF 61
- KTW/W270

Promag E/H/P

No drinking water approval

Pressure Equipment Directive

Promag D/L

No pressure measuring device approval

Promag E/H/P/W

The devices can be ordered with or without a PED approval. If a device with a PED approval is required, this must be explicitly stated in the order. For devices with nominal diameters less than or equal to DN 25 (1"), this is neither possible nor necessary.

- With the PED/G1/x (x = category) marking on the sensor nameplate, Endress+Hauser confirms compliance with the "Essential Safety Requirements" specified in Annex I of the Pressure Equipment Directive 97/23/EC.
- Devices bearing this marking (PED) are suitable for the following types of medium: Media in Group 1 and 2 with a vapor pressure greater than, or smaller and equal to 0.5 bar (7.3 psi)
- Devices not bearing this marking (PED) are designed and manufactured according to good engineering practice. They meet the requirements of Art.3 Section 3 of the Pressure Equipment Directive 97/23/EC. The range of application is indicated in tables 6 to 9 in Annex II of the Pressure Equipment Directive.

Other standards and guidelines

- EN 60529:
  Degrees of protection by housing (IP code).
- EN 61010-1
  Safety requirements for electrical equipment for measurement, control and laboratory use
- IEC/EN 61326
  Electromagnetic compatibility (EMC requirements)
- ASME/ISA-S82.01
  Safety Standard for Electrical and Electronic Test, Measuring, Controlling and related Equipment - General Requirements. Pollution degree 2, Installation Category II.
- CAN/CSA-C22.2 (No. 1010.1-92)
  Safety requirements for Electrical Equipment for Measurement and Control and Laboratory Use. Pollution degree 2, Installation Category I.

10.13 Ordering information

Detailed ordering information is available from the following sources:
- In the Product Configurator on the Endress+Hauser website: www.endress.com → Select country → Instruments → Select device → Product page function: Configure this product
- From your Endress+Hauser Sales Center: www.endress.com/worldwide



Note!
Product Configurator - the tool for individual product configuration
- Up-to-the-minute configuration data
- Depending on the device: Direct input of measuring point-specific information such as measuring range or operating language
- Automatic verification of exclusion criteria
- Automatic creation of the order code and its breakdown in PDF or Excel output format
- Ability to order directly in the Endress+Hauser Online Shop

10.14 Accessories


Various accessories, which can be ordered separately from Endress+Hauser, are available for the transmitter and the sensor.→ 72
Your Endress+Hauser service organization can provide detailed information on the specific order codes on request.

10.15 Documentation

- Flow measuring technology (FA00005D/06)
- Technical Information Promag 10D (TI00081D/06)
- Technical Information Promag 10E (TI01160D/06)
- Technical Information Promag 10H (TI00095D/06)
- Technical Information Promag 10L(TI00100D/06)
- Technical Information Promag 10P (TI00094D/06)
- Technical Information Promag 10W (TI00093D/06)

11 Appendix

11.1 Illustration of the function matrix

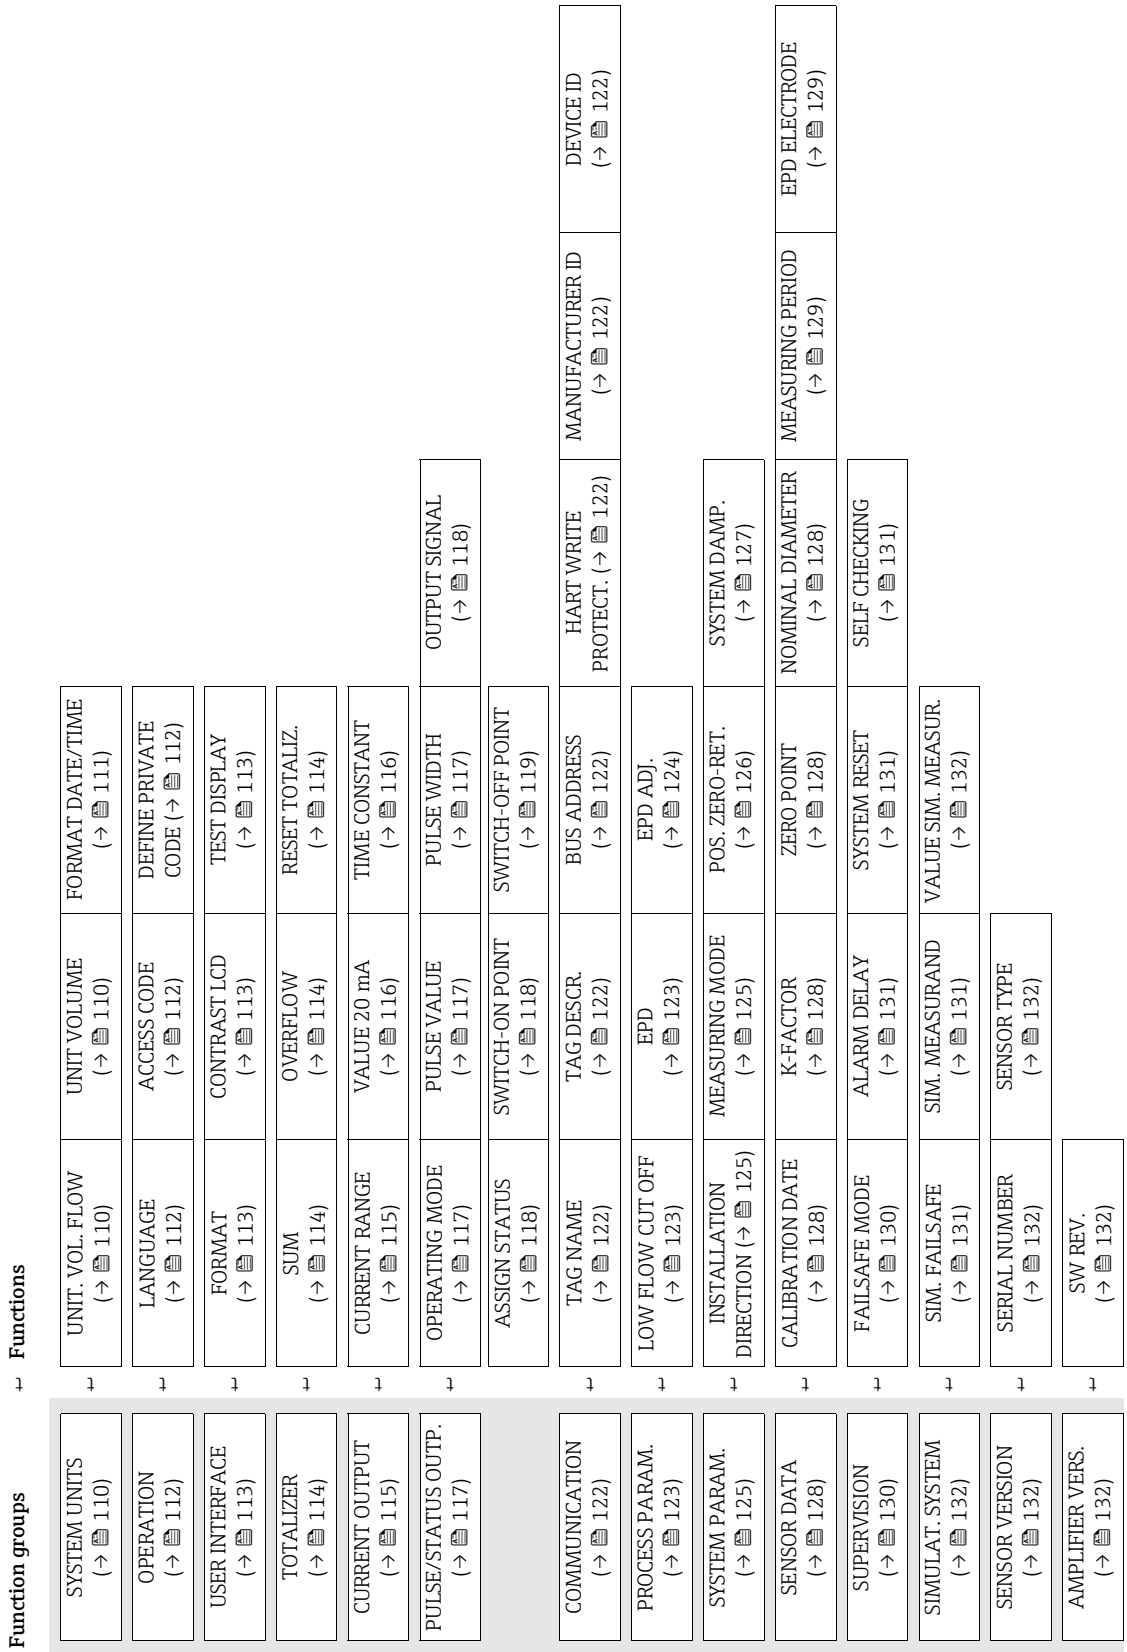

11.2 Group SYSTEM UNITS

Functional description SYSTEM UNITS	
Use this function group to select the unit required and displayed for the measured variable.	
UNIT VOLUME FLOW	Use this function to select the unit required and displayed for the volume flow. The unit you select here is also valid for: ▪ Volume flow display ▪ Current output ▪ Switch points (limit value for volume flow, flow direction) ▪ Low flow cut off **Options:** *Metric:* Cubic centimeter → cm^3/s; cm^3/min; cm^3/h; cm^3/day Cubic decimeter → dm^3/s; dm^3/min; dm^3/h; dm^3/day Cubic meter → m^3/s; m^3/min; m^3/h; m^3/day Milliliter → ml/s; ml/min; ml/h; ml/day Liter → l/s; l/min; l/h; l/day Hectoliter → hl/s; hl/min; hl/h; hl/day Megalith → Ml/s; Ml/min; Ml/h; Ml/day *US*: Cubic centimeter → cc/s; cc/min; cc/h; cc/day Acre foot → af/s; af/min; af/h; af/day Cubic foot → ft3/s; ft3/min; ft3/h; ft3/day Fluid ounce → oz f/s; oz f/min; oz f/h; oz f/day Gallon → gal/s; gal/min; gal/h; gal/day Kilo gallons → kgal/s; kgal/min; kgal/h; kgal/day Million gallons → Mgal/s; Mgal/min; Mgal/h; Mgal/day Barrel (normal fluids: 31.5 gal/bbl) → bbl/s; bbl/min; bbl/h; bbl/day Barrel (beer: 31.0 gal/bbl) → bbl/s; bbl/min; bbl/h; bbl/day Barrel (petrochemicals: 42.0 gal/bbl) → bbl/s; bbl/min; bbl/h; bbl/day Barrel (filling tanks: 55.0 gal/bbl) → bbl/s; bbl/min; bbl/h; bbl/day *Imperial*: Gallon → gal/s; gal/min; gal/h; gal/day Mega gallon → Mgal/s; Mgal/min; Mgal/h; Mgal/day Barrel (beer: 36.0 gal/bbl) → bbl/s; bbl/min; bbl/h; bbl/day Barrel (petrochemicals: 34.97 gal/bbl) → bbl/s; bbl/min; bbl/h; bbl/day **Factory setting**: Depends on nominal diameter and country (dm^3/min to m^3/h or US-gal/min), corresponding to the full scale value unit factory setting → 🖹 133
UNIT VOLUME	Use this function to select the unit required and displayed for the volume. The unit you select here is also valid for: ▪ Totalizer status display ▪ Totalizer unit ▪ Pulse value (e.g. m^3/p) **Options:** *Metric* → cm^3; dm^3; m^3; ml; l; hl; Ml *US* → cc; af; ft3; oz f; gal; Mgal; bbl (normal fluids); bbl (beer); bbl (petrochemicals); bbl (filling tanks) *Imperial* → gal; Mgal; bbl (beer); bbl (petrochemicals) **Factory setting**: Depends on nominal diameter and country (dm^3 to m^3 or US-gal corresponding to the totalizer unit factory setting. → 🖹 133

Functional description SYSTEM UNITS	
FORMAT DATE/TIME	Use this function to select the format for the date and the time. The unit you select here is also valid for displaying the current calibration date (function CALIBRATION DATE on → 🖹 128 **Options**: DD.MM.YY 24H MM/DD/YY 12H A/P DD.MM.YY 12H A/P MM/DD/YY 24H **Factory setting:** DD.MM.YY 24H (SI units) MM/DD/YY 12H A/P (US units)

11.3 Group OPERATION

Functional description OPERATION	
LANGUAGE	Use this function to select the language for all texts, parameters and messages shown on the local display. **Options:** ENGLISH DEUTSCH FRANCAIS ESPANOL ITALIANO **Factory setting**: Depends on country, see factory setting → 133 Note! If you press the ⊕⊖keys simultaneously at startup, the language defaults to "ENGLISH".
ACCESS CODE	All data of the measuring system are protected against inadvertent change. Programming is disabled and the settings cannot be changed until a code is entered in this function. If you press the ⊕⊖ keys in any function, the measuring system automatically goes to this function and the prompt to enter the code appears on the display (when programming is disabled). You can activate programming by entering your private code (**factory setting = 10**, see also the subsequent DEFINE PRIVATE CODE function) **User input**: Max. 4-digit number: 0 to 9999 Note! ▪ The programming levels are disabled if you do not press the operating elements within 60 seconds following automatic return to the HOME position. ▪ You can also disable programming in this function by entering any number (other than the defined private code). ▪ The Endress+Hauser service organization can be of assistance if you mislay your personal code.
DEFINE PRIVATE CODE	Use this function to enter a personal code to enable programming. **User input:** 0 to 9999 (max. 4-digit number) **Factory setting:** 10 Note! ▪ This function only appears if the private code was entered in the ACCESS CODE function. ▪ Programming is always enabled with the code "0". ▪ Programming has to be enabled before this code can be changed. When programming is disabled this function is not available, thus preventing others from accessing your personal code.

11.4 USER INTERFACE

Functional description USER INTERFACE	
FORMAT	Use this function to define the maximum number of places after the decimal point displayed for the reading in the main line. **Options:** XXXXX. XXXX.X XXX.XX XX.XXX X.XXXX **Factory setting**: X.XXXX ✎ Note! ▪ Note that this setting only affects the reading as it appears on the display, it has no influence on the accuracy of the system's calculations. ▪ The places after the decimal point as computed by the measuring device cannot always be displayed, depending on this setting and the engineering unit. In such instances an arrow appears on the display between the measuring value and the engineering unit (e.g. 1.2 → l/h), indicating that the measuring system is computing with more decimal places than can be shown on the display.
CONTRAST LCD	Use this function to optimize display contrast to suit local operating conditions. **User input**: 10 to 100% **Factory setting**: 50%
TEST DISPLAY	Use this function to test the operability of the local display and its pixels. **Options:** OFF ON **Factory setting**: OFF **Test sequence:** 1. Start the test by selecting ON. 2. All pixels of the main line and additional line are darkened for minimum 0.75 seconds. 3. The main line and additional line show an "8" in each field for minimum 0.75 seconds. 4. The main line and additional line show a "0" in each field for minimum 0.75 seconds. 5. The main line and additional line show nothing (blank display) for minimum 0.75 seconds. When the test completes the local display returns to its initial state and the setting changes to "OFF".

11.5 Group TOTALIZER

Functional description TOTALIZER	
SUM	The total for the totalizer's measured variable aggregated since measuring commenced appears on the display. This value can be positive or negative, depending on: ▪ Flow direction and/or ▪ Setting in the MEASURING MODE function → 🖹 125 **Display**: Max. 6-digit floating-point number, incl. sign and unit (e.g. 15467.4 m^3) ✎ Note! ▪ The totalizer's response to faults is defined in the central "FAILSAFE MODE" function → 🖹 130. ▪ The unit of the totalizer is defined in the UNIT VOLUME function → 🖹 110.
OVERFLOW	The total for the totalizer's overflow aggregated since measuring commenced appears on the display. Total flow quantity is represented by a floating-point number consisting of max. 7 digits. You can use this function to view higher numerical values (>9,999,999) as overflows. The effective quantity is thus the total of the OVERFLOW function plus the value displayed in the SUM function. **Example:** Reading for 2 overflows: 2 E7 dm^3 (= 20,000,000 dm^3) The value displayed in the function "SUM" = 196,845 dm^3 Effective total quantity = 20,196,845 dm^3 **Display**: Integer with exponent, including sign and unit, e.g. 2 E7 dm^3
RESET TOTALIZER	Use this function to reset the sum and the overflow of the totalizer to "zero" (= RESET). **Options:** NO YES **Factory setting**: NO

11.6 Group CURRENT OUTPUT

Functional description CURRENT OUTPUT

Note!
The functions of the CURRENT OUTPUT group are only available if the "0" value was entered in the BUS ADDRESS function → 122.


CURRENT RANGE

Use this function to specify the current range. You can configure the current output either in accordance with the NAMUR recommendation (max. 20.5 mA) or for a maximum drive of 25 mA.

Options:
OFF
4-20 mA (25 mA)
4-20 mA (25 mA) HART
4-20 mA NAMUR
4-20 mA HART NAMUR
4-20 mA US
4-20 mA HART US

Factory setting:
4-20 mA HART NAMUR

Current range, work range and signal on alarm level

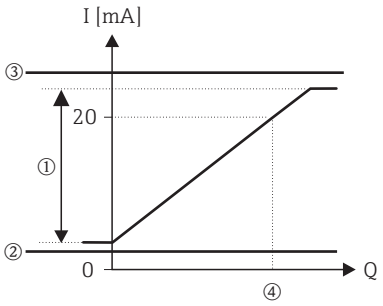

A	①	②	③
OFF	4 mA	-	-
4-20 mA (25 mA)	4 - 24 mA	2	25
4-20 mA (25 mA) HART	4 - 24 mA	2	25
4-20 mA NAMUR	3,8 - 20,5 mA	3,5	22,6
4-20 mA HART NAMUR	3,8 - 20,5 mA	3,5	22,6
4-20 mA US	3,9 - 20,8 mA	3,75	22,6
4-20 mA HART US	3,9 - 20,8 mA	3,75	22,6


A0005392

A = Work range
1 = Work range
2 = Lower signal on alarm level
3 = Upper signal on alarm level
4 = Scaled full scale value
Q = Flow

Note!
- If the measured value is outside the measuring range (defined in the VALUE 20 mA function → 116), a notice message is generated.
- The current output's response to faults is defined in the central FAILSAFE MODE function → 130.

Functional description CURRENT OUTPUT	
VALUE 20 mA	Use this function to assign the 20 mA current a full scale value. Positive and negative values are permitted. The required measuring range is defined by defining the VALUE 20 mA . In the SYMMETRY measuring mode → 🖹 125, the value assigned applies to both flow directions; in the STANDARD measuring mode it applies only to the flow direction selected. **User input**: 5-digit floating-point number, with sign **Factory setting**: Depends on nominal diameter and country, [value] / [dm^3 to m^3 or US-gal to US-Mgal] Corresponds to the factory setting for the full scale value → 🖹 133 ✎ Note! ▪ The appropriate unit is taken from the SYSTEM UNITS group → 🖹 110. ▪ The value for 4 mA always corresponds to the zero flow (0 [unit]). This value is fixed and cannot be edited.
TIME CONSTANT	Use this function to enter a time constant defining how the current output signal reacts to severely fluctuating measured variables, either very quickly (enter a low time constant) or with damping (enter a high time constant). **User input**: Fixed-point number 0.01 to 100.00 s **Factory setting**: 1.00 s

11.7 Group PULSE/STATUS OUTPUT

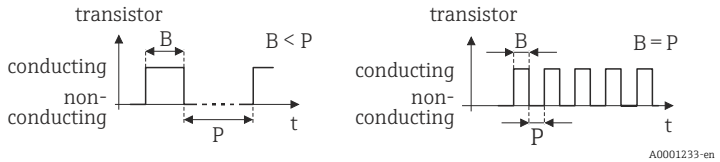Functional description PULSE/STATUS OUTPUT	
OPERATING MODE	Configuration of the output as a pulse or status output. The functions available in this function group vary, depending on which option you select here. **Options:** OFF PULSE STATUS **Factory setting**: PULSE
PULSE VALUE	Note! This function is not available unless the PULSE setting was selected in the OPERATING MODE function. Use this function to define the flow at which a pulse is triggered. These pulses can be totaled by an external totalizer, and the total flow quantity since measuring started can be registered in this way. In the SYMMETRY measuring mode → 125, the value assigned applies to both flow directions; in the STANDARD measuring mode it applies only to the positive flow direction. **User input**: 5-digit floating-point number, [unit] **Factory setting**: Depends on nominal diameter and country, [value] [dm^3 to m^3 or US-gal] / pulse; Corresponds to the factory setting for the pulse value → 133 Note! The appropriate unit is taken from the SYSTEM UNITS group.
PULSE WIDTH	Note! This function is not available unless the PULSE setting was selected in the OPERATING MODE function. Use this function to enter the maximum pulse width of the output pulses. **User input:** 5 to 2000 ms **Factory setting:** 100 ms Pulse output is always with the pulse width (B) entered in this function. The pauses (P) between the individual pulses are automatically configured. However, they must at least correspond to the pulse width (B = P).  *P = Intervals between the individual pulses* *B = Pulse width entered (the illustration applies to positive pulses)* Caution! Buffering (pulse memory) takes place if the number of pulses is too large to output the pulses with the selected pulse width (see PULSE VALUE function on → 117). The system error message RANGE PULSE is displayed if more pulses are in the pulse memory than can be output in 4 seconds. Note! ▪ When selecting the pulse width, choose a value that can still be processed by a connected counter (e.g. mechanical counter, PLC etc.). ▪ The pulse output's response to faults is defined in the central FAILSAFE MODE function → 130.

Functional description PULSE/STATUS OUTPUT	
OUTPUT SIGNAL	Note! This function is not available unless the PULSE setting was selected in the OPERATING MODE function. Use this function to configure the output in such a way that it matches an external counter, for example. Depending on the application, you can select the direction of the pulses here. **Options:** PASSIVE - POSITIVE PASSIVE - NEGATIVE **Factory setting**: PASSIVE - NEGATIVE
ASSIGN STATUS OUTPUT	Note! This function is not available unless the STATUS setting was selected in the OPERATING MODE function. Configuration of the status output. **Options:** ON (operation) FAULT MESSAGE NOTICE MESSAGE FAULT MESSAGE or NOTICE MESSAGE EPD (empty pipe detection, only if active) FLOW DIRECTION VOLUME FLOW LIMIT VALUE **Factory setting**: FAULT MESSAGE Note! ▪ The behavior of the status output is a normally closed behavior, in other words the output is closed (trASMEstor conductive) when normal, error-free measuring is in progress. ▪ It is very important to read and comply with the information on the switching characteristics of the status output → 🖹 121.
SWITCH-ON POINT	Note! This function is not available unless LIMIT VALUE or FLOW DIRECTION was selected in the ASSIGN STATUS OUTPUT function. Use this function to assign a value to the switch-on point (status output pulls up). The value can be equal to, greater than or less than the switch-off point. Positive and negative values are permitted. **User input**: 5-digit floating-point number, [unit] **Factory setting**: 0 [unit] Note! ▪ The appropriate unit is taken from the SYSTEM UNITS group. ▪ Only the switch-on point is available for flow direction output (no switch-off point). If you enter a value not equal to the zero flow (e.g. 5), the difference between the zero flow and the value entered corresponds to half the switchover hysteresis.


Functional description PULSE/STATUS OUTPUT	
SWITCH-OFF POINT	✎ Note! This function is not available unless LIMIT VALUE was selected in the ASSIGN STATUS OUTPUT function. Use this function to assign a value to the switch-off point (status output drops off). The value can be equal to, greater than or less than the switch-on point. Positive and negative values are permitted. **User input**: 5-digit floating-point number, [unit] **Factory setting**: 0 [unit] ✎ Note! ▪ The appropriate unit is taken from the SYSTEM UNITS group. ▪ If SYMMETRY is selected in the MEASURING MODE function and values with different signs are entered for the switch-on and switch-off points, the notice message "INPUT RANGE EXCEEDED" appears.

11.7.1 Information on the response of the status output

General

If you have configured the status output for "LIMIT VALUE" or "FLOW DIRECTION", you can configure the requisite switch points in the SWITCH-ON POINT and SWITCH-OFF POINT functions. When the measured variable in question reaches these predefined values, the status output switches as shown in the illustrations below.

Status output configured for flow direction

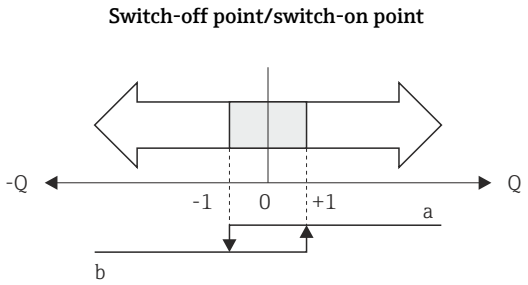


a = Status output conductive
b = Status output not conductive

The value you entered in the function SWITCH-ON POINT defines the switch point for the positive and negative directions of flow. If, for example, the switch point entered is = 1 m^3/h, the status output switches off at −1 m^3/h (not conductive) and switches on again at +1 m^3/h (conductive). Set the switch point to 0 if your process calls for direct switchover (no switching hysteresis). If low flow cut off is used, it is advisable to set hysteresis to a value greater than or equal to the low flow cut off rate.

Status output configured for limit value



















The status output switches as soon as the measured variable undershoots or overshoots a defined switch point.

Application: monitoring flow or process-related boundary conditions.

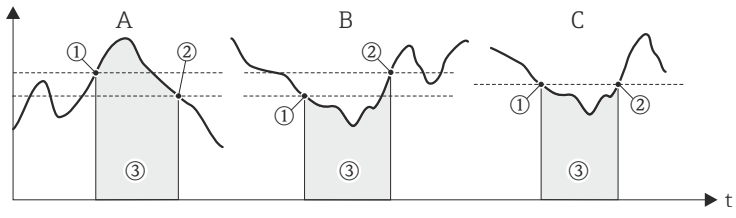

- A = Maximum safety:
  1 SWITCH-OFF POINT > 2 SWITCH-ON POINT
- B = Minimum safety:
  1 SWITCH-OFF POINT < 2 SWITCH-ON POINT
- C = Minimum safety:
  1 SWITCH-OFF POINT = 2 SWITCH-ON POINT (this configuration should be avoided)
- 3 = Relay de-energized


11.7.2 Switching behavior of the status output

Function	State	Open collector behavior (TrASMEstor)
ON (operation)	System in measuring mode 	conductive  A0001237
	System not in measuring mode (power supply failed) 	not conductive  A0001239
Fault message	System OK 	conductive  A0001237
	(System error or process error) fault → Response to error, outputs/inputs and totalizers 	not conductive  A0001239
Notice message	System OK 	conductive  A0001237
	(System error or process error) Notice → Continuation of measuring 	not conductive  A0001239
Fault message or notice message	System OK 	conductive  A0001237
	(System error or process error) Fault → Response to error or Notice → Continuation of measuring 	not conductive  A0001239
Empty pipe detection (EPD)	Measuring tube full 	conductive  A0001237
	Measuring tube partially filled / empty measuring tube 	not conductive  A0001239
Flow direction	Forwards  A0001241	conductive  A0001237
	Backwards  A0001242	not conductive  A0001239
Volume flow limit value	Limit value not overshot or undershot  A0001243	conductive  A0001237
	Limit value overshot or undershot  A0001244	not conductive  A0001239

11.8 Group COMMUNICATION



Functional description COMMUNICATION	
✎ **Note!** **The communication group is only visible if the HART option was selected in the CURRENT RANGE function.**	
TAG NAME	Use this function to enter a tag name for the measuring device. You can edit and read this tag name at the local display or via the HART protocol. **User input**: Max. 8-character text, permitted characters are: A-Z, 0-9, +,-, underscore, space, period **Factory setting**: "_ _ _ _ _ _ _ _" (no text)
TAG DESCRIPTION	Use this function to enter a tag description for the measuring device. You can edit and read this tag description at the local display or via the HART protocol. **User input**: Max. 16-character text, permitted characters are: A-Z, 0-9, +,-, underscore, space, period **Factory setting**: "_ _ _ _ _ _ _ _ _ _ _ _ _ _ _ _" (no text)
BUS ADDRESS	Use this function to define the address for the exchange of data with the HART protocol. **User input**: 0 to 15 **Factory setting**: 0 ✎ Note! Addresses 1 to 15: a constant 4 mA current is applied.
HART WRITE PROTECTION	Use this function to activate HART write protection. **Options:** OFF = function can be edited/read via the HART protocol ON = HART protocol write-protected (only readable) **Factory setting**: OFF
MANUFACTURER ID	Use this function to view the manufacturer ID in decimal numerical format. **Display**: – Endress+Hauser – 17 (≙ 11 hex) for Endress+Hauser
DEVICE ID	Use this function to view the device ID in hexadecimal numerical format. **Display**: 45 hex (≙ 69 dec) for Promag 10


11.9 Group PROCESS PARAMETER

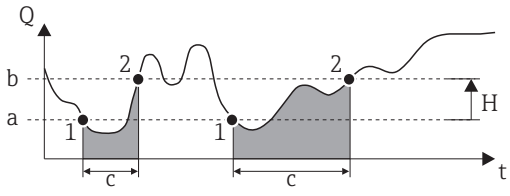Functional description PROCESS PARAMETER	
SWITCH-ON POINT LOW FLOW CUT OFF	Use this function to enter the switch-on point for low flow cut off. Low flow cut off is active if the value entered is not equal to 0. The sign of the flow value is highlighted on the display to indicate that low flow cut off is active. **User input**: 5-digit floating-point number, [unit] **Factory setting**: Depends on nominal diameter and country, [value] / [dm^3 to m^3 or US-gal] Corresponds to the factory setting for the low flow cut off → 133 Note! The appropriate unit is taken from the SYSTEM UNITS group. The switch-off point is specified as a positive hysteresis from the switch-on point with 50%.  A0001245 *Q* *Flow [volume/time]* *t* *Time* *H* *Hysteresis* *a* *SWITCH-ON POINT LOW FLOW CUT OFF = 200 dm^3/h* *b* *Low flow cut off switch-off point = 50%* *c* *Low flow cut off active* *1* *Low flow cut off is switched on at 200 dm^3/h* *2* *Low flow cut off is switched off at 300 dm^3/h*
EPD	Activating empty pipe detection (EPD). **Options:** OFF ON (empty pipe detection) **Factory setting**: OFF Note! ▪ The ON option is not available unless the sensor is fitted with an EPD electrode. ▪ The default setting for the EPD function when the device is delivered is OFF. The function must be activated as required. ▪ When delivered, the measuring device is calibrated with water (500 µS/cm). If the fluid differs from this conductivity, empty-pipe and full-pipe adjustment has to be performed on site. ▪ To activate the function (ON option), valid adjustment coefficients have to be available. ▪ The following error messages are displayed if the empty-pipe and full-pipe adjustment is incorrect: ▪ ADJUSTMENT FULL = EMPTY: the adjustment values for empty pipe and full pipe are identical. ▪ ADJUSTMENT NOT OK: adjustment is not possible as the fluid conductivity values are outside the permitted range. ▪ In cases of this nature you must repeat empty-pipe or full-pipe adjustment.

Functional description PROCESS PARAMETER	
EPD-MODE (continued)	**Notes on empty pipe detection (EPD)** ▪ Flow cannot be measured correctly unless the measuring tube is completely full. This status can be monitored at all times by means of the EPD. ▪ An empty or partially filled pipe is a process error. A default factory setting defines that a notice message is issued and that this process error does not have any effect on the outputs. ▪ The EPD process error can be output via the configurable status output. **Response to partially filled pipe** If the EPD is switched on and responds to a partially filled or empty pipe, the notice message "EMPTY PIPE" appears on the display and zero flow is indicated. If the pipe is partially empty and the EPD is not switched on, the response can vary in identically configured systems: ▪ Flow reading fluctuates ▪ Zero flow ▪ Excessively high flow values
EPD ADJUSTMENT	Use this function to activate adjustment for an empty or full measuring tube. **Options:** OFF EPD EMPTY PIPE ADJ. EPD FULL PIPE ADJUST **Factory setting**: OFF ✎ Note! An exact description of the procedure for an EPD empty-pipe/full-pipe adjustment is provided on → 🖹 70.

11.10 Group SYSTEM PARAMETER

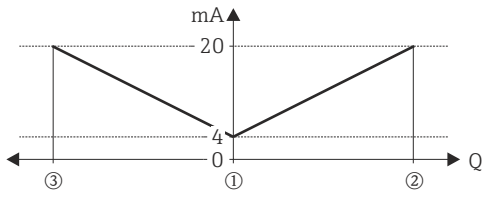Functional description SYSTEM PARAMETER	
INSTALLATION DIRECTION SENSOR	Use this function to reverse the sign of the flow quantity, if necessary. **Options:** FORWARDS (flow as indicated by the arrow) BACKWARDS (flow opposite to direction indicated by the arrow) **Factory setting**: FORWARDS ✎ Note! Ascertain the actual direction of fluid flow with reference to the direction indicated by the arrow on the sensor (nameplate).
MEASURING MODE	Use this function to select the measuring mode for all outputs and for the internal totalizer. **Options:** STANDARD SYMMETRY **Factory setting**: STANDARD The responses of the individual outputs and the internal totalizer in each of the measuring modes are described in detail on the following pages: **Current output** STANDARD Only the flow components for the selected flow direction are output, (positive or negative full scale value (2) = flow direction). Flow components in the opposite direction are not taken into account (suppression). Example for current output:  A0001248 SYMMETRY The output signals of the current output are independent of the direction of flow (absolute amount of the measured variable). The "VALUE20mA" (3) (e.g. backflow) corresponds to the mirrored VALUE20mA (2) (e.g. flow). Positive and negative flow components are taken into account. Example for current output:  A0001249 ✎ Note! The direction of flow can be output via the configurable status output.

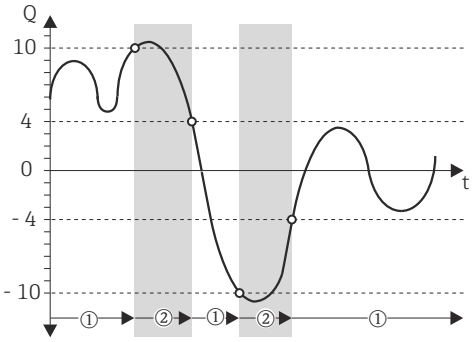Functional description SYSTEM PARAMETER	
MEASURING MODE (Contd)	**Pulse output** STANDARD Only flow components of the positive flow direction are output. Components in the opposite direction are not taken into account. SYMMETRY The absolute value of the positive and negative flow components is taken into account. **Status output** ✎ Note! The information is only applicable if LIMIT VALUE was selected in the function ASSIGN STATUS OUTPUT. STANDARD The status output signal switches at the defined switch points. SYMMETRY The status output signal switches at the defined switch points, irrespective of the sign. In other words, if you define a switch point with a positive sign, the status output signal switches as soon as the value is reached in the negative direction (negative sign), (see illustration). Example for the SYMMETRY measuring mode: Switch-on point: Q = 4 Switch-off point: Q = 10 1 = Status output switched on (conductive) 2 = Status output switched off (nonconductive)  A0001247 **Totalizer** STANDARD Only positive flow components are output. Negative components are not taken into account. SYMMETRY The positive and negative flow components are balanced. In other words, net flow in the flow direction is registered.
POSITIVE ZERO RETURN	Use this function to interrupt evaluation of measured variables. This is necessary when a piping system is being cleaned, for example. This setting acts on all function and outputs of the measuring device. **Options:** OFF ON → Signal output is set to the "ZERO FLOW" value. **Factory setting**: OFF

Functional description SYSTEM PARAMETER	
SYSTEM DAMPING	Use this function to set the filter depth of the digital filter. This reduces the sensitivity of the measuring signal to interference peaks (e.g. high solids content, gas bubbles in the fluid, etc.). The system reaction time increases with the filter setting. **User input**: 0 to 4 **Factory setting**: 3 ✎ Note! ▪ The system damping acts on all functions and outputs of the measuring device. ▪ The higher the value set, the stronger the damping (higher response time).

11.11 Group SENSOR DATA

All sensor data (calibration factors, zero point and nominal diameter etc.) are set at the factory.

Caution!
Under normal circumstances you should not change the following parameter settings, because changes affect numerous functions of the entire measuring facility in general and the accuracy of the measuring system in particular. Therefore, the functions described below are provided with an additional prompt (with the code 10) once you enter your private code.

Functional description SENSOR DATA	
CALIBRATION DATE	Use this function to view the current calibration date and time for the sensor. **User input:** Calibration date and time. **Factory setting**: Calibration date and time of the current calibration. Note! The calibration date and time format is defined in the FORMAT DATE/TIME function, → 111 Selectable formats: DD.MM.YY 24H MM/DD/YY 12H A/P DD.MM.YY 12H A/P MM/DD/YY 24H
K-FACTOR	Use this function to display the current calibration factor (positive and negative flow direction) for the sensor. The calibration factor is determined and set at the factory. **User input**: 5-digit fixed-point number: 0.5000 to 2.0000 **Factory setting**: Depends on nominal diameter and calibration Note! This value is also provided on the sensor nameplate.
ZERO POINT	This function shows the current zero-point correction value for the sensor. Zero-point correction is determined and set at the factory. **User input**: Max. 4-digit number: -1000 to +1000 **Factory setting**: Depends on nominal diameter and calibration Note! This value is also provided on the sensor nameplate.
NOMINAL DIAMETER	This function shows the nominal diameter for the sensor. The nominal diameter depends on the size of the sensor and is set at the factory. **Options:** 2 to 2000 mm 1/12 to 78" **Factory setting**: Depends on the size of the sensor Note! This value is also provided on the sensor nameplate.

Functional description SENSOR DATA	
MEASURING PERIOD	Use this function to set the time for a full measuring period. The duration of the measuring period is calculated from the rise time of the magnetic field, the brief recovery time, the (automatically tracked) integration time and the empty pipe detection time. **User input**: 10 to 1000 ms **Factory setting**: Depends on nominal diameter
EPD ELECTRODE	Indicates whether the sensor is equipped with an EPD electrode. **Display**: YES NO **Factory setting**: YES → Electrode fitted as standard

11.12 Group SUPERVISION

Functional description SUPERVISION	
FAILSAFE MODE	The dictates of safety render it advisable to ensure that the device signal processing assumes a predefined state in the event of a fault. The setting you select here is valid for: ▪ Current output ▪ Pulse output ▪ Totalizer ✎ Note! This has no effect on the display. **Options:** MINIMUM VALUE MAXIMUM VALUE ACTUAL VALUE **Factory setting**: MINIMUM VALUE The response of the individual outputs and the totalizer is listed below. **Current output:** MINIMUM VALUE The current output adopts the value of the lower signal on alarm level (as defined in the CURRENT RANGE function → 🖹 115). MAXIMUM VALUE The current output is set to the upper value of the signal on alarm level. (The values in question can be found in the CURRENT RANGE function on → 🖹 115). ACTUAL VALUE Measured value output is based on the current flow measurement. The fault is ignored. **Pulse output:** MINIMUM or MAXIMUM VALUE Output is zero pulse ACTUAL VALUE Measured value output is based on the current flow measurement (fault is ignored). **Totalizer**: MINIMUM or MAXIMUM VALUE The totalizer is paused until the fault is rectified. ACTUAL VALUE The totalizer continues to count on the basis of the current flow value. The fault is ignored.

Functional description SUPERVISION	
ALARM DELAY	Use this function to define a time span in which the criteria for an error have to be satisfied without interruption before an error or notice message is generated. Depending on the setting and the type of error, this suppression acts on: ▪ Display ▪ Current output ▪ Pulse/status output **User input**: 0 to 100 s (in increments of one second) **Factory setting**: 0 s Caution! If this function is activated error and notice messages are delayed by the time corresponding to the setting before being forwarded to the higher-order controller (process controller, etc.). It is therefore imperative to check in advance in order to make sure whether a delay of this nature could affect the safety requirements of the process. If error and notice messages cannot be suppressed, a value of 0 seconds must be entered here.
SYSTEM RESET	Use this function to perform a reset of the measuring system. **Options:** NO RESTART SYSTEM (Restart without disconnecting main power) RESET DELIVERY (Restart without disconnecting main power, the saved settings of the delivery status (factory settings) are applied). **Factory setting**: NO
SELF CHECKING	Use this function to switch on and off the self-checking function of the electrode amplifier. When the function is switched on, the electrode signal circuit is checked against a reference voltage at 60-second intervals. If there is an impermissible deviation from the value, system error message #101 is output and displayed on the local display. **Options:** ON OFF **Factory setting**: OFF

11.13 Group SIMULATION SYSTEM

Functional description SIMULATION SYSTEM	
SIMULATION FAILSAFE MODE	Use this function to set all outputs and the totalizer to their defined failsafe modes, in order to check whether they respond correctly. During this time, the words "SIMULATION FAILSAFE MODE" appear on the display. **Options:** ON OFF **Factory setting**: OFF
SIMULATION MEASURAND	Use this function to set all outputs and the totalizer to their defined flow-response modes, in order to check whether they respond correctly. During this time, the words "SIMULATION MEASURAND" appear on the display. **Options:** OFF VOLUME FLOW **Factory setting**: OFF ✎ Note! ▪ The measuring device cannot be used for measuring while this simulation is in progress. ▪ The setting is not saved if the power supply fails.
VALUE SIMULATION MEASURAND	✎ Note! This function is not available unless the SIMULATION MEASURAND function is active (= VOLUME FLOW). In this function, a freely selectable value (e.g. 12 m^3/s) is specified. This value is used to test downstream devices and the flowmeter itself. **User input**: 5-digit floating-point number [unit], with sign **Factory setting**: 0 [unit] ☝ Caution! The setting is not saved if the power supply fails. ✎ Note! The appropriate unit is taken from the SYSTEM UNITS group.

11.14 Group SENSOR VERSION

Functional description SENSOR VERSION	
SERIAL NUMBER	Use this function to view the serial number of the sensor.
SENSOR TYPE	Use this function to view the sensor type.

11.15 Group AMPLIFIER VERSION

Functional description AMPLIFIER VERSION	
SOFTWARE REVISION NUMBER	Use this function to view the software revision number of the electronics board.

11.16 Factory settings

11.16.1 SI units (not for USA and Canada)

Low flow cut off, full scale value, pulse value, totalizer

Nominal diameter		Low flow cut off		Full scale value current output		Pulse value		Totalizer
[mm]	[inch]	(approx. v = 0.04 m/s)		(approx. v = 2.5 m/s)		(approx. 2 pulses/s at v = 2.5 m/s)		
2	1/12"	0.01	dm³/min	0.5	dm³/min	0.005	dm³	dm³
4	1/8"	0.05	dm³/min	2	dm³/min	0.025	dm³	dm³
8	3/8"	0.1	dm³/min	8	dm³/min	0.10	dm³	dm³
15	½"	0.5	dm³/min	25	dm³/min	0.20	dm³	dm³
25	1"	1	dm³/min	75	dm³/min	0.50	dm³	dm³
32	1 ¼"	2	dm³/min	125	dm³/min	1.00	dm³	dm³
40	1 ½"	3	dm³/min	200	dm³/min	1.50	dm³	dm³
50	2"	5	dm³/min	300	dm³/min	2.50	dm³	dm³
65	2 ½"	8	dm³/min	500	dm³/min	5.00	dm³	dm³
80	3"	12	dm³/min	750	dm³/min	5.00	dm³	dm³
100	4"	20	dm³/min	1200	dm³/min	10.00	dm³	dm³
125	5"	30	dm³/min	1850	dm³/min	15.00	dm³	dm³
150	6"	2.5	m³/h	150	m³/h	0.025	m³	m³
200	8"	5.0	m³/h	300	m³/h	0.05	m³	m³
250	10"	7.5	m³/h	500	m³/h	0.05	m³	m³
300	12"	10	m³/h	750	m³/h	0.10	m³	m³
350	14"	15	m³/h	1000	m³/h	0.10	m³	m³
375	15"	20	m3/h	1200	m3/h	0.15	m3	m3
400	16"	20	m³/h	1200	m³/h	0.15	m³	m³
450	18"	25	m³/h	1500	m³/h	0.25	m³	m³
500	20"	30	m³/h	2000	m³/h	0.25	m³	m³
600	24"	40	m³/h	2500	m³/h	0.30	m³	m³
700	28"	50	m³/h	3500	m³/h	0.50	m³	m³
–	30"	60	m³/h	4000	m³/h	0.50	m³	m³
800	32"	75	m³/h	4500	m³/h	0.75	m³	m³
900	36"	100	m³/h	6000	m³/h	0.75	m³	m³
1000	40"	125	m³/h	7000	m³/h	1.00	m³	m³
–	42"	125	m³/h	8000	m³/h	1.00	m³	m³
1200	48"	150	m³/h	10000	m³/h	1.50	m³	m³
–	54"	200	m³/h	13000	m³/h	1.50	m³	m³
1400	–	225	m³/h	14000	m³/h	2.00	m³	m³
–	60"	250	m³/h	16000	m³/h	2.00	m³	m³
1600	–	300	m³/h	18000	m³/h	2.50	m³	m³
–	66"	325	m³/h	20500	m³/h	2.50	m³	m³
1800	72"	350	m³/h	23000	m³/h	3.00	m³	m³
–	78"	450	m³/h	28500	m³/h	3.50	m³	m³
2000	–	450	m³/h	28500	m³/h	3.50	m³	m³

Language

Country	Language
Austria	Deutsch
Belgium	English
Denmark	English
England	English
Finland	English
France	Francais
Germany	Deutsch
Holland	English
Hong Kong	English
International Instruments	English
Italy	Italiano
Japan	English
Malaysia	English
Norway	English
Singapore	English
South Africa	English
Spain	Espanol
Sweden	English
Switzerland	Deutsch
Thailand	English

11.16.2 US units (only for USA and Canada)

Low flow cut off, full scale value, pulse value, totalizer

Nominal diameter		Low flow cut off		Full scale value current output		Pulse value		Totalizer
[inch]	[mm]	(approx. v = 0.04 m/s)		(approx. v = 2.5 m/s)		(approx. 2 pulses/s at v = 2.5 m/s)		
1/12"	2	0.002	gal/min	0.1	gal/min	0.001	gal	gal
1/8"	4	0.008	gal/min	0.5	gal/min	0.005	gal	gal
3/8"	8	0.025	gal/min	2	gal/min	0.02	gal	gal
½"	15	0.10	gal/min	6	gal/min	0.05	gal	gal
1"	25	0.25	gal/min	18	gal/min	0.20	gal	gal
1 ¼"	32	0.50	gal/min	30	gal/min	0.20	gal	gal
1 ½"	40	0.75	gal/min	50	gal/min	0.50	gal	gal
2"	50	1.25	gal/min	75	gal/min	0.50	gal	gal
2 ½"	65	2.0	gal/min	130	gal/min	1	gal	gal
3"	80	2.5	gal/min	200	gal/min	2	gal	gal
4"	100	4.0	gal/min	300	gal/min	2	gal	gal
5"	125	7.0	gal/min	450	gal/min	5	gal	gal
6"	150	12	gal/min	600	gal/min	5	gal	gal
8"	200	15	gal/min	1200	gal/min	10	gal	gal
10"	250	30	gal/min	1500	gal/min	15	gal	gal
12"	300	45	gal/min	2400	gal/min	25	gal	gal
14"	350	60	gal/min	3600	gal/min	30	gal	gal
15"	375	60	gal/min	4800	gal/min	50	gal	gal
16"	400	60	gal/min	4800	gal/min	50	gal	gal
18"	450	90	gal/min	6000	gal/min	50	gal	gal
20"	500	120	gal/min	7500	gal/min	75	gal	gal
24"	600	180	gal/min	10500	gal/min	100	gal	gal
28"	700	210	gal/min	13500	gal/min	125	gal	gal
30"	–	270	gal/min	16500	gal/min	150	gal	gal
32"	800	300	gal/min	19500	gal/min	200	gal	gal
36"	900	360	gal/min	24000	gal/min	225	gal	gal
40"	1000	480	gal/min	30000	gal/min	250	gal	gal
42"	–	600	gal/min	33000	gal/min	250	gal	gal
48"	1200	600	gal/min	42000	gal/min	400	gal	gal
54"	–	1.3	Mgal/d	75	Mgal/d	0.0005	Mgal	Mgal
–	1400	1.3	Mgal/d	85	Mgal/d	0.0005	Mgal	Mgal
60"	–	1.3	Mgal/d	95	Mgal/d	0.0005	Mgal	Mgal
–	1600	1.7	Mgal/d	110	Mgal/d	0.0008	Mgal	Mgal
66"	–	2.2	Mgal/d	120	Mgal/d	0.0008	Mgal	Mgal
72"	1800	2.6	Mgal/d	140	Mgal/d	0.0008	Mgal	Mgal
78"	–	3.0	Mgal/d	175	Mgal/d	0.001	Mgal	Mgal
–	2000	3.0	Mgal/d	175	Mgal/d	0.001	Mgal	Mgal

Language

Country	Language
USA	English
Canada	English

Index

A

ACCESS CODE 112
Accessories 72
Adapters 15
ALARM DELAY 131
Ambient temperature range 87
Anziehdrehmomente
  Promag D 23
Applicator (selection and configuration software) 73
Approvals 8, 106
ASSIGN STATUS OUTPUT 118

B

Brief commissioning guide 68
BUS ADDRESS 122

C

Cable entry 86
Cable specifications 49
CALIBRATION DATE 128
Calibration factor 7
CE mark 106
CE mark (Declaration of Conformity) 8
Centering sleeve
  Promag D 21
Certificates 8, 106
CIP cleaning 88
Cleaning (exterior cleaning) 71
Code entry (function matrix) 59
Commissioning
  Brief operating instructions 68
  General 68
  Setup 69
  With a new electronics board 69
Commissioning setup 69
Communication 61
Conductivity of fluid 90
Connecting cable 18
Connection
  HART 51
  Remote version 44
  Terminal assignment 51
  Transmitter 50
CONTRAST LCD 113
C-tick mark 106
CURRENT RANGE 115

D

Declaration of Conformity (CE mark) 8
DEFINE PRIVATE CODE 112
Degree of protection 55, 88
Design 94
Device description files 62
DEVICE ID 122
Device variable via HART protocol 62
Display
  Elements 57, 106
  Turning 41
Documentation 108
Drinking water approval 107

E

Electrical connections 86
Electrodes
  EPD electrode 13
EMC (electromagnetic compatibility) 49, 88
Empty-pipe/full-pipe adjustment 70
Environment 87
EPD 123
EPD ADJUSTMENT 124
EPD ELECTRODE 129
Error message types 60
Ex approval 106
Exterior cleaning 71

F

Factory setting
  SI units 133
  US units 135
FAILSAFE MODE 130
Field Xpert SFX100 51
FieldCare 61, 73
Fieldcheck (tester and simulator) 73
Fitted electrodes 104
Flow rate/limits 16
FORMAT 113
FORMAT DATE/TIME 111
Function matrix
  Brief operating instructions 58
  Illustration 109
FXA 193 service interface 74
FXA193 74

G

Galvanic isolation 86
Ground cable
  Promag E 24
  Promag L 29
  Promag P 33
  Promag W 36
Group
  AMPLIFIER VERSION 132
  COMMUNICATION 122
  CURRENT OUTPUT 115
  DISPLAY 113
  OPERATION 112
  PROCESS PARAMETER 123
  PULSE/STATUS OUTPUT 117
  SENSOR DATA 128
  SENSOR VERSION 132
  SIMULATION SYSTEM 132
  SUPERVISION 130
  SYSTEM PARAMETER 125
  SYSTEM UNITS 110

TOTALIZER 114

H
HART
Command classes 61
Commands 63
Communicator DXR 375 61
Device description files 62
Device status / Error messages 67
Write protection 62
HART WRITE PROTECTION 122
Hazardous substances 84
HOME position (operating mode) 57

I
Incoming acceptance 9
Inlet/outlet run 14
Installation
Promag D 20, 23
Promag E 24
Promag H 27
Promag L 29
Promag P 33
Promag W 36
Remote version 42
See Installation instructions
Installation conditions
Adapters 15
Dimensions 11
Down pipe 12
EPD electrode 13
Foundations, supports 15
Inlet/outlet run 14
Installation of pumps 11
Mounting location 11
Orientation 13
Partially filled pipes 12
Vibrations 14
INSTALLATION DIRECTION SENSOR 125

K
K-FACTOR 128

L
LANGUAGE 112
Load 86
Local display
See Display
Low flow cut off 86

M
Maintenance 71
MANUFACTURER ID 122
Material 103
Material load diagram 90
Maximum measured error 87
Measured variable 85
MEASURING MODE 125–126
MEASURING PERIOD 129
Measuring principle 85
Measuring range 85
Measuring system 85
Mechanical construction 94
Medium pressure range 90
Medium temperature range 88
Mounting bolts
Promag D 21

N
Nameplate specifications
Connections 7
Sensor 7
Transmitter 6
NOMINAL DIAMETER 128
Nominal diameter and flow rate
Promag W 16

O
Operable flow range 85
Operating conditions
Process 88
Operating elements 57, 106
OPERATING MODE 117
Operation 57
Device description files 62
FieldCare 61
Operating programs 61
Operational safety 4
Order code
Accessories 72
Sensor 7
Transmitter 6
Output 85
OUTPUT SIGNAL 118
Output signal 85
OVERFLOW 114

P
Performance characteristics 87
Pig (cleaning) 28
POSITIVE ZERO RETURN 126
Post-connection
Check 56
Post-installation
Check 43
Potential equalization 52
Power consumption 86
Power supply 86
Power supply failure 86
Pressure Equipment Directive 107
Pressure loss
Adapters (reducers, expanders) 15
Pressure tightness 91
Process connections 105
Process error messages 77
Process errors (definition) 60
Programming mode
Disable 59
Enable 59
Promag D

Centering sleeve 21
Installation 20, 23
Mounting bolts 21
Seals 20, 23
Tightening torques 22–23
Promag D mounting kit 20, 23
Promag E
Ground cable 24
Installation 24
Seals 24
Tightening torques 25
Promag H
Cleaning with pigs 28
Installation 27
Seals 27
Weld nipple 28
Promag H cleaning with pigs 28
Promag H with weld nipples 28
Promag L
Ground cable 29
Installation 29
Seals 29
Tightening torques 30
Promag P
Ground cable 33
Installation 33
Seals 33
Tightening torques 33
Promag W
Ground cable 36
Installation 36
Seals 36
Tightening torques 36
PULSE VALUE 117
PULSE WIDTH 117

R
Reference operating conditions 87
Registered trademarks 8
Remote operation 106
Remote version
Connection 44
Installation 42
Repair 84
Repeatability 87
RESET TOTALIZER 114
Response of the status output 120
Response to errors 79
Returning devices 84

S
Safety icons 5
Safety instructions 4
Sanitary compatibility 107
Seals 71
Promag D 20, 23
Promag E 24
Promag H 27
Promag L 29
Promag P 33
Promag W 36
SELF CHECKING 131
SENSOR TYPE 132
SERIAL NUMBER 132
Serial number
Sensor 7
Transmitter 6
Shock resistance 88
Signal on alarm 85
SIMULATION FAILSAFE MODE 132
SIMULATION MEASURAND 132
SIP cleaning 88
Spare parts 80
Standards, guidelines 107
Storage temperature 88
SUM 114
Supply voltage 86
Surface roughness 106
SW REV. NUMBER 132
Switching behavior of the status output 121
Switching on (measuring device) 68
SWITCH-OFF POINT 119
SWITCH-ON POINT 118
SWITCH-ON POINT LOW FLOW CUT OFF 123
SYSTEM DAMPING 127
System error messages 76
System errors (definition) 60
SYSTEM RESET 131

T
TAG DESCRIPTION 122
TAG NAME 122
Technical data 85
Temperature
Ambient 87
Medium 88
Storage 88
TEST DISPLAY 113
Tightening torques
Promag D 22–23
Promag E 25
Promag L 30
Promag P 33
Promag W 36
TIME CONSTANT 116
Troubleshooting 75
Types of error (system and process errors) 60

U
UNIT VOLUME 110
UNIT VOLUME FLOW 110

V
VALUE 20 mA 116
VALUE SIMULATION MEASURAND 132
Verbindungskabel 19
Vibration resistance 88
Vibrations 14

W

Weight 94, 100
Wiring 44

Z

ZERO POINT 128

www.addresses.endress.com

Endress+Hauser

People for Process Automation

Artisan Technology Group is an independent supplier of quality pre-owned equipment

Gold-standard solutions

Extend the life of your critical industrial, commercial, and military systems with our superior service and support.

We buy equipment

Planning to upgrade your current equipment? Have surplus equipment taking up shelf space? We'll give it a new home.

Learn more!

Visit us at **artisantg.com** for more info on price quotes, drivers, technical specifications, manuals, and documentation.

Artisan Scientific Corporation dba Artisan Technology Group is not an affiliate, representative, or authorized distributor for any manufacturer listed herein.

We're here to make your life easier. How can we help you today?

(217) 352-9330 | sales@artisantg.com | artisantg.com

ARTISAN® TECHNOLOGY GROUP