ARTISAN®
TECHNOLOGY GROUP

Your **definitive** source for quality pre-owned equipment.

Artisan Technology Group
(217) 352-9330 | sales@artisantg.com | artisantg.com

Full-service, independent repair center
with experienced engineers and technicians on staff.

We buy your excess, underutilized, and idle equipment
along with credit for buybacks and trade-ins.

Custom engineering
so your equipment works exactly as you specify.

- Critical and expedited services
- In stock / Ready-to-ship
- Leasing / Rentals / Demos
- ITAR-certified secure asset solutions

Expert team | Trust guarantee | 100% satisfaction

All trademarks, brand names, and brands appearing herein are the property of their respective owners.

Find the *Fuji Electric PXZ4-SDY2-5V* at our website: ***Click HERE***

FUJI ELECTRIC

Instruction Manual

Micro-controller X
Model: PXZ 4 5 7 9

INP-TN2PXZa-E

Fuji Electric Co., Ltd.
Head Office
11-2, Osaki 1-chome, Shinagawa-ku, Tokyo, 141-0032 Japan
http://www.fujielectric.co.jp

Fuji Electric Instruments Co., Ltd.
Sales Div. International Sales Dept.
No.1, Fuji-machi, Hino-city, Tokyo, 191-8502 Japan
Phone : +81-42-585-6201,6202
Fax : +81-42-585-6187,6189
http://www.fic-net.co.jp

Thank you for your purchasing "Fuji Digital Temperature Controller."Please check that the product is exactly the one you ordered and use it according to the following instructions. (Please refer to a separate operation manual for details.) Dealers are cordially requested to ensure the delivery of this Instruction Manual to hands of the end-users.

NOTICE The contents of this document may be changed in the future without prior notice.

We paid the utmost care for the accuracy of the contents. However, we are not liable for direct and indirect damages resulting from incorrect descriptions, omission of information, and use of information in this document.

CONENTS

Read before using 2
For normal usage 6
1. Confirming type specification 7
2. Installation/mounting 8
Standard type 8
Waterproof type 8
3. Wiring 9
100 to 240 VAC 9
24Vac/24VDC 10
4. Usage 11
Method of setting temperature and parameter 12
5. Useful usage of this equipment 19
5-1 ON/OFF (two position) control 21
5-2 Auto-tuning (AT) 22
5-3 bAL and Ar function 23
6. Read if the indication is abnormal. 24
Specification 25

The related documents

Contents	Title	Document No.
Specifications	Catalogue (Data sheets)	ECNO 1125
Operation	Operation Manual	PXZ-1

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Read before using SAFETY PRECAUTIONS

Before using this product, the user is requested to read the following precautions carefully to ensure the safety. Safety precautions must be taken by every user to prevent an accident.
The safety requirements are classified into "warning" and "caution" according to the following interpretation :

⚠ **Warning**	Suggesting that the user's mishandling can result in personal death or serious injury.
⚠ **Caution**	Suggesting that the user's mishandling can result in personal injury or damage to the property.

⚠ WARNING Over-temperature Protection

Any control system should be designed with prior consideration that any part of the system has potential to fail. In case of temperature controlling, a continuance of heating on should be regarded as the most dangerous state.
The followings are the most probable causes of inducing continuance of heating on:
1) The failure of the controller with heating output constantly on
2) The disengagement of the temperature sensor out from the system
3) The short circuit in the thermocouple wiring
4) Valve or switch contact point outside the system is locked to keep heating on
In any application in which it is apprehended that physical injury or destruction of equipment might occur, please install an independent safeguard equipment to prevent over-temperature which shut down the heating circuit, and for additional safety, we recommend this equipment to have its own temperature sensor.
The alarm output signal of the controller is not designed to work as protective measures when the controller is in failure condition.

1. ⚠ Warning

1.1 Installation and wiring

- This equipment intends to be installed with the following conditions.

Operating temperature	-10 to 50 [°C]	
Operating humidity	90%RH or less (Non condensing)	
Installation category	II	Conforming to IEC1010-1
Pollution degree	2	

- Preserve the creepage and clearance as shown below between the temperature sensor and the location which indicates or generates the voltages as shown in the following table.
  Failure to maintain these minimum distances would invalidate the EN 61010 safety approval.

Voltage used or generated by the other assemblies	Clearance (mm)	Creepage (mm)
Up to 50Vrms or Vdc	0.2	1.2
Up to 100Vrms or Vdc	0.2	1.4
Up to 150Vrms or Vdc	0.5	1.6
Up to 300Vrms or Vdc	1.5	3.0
Above 300Vrms or Vdc	Contact with sales office.	

Hazardous voltage

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

- If the voltage shown above exceeds 50Vdc(i.e. hazardous voltage), the basic insulation is required between all terminals of this equipment and the ground, and supplementary insulation is required for the alarm output.
  Isolation class of this equipment is shown below. Be sure check that the isolation class of the equipment satisfies your requirements before installation.

MAINS-INPUTS	BASIC insulation
MAINS-OUTPUTS	BASIC insulation
inputs - outputs(relay, alarm output)	BASIC insulation
inputs - outputs(SSR drive, DC 4-20mA)	Non-insulation

- If there is a danger of a serious accident resulting from a failure or a defect in this unit, provide the unit with an appropriate external protective circuit to prevent an accident.
- The unit is normally supplied without a power switch and fuses.
  Make wiring so that the fuse is placed between the main power supply switch and this equipment. (main power supply: 2 pole breaker, fuse rating: 250V, 1A)
- When wiring the power supply terminal, use vinyl insulated 600 volt cable or equivalent.
- To avoid the damage and failure of equipment, supply the power voltage fitting to the rating.
- To avoid an electric shock and equipment failure, do not turn ON the power before all wiring is completed.
- Be sure to check that the distance is kept to avoid electric shock or firing before turning the power ON.
- Keep away from terminals while the circuit is energized in order to avoid an electric shock and a malfunction.
- Never attempt to disassemble, fabricate, modify, or repair this unit because tampering with the unit may result in a malfunction, electric shock, or a fire.

1.2 Maintenance precautions

- Be sure to turn off the power before this unit is installed or removed in order to avoid an electric shock, malfunction, and fault.
- Regular maintenance is recommended a longer service life of this unit. Some parts of this unit have a limited life span, or they will be deteriorated with the lapse of time.
- One-year warranty is guaranteed for this unit including accessories, provided that the unit is properly used.

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

2. ⚠ Caution

2.1 Cautions on installation

Avoid the following places for installation.

- a place where the ambient temperature may reach beyond the range of from 0 to 50°C while in operation.
- a place where the ambient humidity may reach beyond the range of from 45 to 85% RH while in operation.
- a place where a change in the ambient temperature is so rapid as to cause condensation.
- a place where corrosive gases (sulfide gas and ammonia gas, in particular) or combustible gases are emitted.
- a place where the unit is subject directly to vibration or shock.
- a place exposed to water oil, chemicals, steam and vapor.
  (if immersed with water, take the inspection by sales office to avoid an electrical and firing)
- a place where the unit is exposed to dust, salt air, or air containing iron particles.
- a place where the unit is subject to intereference with static electricity, magnetism, and noise.
- a place where the unit is exposed to direct sunlight.
- a place where the heat may be accumulated due to the radiation of heat.

2.2 Caution on installation on panel

- For PXZ5/7/9, install 2 pieces of mounting fixtures; one in the upper position and the other in the lower position, by tightening screws with a standard screwdriver to a torque of about 14.7 N-cm . (Take care not to tighten the screws excessively because the casing is made of plastic.)
- For PXZ4 insert the mounting bracket (accessory) from the rear side until the main unit is securely fit into the panel. If there should be a play, tighten two screws lightly until the play is eliminated. (Do not tighten the screws excessively because the mounting bracket can be removed from the stopper by the force.)
- The front side of this instrument conforms to NEMA 4X (equivalent with IP66). To ensure the waterproofness between the instrument and the panel, use packings that are provided as accessories in the following manner: (The improper fitting of packings will ruin the waterproofness.)
  ① As shown in Figure 1, fit a packing to the case of the unit and then insert it in the panel.
  ② Tighten screws on the fixing frame or fixtures so that no gaps are given between the front of equipment and packing and between panels. Check that there are no deviation and deformation of packing as shown in Fig.3.

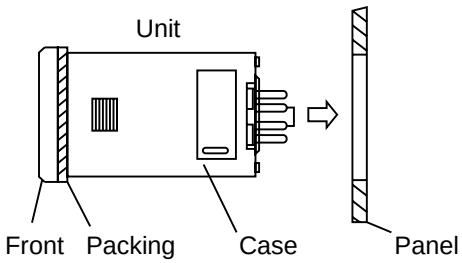


Figure 1

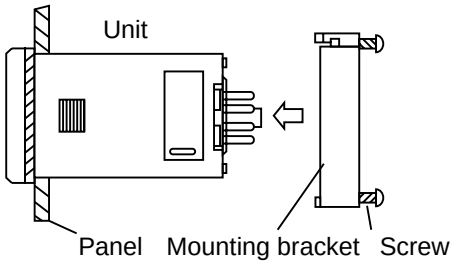


Figure 2

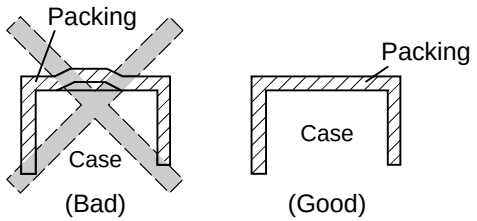


Figure 3

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

2.3 Precautions in wiring connection


- For the thermocouple sensor type, use thermocouple extension wires for wiring.
  For the RTD type, use a wiring material with a small lead wire resistance and no resistance differentials among three wires.
- Keep input lines away from power line and load line to avoid the influence from noise induced.
- For the input and output signal lines, be sure to use shielded wires and keep them away from each other.
- If a noise level is excessive in the power supply, the additional installation of an insulating transformer and the use of a noise filter are recommended. (example: ZMB22R5-11 Noise Filter manufactured by TDK)
  Make sure that the noise filter is installed to a place such as a panel that is properly grounded. The wiring between the noise filter output terminal and the instrument power supply terminal should be made as short as possible. None of fuses or switches should be installed to the wiring on the noise filter output side because the filter effect will be degraded by such a installation.
- A better anti-noise effect can be expected by using stranded power supply cable for the instrument. (The shorter the stranding pitch is, the better the anti-noise effect can be expected.)
- For the unit with an alarm against a failure (burn-out) in the heater, use the same power line for connection of the power supplies for the heater and the controller.
- A setup time is required for the contact output when the power is turned on. If the contact output is used as a signal for an external interlock circuit, use a delay relay at the same time.
- Use the supplemental relay since the life is shortened if full capacity load is connected to the output relay. SSR/SSC drive output type is preferred if the output operations occur frequently.
  [Proportional interval] relay output: 30 seconds or more, SSR/SSC: one second or more.]
- If inductive load such as magnetic switches connected as a relay output load, it is recommended to use Z-Trap manufactured by Fuji Electric to protect a contact from switching serge and keep a longer life.

  Model : ENC241D-05A (power supply voltage: 100 V)
  ENC471D-05A (power supply voltage: 200 V)

  Where to install : Connect it between contacts of the relay control output.

  [Example]

  (For TP48X)



PXZ4

PXZ9

- The SSR/SSC-driven output, an output of 4 to 20 mA DC, is not electrically insulated from internal circuits.
  Use a non-grounded sensor for resistance bulb or thermocouple.

2.4 Requirement for key operation/operation in abnormalities

- Prior to the operation, be sure to check alarm functions, since a failure in the proper setting will result in a failure in the proper output of an alarm in case of an abnormality.
- A display of UUUU or LLLL will appear in case of a break in the input. Be sure to turn off the power when a sensor is replaced.


2.5 Others

- Do not use organic solvents such as alcohol and benzine to wipe this unit. Use a neutral detergent for wiping the unit.

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

For normal usage

<Reference items> <Description>

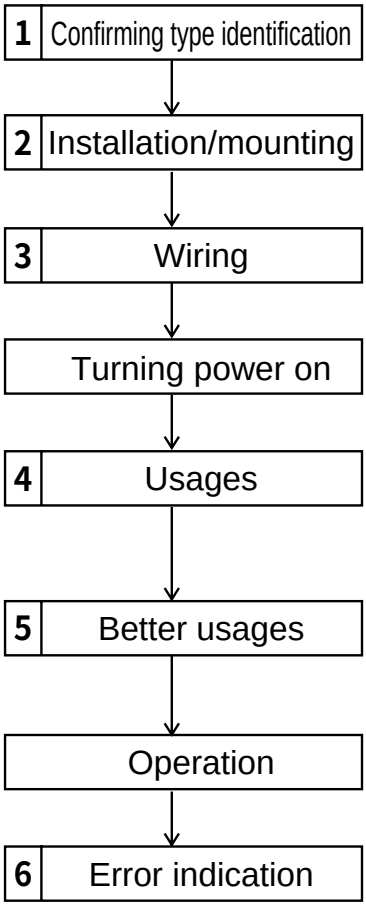


- Confirming that product delivered matches with the ordered one
- Outline dimension
- Panel cutout dimension
- Mounting method on the panel
- Terminal connection diagram
- Changing temperature set value
- Basic operation method
- List of parameters
- List of input/output/alarm codes
- Setting of input/output ranges
- Selection of control method
- Automatic setting of control parameters by auto-tuning
- Error indication

* Wait for about 30 minutes until the controller stabilizes thermally: the operation e.g. measurement should be started 30 minutes after the power is turned on.

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

1 Confirming type specification

Model Configuration

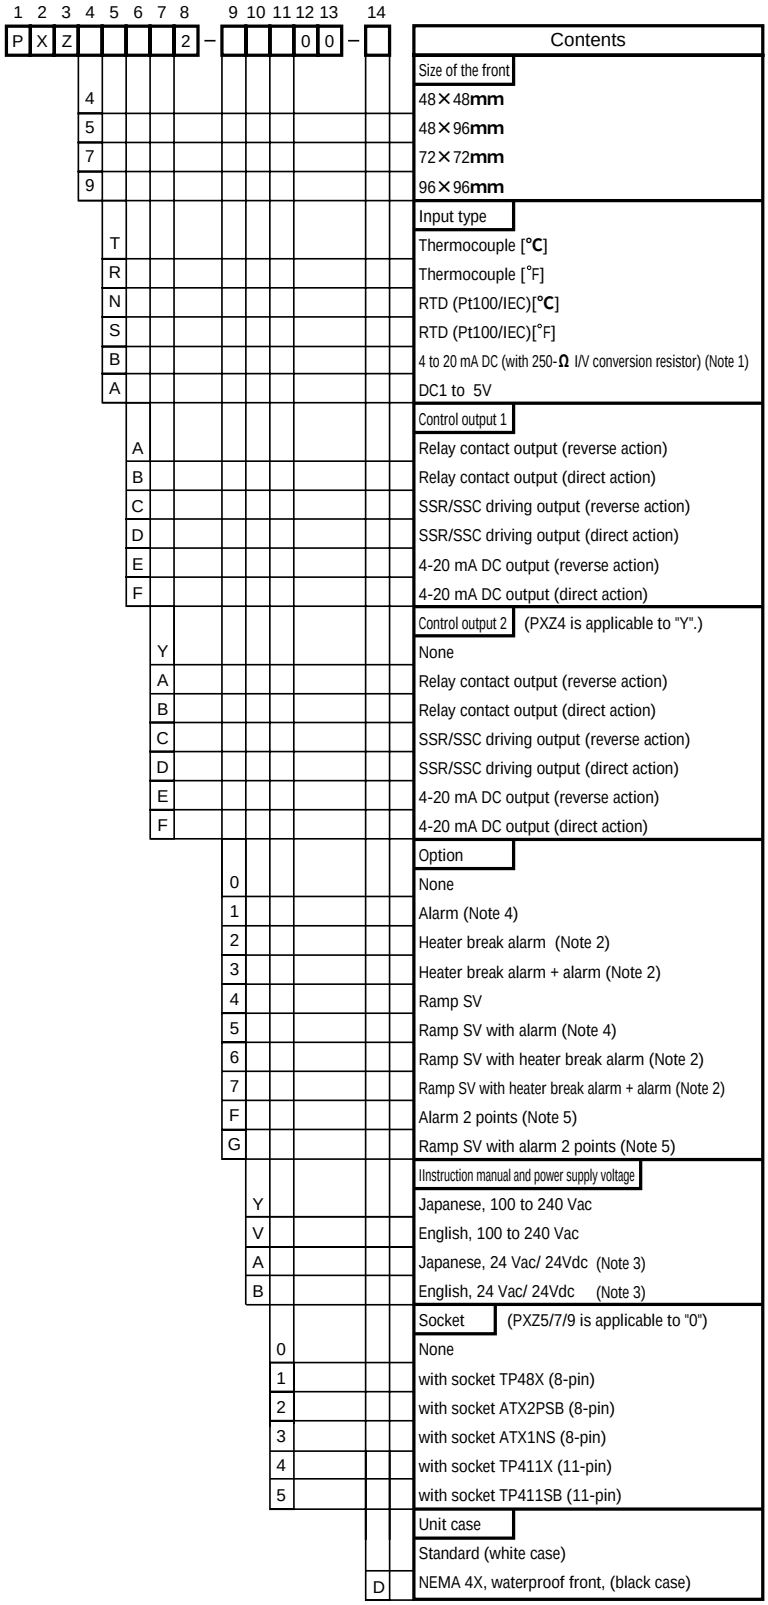

Note 1: Install the 250-Ω resistor (accessory) to the terminal.

Note 2: Not applicable to PXZ4, SSR/SSC driving output, and 4 to 20 mA DC output.

Note 3: Not available in case of PXZ7.

Note 4: Alarm output(s) : 1 point (48 x 48 mm), 2 points (Other types)






Note 5: Available only on 48 x 48 mm type

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

2 Installation/mounting

Outline and Panel Cutout Dimensions (Standard type)





(Unit: mm)

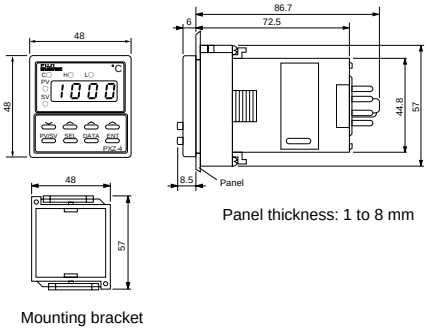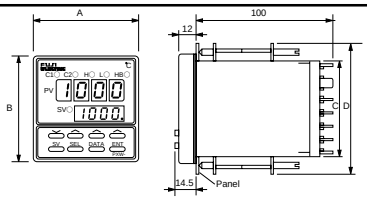Model	Outline dimensions	Panel cutout dimensions
PXZ4	 Panel thickness: 1 to 8 mm Mounting bracket	When installing "n" numbers of units:  For grouped installation *Note) See the note below.* Grouping  Number of units: 2 / 3 / 4 / 5 / 6 a: 93 / 141 / 189 / 237 / 285
PXZ 5/7/9	 Panel thickness: 1 to 8 mm	When installing "n" numbers of units:  In the grouped installation of PXZ5 *Note) See the note below.*  Number of units: 2 / 3 / 4 / 5 / 6 a: 93 / 141 / 189 / 237 / 285

Model	A	B	C	D	E	F	G	H
PXZ5	48	96	90.5	114.5	45 $^{0.6}_{-0}$	92 $^{0.8}_{-0}$	116MIN	50MIN
PXZ7	72	72	67	91	68 $^{0.7}_{-0}$	68 $^{0.7}_{-0}$	92MIN	82MIN
PXZ9	96	96	90.5	114.5	92 $^{0.8}_{-0}$	92 $^{0.8}_{-0}$	116MIN	100MIN

Outline and Panel Cutout Dimensions (Waterproof type)

(Unit: mm)

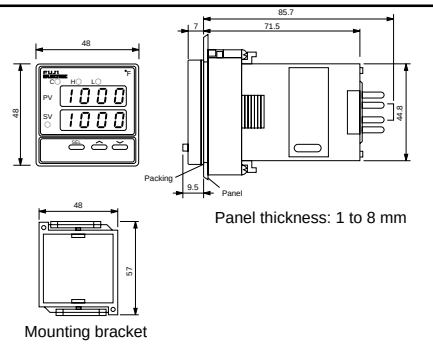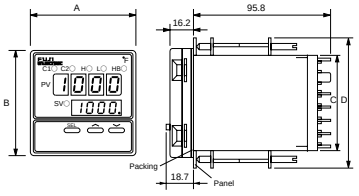Model	Outline dimensions	Panel cutout dimensions
Water-proof type PXZ4	 Panel thickness: 1 to 8 mm Mounting bracket	When installing "n" numbers of units: 
Water-proof type PXZ 5/7/9	 Panel thickness: 1 to 8 mm	When installing "n" numbers of units: 

Model	A	B	C	D	E	F	G	H
PXZ5	52.5	100.5	90.5	114.5	45 $^{0.6}_{-0}$	92 $^{0.8}_{-0}$	120MIN	92MIN
PXZ7	76.5	76.5	67	91	68 $^{0.7}_{-0}$	68 $^{0.7}_{-0}$	96MIN	116MIN
PXZ9	100.5	100.5	90.5	114.5	92 $^{0.8}_{-0}$	92 $^{0.8}_{-0}$	120MIN	140MIN


Note) Caution in the grouped installation: For those models using 200-VAC power supply, the installation of a fan is recommended for the radiation of heat.
For the unit to be installed in the vertical group mode, 100-VAC power supply alone can be used.

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com


3 Wiring

Terminal Connection (for 100 to 240 VAC)


PXZ7

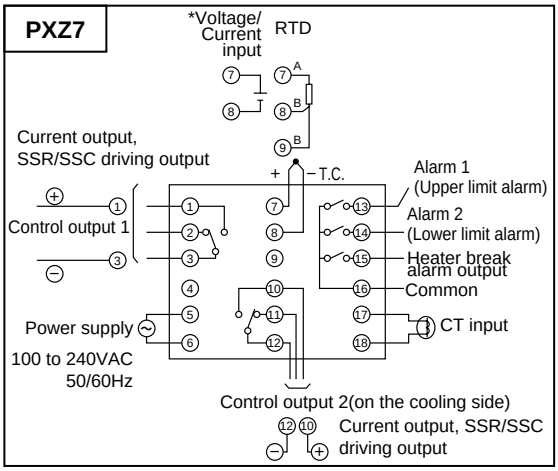

PXZ5, PXZ9

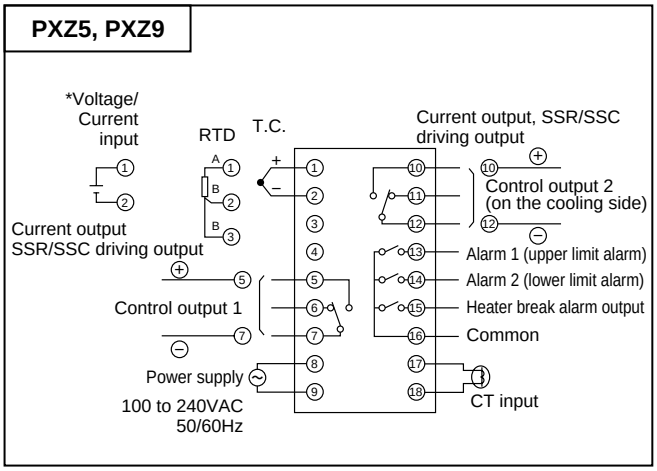


PXZ4 socket type (standard) (viewing from the back of instrument)

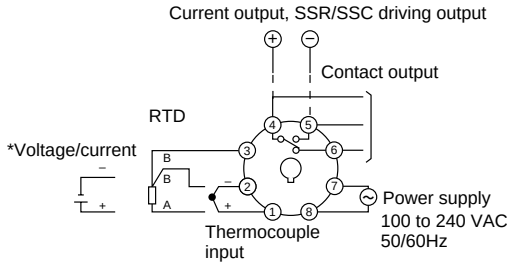


When no alarms are provided

PXZ4 socket type (with alarm 1 point) (viewing from the back of instrument)

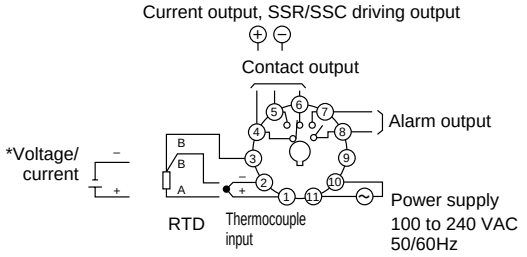


When alarms are provided (1 point)

* When allowing an input of 4 to 20 mA DC, install a 250-Ω resistor (accessory) before using the unit.



PXZ4 socket type (with alarm 2 points) (viewing from the back of instrument)

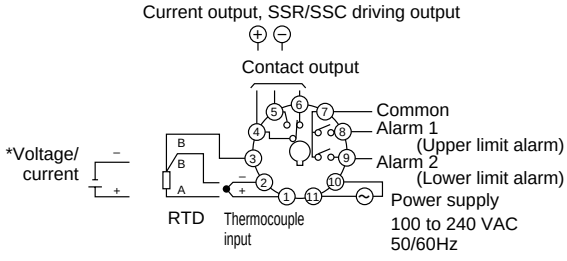

When alarms are provided (2 points)

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Terminal Connection (for 24Vac/24VDC)

Attention : In case of PX✳✳✳✳✳2-✳#✳✳✳ (✳: Don't care, #: A or B)

Not available in case of PXZ7.


⚠ Warning

Be sure to use the rated voltage power supply and polarity.


This type can be used for 24 VAC and 24 VDC power supply only.

Do not use for 100 to 240 VAC power supply.

PXZ4

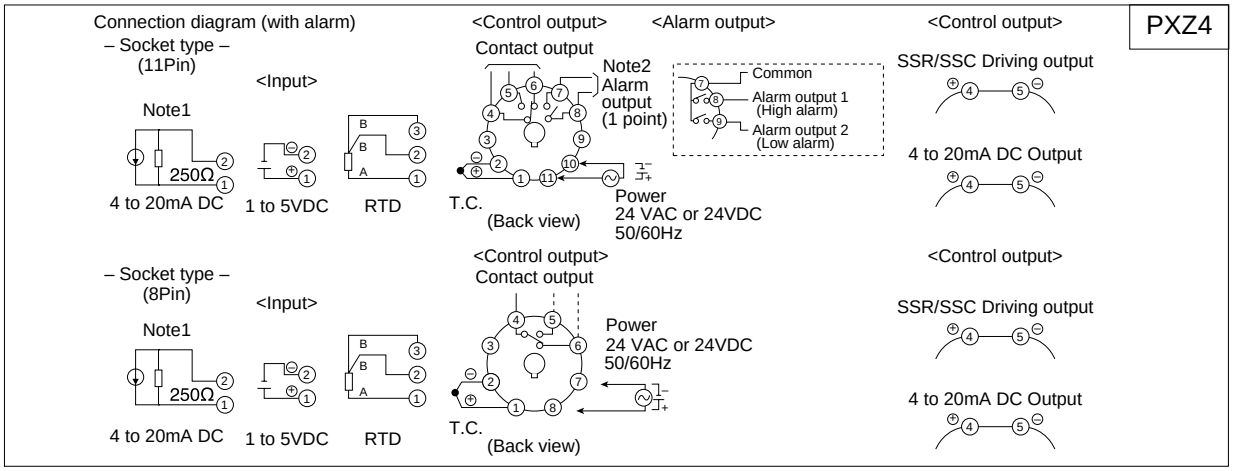

PXZ5,PXZ9

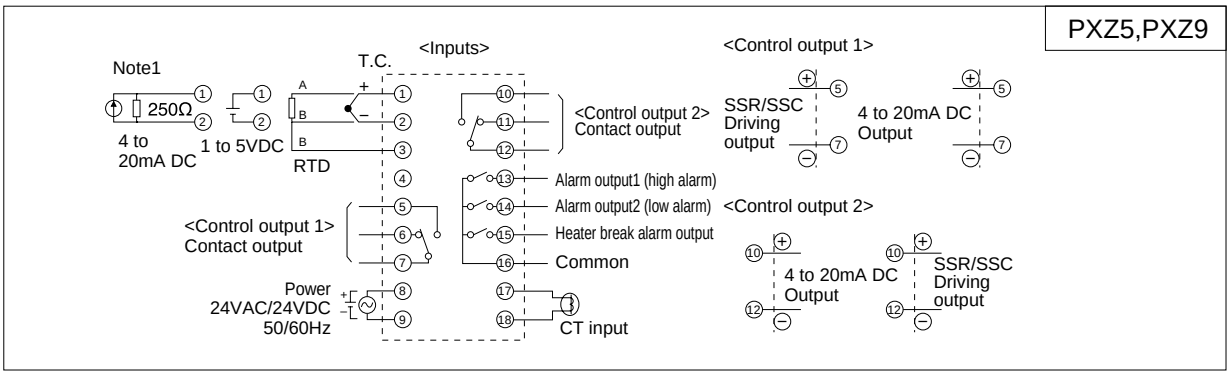


Note 1: Use the 250Ωresistance (accessory).

Note 2: Outputted when either upper/lower limit alarm is turned on.


Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

4 Usage (Read before using)


Name of Functional Parts and Functions



Model : PXZ4



Model : PXZ5



Model : PXZ7, 9


Name	Function
①Measured value (PV) display	Displays a measured value (PV).
②Set value (SV) indication lamp	Stays on while a set value (SV) is on the display.
③Set value (SV) parameter display	Parameter symbols and codes are displayed for a set value (SV) and when setting various parameters.
④DOWN key (common for each digit)	Decrements the numerical value in the place selected with the UP key. Where various parameters are displayed, each parameter is displayed one by one every time this key is pressed. The sequence of displays, however, is just opposite to the sequence of displays with the SEL key.
⑤Direct SV key	By pressing this key, a set value (SV) is displayed.
⑥SELECT key	The key to be used when switching over to the 1st or 2nd block parameters, or when moving parameters within a block.
⑦Data display key	Displays the data assigned to the parameter selected with the SEL key.
⑧Data entry key	The key to be used for storing the data after previous data is changed. (None of changed data can be registered unless this key is pressed.)
⑨UP key for first place	By pressing once, a number in the units place blinks. The number is continuously incremented with the key kept on pressing
⑩UP key for second place	By pressing once, a number in the tens place blinks. The number is continuously incremented with the key kept on pressing.
⑪UP key for third place	By pressing once, a number in the hundreds place blinks. The number is continuously incremented with the key kept on pressing. A numeric "9" is followed by "0" and, concurrently, a number of the thousands place is incremented by 1.
⑫Control output indication lamp	C : Comes on when the control output is ON. C1: Comes on when the control output 1 is ON. C2: Comes on when the control output 2 is ON.
⑬Upper limit alarm indication lamp (option)	Comes on when the upper limit alarm is activated. Blinks while setting the alarm value.
⑭Lower limit alarm indication lamp (option)	Comes on when the lower limit alarm is activated. Blinks while setting the alarm value.
⑮Heater burnout alarm indication lamp (option)	Comes on when the heater burnout alarm is output. Blinks while setting the detection/activation value.
⑯Measured value (PV)/set value (SV) parameter display (applicable to PXZ4 only)	Parameter symbols and codes are displayed for measured value (PV) and set value (SV) and when setting various parameters.
⑰Measured value (PV) indication lamp	Stays on while measured value (PV) is on display.
⑱PV/SV SELECT key (for PXZ4 only)	The display of measured value (PV) and set value (SV) is switched over every time this key is pressed.

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Method of setting temperature and parameter


Operating state (PV/SV indication)

PXZ5, 7, 9



・ SV lamp lights, indicating measurement value(PV) and setting value(SV).

PXZ4



・ PV lamp lights, indicating measurement value(PV).

To change temperature setting value (SV)

1) Press ⌃ key for the position to change value. Light of corresponding position flashes.
2) Press ⌃ or ⌄ keys to change value.
3) The value is registered by pressing the ENT key.


Cautions in the setting

○ After setting data, the data is automatically registered by pressing the ENT key.
○ If the data setting is left as it is for about 30 seconds, the display is automatically returned to the operating state (PV/SV) display.
○ Where none of optional functions are incorporated into the unit, optional function parameters will be skipped without appearing on the display.

SEL 3 sec. ⇩ ⇧ SEL 3 sec.

The 1st block parameters

The operating state (PV/SV) display can be resumed by pressing the key or key in the current state. (For PXZ4 type, the SV display is resumed.)

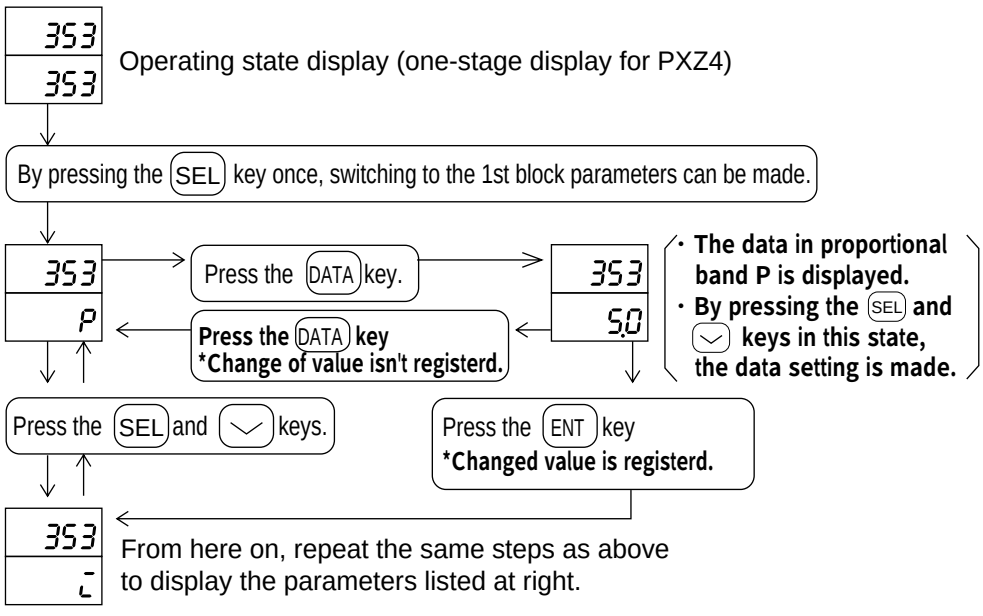

Note) " 353 "on the upper line is not displayed for PXZ4.


Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

	Parameter display code	Description	Setting range(setting unit)	Reference
ProG	ProG	Ramp soak command	oFF:Local operation rUn : Start of program operation HLd : Pause of program operation End : End of program operation	
P	P	Proportional band (ON/OFF control at 0.0)	0.0 to 999.9%FS	
I	I	Integral action time	0 to 3200 sec.	
d	D	Derivative action time	0.0 to 999.9 sec.	
AL	AL	Alarm 2 setting value	0.0 to 100% FS(enginering unit)	
AH	AH	Alarm 1 setting value	0.0 to 100% FS(enginering unit)	
TC	TC	Proportional time cycle of control output 1	1 to 150 sec.	Note 5, *3
HYS	HYS	Insensitive zone	0 to 50%FS (engineering unit)	
Hb	Hb	Heater burnount alarm setting value	0.0 to 50.0 A	
AT	AT	Auto-turning	0 : Not performed 1 : Performed in the standared mode 2 : Performed in the low PV mode	
TC2	TC2	Proportional time cycle of control output 2	1 to 150 sec.	Note 5, *6
Cool	Cool	Proportional band coefficient on the cooling side	0.0 to 100.0 times	*5
db	db	Shifting the proportional band on the cooling side	-50 to 50% (MV)	*5
bAL	bAL	Manual reset value	–100.0 to 100.0%	*4
Ar	Ar	Anti-reset wind up	0.0 to 100.0%FS (engineering unit)	*4
Loc	Loc	Key lock	0 : enables the change of setting for all paramater 1 : disable the change of setting for all paramater 2 : enables the setting of a set value (SV) only	
STAT	STAT	The current position of the program	Can not be set	*1
SV-1 to SV-4	SV-1 to SV-4	Target value in the 1st ramp to Target value in the 4th ramp	0 to 100%FS (engineering unit)	*1
TM1r to TM4r	TM1r to TM4r	Segment time in the 1st ramp to Segment time in the 4th ramp	0:00 to 99:59	*1
TM1S to TM4S	TM1S to TM4S	Segment time in the 1st soak to Segment time in the 4th soak	0:00 to 99:59	*1
Mod	MOD	Ramp SV mode	0 Note 1	*1

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com


Operating state (PV/SV indication)

PXZ5, 7, 9



・ SV lamp lights, indicating measurement value(PV) and setting value(SV).

PXZ4



・ PV lamp lights, indicating measurement value(PV).

To change temperature setting value (SV)


1) Press ⌃ key for the position to change value. Light of corresponding position flashes.
2) Press ⌃ or ⌄ keys to change value.
3) The value is registered by pressing the ENT key.

Cautions in the setting

○ After setting data, the data is automatically registered by pressing the ENT key.
○ If the data setting is left as it is for about 30 seconds, the display is automatically returned to the operating state (PV/SV) display.
○ Where none of optional functions are incorporated into the unit, optional function parameters will be skipped without appearing on the display.


SEL 7 sec. ⇓ ⇑ SEL 3 sec.

The 2nd block parameters

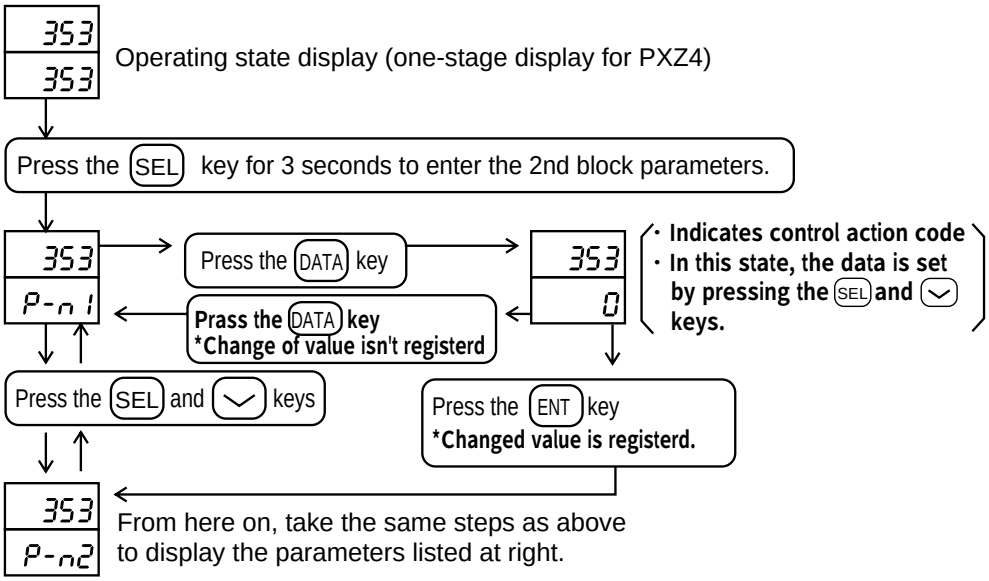

Note) " 353 "on the upper line is not displayed for PXZ4.

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

	Parameter display code	Description	Setting range (Setting unit)	Reference
P-n1	P-n1	Specifying control operation	0 to 19	Table 4
P-n2	P-n2	Input type setting	0 to 16	Table 1
P-dF	P-dF	Input filter (Time constant)	0.0 to 900.0 sec.	
P-SL	P-SL	Setting of lower limit in the range	-1999 to 9999 (engineering unit) Note 3, Note 4	Table 2
P-SU	P-SU	Setting of upper limit in the range	-1999 to 9999 (engineering unit) Note 3, Note 4	Table 2
P-AL	P-AH	Alarm type, Alarm type 2	0 to 15	Table 3,*2
P-AH	P-AH	Alarm type, Alarm type 1	0 to 11	Table 3,*2
P-An	P-An	Alarm insensitive zone	0.0 to 50.0%FS (engineering unit)	*2
P-dP	P-dp	Setting of decimal point position	0 to 2 Note 2, Note 3  	
PVOF	PVOF	PV offset	-10 to 10%FS (engineering unit)	
FUZY	FUZY	Specifying control method	OFF: PID control ON : FUZZY control	
dSP1 to dSP7	dSP1 to dSP7	Specifying parameter mask	0 to 255	Note 6

Note 1) Always set to 0 before using.
Note 2) 2 is valid only if voltage and current are applied.
Note 3) When P-SL/P-SU/P-dP is changed, check that all the parameters including the SV are properly assigned.
(They may have change)
Note 4) Not indicated if no HB occurs.
Note 5) The setting of 0 is for current output.
Don't set 0 at contact or SSR driving output.
It is recommended more than 30 at contact or more than 1 at SSR driving output.
Note 6) If you miss setting to dSP1 to dSP7, any parameters that you want to see don't apper.
Before you change them, record the current value of them.
Take care enough to change them.
**1: Not indicated without ramp/soak.*
**2: Not indicated without alarm.*
**3: Not indicated for current output.*
**4: Not indicated at shipment from factory.*
**5: Not indicated without control output 2.*
**6: Indicated only when control output 2 is relay or SSR drive output.*

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

[Table 1] Input type codes

Parameter: P-n2

Group	Input type	Code (P-n2)
I	RTD	
	· Pt100 (IEC)	1
	Thermocouple	
	· J	2
	· K	3
	· R	4
	· B	5
	· S	6
	· T	7
	· E	8
	· N	12
	· PL-II	13

Group	Input type	Code
II	1 to 5VDC, 4 to 20mA	16

* In the case of 4-20 mA DC input, use an 250-Ω outboard resistor to input 1-5 VDC.

Note 1) Code may be changed to another that is in the same group.

[Table 2] Input range (Standard range)

Parameter: P-SL, P-SU

		Range of measurement (℃)	Range of measurement (℉)
RTD (IEC)	Pt100Ω	0 to 150	32 to 302
	Pt100Ω	0 to 300	32 to 572
	Pt100Ω	0 to 500	32 to 932
	Pt100Ω	0 to 600	32 to 1112
	Pt100Ω	-50 to 100	-58 to 212
	Pt100Ω	-100 to 200	-148 to 392
	Pt100Ω	-150 to 600	-238 to 1112
	Pt100Ω	-150 to 850	-238 to 1562
Thermo-couple	J	0 to 400	32 to 752
	J	0 to 800	32 to 1472
	K	0 to 400	32 to 752
	K	0 to 800	32 to 1472
	K	0 to 1200	32 to 2192

		Range of measurement (℃)	Range of measurement (℉)
Thermo-couple	R	0 to 1600	32 to 2912
	B	0 to 1800	32 to 3272
	S	0 to 1600	32 to 2912
	T	-199 to 200	-328 to 392
	T	-150 to 400	-238 to 752
	E	0 to 800	32 to 1472
	E	-199 to 800	-328 to 1472
	N	0 to 1300	32 to 2372
	PL-Ⅱ	0 to 1300	32 to 2372
DC voltage	DC1 to 5V	-1999 to 9999 (Scaling is possible)	

Note 1) Except for the following, the input accuracy is ±0.5% FS ±1 digit ±1°C
(Input accuracy does not be guaranteed for the ranges of measurement other than in the table above.)
R thermocouple 0 to 500°C
B thermocouple 0 to 400°C
} : *in these ranges, this controller may display an incorrect process value due to the characteristic of the sensor.*















Note 2) In case a measuring range of -150 to 600°C or -150 to 850°C is used for resistance bulb input, temperatures below -150°C does not be indicated correctly. Therefore, "LLLL" does not appear despite a continuous fall below -150°C.

Note 3) If the resistance bulb or thermocouple is used at a temperature below the lowest value in the measurement range, the input accuracy cannot be guaranteed.

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

[Table 3] Alarm action type codes

Parameter: P-AH, P-AL

	ALM1 (P-AH)	ALM2 (P-AL)	Alarm type	Action diagram
	0	0	No alarm	
Absolute value alarm	1	1	High alarm	
	2	2	Low alarm	
	3	3	High alarm (with hold)	
	4	4	Low alarm (with hold)	
Deviation alarm	5	5	High alarm	
	6	6	Low alarm	
	7	7	High/Low alarm	
	8	8	High alarm (with hold)	
	9	9	Low alarm (with hold)	
	10	10	High/Low alarm (with hold)	
Zone alarm	11	11	High/Low deviation alarm (ALM 1/2 independent action)	
	—	12	High/Low absolute alarm	
	—	13	High/Low deviation alarm	
	—	14	High absolute/ Low deviation alarm	
	—	15	High deviation/ Low absolute alarm	

Note 1) When you change alarm type, check the alarm set value. A change of alarm action type may cause the alarm set value to be changed, but this is not a malfunction.

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

[Table 4] Control action codes

Parameter: P-n1

Code (P-n1)	Output type	Control action		Burn-out direction	
		Output 1	Output 2	Output 1	Output 2
0	Single	Reverse action	---	Lower limit	---
1				Upper limit	
2		Direct action		Lower limit	
3				Upper limit	
4	Dual	Reverse action	Direct action	Lower limit	Lower limit
5				Upper limit	
6				Lower limit	Upper limit
7				Upper limit	
8		Direct action		Lower limit	Lower limit
9				Upper limit	
10				Lower limit	Upper limit
11				Upper limit	
12		Reverse action	Reverse action	Lower limit	Lower limit
13				Upper limit	
14				Lower limit	Upper limit
15				Upper limit	
16		Direct action		Lower limit	Lower limit
17				Upper limit	
18				Lower limit	Upper limit
19				Upper limit	

[Burn-out direction]
Output direction if input is outside range or has an error.
Lower limit: OFF or 4mA or less
Upper limit: ON or 20mA or more

[Caution for dual output form]
(option)

(1) ID operation can not be set separately for heating/cooling.
(2) Setting the heating side to two position operation will set the cooling side to the same operation.
(3) If set to CooL=0.0, cooling side takes ON/OFF operation.
In this case, ON/OFF operation hysteresis is fixed (0.5%FS).

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

5 Useful usage of this equipment

1 Setting the input

* Skip this procedure if specified when you order.

① Is the input sensor type same as what you use ?

Select the sensor you use from those in Table 1, and set it in the parameter P-n2.

(Example) For T thermo-couple, set P-n2 to "7".

(Note) Changing between resistance bulb and thermo-couple is allowed, though that between 1 to 5VDC (4 to 20mA DC) and thermo-couple/resistance bulb is not allowed.

② Is setting of input temperature range suitable for the sensor you use?

Standard range to each sensor is shown in Table 2. Select the temperature range suitable for the equipment you use, set lower/upper limit values to P-SL/P-SU respectively.

(Example) Temperature range 0 to 800 [°C] set P-SL and P-SU to 0 and 800 respectively.

(Note) Standard range is recommended to set though other setting is available.

(Note) No standard range is given if 1 to 5VDC(4 to 20mA DC) are input.
Any upper/lower limits can be set (-1999 to 9999, and lower limit< upper limit)

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

2 Setting of controls

* Read if the control doesn't work as you expect.

① Objective of control (heating or cooling applied?)

Objective	Operation scheme	Description	Method
Heating	Reverse	Increased measurement value will decrease operational output value.	Set parameter P-n1 to 0 or 1. (Refer to Table 4)
Cooling	Direct	Increased measurement value will increase operational output value.	Set parameter P-n1 to 2 or 3. (Refer to Table 4)

② Types of control (ON/OFF, PID, fuzzy)

Type of control	Description	Method
ON/OFF control (2 position control)	Output takes either ON (100%) or OFF (0%). (Suitable when frequent output switching is inconvenient.)	Parameter P is set to 0.0. *Refer to “5-1 ON/OFF control”
PID control	Output is calculated with PID parameters, outputting 0 to 100% with setting proportional period (TC) as 100%. Control with less overshoot is available.	Perform the auto-tuning to automatically calculate an optimal PID (manual operation is also available). *Refer to “5-2 Auto-tuning”.
Fuzzy control	Fuzzy operation is added to PID providing control with less overshoot.	Set the parameter FUZY to ON. Perform the auto-tuning (same as PID control).

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

5-1 ON/OFF (two position) control


- Output ON/OFF is determined according to which of PV or SV is larger.
- Set parameter P to 0 for selecting the two-position control.
- Set the operation insensitive zone (hysteresis) to avoid an output chattering near PV ≒ SV. (setting at shipping: HYS=1)

- Parameter setting and operation example

Example 1: Reverse action

Parameter	Setting value
P	0.0
P-n1	0 (or 1)
HYS	Any value


Relationship of PV and SV	Output
PV＞SV	**OFF**
PV＜SV	**ON**

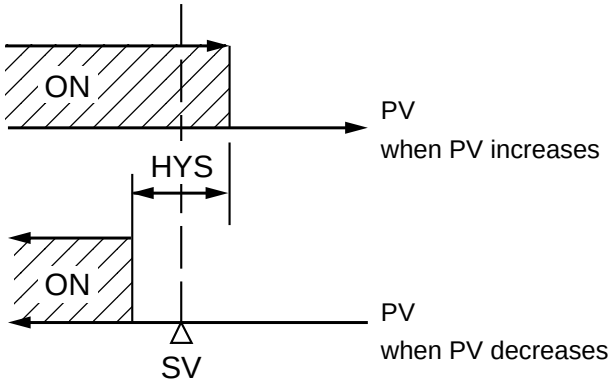

Example 2: Direct action

Parameter	Setting value
P	0.0
P-n1	2 (or 3)
HYS	Any value

Relationship of PV and SV	Output
PV＞SV	**ON**
PV＜SV	**OFF**

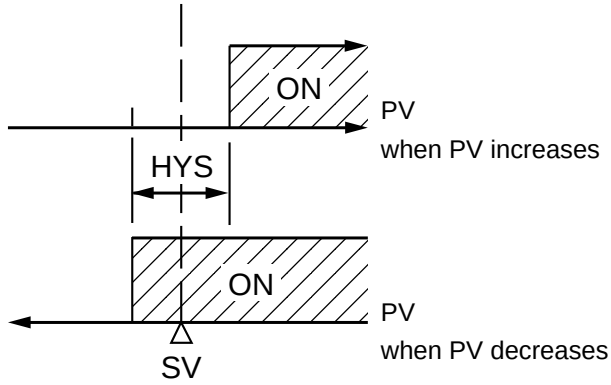

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

5-2 Auto-tuning (AT)


The auto-tuning is automatic measurement, computation, and setting of the P.I.D. constant that are performed by the micro-controller. Prior to the auto-tuning, complete the setting of input range (P-SL, P-SU, P-dP), a set value (SV), alarm setting (H,L), and proportional time cycle (TC).

How to start the auto-tuning


Set the parameter, AT to either "1" or "2" by using ⌃ or ⌄ key, and press the ENT key to start auto-turning. Then the point indicator at the lower right will start blinking. When auto-tuning ends, parameter AT is automatically set to 0 after flashing at decimal point of digit 1 disappears.

	When auto-tuning is not performed or when it is cancelled	Standard type (auto-tuning on the basis of SV)	Low PV type (auto-tuning on the basis of SV･10%FS)
Setting code (AT)	0	1	2

① Standard type (AT=1)

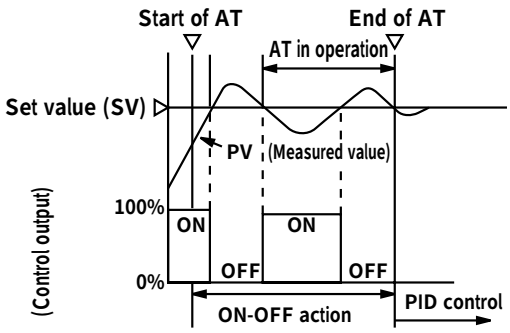

② Low PV type (AT=2) : Overshoot decreases when tuning is performed.

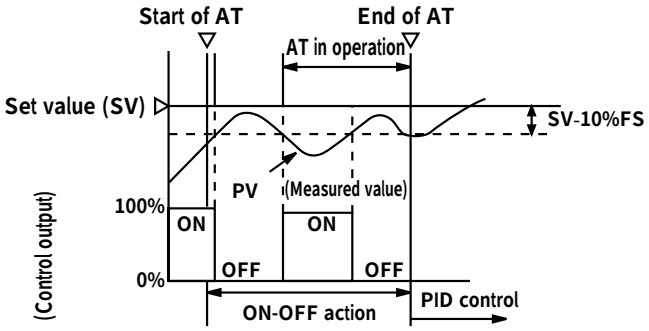

(a) The P.I.D. parameter calculated by auto-tuning, will be retained even if the power is turned off. If, however, the power is turned off in the auto-tuning, you must restart the auto-tuning.

(b) The PV may be changed greatly depending on the process, because the control output is ON/OFF action in the auto-tuning. So, do not use the auto-turning if the process does not allow a significant variation of PV.
Also, the auto-tuning should not be used in a quick-responsive process such as pressure control and flow control.

(c) If the auto-tuning fails to complete in four hours, an abnormality in the auto-tuning may be suspected. In this case, recheck the wiring, control output operations (nomal and reverse action), and parameters such as the input sensor type.

(d) Carry out the auto-tuning again when the SV is significantly changed, parameter P-SL, P-SU or P-dP is changed or a controlled equipment operation is changed.

(e) Figures ① and ② show the behavior of PV during the auto-tuning.

(f) Perform the auto-tuning also when fuzzy control is selected in the control type setting.

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com


5-3 bAL and Ar function


Note: The parameters bAL and Ar disappear at shipment.
you need to set to appear below,"Switching bAL and Ar to appear or to disappear.

1) These are functions to suppress overshoot.
2) If they aren't optimum value, sometime you don't get the good control. Usually it is not necessary to set them.
3) "Ar" is automatically calculated and set by "Auto tuning".

1 bAL


This is added as offset to MV' that PID calculates from PV and SV.
This is MV after calculation above.

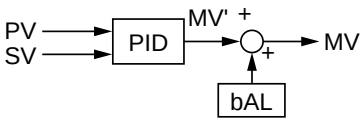

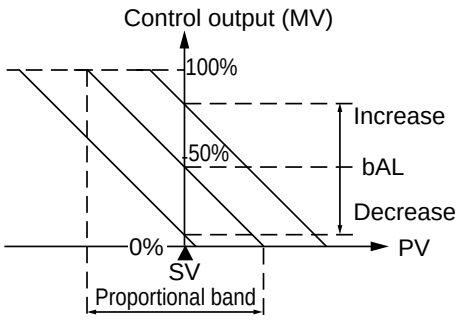

2 Ar

The "Ar" limits the integral range. The integral range is SV ± Ar.
Integral action don't work when PV is out of the range of SV ± Ar.

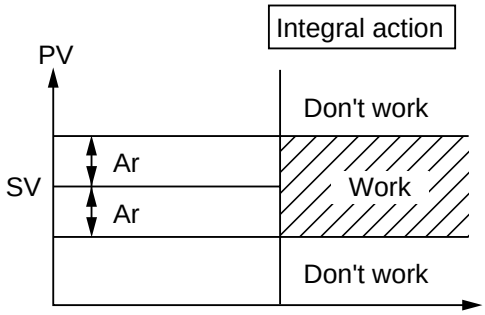

Switching bAL and Ar to appear or to disappear

1 Switch to appear

① Display the "dSP2" of the third block parameter and then subtract 128 from current value.
② Display the "dSP3" of the third block parameter and then subtract 1 from current value.

2 Switch to disappear

① Display the "dSP2" of the third block parameter and then add 128 to current value.
② Display the "dSP3" of the third block parameter and then add 1 to current value.

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

6 Read if the indication is abnormal.

Displays in abnormalities

This unit has a display function to indicate several abnormalities. If an abnormality occurs, eliminate the cause of abnormality immediately. After the cause is eliminated, turn off the power once before the power is turned on.

Display	Cause	Control output
UUUU	① when the thermocouple sensor is burnt out. ② when the RTD (A) is burnt out. ③ when the PV value exceeds the upper limit value of the range +5% FS.	① when the burn-out control output is set for the lower limit (standard): OFF or 4 mA or less ② when the burn-out control output is set for the upper limit: ON or 20 mA or larger
LLLL	① when the RTD (B or C) is burnt out. ② when the RTD (between A and B, or between A and C) is shorted. (Note) ③ when the PV value is below the lower limit value of the range -5% FS. ④ when the 1 to 5 VDC wiring is opened or shorted.	
LLLL	① when a PV value is below -199.9.	The control is continued. *Note) The control is continued until the value reaches -5% FS or less. The burn-out will take place when the value reaches -5% FS or less.*
HB lamp ON	The heater is burnt out.	The control is continued.
Err	When P-SL/P-SU setting is improper.	OFF or 4mA or less
FAL 1	Fault in the unit	Undefined (Don't use this controller immediately.)

Note : In case a measuring range of -150 to 600°C or -150 to 850°C is used for resistance bulb input, control will be continued without "LLLL" display.

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Specification

Power voltage:	100 (- 15%) to 240 VAC (+10%), 50/60Hz or 24VDC/24 VAC (±10%), 50/60Hz
Power consumption:	15VAC or less/240VAC
Sensor input:	Thermocouple, 3-wire resistance bulb, 1 to 5VDC
Control method:	PID or fuzzy PID or ON/OFF (two positions)
Relay output:	1C contact, 220 VAC/30 VDC 3A (resistive load) mechanical life ; 10 million times or over (no load) electrical life ; 100 thousands times or over (rating load)
SSR/SSC driving output: (voltage pulse output)	ON: 15 to 30 VDC OFF: 0.5VDC or less maximum current ; 60mA or less 2 point alarm for PXW4: 25mA or less SSR/SSC driving output for control outputs 1 and 2: 60mA or less in total
DC4-20mA output:	Allowable load resistor 600Ω or less
Alarm output:	Relay contact (1a contact) 220 VAC/30 VDC 1A (resistive load)
Heater disconnection alarm output:	Relay contact (1a contact) 220 VAC/30 VDC 1A (resistive load)
Operating ambient temperature:	-10 to 50°C
Operating ambient humidity:	90%RH or less (no condensation)
Preservation temperature:	-20 to 60°C
Operating environmental condition:	Installation category II, contamination degree 2 Warm-up time: 30 minutes or more

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

FUJI ELECTRIC



Micro controller X



Type: PXZ

OPERATION MANUAL

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Contents

1. Operating Parts and Functions 1
2. Operation 2
   - 2-1 Parameter Table 2
   - 2-2 Basic operation 4
   - 2-3 Parameter functions and setting method 5
     - Setting of set value (SV) 5
     - Setting of proportional band 6
     - Integral time 7
     - Derivative time 8
     - Lower limit alarm (ALM2) setting (option) 9
     - Upper limit alarm (ALM1) setting (option) 10
     - Setting of proportional cycle of control output 1 11
     - 2-position action hysteresis width 12
     - Heater burnout alarm (option) 13
     - Auto-tuning 15
     - Cooling side cycle of control output 2 16
     - Cooling side proportional band coefficient 17
     - Shift of cooling side proportional band 18
     - Output 1 lower limit setting 19
     - Output 1 upper limit setting 19
     - Output 2 lower limit setting 19
     - Output 2 upper limit setting 19
     - Setting of operation mode of output limiter 20
     - Output convergence value, Anti-reset wind up 21
     - Key lock 22
     - Program status display 23
     - Setting of ramp/soak control (ProG) (option) 24
     - Setting of control mode 25
     - Input filter constant 26
     - Setting of input type 27
     - Alarm hysteresis width (option) 28
     - Lower limit of measurement range and set value (SV) 29
     - Upper limit of measurement range and set value (SV) 29
     - Setting of lower limit alarm (ALM2) action type (option) 30
     - Setting of upper limit alarm (ALM1) action type (option) 30
     - Setting of RCJ compensation 32
     - Setting of decimal point position 33
     - PV offset 34
     - SV offset 35
     - Selection of measurement input °C/°F 36
     - FUZY control setting 37
     - User's adjust zero adjustment, User's adjust span adjustment 38
     - Skipping of parameter display 39
3. Troubleshooting 40

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Operating Parts and Functions

Fig. 1-1 shows the outline of the front panel of the unit.
One the front of the unit, there are PV/SV digital indication lamps, condition indication lamps and setting keys.
Table 1-1 shows the functions of these oeprating parts. Before using the unit, be sure to understand the functions of the operating parts.
For details of setting parameters, refer to Chapter 2 of this manual.

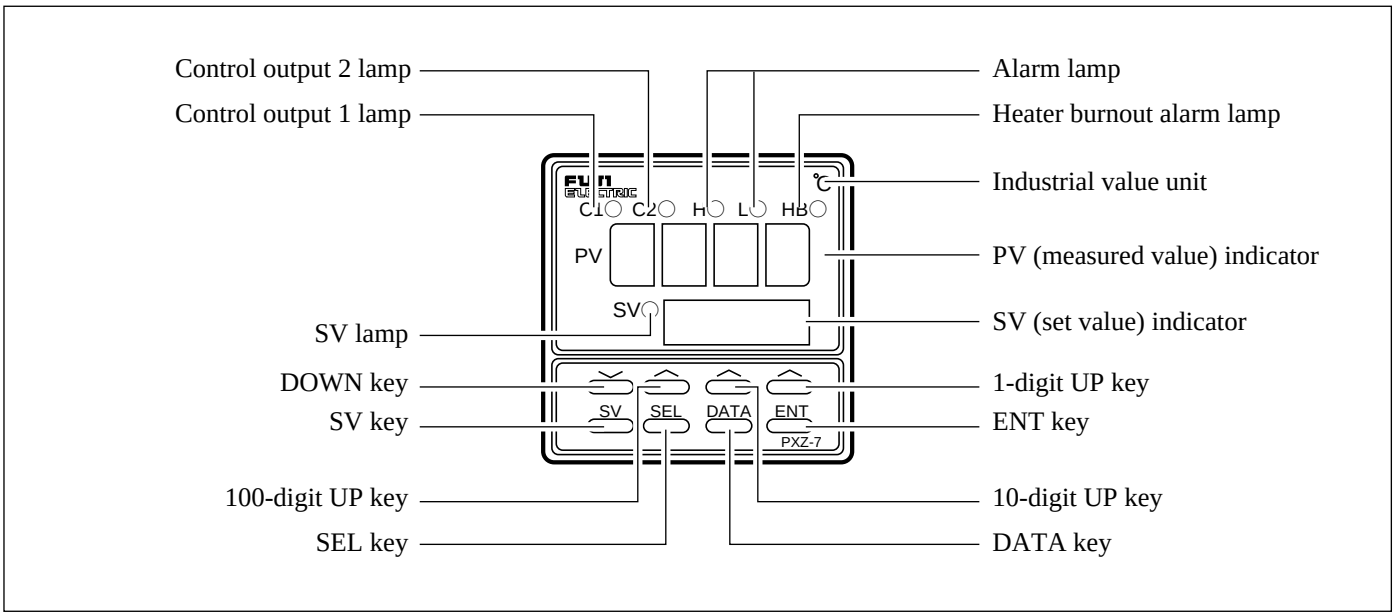


Fig. 1-1

Table 1-1

Name	Function
Control output 1 lamp	Lights at ON of control output 1.
Control output 2 lamp	Lights at ON of control output 2.
Alarm lamp	Lights at alarm detection. Alarm output is ON at the same time.
Heater burnout alarm lamp	Lights at detection of heater burnout. Heater burnout alarm output is ON at the same time.
PV (measured value) indicator	Indicates measured values.
SV (set value) indicator	Indicates set values. Also indicates parameters and data at setting of parameters.
1-digit "(∧)" key (1-digit key)	1-digit data value increases at change of SV or at data setting.
10-digit "(∧)" key (10-digit key)	10-digit data value increases at change of SV or at data setting.
100-digit "(∧)" key (100-digit key)	100-digit data value increases at change of SV or at data setting.
"(∨)" key	Value of flickering digit decreases at change of SV or data setting.
"(SV)" key	48 x 48mm size: Used to select SV/PV display.
	Other size: Returns to set value (SV) display from parameter display.
"(SEL)" key	Used to select parameter block or parameter.
"(DATA)" key	Used to display parameter value.
"(ENT)" key	Used to enter parameter value.

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

2 Operation

The setting of set values (SV) and internal parameters of the Micro Controller X are explained in the following.

2-1 Parameter Table

On Micro Controller X, parameters are classified into No. 1 and No. 2 blocks according to operation frequency. No. 1 and No. 2 blocks are used for initial setting and whenever necessary.


① No. 1 block parameter table

Parameter display symbol	Name		Description	Initial set value prior to delivery	User's set value	Parameter mask DSP	Page
PrOG	ProG	Lamp soak control oFF: Stop rUn: Start HLd: Pause	Lamp soak start/stop	oFF		1-1	24
P	P	Proportional band	Setting range; 0.0 to 999.9% (for input range)	5.0		1-2	6
I	I	Integral time	Setting range; 0 to 3200 sec.	240		1-4	7
d	D	Derivative time	Control stability is enhanced with input change. It reacts quickly with change of small deviation at large derivative time (D). (Setting range: 0.0 to 999.9 sec.)	60.0		1-8	8
AL	L	Lower limit alarm	Used to set lower limit operation of alarm. Setting within input range is possible (option).	10		1-16	9
AH	H	Upper limit alarm	Used to set upper limit operation of alarm. Setting within input range is possible (option).	10		1-32	10
TC	TC	Control output 1 proportional cycle	Used to set control output proportional cycles. (Setting range: 1 to 150 sec.)	Contact output: 30 SSR/SSC drive output 2		1-64	11
HYS	HYS	2-position action hysteresis width	Used to set hysteresis width at 2-position action. (Setting range: 0.0 to 50.0%FS)	1		1-128	12
Hb	HB	Heater burnout alarm	Used to set value of heater burnout detection (option). (Setting range: 1.0 to 50.0A) [Alarm function OFF at 0]	0.0		2-1	13
AT	AT	Auto-tuning	Used to set PID parameters by auto-tuning. 0: None (auto-tuning released or not executed) 1: Execution (standard type; auto-tuning is executed by SV value) 2: Execution (low PV type; auto-tuning is executed at -10FS of SV value)	0		2-2	15
TC2	TC2	Control output 2 proportiona cycle	Used to set proportional cycle of cooling side control output (option). (Setting range: 1 to 150 sec.)	Contact output: 30 SSR/SSC drive output 2		2-4	16
CooL	CooL	Cooling side proporitonal band coefficient	Used to set cooling side proportional band coefficient (option). (Setting range: 0.0 to 100.0) The setting of 0 will lead to ON-OFF operation.	1.0		2-8	17
db	db	Cooling side pro-portional band shift	Used to shift cooling side output value (option). (Setting range: -50.0 to +50.0)	0.0		2-16	18
PLC1	PLC1	Output 1 lower limit setting	Setting range: -3.0 to 103.0%	-3.0		2-32	19
PHC1	PHC1	Output 1 higher limit setting	Setting range: -3.0 to 103.0%	103.0		2-64	19
PCUT	PCuT		Peculiar parameter for device. Do not use.	—		2-128	20
bAL	BAL	Output conver-gence value	Function to suppress overshoot.	Single: 0.0 Dual : 50.0		3-1	21
Ar	AR	Antireset wind up	Used to suppress overshoot due to integral action. (Setting range: 0 to 100%FS)	100%FS		3-2	21
LoC	LoC	Key lock	Designates enable or disable to change the parameter setting. 0: Change of all parameter setting is possible. 1: Change of all parameter setting is not possible. 2: Change of set value (SV) only is possible.	0		3-4	22
STAT	STAT	Ramp/soak present position display	Used to display present ramp/soak position (option).	OFF		3-8	23
SU-1 ⟆ SU-4	SV-1 ⟆ SV-4	No.1 to No.4 target value	Used to set ramp/soak target value (option). (setting range: 0 to 100%FS)	0%FS		3-16 3-128 4-4 4-32	23
rM1r ⟆ rM4r	TM1r ⟆ TM4r	No.1 to No.4 ramp segment time	Used to set time for segment of ramp (option). (setting range: 0 to 99h59m)	0.0		3-32 4-1 4-8 4-64	23
rM1S ⟆ rM4S	TM1S ⟆ TM4S	No.1 to No.4 soak segment time	Used to set time for segment of soak (option). (setting range: 0 to 99h59m)	0.0		3-64 4-2 4-16 4-128	23
Mod	Mod	Ramp/soak func-tion mode setting	Setting of ouptut at power ON start and end, at power OFF, and setting of repeat action (option).	0		5-1	23

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

No. 2 block parameters are used for setting the initial set values, and for special operation and setting.

② No. 2 block parameter table

Parameter display symbol	Name		Description	Initial set value prior to delivery	User's set value	Parameter mask DSP	Page
P-n1	P-n1	Setting of control method	Setting of normal/reverse action of set output and burnout direction.	As per ordering specification		5-4	25
P-n2	P-n2	Setting of input type	Setting of input type	As per ordering specification		5-8	27
P-dF	P-dF	Input filter parameter	Setting of input filter parameter (second) (Setting range: 0.0 to 900.0 sec.)	5.0		5-16	26
P-SL	P-SL	Setting of lower limit range	Setting of lower limit input range	As per ordering specification		5-32	29
P-SU	P-SU	Setting of higher limit range	Setting of higher limit input range	As per ordering specification		5-64	29
P-AL	P-AL	Setting of lower limit alarm (ALM2) type	Setting of alarm action type	9		5-128	30
P-AH	P-AH	Setting of higher limit alarm (ALM1) type	Setting of alarm action type	5		6-1	30
P-An	P-An	Setting of alarm hysteresis	Setting of alarm output ON-OFF hysteresis width (Setting range: 0 to 50%FS)	1		6-2	28
rCJ	RCJ	RCJ compensation setting	on: RCJ compensation ON (cold contact compensation is performed) off: RCJ compensation OFF (cold contact compensation is not performed)	on		6-8	32
P-dP	P-dP	Setting of decimal point position	Selects decimal point position of PV/SV display.  No decimal point : "0" "1" "2"	As per ordering specification		6-4	33
PVOF	PVOF	PV offset	Shift of input value (PV) display. (Setting range: -10 to 10%FS)	0		6-16	34
SVOF	SVOF	SV offset	Shift of set value (SV) display. SV display remains unchanged. (Setting range: -50 to 50%FS)	0		6-32	35
P- F	P-F	Selection of unit °C/°F of measured value input	Measured value is selected, so other parameters need to be changed. °C display: C °F display: F	As per ordering specification		6-64	36
PLC2	PLC2	Output 2 lower limit setting	Setting range: -3.0 to 103.0%	-3.0		6-128	19
PHC2	PHC2	Output 2 higher limit setting	Setting range: -3.0 to 103.0%	103.0		7-1	19
FUZY	FUZY	FUZY control setting	ON: FUZY control is performed. OFF: Normal PID control is performed.	OFF		7-2	37
AdJ0	ADJO	User adjust zero adjustment	Used for shifting input zero side by user adjust function.	0		7-8	38
AdJS	ADJS	User adjust span adjustment	Used for shifting input span side by user adjust function.	0		7-16	38
OUT	OUT	Output value (MV) display	display of present output value (MV)	—		7-32	—
dSP1 ⟆ dSP7	dSP1 ⟆ dSP7	Parameter skip	Setting of parameter display "yes or no"	Setting is made according to code symbol		—	39

Items shown in ▭ are not displayed. If necessary, they are able to be displayed and set by using the dsp1 to dsp7 function of No.2 block parameter.

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

2-2 Basic operation

① Condition at power ON


Operation	Description	Display	
Power ON	Display at power ON is shown at right.	PXZ4	PV SV
		PXZ5/7/9	PV SV

② Selection of parameter


Basic operation of PXZ is shown below. When PXZ4 (1 stage display type) is used, PV/SV is displayed on the one stage display. In this case, PV/SV display is selected by pressing [SEL]and [PV/SV] keys.

If the unit is not operated for 30 seconds, the display is set to PV/SV display just after power ON.

Key type (PXZ)

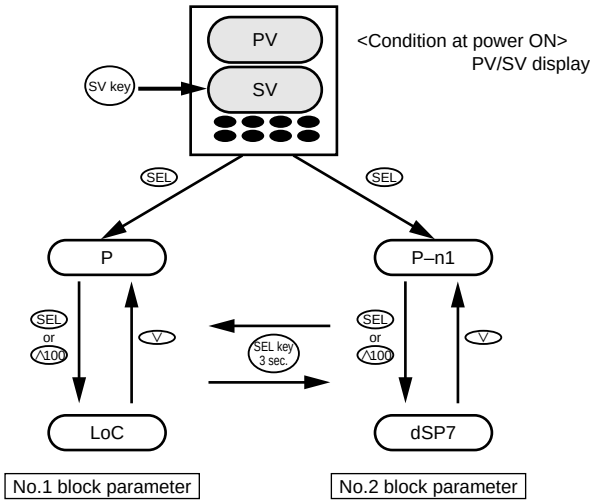

< No.1 and No.2 block parameter setting operation >

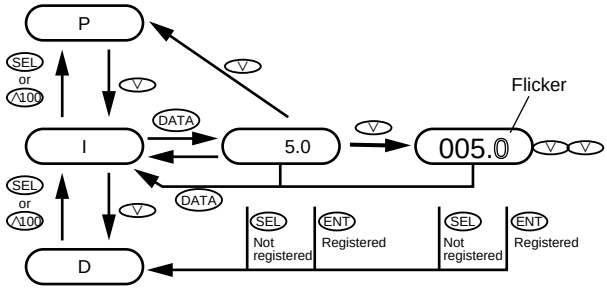

< Fig. 2-1 Basic operation of PXZ >

③ Setting of numerical value

(∧) key : Numerical value increases by 1 at each press of key.
It keeps increasing by pressing continuously.

(∨) key : Numerical value decreases by 1 at each press of key.
It keeps decreaasing by pressing continuously.

④ Registration of set data

Automatically registered 3 seconds after data is set.

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

2-3 Parameter functions and setting method

Setting of set value (SV)


[Description]

- Set values are control target values.
- Upper/lower limit of set value is designated by No. 2 block parameter P-SU/P-SL. P-SL (lower limit) or P-SU (upper limit) cannot be used for setting outside the range (See page 29).
- When a temperature sensor is used for input, the unit of set value is °C or °F. Selection between °C and °F is made by No. 2 block parameter P-F.

Related parameter: P-SL (Page 29)
P-SU (Page 29)
LOC (Page 22)

Example) Altering SV 250°C to 1195°C

Key operation	Description	Display
SEL	Press the SEL key to display P.	P
DATA	Press DATA key once, then SV display lamp is lighted, and current value is displayed.	PV SV○ 250
∧ ∨	Press the ∧ or ∨ key to display 1195.	
ENT	SV is automatically registered in 3 seconds.	1195
SV	Press the SV key to return to the operating status display. Also, after 30 seconds without key operation, data is automatically returned to the operating status display.	1195







Setting of proportional band (Setting range: 0 to 999.9% for input range)

[Description]


- Proportional band can be set automatically by auto-tuning.
- Manual setting is also possible. If P value is too small, control action becomes unstable, and if it is too large, the response becomes slow.
- When P is set to 0.0, 2-position action becomes effective.

  The hysteresis under 2-position action should be set with the parameter HYS.
- When dual output type is used and it is set to P = 0.0 and COOL = 0.0, the heating and cooling outputs are as shown in the following diagram. In this case, the hysteresis is fixed at 0.5%.

Example) Altering proportional band 10.0% to 15.0%

Key operation	Description	Display
SEL	Press the SEL key to display P.	
DATA	Press the DATA key once. Current proportional band (10.0%) is diplayed.	
∧ ∨	Press the ∧ or ∨ key to display 15.0.	
ENT	Press the ENT key, then proportional band is registered. Operation is started with 15.0% proportional band.	
SV	Hold down the key for 3 seconds to display the operation status.	

Related parameter: HYS (Page 12)

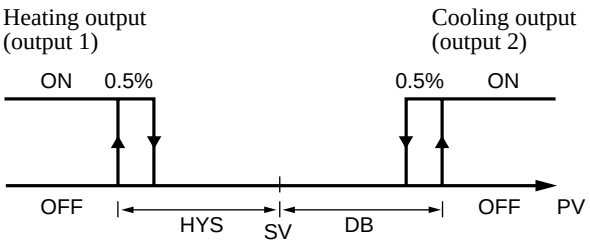

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Integral time (Setting range: 0 to 3200 sec.)

[Description]

- Integral time can be set automatically by auto-tuning.
- Manual setting is also possible.
- When I value is set to 0, integral action becomes OFF and P action or PD action is effected.

Example) Altering the integrating time of 600 seconds to 840 seconds

Key operation	Description	Display
SEL	Press the SEL key to display P.	P
SEL	Press the SEL key once.	I
DATA	Press the DATA key once. Current integrating time (600 seconds) is displayed.	600
∧ ∨	Press the ∧ or ∨ key to display 840.	840
ENT	Press the ENT key, then the integrating time is registred. Operation is started with an integrating itme of 840 seconds.	
SV	Press the SV key, when you need display the operation status.	1195








Derivative time (Setting range: 0.0 to 999.9 seconds)


[Description]

- Derivative time can be set automatically by auto-tuning.
- Manual setting is also possible.
- When D value is set to 0, derivative action becomes OFF and P action or PI action is effected.

Example) Altering a derivative time of 120.0 seconds to 100.0 seconds

Key operation	Description	Display
SEL	Press the SEL key to display P.	
SEL	Press the SEL key repeatedly until d is displayed.	
DATA	Press the DATA key once. Current derivative time (120.0 seconds) is displayed.	
∧ ∨	Press the ∧ or ∨ key to display 100.0.	
ENT	Press the ENT key, then the derivative time is registred. Operation is started with 100.0 seconds of derivative time.	
SV	Press the SV key when you need to display the operation status.	

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com




Lower limit alarm (ALM2) setting (option)
(Setting is possible within input range)

[Description]

- Alarm is not displayed without lower limit alarm function.
- When input or deviation is smaller than AL, or when deviation is larger than AL, alarm output turns ON.
- When using lower limit alarm, it is necessary to set alarm type (see parameter P-AL) and appropriate code.
- When lower limit alarm with hold function is used, lower limit alarm does not turn ON even it the input is smaller than AL (see diagram (c) below).
- When it is the range alarm and input or deviation is smaller than AL, the alarm output turns OFF (see diagram (b) below).
- Selection between absolute value alarm and deviation alarm is made by P-AL.
- Alarm action hysteresis can be set by No. 2 block parameter P-An.

Related parameter: P-AH (Page 30)
P-AL (Page 30)
P-An (Page 28)

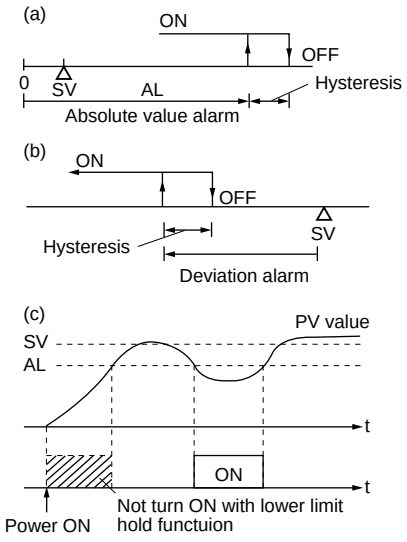

Example) Altering the lower limit alarm of 200°C to 100°C

Key operation	Description	Display
SEL	Press the SEL key to display P.	P
SEL	Press the SEL key repeatedly until AL is displayed.	AL
DATA	Press the DATA key once. Current lower limit alarm value (200°C) is displayed.	200
∧ ∨	Press the ∧ or ∨ key to display 100.	100
ENT	Press the ENT key, then the lower limit alarm value is registred. Operation is started with 100°C of lower limit alarm.	
SV	Press the SV key when you need to display the operation status display.	1195

Upper limit alarm (ALM1) setting (option) (Setting is possible within input range)


[Description]

- Alarm is not displayed without upper limit alarm function.
- When using upper limit alarm, it is necessary to set alarm type (see parameter P-AH) and appropriate code.
- When input or deviation is larger than AH, the alarm output turns ON (see diagram (a) below).
- When it is the range alarm and input or deviation is larger than AH, the alarm output turns ON (see diagram (b) below).
- Selection between absolute value alarm and deviation alarm is made by P-An.
- Alarm action hysteresis can be set by No. 2 block parameter P-An.

Related parameter: P-AH (Page 30)
P-AL (Page 30)
P-An (Page 28)

Example) Altering the upper limit alarm of 300°C to 550°C

Key operation	Description	Display
SEL	Press the SEL key to display P.	P
SEL	Press the SEL key repeatedly until AH is displayed.	AH
DATA	Press the DATA key once. Current upper limit alarm value (300°C) is displayed.	300
∧ ∨	Press the ∧ or ∨ key to display 550.	550
ENT	Press the ENT key, then the upper limit alarm value is registred. Operation is started with 550°C of lower limit alarm.	
SV	Press the SV key when you need to display the operation status display.	1195

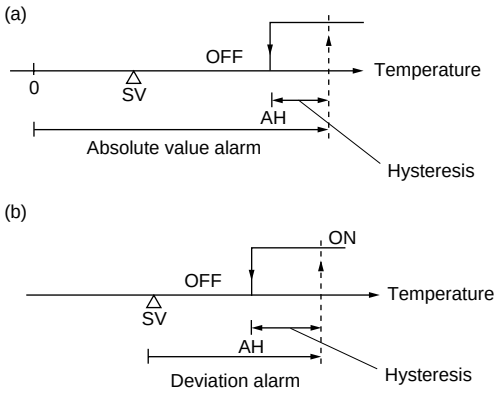

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

7C Setting of proportional cycle of control output 1 (Setting range 1 to 150 sec.)

[Description]

- When contact output or SSR drive output type is used, the output turns ON/OFF at a contact cycle when the input is within the proportional band.

  This cycle is called the proportional cycle. The output value is expressed by the ratio which the output turns ON within the time of proportional cycle.

  As the time of proportional cycle becomes short, control can be made more accurately, but it reduces the life of operation terminal unit, so it needs to be set in consideration of the life of operation terminal unit.

  In this case of current output, this parameter is not displayed.


The following shows the standard proportional cycles.

SSR, SSC :

Proportional cycle, 1 to 2 sec.

Contact output :

Proportional cycle, 20 to 30 sec.

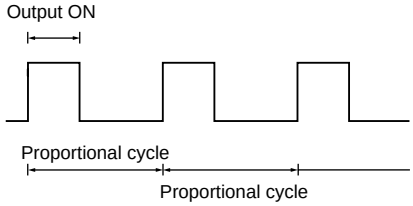

Example) Altering a proportional cycle of 30 seconds to 20 seconds


Key operation	Description	Display
SEL	Press the SEL key to display P.	P
SEL	Press the SEL key repeatedly until 7C is displayed.	7C
DATA	Press the DATA key once. Current proportional cycle (30 seconds) is displayed.	30
∧ ∨	Press the ∧ or ∨ key to display 20.	20
ENT	After press the ENT key, the proportional cycle is registred. Operation is started with 20 seconds of proportional cycle.	
SV	Press the SV key when you need to display the operation status display.	1195

H45 2-position action hysteresis width (Setting range: 0.0 to 50.0%FS)

[Description]

- Hysteresis width under the 2-position action control can be set as shown in the example. When hysteresis width is set small, the control efficiency is improved, but the number of operations increases and decreases the life of the operation terminal unit and the device.
- Hysteresis width is necessary to prevent chattering due to noise.
- For 2-position action, the value of P (proportional band) should be set to 0.0.
- Set value can be obtained by industrial value.

Related parameter: P (Page 6)

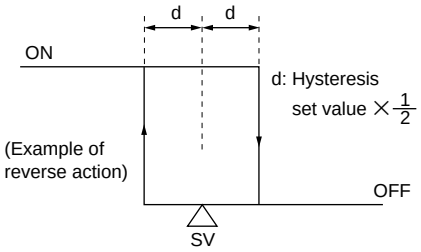

Example) Altering the hysteresis width of 1°C to 2°C

Key operation	Description	Display
SEL	Press the SEL key to display P.	P
SEL	Press the SEL key repeatedly until H45 is displayed.	H45
DATA	Press the DATA key once. Current data of 1°C is displayed.	1
∧ ∨	Press the ∧ or ∨ key to display 2.	2
ENT	After press the ENT key, data of 2°C is registred. Operation is started with 2°C of data.	
SV	Press the SV key when you need to display the operation status display.	1195


Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Heater burnout alarm (option) (Setting range: 1.0 to 50.0A)


[Description]

- Burnout detect current (parameter Hb) should be set according to the type of heater being used.


  It is set to 0.0 prior to delivery from the factory.
- Alarm operating point is set by parameter Hb.
- Current detector (CT) comes in 2 types, 0 to 30A type (CTL-6-SF) and 20 to 50A type (CTL-12-S36-8F). It should be selected according to the heater power source being used.
- Setting of alarm operating point
  - · Apply current to the heater with the controller output turned ON.
  - · Search alarm operating value while changing the set value of Hb (when changing the set value, the next set value should be changed more than 3 seconds later).
  - · After operating point is obtained, use 70 to 80% of the value as the final set value.
  - · When N number of heaters are used, set it in the middle between the current at N number of heaters and that of N-1 number.
- The heater burnout alarm function can not be used in case when the heater is controlled by thyristor phase angle control system.
- When 3-phase heater is used, heater burnout can be detected in some cases. For details, contact our office.
- Connect of heater burnout detect CT

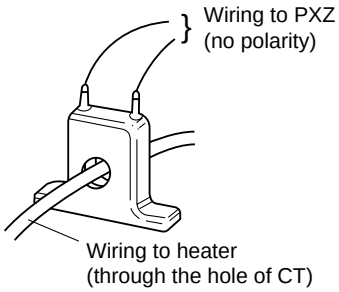

- Example of connection of heater burnout alarm (Type: PXZ5, PXZ9)

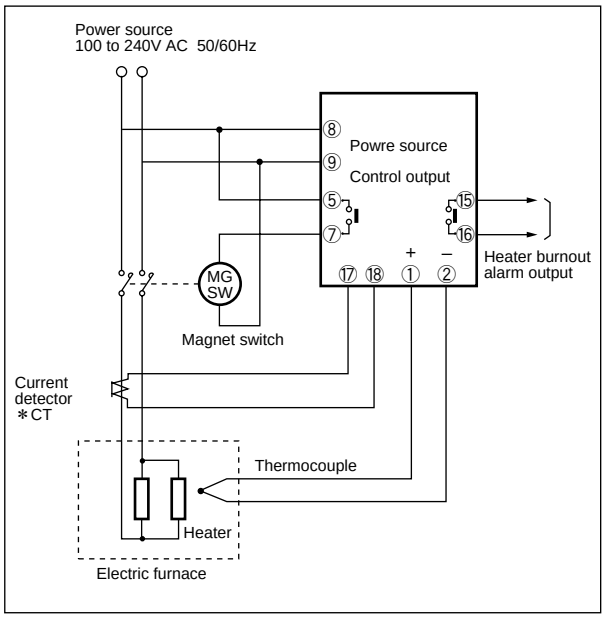






- When detection error is large due to small heater capacity, increase the apparent current 2 times larger by putting the wire twice through the hole to improve the sensitivity of the detector (in this case, set the current to a two-fold value).
- When wire through CT is wound many turns, be sure to wind it from the same direction.

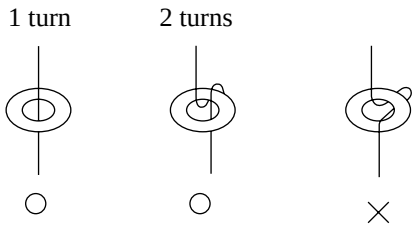

(Note) In using heater burnout alarm, set the proportional cycle (TC) to more than 20 seconds.

Related parameter: TC (Page 11)

Example) Altering alarm setpoint of heater burnout current of 9.0A to 8.0A

Key operation	Description	Display
SEL	Press the SEL key to display P.	
SEL	Press the SEL key repeatedly until Hb is displayed.	
DATA	Press the DATA key once. Current data of 9.0A is displayed.	
∧ ∨	Press the ∧ or ∨ key to display 8.0.	
ENT	After pressing the ENT key, data of 8.0A is registred. Operation is started with data of 8.0A.	
SV	Press the SV key when you need to display the operation status display.	

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

AT Auto-tuning (Setting range: 0, 1, 2)

[Description]

- PID value can be set automatically.
- Once PID value is set automatically by auto-tuning, it is saved in the controller even when the power is turned OFF, so auto-tuning function is not required any further.
- Auto-tuning is started by setting 1 or 2 in AT parameter. AT value is automatically reset to 0 at the end of auto-tuning.
- At the end of auto-tuning, control action is started automatically by setting PID.
- During auto-tuning, the decimal point at 1 digit of SV display flickers.
- When auto-tuning is forcedly suspended, set AT value to 0 or turn OFF the instrument power.
- AT is available in the following 2 types.

Setting code	Method
1	SV type SV ON-OFF action
2	Low PV type SV-10%FS ON-OFF action

During auto-tuning, ON-OFF control is performed which causes overshoot for SV. But, the overshoot can be eliminated by low PV type auto-tuning.

- Auto-tuning is available just after the start of operation or in the stare of stable control.

Example) Starting auto-tuning

Key operation	Description	Display
SEL	Press the SEL key to display P.	P
SEL	Press the SEL key repeatedly until AT is displayed.	AT
DATA	Press the DATA key once. Current data of 0 is displayed.	0
∧ ∨	Press the ∧ or ∨ key to display 1.	1
ENT	After pressing the ENT key, auto-tuning is started automatically.	
SV	Press the SV key when you need to display the operation status display.	1195
(In auto-tuning)	Decimal point in 1st digit blinks. (In case of the type of 2-stage display, decimal point in the 1st digit of the lower stage blinks.)	1195
(Auto-tuning ends)	When auto-tuning is finished, decimal point is the 1st digit stops blinking.	1195 Blinking disappears.

Related parameter: P (Page 6)
I (Page 7)
D (Page 8)
CooL (Page 17)
Ar (Page 21)

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Cooling side proportional cycle of control output 2 (DUAL type only) (Setting range: 1 to 150 sec.)

[Description]

- This setting is required only for DUAL type.
- When contact output or SSR drive output type is used, the output turns ON/OFF at a constant cycle when the input is within the proportional band.

  This cycle is called the proportional cycle.

  The output value is expressed by the ratio of which the output turns ON within the time of proportional cycle.

  As the time of proportional cycle becomes short, control can be made more accurately, but it reduces the life of operation terminal unit, so it needs to be set in consideration of the life of operation terminal unit.
- In the case of current output, this parameter is not displayed.


The following shows the standard proportional cycles.

SSR, SSC :

Proportional cycle, 1 to 2 sec.

Contact output :

Proportional cycle, 20 to 30 sec.

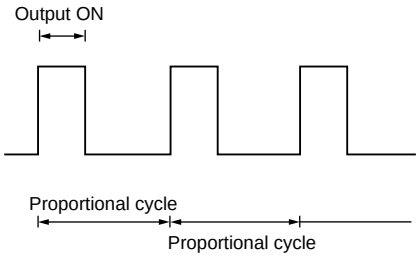

Example) Altering cooling control proportional cycle of 30 seconds to 20 seconds

Key operation	Description	Display
SEL	Press the SEL key to display P.	P
SEL	Press the SEL key repeatedly until 7C2 is displayed.	7C2
SEL	Press the DATA key once. Current data (30 seconds) is displayed.	30
∧ ∨	Press the ∧ or ∨ key to display 20.	20
ENT	After pressing the ENT key, the proportional cycle value of the control output 2 is registered. Operation is started with 20 seconds of cycle.	
SV	Press the SV key when you need to display the operation status display.	1195

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

C o o L Cooling side proportional band coefficient (DUAL type only) (Setting range: 0, 0.1 to 100.0)

[Description]

- Cooling side proportional band coefficient can be set automatically by auto-tuning.
- Cooling side proportional band can be set (see diagram (a) below).
- To set cooling side proportional band, its coefficient should be obtained to optimum control from the following equation after setting heating side proportional band.
  - · Heating side proportional band is $\frac{\text{Proportional band (P)}}{2}$.
  - · Set the coefficient to 0, and the cooling side is put in ON-OFF action.


Cooling side proporitona band = $\frac{\text{Proportional band (P)}}{2} \times$ Coefficient

Example) Set cooling side proportional band to 10% of full scale by proportional band (P) = 50%.

$$10\% = \frac{50\%}{2} \times \text{Coefficient}$$

Therefore, Coefficient = 0.4


(a)

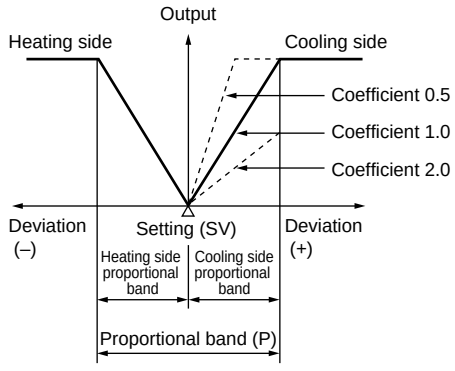

Related parameter: P (Page 6)

Example) Altering cooling control proportional band coefficient of 5.0 to 5.5

Key operation	Description	Display
SEL	Press the SEL key to display P.	P
SEL	Press the SEL key repeatedly until C o o L is displayed.	C o o L
DATA	Press the DATA key once. Current data (5.0 coefficient) is displayed.	5.0
∧ ∨	Press the ∧ or ∨ key to display 5.5.	5.5
ENT	After pressing the ENT key, the cooling side proportional band coefficient is registered. Operation will be started with 5.5 coefficient.	
SV	Press the SV key when you need to display the operation status display.	1195



Shift of cooling side proportional band (dead band/overlap band) (DUAL type only) (Setting range: -50.0 to +50.0%)

[Description]

- Cooling side proportional band can be shifted for set value (SV) (see diagram (a) below).
- When the value of db is positive, it is called the dead band, and when the value is negative, it is called the overlap band.
- The value of db is set in MV (%). When it is set in deviation (%), it can be converted from the following equation and set.


$$\text{DB (\%)} = \text{Deviation} \times \frac{100}{\text{P}} \text{ (\%)}$$

Example) When proportional band (P) = 5.0% and dead band for SV is set at deviation 1.0 (%), the following equation is used for setting this parameter to 20%.






$$\text{DB (\%)} = 1.0 \times \frac{100}{5.0} = 20 \text{ (\%)}$$

Related parameter: P (Page 6)

(a)

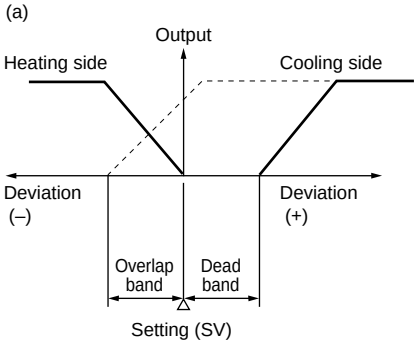

Example) Altering dead band/overlap band of 0% to 1.0% (dead band)

Key operation	Description	Display
SEL	Press the SEL key to display P.	
SEL	Press the SEL key repeatedly until db is displayed.	
DATA	Press the DATA key once. Current data (0%) is displayed.	
∧ ∨	Press the ∧ or ∨ key to display 1.0.	
ENT	After pressing the ENT key, the shift value of the cooling side proportional band is registered. Operation will be started with 1.0%.	
SV	Press the SV key when you need to display the operation status display.	

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

PLC1 Output 1 lower limit setting (Setting range: -3.0 to 103.0%)

PHC1 Output 1 upper limit setting (Setting range: -3.0 to 103.0%)

PLC2 Output 2 lower limit setting (Setting range: -3.0 to 103.0%)

PHC2 Output 2 upper limit setting (Setting range: -3.0 to 103.0%)

(No display prior to delivery)

[Description]

- These setting is not required unless necessary especially.
- These are used when the output is contact output or SSR/SSC drive output.
- Output pulse width (ON time) is set not to lower below the set value (PLC1, PLC2).

  Also, output pulse width (ON time) is set not to raise above the set value (PHC1, PHC2). (This determines the minimum value of output OFF time).
- This function prevents flashing when combustion is controlled by ON/OFF of gas supply.

$$PLC1 = \frac{100}{TC} \times (\text{Minimum ON pulse width [sec.]})$$

$$PHC1 = 100 - \frac{100}{TC} \times (\text{Minimum OFF pulse width [sec.]})$$

$$PLC2 = \frac{100}{TC2} \times (\text{Minimum ON pulse width [sec.]})$$

$$PHC2 = 100 - \frac{100}{TC2} \times (\text{Minimum OFF pulse width [sec.]})$$


TC : Proportional cycle

TC2 : Control output 2 proportional cycle

Related parameter: TC (Page 11)
TC2 (Page 16)

Example) Altering lower limit pulse width limiter from 20% to 10%

Key operation	Description	Display
SEL	Press the SEL key to display P.	P
SEL	Press the SEL key repeatedly until PLC1 is displayed.	PLC1
DATA	Press the DATA key once. Current lower limit pulse width limitter (20) is displayed.	20
∧ ∨	Press the ∧ or ∨ key to display 10.	10
ENT	After pressing the ENT key, the lower limit pulse width limiter is registered.	
SV	Press the SV key when you need to display the operation status display.	1195

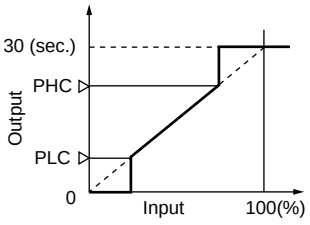


(TC = 30 sec.)

PCUT Setting of operation mode of output limiter (Setting range: 0 to 1.5)

[Description]

- This function is used to set the operation mode of the output (1 or 2) limiter.
- Normally, this parameter need not be changed.
- When the output value is set to the limit set value, it is possible to set whether the output is limited by that value or it is scaled out.

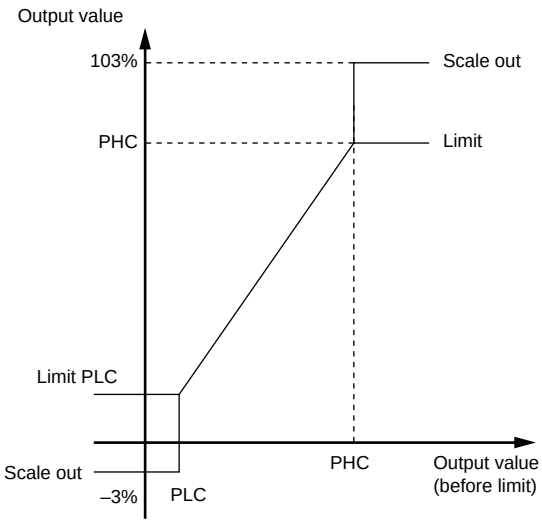


Example) Set the lower/upper limit of output 1 and output 2 to limit action

Key operation	Description	Display
SEL	Press the SEL key for 3 seconds, and P-n1 is displayed.	P-n1
SEL	Press the SEL key to display PCUT.	PCUT
DATA	Press the DATA key to display current data.	0
∧ ∨	Press the ∧ or ∨ key to display 15.	15
ENT	After pressing the ENT key, the data is registered.	
SV	Press the SV key when you need to display the operation status display.	1195

PCUT	Output 1		Output 2	
	Upper limit	Lower limit	Upper limit	Lower limit
0	103%	-3%	103%	-3%
1	103%	Limit	103%	-3%
2	Limit	-3%	103%	-3%
3	Limit	Limit	103%	-3%
4	103%	-3%	103%	Limit
5	103%	Limit	103%	Limit
6	Limit	-3%	103%	Limit
7	Limit	Limit	103%	Limit
8	103%	-3%	Limit	-3%
9	103%	Limit	Limit	-3%
10	Limit	-3%	Limit	-3%
11	Limit	Limit	Limit	-3%
12	103%	-3%	Limit	Limit
13	103%	Limit	Limit	Limit
14	Limit	-3%	Limit	Limit
15	Limit	Limit	Limit	Limit

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

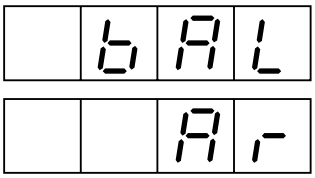

Output convergence value (Setting range: -100.0 to 100.0%)

Anti-reset wind up (Setting range: 0 to 100%FS) (No display prior to delivery)

[Description]






- This setting is not require unless it is necessary.


  This function is used to suppress over-shoot.
- Anti-reset wind up (Ar) is automatically set in optimum value by P.I.D auto-tuning.

  The value of over-shoot can be controlled by setting BAL.
- By setting anti-reset wind up (Ar) in optimum value, unwanted integral action can be cut and over-shoot is reduces.

(Note) This controller has fuzzy control function, so over-shoot can be minimized without using BAL and Ar. This parameter is used only for interchangeability with former type (PYZ series).

Example) Altering anti-reset wind up of 80°C to 60°C

Key operation	Description	Display
SEL	Press the SEL key to display P.	
SEL	Press the SEL key repeatedly until Ar is displayed.	
DATA	Press the DATA key once. Current data (80°C) of anti-reset wind up is displayed.	
∧ ∨	Press the ∧ or ∨ key to display 60.	
ENT	After pressing the ENT key, anti-reset wind up data is registred.	
SV	Press the SV key when you need to display the operation status display.	

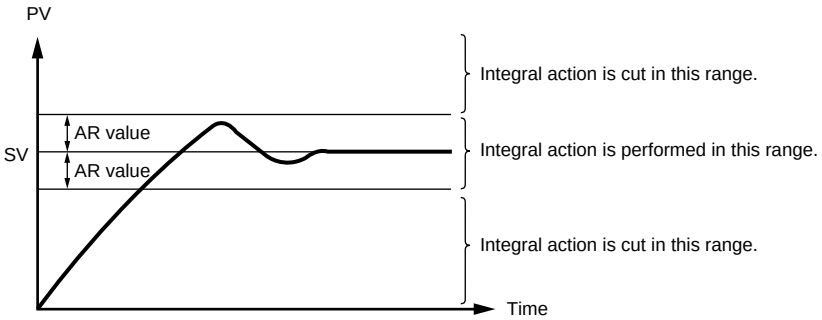

Key lock (Setting range: 0, 1, 2)

[Description]

- Key lock is a function not to change set data accidentally. Parameters SV and data can be displayed.
- When key lock is released again, change the setting to release the key to “0”.

(Note) Key lock comes in 2 types, one is used to prevent change of all setting (setting = 1) and another is used to prevent change of values other than SV (setting = 2).

Setting code 0: No lock

Setting code 1: Lock of all settings

Setting code 2: Lock of values other than SV

Example) Key lock to prevent accidental data change

Key operation	Description	Display
SEL	Press the SEL key to display P.	P
SEL	Press the SEL key repeatedly until Lock is displayed.	Lock
DATA	Press the DATA key once. Current data 0 is displayed.	0
∧ ∨	Press the ∧ or ∨ key to display 1.	1
ENT	After pressing the ENT key, key-locked data is registred. Operation will be started with lock of all settings.	
SV	Press the SV key when you need to display the operation status display.	1195

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

STAT Program status display (display only)


SV-1 ~ SV-4 No. 1 to 4 target value

TM1r ~ TM4r No. 1 to 4 ramp time

TM1S ~ TM4S No. 1 to 4 soak time

[Description]

- This is a function to change set value (SV) with time automatically according to preset pattern. Up to 4 ramp/soak data can be programmed.
- No. 1 ramp starts from measurement value (PV) just before the program is executed.
- It is also possible to run the program automatically at power ON (power ON start function).

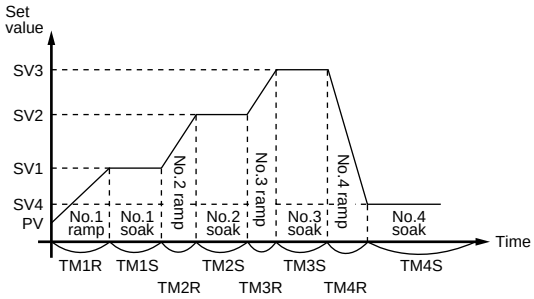

Ramp .... Time to change in set value toward target value.

Soak ..... Time not to change set value as it is set to target value.

Example) Set No. 1 target value to 400°C

Key operation	Description	Display
SEL	Press the SEL key to display P.	P
SEL	Press the SEL key repeatedly until SV-1 is displayed.	SV-1
DATA	Press the DATA key to display data.	0
∧ ∨	Press the ∧ or ∨ key to display 400°C.	400
ENT	After pressing the ENT key, the data is registered.	
SV	Press the SV key when you need to display the operation status display.	1195

[Parameters]

To execute this function, the program should be set in advance. It can be set by setting the required set value (SV) in the parameters shown in the table at right.


Related parameter: ProG (Page 24)

Parameter display symbol	Name		Description	Initial value at delivery	Remarks
STAT	STAT	Actual program position	The state of program execution is displayed. This parameter is used only for display and cannot be used for setting. oFF: Stop 1-rP ~ 4-rP: No.1 to 4 ramp under execution 1-SL ~ 4-SL: No.1 to 4 soak under execution End: Program end	—	Not displayed when ramp/soak is not given.
SV-1 ~ SV-4	SV-1 ~ SV-4	No.1 to 4 ramp target value	Target value (SV) of each ramp time can be set. (Setting range: 0 to 100%FS)	0	
TM1r ~ TM4r	TM1r ~ TM4r	No.1 to 4 ramp time	Each ramp time can be set. (Setting range: 0 to 99 hour and 59 minute)	0.00	
TM1S ~ TM4S	TM1s ~ TM4s	No.1 to 4 soak time		0.00	
Mod	Mod	Ramp SV mode	Used for selection of mode of ramp/soak function. Normally it is set to "0".	0	

Setting of ramp/soak control (ProG) (option)

[Description]

- This function is used to change time and set value (SV) automatically according to preset pattern. Up to 4 ramp/soak programs can be used.
- The No. 1 ramp starts from measurement value (PV) just before the execution of program.
- It is also possible to run the program automatically at power ON (power ON start function).

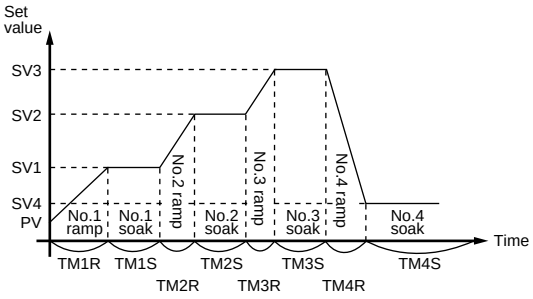

Ramp .... Range of change in set value toward target value

Soak ..... Range of unchanged set value, the same as target value

Related parameter: STAT (Page 23)
SV-1 ~ SV-4 (Page 23)
TM1r ~ TM4r (Page 23)
TM1s ~ TM4s (Page 23)

Example) Start ramp/soak operation (rUn) from local operation (oFF)

Key operation	Description	Display
SEL	Press the SEL key to display ProG.	ProG
DATA	Press the DATA key. Current data (oFF) is displayed.	oFF
∧ ∨	Press the ∧ or ∨ key to display rUn.	rUn
ENT	After pressing the ENT key, setting data of ramp/soak control is registered. Start operation according to preset ramp/soak patterns.	
SEL	Press the SEL key when you need to display the operation status display.	1191

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

P-n1 Setting of control mode

[Description]

- Used to set control mode, normal/ reverse action and the direction of burnout.
- Control mode is classified into the standard type (1 output) and the dual output type for heating/cooling control.
- The main body of standard type is different from that of dual output type. Be sure to set a code that conforms to the main unit.

Example) Altering lower burnout/reverse action to upper burnout/normal action

Key operation	Description	Display
SEL	Press the SEL key for 3 seconds, and P-n1 is displayed.	P-n1
DATA	Press the DATA key to display data.	0
∧ ∨	Press the ∧ or ∨ key to display 3.	3
ENT	After pressing the ENT key, upper burnout/normal action is registered.	
SV	Press the SV key when you need to display the operation status display.	1195

Control action code table

Code (P-n1)	Output type	Control action		Direction of burnout	
		Output 1	Output 2	Output 1	Output 2
0	Single	Reverse action	...	Lower limit	...
1				Upper limit	
2		Normal action		Lower limit	
3				Upper limit	
4	Dual	Reverse action	Normal action	Lower limit	Lower limit
5				Upper limit	
6				Lower limit	Upper limit
7				Upper limit	
8		Normal action		Lower limit	Lower limit
9				Upper limit	
10				Lower limit	Upper limit
11				Upper limit	
12		Reverse action	Reverse action	Lower limit	Lower limit
13				Upper limit	
14				Lower limit	Upper limit
15				Upper limit	
16		Normal action		Lower limit	Lower limit
17				Upper limit	
18				Lower limit	Upper limit
19				Upper limit	


Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com


P-dF Input filter constant (Setting range: 0.0 to 900.0 sec.)

[Description]

- Input filter function is used to reduce noise contained in input signal. Input filter constant is time constant.

  For example, the following response can be obtained by setting the input filter constant to 10 seconds.





- The set value is the time to read 63% (Y) on the controller for change in PV of 100% (X).

(Note) The unit is set to 5.0 (5 sec.) prior to delivery. Do not change it unless necessary.

Example) Altering filter constant 5.0 (5 seconds) to 10.0 (10 seconds)

Key operation	Description	Display
SEL	Press the SEL key for 3 seconds, and P-n1 is displayed.	P-n1
SEL	Press the SEL key repeatedly until P-dF is displayed.	P-dF
DATA	Press the DATA key. Current data is displayed.	5.0
∧ ∨	Press the ∧ or ∨ key to display 10.0.	10.0
ENT	After pressing the ENT key, the data is registered.	
SV	Press the SV key when you need to display the operation status display.	1195

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

P-n2 Setting of input type

[Description]

- Input type can be set.
- The main unit is determined according to input type (2 types shown below). Set a code that conforms with the main unit.
- Input type can be changed within the same types. It cannot be changed to different types.

Type I : Thermocouple (9 types), Resistance bulb (1 type)

Type II : Voltage, current

- On the Type II, when selecting voltage input or current input, it becomes necessary to change the code and connect an resistor 250Ω to the input terminal when current input is used.
- When changing the voltage input, remove the resistor 250Ω from the input terminal.

Change of software

After changing software, turn OFF the power and then turn ON once again.

- Input type and code

① Input type code table

Type	Code (P-n2)
Resistance bulb	
• Pt100	1
Thermocouple	
• J	2
• K	3
• R	4
• B	5
• S	6
• T	7
• E	8
• N	12
• PL-II	13
1 to 5V DC, 4 to 20mA DC	16

Example) Altering thermocouple from K to T on Type I

Key operation	Description	Display
SEL	Press the SEL key for 3 seconds, and P-n1 is displayed.	P-n1
SEL	Press the SEL key repeatedly until P-n2 is displayed.	P-n2
DATA	"3" is displayed, and it is clear thermocouple K is selected.	3
∧ ∨	Press the ∧ or ∨ key to display 7.	7
ENT	After pressing the ENT key, the data is registered.	
SEL	Press the SEL key for 3 seconds when you need to display the operation status display.	1195

Related parameter: P-SL (Page 29)
P-SU (Page 29)
P-dP (Page 33)

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com


P-An Alarm hysteresis width (option) (Setting range: 0 to 50%FS)

[Description]


- Alarm is 2-position action, ON and OFF, while hysteresis is the difference in input ON and OFF. For example, when hysteresis is 5°C, the width of ON and OFF is 5°C.

  Normally, it is set to 1°C
- Decimal point is given automatically by setting it with P-dP.


(Upper limit alarm)

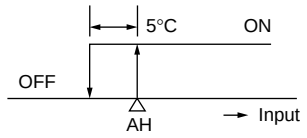

(Lower limit alarm)

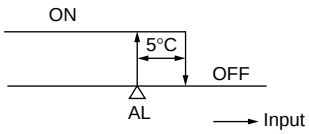

(Range alarm)

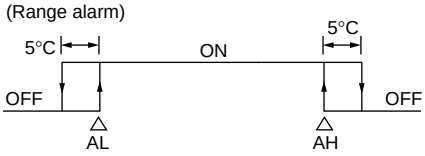

Related parameter: AL (Page 9)
AH (Page 10)
P-AH (Page 30)
P-AL (Page 30)

Example) Altering alarm hysteresis 1°C to 3°C

Key operation	Description	Display
SEL	Press the SEL key for 3 seconds, and P-n1 is displayed.	P-n1
SEL	Press the SEL key repeatedly until P-An is displayed.	P-An
DATA	Press the DATA key. Current data is displayed.	1
∧ ∨	Press the ∧ or ∨ key to display 3.	3
ENT	After pressing the ENT key, the data is registered.	
SV	Press the SV key when you need to display the operation status display.	1195

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

P-SL — Lower limit of measurement range and set value (SV) (Setting range: -1999 to 9999)

P-SU — Upper limit of measurement range and set value (SV) (Setting range: -1999 to 9999)

[Description]

- Lower limit (minimum range) and upper limit (maximum range) of measurement ranges can be set. This setting is used as a limiter of set value (SV). Change of set value (SV) to others outside of the lower/ upper limit range is not possible.
- When 1 digit below the decimal point needs to be displayed, it should be set to 1 by P-dP.
- When P-n2 is set to 0 to 13 (temperature input), up to 1 digit (P-dP parameter = 1) below the decimal point becomes effective.
- For the input range, refer to the following table.

Related parameter: P-dP (Page 33)

② Input range table (standard range)

		Measurement range (°C)	Measurement range (°F)	With decimal point (°C)	With decimal point (°F)
Resistance bulb JIS (IEC)	Pt100Ω	0 to 150	32 to 302	○	○
	Pt100Ω	0 to 300	32 to 572	○	○
	Pt100Ω	0 to 500	32 to 932	○	○
	Pt100Ω	0 to 600	32 to 1112	○	×
	Pt100Ω	-50 to 100	-58 to 212	○	○
	Pt100Ω	-100 to 200	-148 to 392	○	○
	Pt100Ω	-150 to 600	-238 to 1112	○	×
	Pt100Ω	-150 to 850	-238 to 1562	×	×
Thermocouple	J	0 to 400	32 to 752	○	○
	J	0 to 800	32 to 1472	○	×
	K	0 to 400	32 to 752	○	○
	K	0 to 800	32 to 1472	○	×
	K	0 to 1200	32 to 2192	×	×
	R	0 to 1600	32 to 2912	×	×
	B	0 to 1800	32 to 3272	×	×
	S	0 to 1600	32 to 2912	×	×
	T	-199 to 200	-328 to 392	○	×
	T	-150 to 400	-238 to 752	○	×
	E	0 to 800	32 to 1472	○	×
	E	-199 to 800	-328 to 1472	○	×
	PL-II	0 to 1300	32 to 2372	×	×
Direct current voltage	1 to 5V DC	-1999 to 1999 (Scaling possible)			

Example) Altering the measuring range of 0 ～ 150°C to -100 ～ 200°C (Pt100)

Key operation	Description	Display
SEL	Press the SEL key for 3 seconds, and P-n1 is displayed.	P-n1
SEL	Press the SEL key repeatedly until P-SL is displayed.	P-SL
DATA	Current measuring range is displayed.	0
∧ ∨	Press the ∧ or ∨ key to display -100.	-100
ENT	After pressing the ENT key, the data is registered.	P-SU
DATA	Press the DATA key. Current measuring range is displayed.	150
∧ ∨	Press the ∧ or ∨ key to display 200.	200
ENT	After pressing the ENT key, the data is registered.	
SV	Press the SV key when you need to display the operation status display.	195

* For 4 to 20mA DC input, connect external resistor 250Ω and use as 1 to 5V DC input.

Note) Input accuracy is ±0.5%FS±1digit with the exception of the following.
R thermocouple, 0 to 400°C : ±1%FS±1digit±1°C
B thermocouple, 0 to 500°C : ±5%FS±1digit±1°C
Other thermocouples : ±0.5%FS±1digit±1°C

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

P-AL Setting of lower limit alarm (ALM2) action type (option)


P-AH Setting of upper limit alarm (ALM1) action type (option)

[Description]

- Alarm action can be selected from 16 types. Of these types, deviation alarm, absolute value alarm, range alarm and hold (lower limit) are explained in the following. Alarm is specified by either one of deviation and absolute value.


Deviation alarm

When alarm is outputted at temperature of more than 100°C above 100°C of set value (SV) and more than 50°C below the set value, the setting of upper limit alarm (AH) is 100°C and that of lower limit alarm (AL) is 50°C. When the set value (SV) changes, the alarm action point is also changed.




Absolute value alarm

When alarm is outputted at temperature of more than 200°C and less than 50°C, the setting of upper limit alarm (AH) is 200°C and that of lower limit alarm (AL) is 50°C. Unlike the deviation alarm, the alarm action point remains unchanged at change of the set value.




Range alarm

In the case of range alarm, either one of absolute value and deviation can be selected. Alarm is outputted between AL and AH.



Lower limit hold

At the start of operation, the furnace temperature is normally below 100°C. In this case, lower limit alarm is not outputted. When temperature rises above the set value of AL and then lowers, lower limit alarm turns ON. This function is called the alarm action "Hold".



Related parameter: AL (Page 9)
AH (Page 10)
P-An (Page 28)

Alarm action type code table

	ALM1 (P-AH)	ALM2 (P-AL)	Alarm type	Action diagram
	0	0	Without alarm	
Absolute value alarm	1	1	Upper limit absolute	
	2	2	Lower limit absolute	
	3	3	Upper limit absolute (with hold)	
	4	4	Lower limit absolute (with hold)	
Deviation alarm	5	5	Upper limit deviation	
	6	6	Lower limit deviation	
	7	7	Upper/lower limit deviation	
	8	8	Upper limit deviation (with hold)	
	9	9	Lower limit deviation (with hold)	
	10	10	Upper/lower limit deviation (with hold)	
Range alarm	11	11	Range upper/lower limit deviation (ALM1/2 independent action)	
	—	12	Range upper/lower limit absolute	
	—	13	Range upper/lower limit deviation	
	—	14	Range upper limit absolute and lower limit deviation	
	—	15	Range upper limit deviation and lower limit absolute	

Note) Alarm set value may change with change in alarm action type.

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Example) Altering upper limit alarm (ALM1) action from upper limit deviation alarm to upper limit absolute value alarm

Key operation	Description	Display
SEL	Press the SEL key for 3 seconds, and P-n1 is displayed.	P-n1
SEL	Press the SEL key repeatedly until P-AH is displayed.	P-AH
DATA	Press the DATA key. Data is displayed. Display 5 due to deviation alarm. Check that 5 is displayed and change the alarm to absolute value alarm 1.	5
∧ ∨	Press the ∧ or ∨ key to display 1.	1
ENT	After pressing the ENT key, the data is registered.	
SV	Press the SV key when you need to display the operation status display.	1195

Upper limit alarm (ALM1) and lower limit alarm (ALM2) are the same key operation with the exception of range alarm action. Upper limit alarm (ALM1) can be used low-low limit alarm by setting is as lower limit alarm or lower limit alarm (ALM2) as upper-upper alarm by setting is as upper limit alarm.

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Setting of RCJ compensation

[Description]

- This function is used whether or not RCJ compensation (cold contact compensation) is used for thermo-couple input. Normally, it should be used at ON (RCJ compensation) which has been set prior to delivery from the factory.
- It should be set to OFF only when cold contact compensation is not required, for example, when cold contact compensation is to be made with external circuit or temperature deviation needs to be obtained.

Example) Altering cold junction compensation from ON to OFF


Key operation	Description	Display
SEL	Press the SEL key for 3 seconds, and P-n1 is displayed.	P-n1
SEL	Press the SEL key repeatedly until RCJ is displayed.	rCJ
DATA	Current data is displayed.	on
∧ ∨	Press the ∧ or ∨ key to display OFF.	oFF
ENT	After pressing the ENT key, the data is registered.	
SV	Press the SV key when you need to display the operation status display.	1195

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

P-dP Setting of decimal point position (Setting range: 0 to 2)

[Description]

- Decimal point position can be set on LED display.

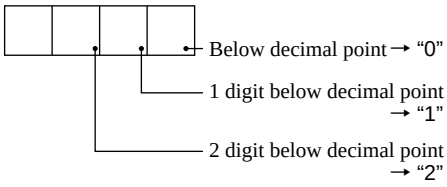

Related parameter: P-SL (Page 29)
P-SU (Page 29)

Example) Altering the measuring range 0～150°C to 0.0 ～150°C

Key operation	Description	Display
SEL	Press the SEL key for 3 seconds, and P-n1 is displayed.	P-n1
SEL	Press the SEL key repeatedly until P-dP is displayed.	P-dP
DATA	"0" is displayed and it is clear that none below decimal point is set.	0
∧ ∨	Press the ∧ or ∨ key to display 1.	1
ENT	After pressing the ENT key, the data is registered.	
SV	Press the SV key when you need to display the operation status display.	1195

PV offset (Setting range: -10 to 10%FS)

[Description]

- Set value is added to designated input value. It is mainly used when recorder needs to conform with the designated value.
- Control is performed by the displayed PV value (PV offset is added).

Example) Set the zero shift width of 5°C to input value 1200°C

Key operation	Description	Display
SEL	Press the SEL key for 3 seconds, and P-n1 is displayed.	P-n1
SEL	Press the SEL key repeatedly until PVOF is displayed.	PVOF
DATA	Press the DATA key. Data is displayed.	0
∧ ∨	Press the ∧ or ∨ key to display 5.	5
ENT	After pressing the ENT key, the data is registered.	
SV	Press the SV key when you need to display the operation status display.	1195

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com


SUOF SV offset (Setting range: -50 to 50%FS)

[Description]

- The value set in SV offset is added to original SV to perform control by SV value. It is mainly used to eliminate offset during P control. In this case, designated SV value remains unchanged.
- Control is performed by the display SV value (SV offset is added).

Example) Set the zero shift width of 9°C to current setting value.

Key operation	Description	Display
SEL	Press the SEL key for 3 seconds, and P-n1 is displayed.	P-n1
SEL	Press the SEL key repeatedly until SVOF is displayed.	SUOF
DATA	Press the DATA key. Data is displayed.	0
∧ ∨	Press the ∧ or ∨ key to display 9.	9
ENT	After pressing the ENT key, the data is registered.	
SV	Press the SV key when you need to display the operation status display.	1195



Selection of measurement input °C/°F

[Description]






- The unit (°C or °F) of temperature can be selected for temperature input. It has been set according to the ordering specifications prior to delivery from factory. If it becomes necessary to change it after purchase, the input range (P-SL, P-SU), alarm value (AL, AH), set value (SV) and offset (PVOF, SVOF) should be changed.
  The unit of temperature is shown on the front nameplate. It should also be changed at the same time.

  (Note 1)

  T_1 (°F) = $\frac{9}{5}$ T_2 (°C) + 32

Related parameter: SV (Page 5)
P-SL (Page 29)
P-SU (Page 29)
AL (Page 9)
AH (Page 10)

Example) Altering the unit of measurement input from °C to °F

Key operation	Description	Display
SEL	Press the SEL key for 3 seconds, and P-n1 is displayed.	
SEL	Press the SEL key repeatedly until P-F is displayed.	
DATA	Press the DATA key. Data is displayed.	
∧ ∨	Press the ∧ or ∨ key to display °F.	
ENT	After pressing the ENT key, the data is registered.	
SV	Press the SV key when you need to display the operation status display.	

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

FUZY control setting

[Description]

- This function is used to select or not to select FUZY control.
- FUZY control provides the following advantages.
  - · Quick start without causing overshoot
  - · Quick settlement in response to external disturbance.
- Use this function after setting P.I.D parameter to optimum value, using auto-tuning, etc.

Example) Set FUZY control to ON.

Key operation	Description	Display
SEL	Press the SEL key for 3 seconds, and P-n1 is displayed.	P-n1
SEL	Press the SEL key repeatedly until FUZY is displayed.	FUZY
DATA	Press the DATA key. Current data is displayed.	oFF
∧ ∨	Press the ∧ or ∨ key to display ON.	on
ENT	After pressing the ENT key, the data is registered.	
SV	Press the SV key when you need to display the operation status display.	1195

AdJ0 User's adjust zero adjustment (Setting range: -50 to 50%FS)

AdJ5 User's adjust span adjustment (Setting range: -50 to 50%FS)

[Description]

- This function is used to calibrate input by user.
- Using zero input or span input, error is set in the input range.
- User calibration function is independent of adjustment of the controller. By setting 0 in this parameter, it can easily be set back to the state prior to delivery from the factory.
- It is used to set the same reading between controllers or between controller and recorder.

Example)

When the input range is 0 to 400°C, the reading at 0°C input is -1°C and that at 400°C is 402°C.


In this case, when ADJO parameter is set to 1 and ADJS to -2, the reading at 0°C input becomes 0°C and that at 400°C input becomes 400°C.

When both ADJO and ADJS are set to 0, the controller is set in the calibrated state prior to delivery from the factory.

Example) Set zero adjustment to +1°C

Key operation	Description	Display
SEL	Press the SEL key for 3 seconds, and P-n1 is displayed.	P-n1
SEL	Press the SEL key repeatedly until ADJO is displayed.	AdJ0
DATA	Press the DATA key. Current data is displayed.	0
∧ ∨	Press the ∧ or ∨ key to display 1.	1
ENT	After pressing the ENT key, the data is registered.	
SV	Press the SV key when you need to display the operation status display.	1195

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

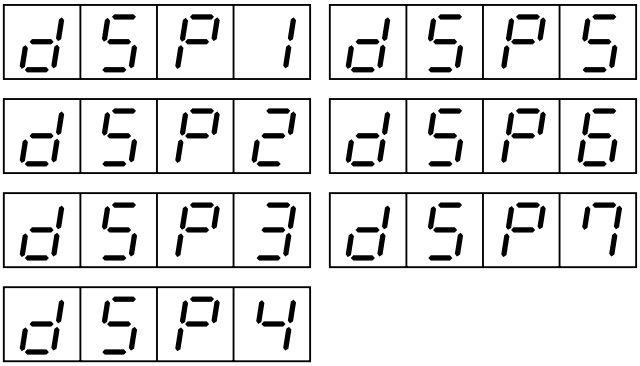

Skipping of parameter display

[Description]

- This parameter is used to skip parameter display for each item.
- This function can be used to prevent unused items from being displayed or set values from being changed by mistake.
- Correspondence of the setting of dSP1 to 7 and skipped items in shown below.
- It is possible to set the total code of items to be skipped.

Example) Skip I and D

Set 4 + 8 = 12 according to dSP1 code table.

Key operation	Description	Display
SEL	Press the SEL key for 3 seconds, and P-n1 is displayed.	P-n1
SEL	Press the SEL key repeatedly until dSP1 is displayed.	dSP1
DATA	Press the DATA key. Current data is displayed.	0
∧ ∨	Press the ∧ or ∨ key to display 12.	12
ENT	After pressing the ENT key, the data is registered.	
SV	Press the SV key when you need to display the operation status display.	1195

	Parameter	DSP allocation
No.1 block	PRoG	dSP1-1
	P	dSP1-2
	I	dSP1-4
	D	dSP1-8
	AL	dSP1-16
	AH	dSP1-32
	TC	dSP1-64
	HYS	dSP1-128
	Hb	dSP2-1
	AT	dSP2-2
	TC2	dSP2-4
	CooL	dSP2-8
	db	dSP2-16
	PLC1	dSP2-32
	PHC1	dSP2-64
	PCUT	dSP2-128
	bAL	dSP3-1
	Ar	dSP3-2
	LoC	dSP3-4
	STAT	dSP3-8
	SV-1	dSP3-16
	TM1r	dSP3-32
	TM1S	dSP3-64
	SV-2	dSP3-128
	TM2r	dSP4-1
	TM2S	dSP4-2
	SV-3	dSP4-4
	TM3r	dSP4-8
	TM3S	dSP4-16
	SV-4	dSP4-32
	TM4r	dSP4-64
	TM4S	dSP4-128
	MoD	dSP5-1

No.2 block	P-n1	dSP5-4
	P-n2	dSP5-8
	P-dF	dSP5-16
	P-SL	dSP5-32
	P-SU	dSP5-64
	P-AL	dSP5-128
	P-AH	dSP6-1
	P-An	dSP6-2
	P-dP	dSP6-4
	RCJ	dSP6-8
	PVOF	dSP6-16
	SVOF	dSP6-32
	P-F	dSP6-64
	PLC2	dSP6-128
	PHC2	dSP7-1
	FUZY	dSP7-2
	GAIN	dSP7-4
	ADJO	dSP7-8
	ADJS	dSP7-16
	OUT	dSP7-32
	dSP1	···
	dSP2	···
	dSP3	···
	dSP4	···
	dSP5	···
	dSP6	···
	dSP7	···

(Note 1) Registered function operates normally even when the display is skipped.

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

3 Troubleshooting

When trouble arises with the unit, check and remove the cause referring to the following table of troubleshooting.

Trouble	Cause	Remedy
Data are not displayed.	(1) Power is not supplied. (2) Unit is not connected to connector. (3) Instrument is in trouble.	(1) Check powre source. (2) Connect unit firmly to connector. (3) Replace instrument or contact your dealer for advice.
PV display is LLLL or LLLL.	(1) Measured value is very high or low. (2) Input is not connected. (3) Sensor is damaged.	(1) Check temperature of controlled object. (2) Connect input terminal. (3) Replace sensor or contact your dealer for advice.
Data are not changed at press of key.	(1) Unit is set in the position where parameter cannot be changed. (2) Unit is set over data setting range.	(1) Check set value of paremater LoC (Page 22). (2) Check set values of parameter P-SL (Page29) and P-SU (Page 29)
HB lamp ON	(1) Lamp is ON at detection of heater burnout.	(1) Remove the cause of heater burnout.
Control output is not ON when output lamp (C1, C2) is ON.	(1) Output is disconnected. (2) Instrument is in trouble.	(1) Check connection of output terminal. (2) Replace instrument or contact your dealer for advice.
Hunting of PV	(1) Input filter time constant is small. (2) Hysteresis is very large for 2-position action. (3) Control output proportional cycle is very large. (4) Improper adjustment of PID	(1) Check set value of parameter P-dF (Page 26). (2) Check set value of parameter HYS (Page 12). (3) Check set value of parameter TC (Page 11), and TC2 (Page 16) control otuput 2. (4) Perform auto-tuning (Page 15).
Auto-tuning is not finished.	(1) Wrong wiring (2) Wrong setting of normal/reverse action of controller (3) Time constant of measured object is very long.	(1) Check wiring between control object and controller. (2) Check set value of parameter P-n1 (Page 25). (3) It takes time for time constant. Wait until it is set.

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Artisan Technology Group is an independent supplier of quality pre-owned equipment

Gold-standard solutions

Extend the life of your critical industrial, commercial, and military systems with our superior service and support.

We buy equipment

Planning to upgrade your current equipment? Have surplus equipment taking up shelf space? We'll give it a new home.

Learn more!

Visit us at **artisantg.com** for more info on price quotes, drivers, technical specifications, manuals, and documentation.

Artisan Scientific Corporation dba Artisan Technology Group is not an affiliate, representative, or authorized distributor for any manufacturer listed herein.

We're here to make your life easier. How can we help you today?

(217) 352-9330 | sales@artisantg.com | artisantg.com

ARTISAN® TECHNOLOGY GROUP