

ARTISAN®
TECHNOLOGY GROUP

Your **definitive** source for quality pre-owned equipment.

Artisan Technology Group
(217) 352-9330 | sales@artisantg.com | artisantg.com

Full-service, independent repair center
with experienced engineers and technicians on staff.

We buy your excess, underutilized, and idle equipment
along with credit for buybacks and trade-ins.

Custom engineering
so your equipment works exactly as you specify.

- Critical and expedited services
- In stock / Ready-to-ship
- Leasing / Rentals / Demos
- ITAR-certified secure asset solutions

Expert team | Trust guarantee | 100% satisfaction

All trademarks, brand names, and brands appearing herein are the property of their respective owners.

Visit our website - *Click HERE*

SmartLine

Honeywell

Technical Information

STR800 SmartLine Remote Diaphragm Seals Specification 34-ST-03-88, February 2025



Introduction

Part of the SmartLine® family of products, the STR800 is a series of high performance pressure transmitters hydraulically matched and optimized with a complete set of remote diaphragm seals. Utilizing the same high performance sensor technology of the ST 800 product line Honeywell has optimized the mechanical and hydraulic designs in order to minimize the typical effects of temperature on remote seal systems.
The SmartLine family is also fully tested and compliant with Experion® PKS providing the highest level of compatibility assurance and integration capabilities. SmartLine easily meets the most demanding application needs for pressure measurement applications.



Figure 1 – STR800 Remote Diaphragm Seal Unit

Best in Class Features:

- Accuracies of up to 0.0375% of span.
- Automatic static pressure & temperature compensation.
- Rangeability up to 100:1.
- Multiple local display capabilities.
- External zero, span, & configuration capability.
- Polarity insensitive electrical connections.
- Comprehensive on-board diagnostic capabilities.
- Integral Dual Seal design for highest safety based on ANSI/NFPA 70-202 and ANSI/ISA 12.27.0.
- World class overpressure protection.
- Full compliance to SIL 2/3 requirements.
- Modular design characteristics.
- Supports NAMUR NE-107 Extended Diagnostics (FF).
- Available with an additional 15-year warranty.

Typical Diaphragm Seal applications

- High Process Temperatures.
- Viscous or Suspended Solids.
- Highly Corrosive Process Materials.
- Sanitary Applications.
- Applications with Hydrogen Permeation Possibilities.
- Level Applications with Maintenance Intensive Wet Legs.
- Applications requiring remote Transmitter Mounting.
- Tank Applications with Density or Interface Measurements.

Communications/Output Options:

- Honeywell Digitally Enhanced (DE)
- HART ® (version 7.0)
- FOUNDATION™ Fieldbus

All transmitters are available with the above listed communications protocols.

Span & Range Limits:

Model	URL inH_2O (mbar)	LRL inH_2O (mbar)	Min Span inH_2O (mbar)
STR82D	400 (1000)	-400 (-1000)	4.0 (10)
Model	**psi (bar)**	**psi (bar)**	**psi (bar)**
STR83D	100 (7.0)	-100 (-7.0)	1 (0.07)
STR84G	500 (35.0)	-14.7 (-1.0)	5 (0.35)
STR87G	3000 (210)	-14.7 (-1.0)	30 (2.1)
Model	**psia (bara)**	**psia (bara)**	**psia (bara)**
STR84A	500 (35)	0 (0)	5 (0.35)

Description

The SmartLine family of gauge pressure, differential pressure, and absolute pressure transmitters is designed around a high performance piezo-resistive sensor. This one sensor actually integrates multiple sensors linking process pressure measurement with on-board static pressure (DP Models) and temperature compensation measurements resulting in the best total performance available. This level of performance allows the ST 800 to replace virtually any competitive transmitter available today.

Unique Indication/Display Options

The ST 800 modular design accommodates a standard alphanumeric LCD display or a unique advanced graphics LCD display with many unparalleled features.

Standard LCD Display Features

- Modular (may be added or removed in the field).
- Supports HART protocol variant.
- 0, 90,180, & 270 degree position adjustments.
- Four configurable screens.
- Standard and custom measurement units available.
- Display calculated flow (square root) value in addition to analog output signal.
- 2 Lines 6 digits PV (9.95H x 4.20W mm) 8 Characters.
- Write protect Indication.
- Built-in Basic Device Configuration through Internal or External Buttons – Range/Engineering Unit/Loop Test /Loop Calibration/Zero /Span Setting.
- Multiple language capabilities (EN, RU).

Advanced Graphics LCD Display Features

- Modular (may be added or removed in the field).
- 0, 90, 180, & 270 degree position adjustments.
- Standard and custom measurement units available.
- Up to eight display screens with 3 formats are possible.
- Large PV with Bar Graph or PV with Trend Graph.
- Configurable screen rotation timing (1 to 30 sec).
- Display calculated flow (square root) value in addition to analog output signal.
- Unique “Health Watch” indication provides instant visibility of diagnostics.
- Multiple language capability (EN, DE, FR, IT, ES, RU, TR, CN, & JP).

Diagnostics

SmartLine transmitters all offer digitally accessible diagnostics which aid in providing advanced warning of possible failure events minimizing unplanned shutdowns, providing lower overall operational costs.

Configuration Tools

Integral Three Button Configuration Option

Suitable for all electrical and environmental requirements, SmartLine offer the ability to configure the transmitter and display via three externally accessible buttons when either display option is selected. Zero/span capabilities are also optionally available via these buttons with or without selection of a display option.

Handheld Configuration

SmartLine transmitters feature two-way communication and configuration capability between the operator and the transmitter. All Honeywell transmitters are designed and tested for compliance with the offered communication protocols and are designed to operate with any standards compliant handheld configuration device, such as Honeywell Versatilis Configurator.

Personal Computer Configuration

On a personal computer or laptop, Honeywell Field Device Manager (FDM) Software and FDM Express can be used for managing HART & Fieldbus device configurations.

System Integration

- SmartLine communications protocols all meet the most current published standards for HART/DE/Fieldbus.
- Integration with Honeywell’s Experion PKS offers the following unique advantages.
  - Transmitter messaging.
  - Maintenance mode indication.
  - Tamper reporting.
  - FDM Plant Area Views with Health summaries.
  - All ST 800 units are Experion tested to provide the highest level of compatibility assurance.

Modular Design

To help contain maintenance & inventory costs, all STR800 transmitters are modular in design supporting the user’s ability to replace or add indicators, terminal connections or electronic modules without affecting overall performance or approval body certifications

Modular Features

- Exchange/replace electronics/comms modules*
- Add or remove integral indicators*
- Add or remove lightning protection (terminal connection)*

* Field replaceable in all electrical environments (including IS) except flameproof without violating agency approvals.

With no performance effects, Honeywell’s unique modularity results in ***lower inventory needs and lower overall operating costs.***

Performance Specifications

Reference Accuracy (conformance to +/-3 Sigma)

Table 1

Model	URL	LRL	Min Span	Maximum Turndown Ratio	Reference Accuracy[1,2] (% Span)
STR82D	400 in H_2O (1000 mbar)	-400 in H_2O (-1000 mbar)	4 in H_2O (10 mbar)	100:1	0.0375
STR83D	100 psid (7.0 bar)	-100 psi (-7.0 bar)	1 in psi (0.07 bar)		
STR84G	500 psi (35 bar)	-14.7 (-1.0 bar)	5 psi (0.35 bar)		
STR87G	3000 psi (210 bar)	-14.7 psi (-1.0 bar)	30 psi (2.1 bar)		
STR84A	500 psia (35 bar)	0 psia (0 bar)	5 psia (0.35 bara)		

Zero and span may be set anywhere within the listed (URL/LRL) range limits.

Accuracy at Specified Span, Temperature and Static Pressure: (conformance to +/-3 Sigma)

Table 2

			Accuracy[1,2] (% of Span)				Combined Zero & Span Temperature Effect[3] (% Span/28°C (50°F))		
	Model	URL	Reference Turndown	A	B	C (see URL units)	D	E	F (see URL units)
Standard Accuracy	STR82D	400 in H2O (1000mbar)	8:1	0.005	0.0325	50 (125)	0.175	1.000	200 (500)
	STR83D	100 psid (7.0 bar)	3.33:1			30 (2.1)	0.025	0.280	30 (2.1)
	STR84G	500 psi (35 bar)	25:1			20 (1.4)			
	STR87G	3000 psi (210 bar)	10:1			300 (21)			
	STR84A	500 psia (35 bara)	25:1			20 (1.4)			
			Turn Down Effect				**Temp Effect**		
			$\pm[A+B] \quad if\ Span \geq C$ $\pm\left[A+B\left(\frac{C}{Span}\right)\right] \quad if\ Span < C$				$\pm[D+E\left(\frac{F}{Span}\right)]$		

Total Performance (% of Span):

Total Performance = $\pm\sqrt{(Accuracy)^2 + (Temp\ Effect)^2}$

Total Performance Examples: (standard accuracy, 5:1 Turndown, up to 50°F shift)

STR82D @ 80 inH_2O: 2.68% of span **STR83D @ 20 psid:** 0.45% of span

Typical Calibration Frequency:

Calibration verification is recommended every four (4) years.

Notes:

1. Terminal based Accuracy – Incudes combined effects of linearity, hysteresis and repeatability. Analog output adds 0.005% of span.
2. For zero based spans and reference conditions of 25°C (77°F). 0 psi static pressure for DP, >= 0 psia for GP, 10 to 55% R.H, and 316 Stainless Steel barrier diaphragms.
3. Specification applies to transmitter with 2 balanced remote seals. Apply a 1.5 factor for temperature effect for capillary lengths greater than 10 feet.

Operating Conditions – All Models

Parameter	Reference Condition (at zero static)		Rated Condition		Operative Limits		Transportation and Storage	
	°C	°F	°C	°F	°C	°F	°C	°F
Ambient Temperature[1]	25±1	77±2	-	-	-	-	-55 to 90	-67 to 194
Humidity %RH	10 to 55		0 to 100		0 to 100		0 to 100	
Vac Region - Min Pressure mmHg absolute	Atmospheric (See Figure 4 for vacuum limitation)							
Supply Voltage, Current, and Load Resistance	HART: 10.8 to 42.4 VDC at terminals (IS versions limited to 30 VDC) 0 to 1,440 ohms DE: 15 to 49.3VDC at terminals (IS versions limited to 30VDC), 0 to 1,200 ohms (as shown in Figure 2). FOUNDATION Fieldbus: 9.0 to 32.0 VDC at terminals, steady state current: 17.6mA, software download current: 27.4mA							
Maximum Allowable Working Pressure (MAWP)[2] (ST 800 products are rated to Maximum Allowable Working Pressure. MAWP depends on Approval Agency and transmitter materials of construction.)	MAWP is minimum of Body Rating or Seal Rating (See Model Selection Guide for Seal **Body** **MAWP** STR82D 2,500 psig (172 bar) Bolted Process Heads STR83D 2,500 psig (172 bar) Bolted Process Heads STR82D 1,450 psig (100 bar) All Welded Process STR83D 1,450 psig (100 bar) All Welded Process STR84G 500 psig (35 bar) STR87G 3,000 psig (210 bar) STR84A 500 psia (35 bara)							

[1] Ambient Temperature Limit is a function of Process Interface Temperature and fill fluid. (See Figure 3 and Figure 4)
LCD Display operating temperature -20°C to +70°C . Storage temperature -30°C to 80°C.

[2] Consult factory for MAWP of ST 800 transmitters with CRN approval.

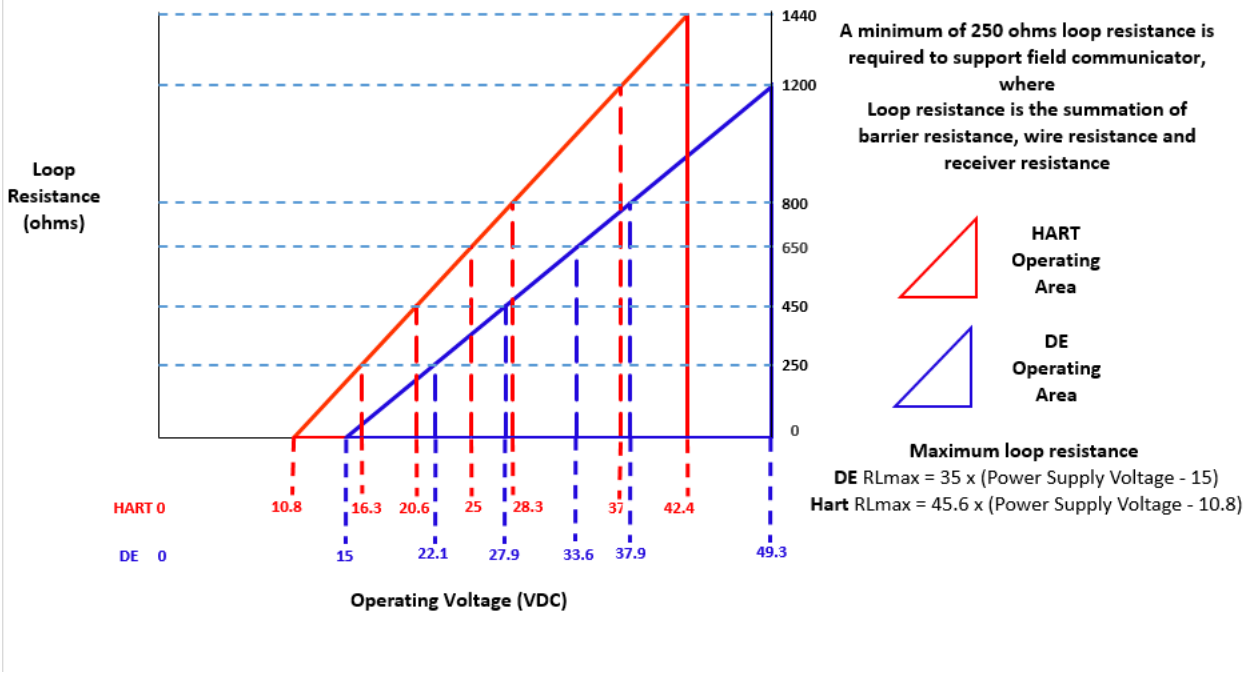


Figure 2 - Supply voltage and loop resistance

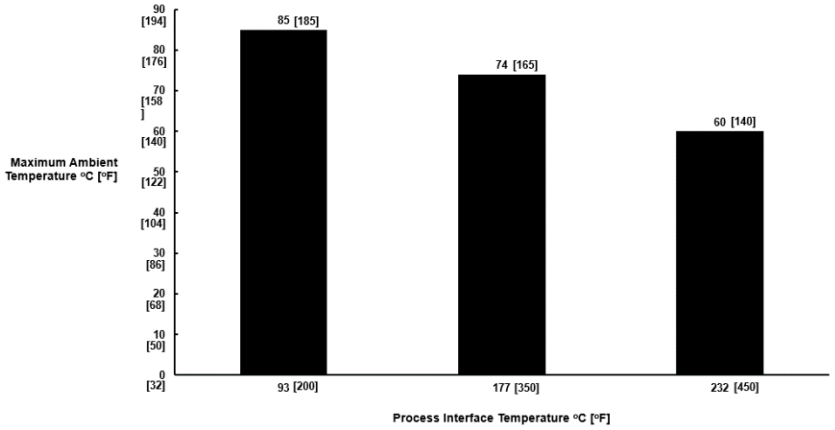


Figure 3 - Ambient temperature limits

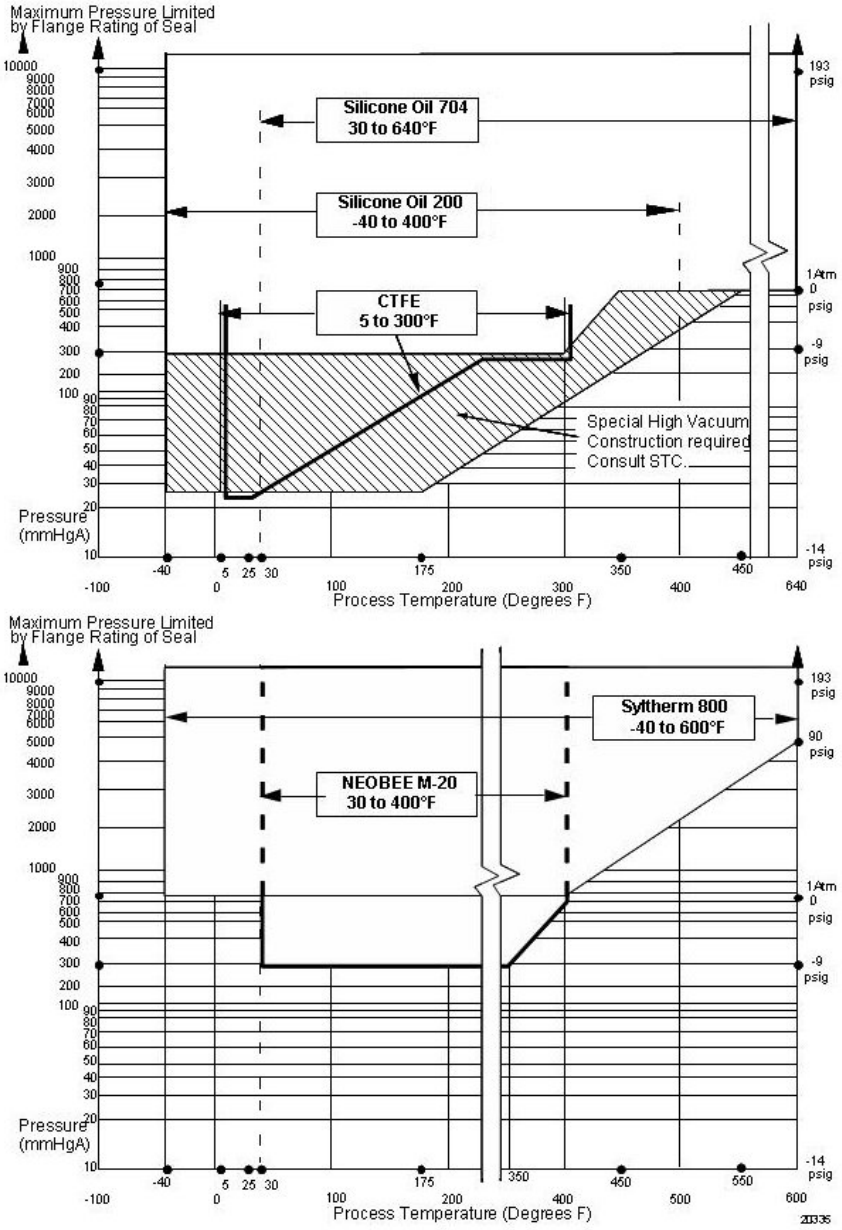


Figure 4 - STR800 Remote Seals operable limits for pressure vs. temperature

Performance Under Rated Conditions – All Models

Parameter	Description
Analog Output **Digital Communications**	Two-wire, 4 to 20 mA (HART & DE Transmitters only) Honeywell DE, HART 7 protocol or FOUNDATION Fieldbus ITK 6.0.1 compliant All transmitters, irrespective of protocol have polarity insensitive connection
HART & DE Output Failure Modes (NAMUR for DE Units requires selecting display and configuration buttons or factory configuration)	**Honeywell Standard** / **NAMUR NE 43 Compliance** **Normal Limits:** 3.8 – 20.8 mA / 3.8 – 20.5 mA **Failure Mode:** ≤ 3.6 mA and ≥ 21.0 mA / ≤ 3.6 mA and ≥ 21.0 mA
Supply Voltage Effect	0.005% span per volt
Transmitter Turn on Time (includes power up & test algorithms)	HART or DE: 2.5 seconds Foundation Fieldbus: host dependent
Damping Time Constant	**HART:** Adjustable from 0 to 32 seconds in 0.1 increments. **Default:** 0.50 seconds **DE:** Discrete values 0, .16, .32, .48, 1, 2, 4, 8, 16, 32 seconds. **Default:** 0.48 seconds
Electromagnetic Compatibility	IEC 61326-3-1
Lightning Protection Option	**Leakage Current:** 10uA max @ 42.4VDC 93C **Impulse rating:** 8/20us 5000A (>10 strikes) 10000A (1 strike min.) 10/1000us 200A (> 300 strikes)

Materials Specifications (see Model Selection Guide for availability/restrictions with various models)

Parameter	Description
Process Interface	See Model Selection Guide for Material Options for desired seal type
Seal Barrier Diaphragm	316L Stainless Steel, Monel®, Hastelloy® C, Tantalum
Seal Gasket Materials	Viton, Graphite, Teflon®
Mounting Bracket	Carbon Steel (Zinc-Chromate plated) or 304 Stainless Steel or 316 Stainless Steel
Fill Fluid (Meter Body)	Silicone 200 S.G. @ 25°C = 0.94 CTFE (Chlorotrifluoroethylene) S.G. @ 25°C = 1.89 Silicone 704 S.G. @ 25°C = 1.07 NEOBEE M-20® S.G. @ 25°C = 0.93
Fill Fluid (Secondary)	Silicone Oil 200 S.G. @ 25°C = 0.94 CTFE (Chlorotrifluoroethylene) S.G. @ 25°C = 1.89 Silicone Oil 704 S.G. @ 25°C = 1.07 Syltherm 800® S.G. @ 25°C = 0.90 NEOBEE M-20® S.G. @ 25°C = 0.93
Electronic Housing	Pure Polyester Powder Coated Low Copper (<0.4%) – Aluminum. Meets Type 4X / IP66 / IP67. Dual certified SS316/316L housing is optional. Cover O ring material: Silicone.
Capillary Tubing	**Material:** Armored Stainless Steel or PVC Coated Armored Stainless Steel **Length:** 5, 10, 15, 20, 25, and 35 feet (1.5, 3, 4.6, 6.1, 7.5, and 10.7 meters) A 2-inch (51 millimeter) S.S. close-coupled nipple is also available. See Model Selection Guide Note: The minimum span is the higher of the higher of the value from the table above or the value defined under the Performance Conditions for the range transmitter for guide to maximum capillary length vs. diaphragm diameter
Wiring	Accepts up to 16 AWG (1.5 mm diameter)
Mounting	See Figure 6, Figure 7, and Figure 8.
Dimensions	**Transmitter:** See Figure 7 and Figure 8. **Seal:** See Figure 9 through **Error! Reference source not found.**

Parameter	Description
Net Weight	**Transmitter:** 8.3 pounds (3.8 Kg). With Aluminum Housing. Total weight is dependent on seal

NOTE: Pressure transmitters that are part of safety equipment for the protection of piping (systems) or vessel(s) from exceeding allowable pressure limits, (equipment with safety functions in accordance with Pressure Equipment Directive 97/23/EC article 1, 2.1.3), require separate examination.

Minimum recommended span for STR82D and STR83D Transmitter with two Remote Seals

Diaphragm Size (Inches)	Capillary Length (Feet)						Maximum Capillary Length (Feet)
	5	10	15	20	25	35	
2.4	7.2 psi						5
2.9	3.6 psi	4.5 psi	5.4 psi	6.3 psi			20
3.5	0.6 psi	0.7 psi	0.9 psi	1.0 psi	1.2 psi	1.4 psi	35
4.1	0.4 psi	0.5 psi	0.6 psi	0.8 psi	0.9 psi	1.1 psi	35


Minimum recommended span for STR82D and STR83D Transmitter with one Remote Seal

Diaphragm Size (Inches)	Direct Mount	Capillary Length (Feet)						Maximum Capillary Length (Feet)
		5	10	15	20	25	35	
2.4	20 psi	30 psi						5
2.9	10 psi	15 psi	20 psi	25 psi	30 psi			20
3.5	1.8 psi	2.9 psi	3.6 psi	4.3 psi	5.0 psi	5.8 psi	7.2 psi	35
4.1	1.4 psi	2.2 psi	2.9 psi	3.6 psi	4.3 psi	5.0 psi	5.8 psi	35

Minimum recommended span for STR84G, STR84A and STR87G Transmitter

Diaphragm Size (Inches)	Direct Mount	Capillary Length (Feet)						Maximum Capillary Length (Feet)
		5	10	15	20	25	35	
1.9	25 psi	30 psi	40 psi	50 psi				15
2.4	10 psi	15 psi	20 psi	25 psi	30 psi	35 psi	50 psi	35
2.9	8 psi	9 psi	10 psi	11 psi	12 psi	13 psi	15 psi	35
3.5	5 psi	5 psi	5 psi	5 psi	5 psi	6 psi	8 psi	35
4.1	5 psi	5 psi	5 psi	5 psi	5 psi	6 psi	8 psi	35

Note: The minimum span is the higher of the higher of the value from the table above or the value defined under the Performance Conditions for the range transmitter

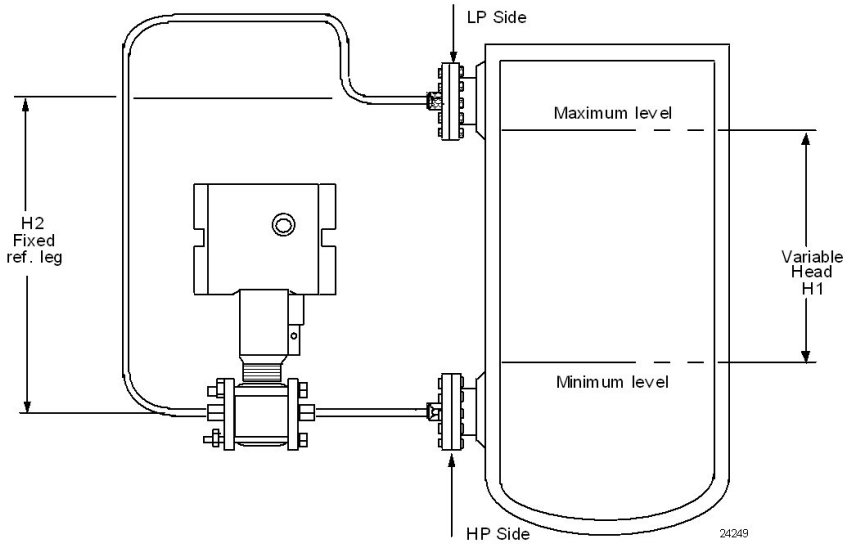

NOTE: Lower flange seal should not be mounted over 22 feet below or above the transmitter for silicone fill fluid (11 feet for CTFE fill fluid) with tank at one atmosphere. The combination of tank vacuum and high pressure capillary head effect should not exceed 9 psi vacuum (300 mmHg absolute).

Figure 5 - Typical Maximum capillary length and diaphragm size chart

Reference Dimensions Horizontal Mounting


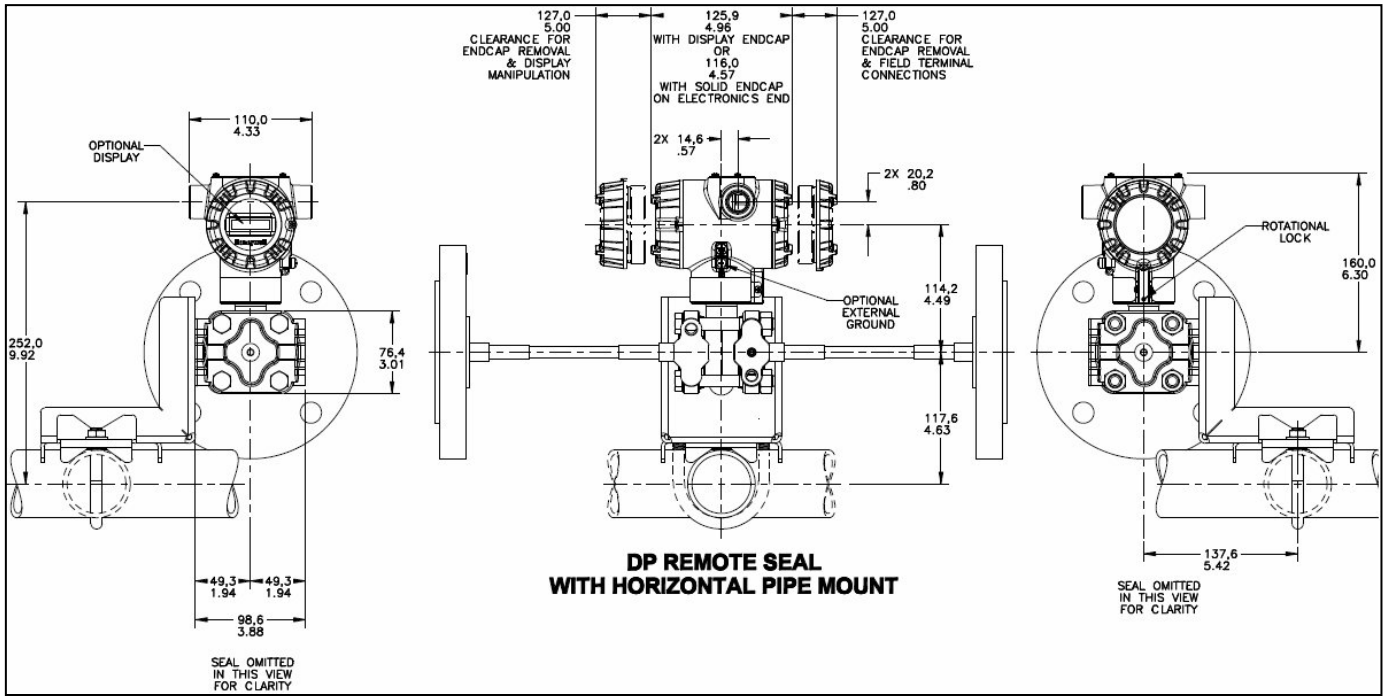


Figure 6 - STR800 transmitter with remote diaphragm seals shown mounted on a tank

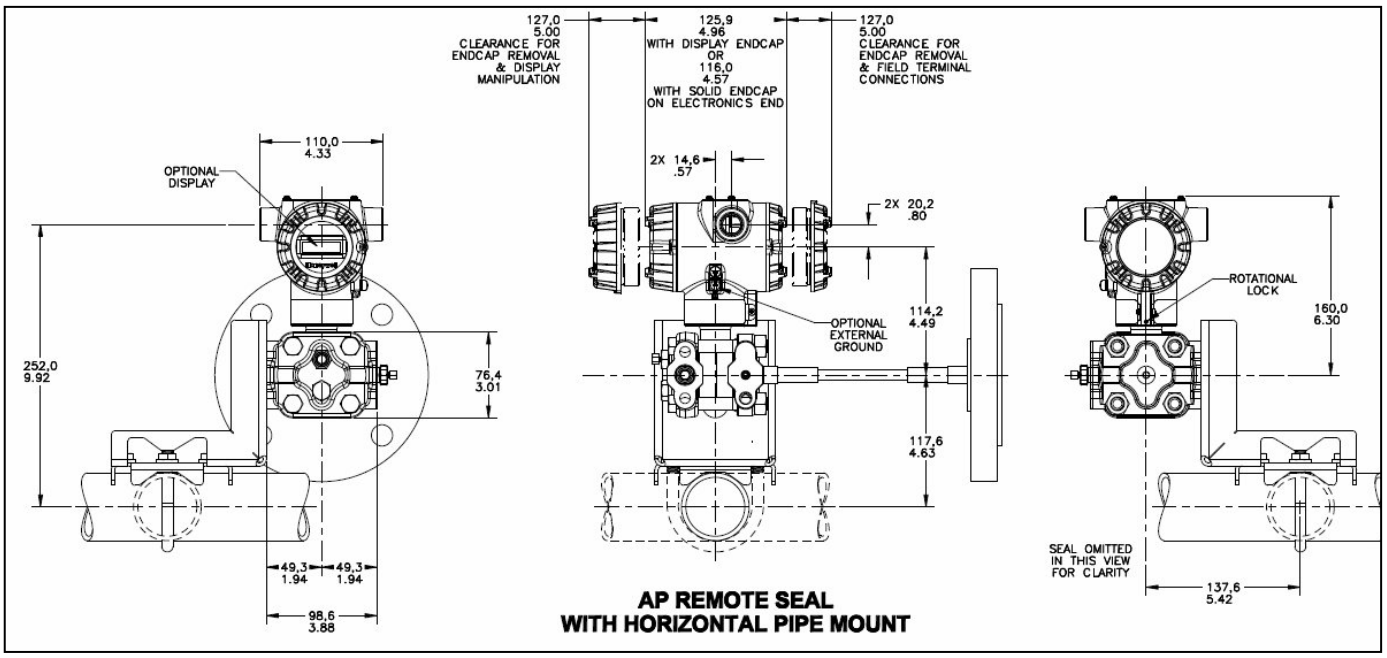

Reference Dimensions Horizontal Mounting (cont'd)


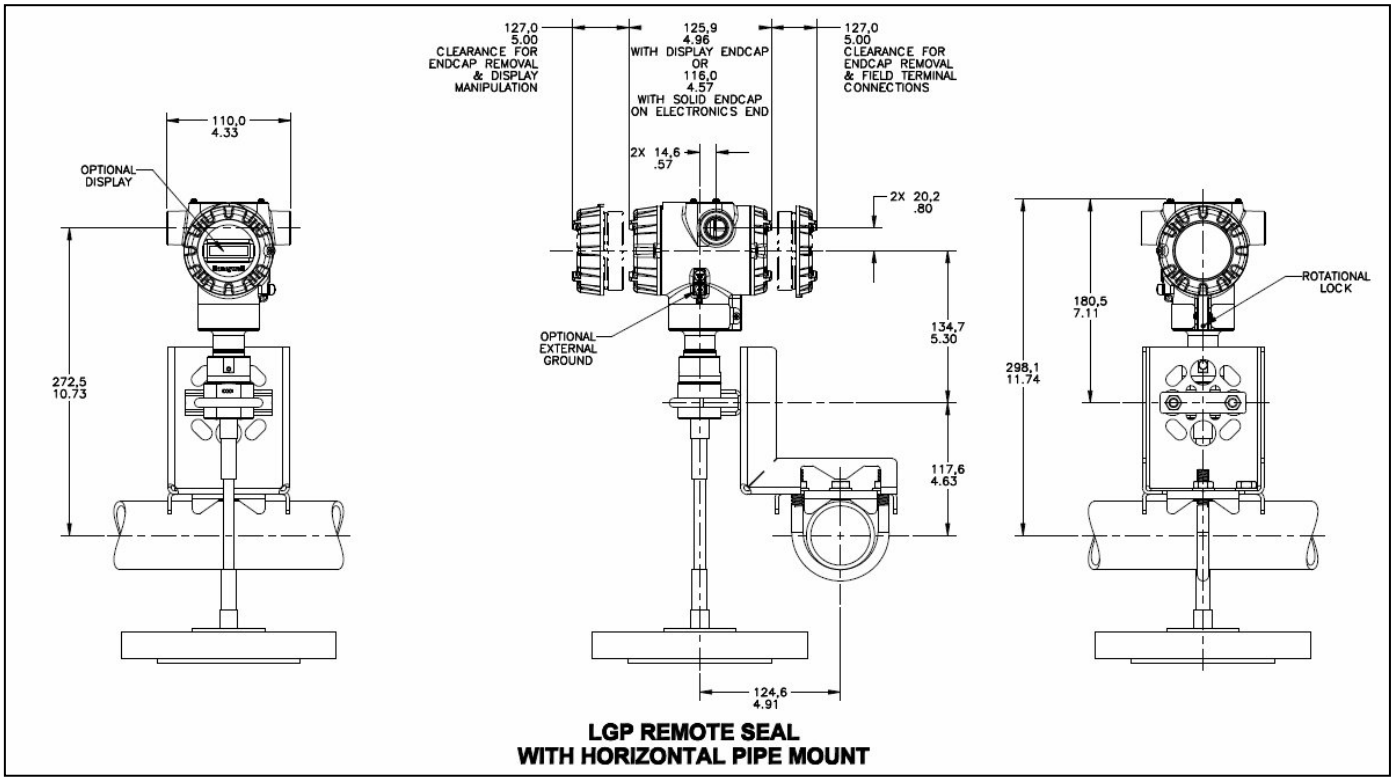


Figure 7 - Approximate horizontal mounting dimensions for Remote Seal Transmitter

Reference Dimensions Vertical Mounting

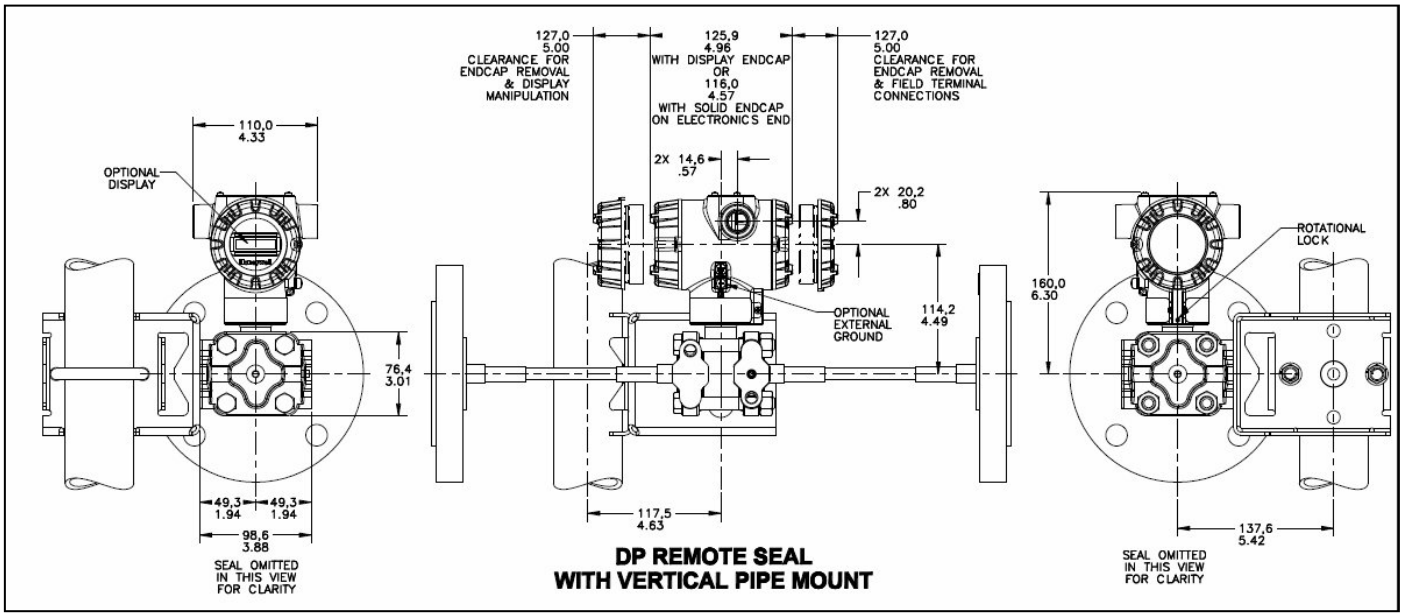

Reference Dimensions Vertical Mounting (cont'd)


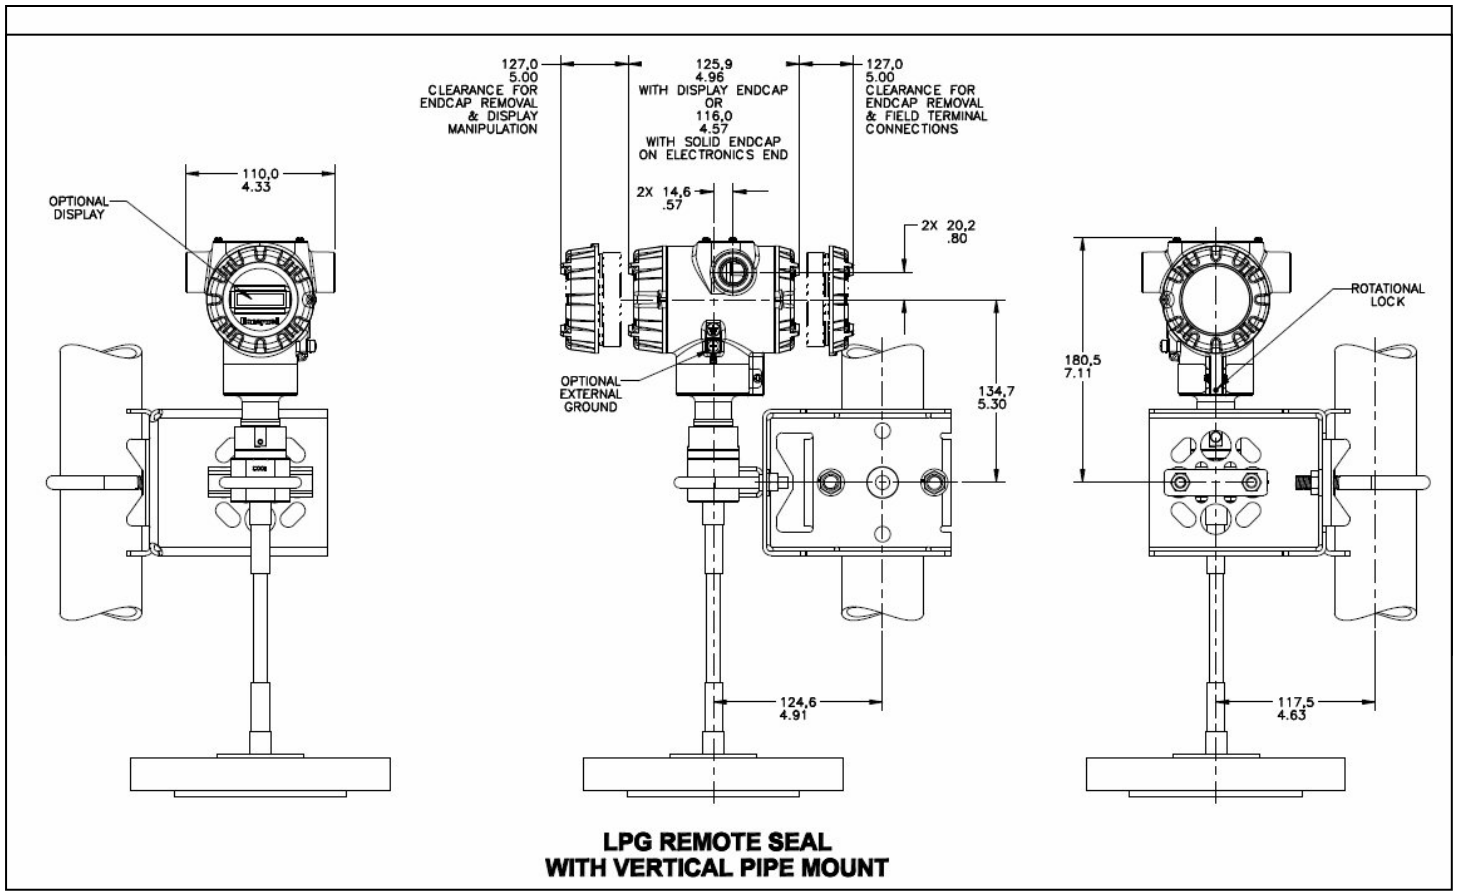


Figure 8 - Approximate vertical mounting dimensions for Remote Seal Transmitter

Reference Dimensions (cont'd)


Flush Flanged Seal Dimensions

Type	ANSI/DIN Rating	Flange Material	Wetted Materials		Construction See figure	↔	↕
			Diaphragm	Body		A	B
Flush Flanged Seal	3" Class 150#	CS	SS Hastelloy C Hastelloy C Monel Tantalum	SS SS Hastelloy C Monel SS	D C D D C	7.5	2.06
		SS	SS Hastelloy C Hastelloy C Monel Tantalum	N/A SS Hastelloy C Monel SS	B A D D C	7.50	0.94 2.06
	3" Class 300#	CS	SS Hastelloy C Hastelloy C Monel Tantalum	SS SS Hastelloy C Monel SS	D C D D C	8.25	2.25
		SS	SS Hastelloy C Hastelloy C Monel Tantalum	N/A SS Hastelloy C Monel SS	B A D D C	8.25	1.12 2.25
	3" Class 600#	CS	SS Hastelloy C Hastelloy C Monel Tantalum	SS SS Hastelloy C Monel SS	D C D D C	8.25	2.25
		SS	SS Hastelloy C Hastelloy C Monel Tantalum	N/A SS Hastelloy C Monel SS	B A D D C	8.25	1.5 2.25
	DN80-PN40	CS	SS Hastelloy C Hastelloy C Monel Tantalum	SS SS Hastelloy C Monel SS	D C D D C	7.87	1.95
		SS	SS Hastelloy C Hastelloy C Monel Tantalum	N/A SS Hastelloy C Monel SS	B A D D C	7.87	0.94 1.95

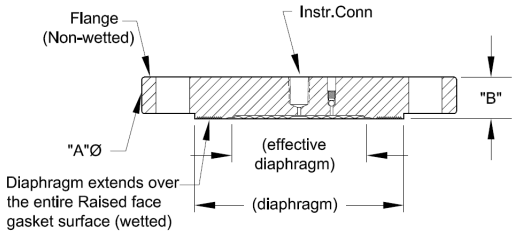


Configuration "HS"

Figure A

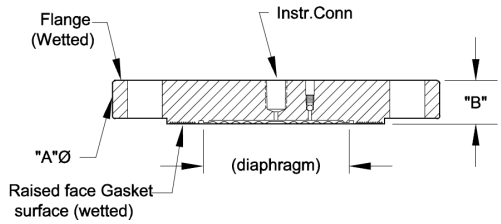


Configuration "HT"

Figure B

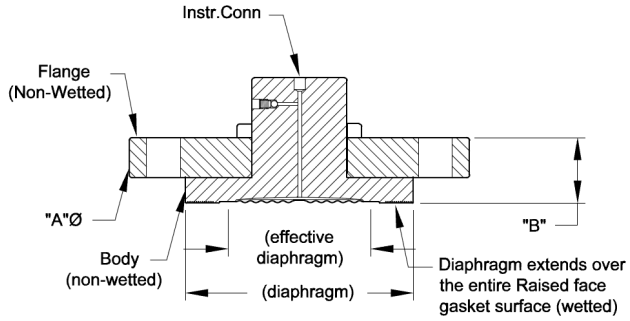

Configuration "IS"

Figure C

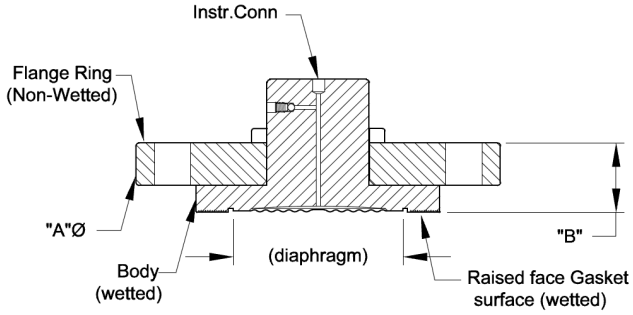

Configuration "IT"

Figure D


Figure 9 - Seal Dimensions (Flush Flanged)

Reference Dimensions (cont'd)


Flush Flanged Seal with Lower

Type	ANSI/DIN Rating	Size	Dimension	2.4" Diaphragm (52 mm effective)	2.9" Diaphragm (64 mm effective)	4.1" Diaphragm (35 mm effective)
Flush Flanged Seal with Lower	Class 150#	½"	A	3.74	N/A	5.91
			B0	1.55		2.21
			B1	1.55		2.21
			B2	1.70		2.21
		1"	A	4.33		5.91
			B0	1.33		2.05
			B1	1.33		2.05
			B2	1.48		2.05
		1-1/2"	A	5.00	4.92	5.91
			B0	1.33	2.33	1.97
			B1	1.33	2.33	1.97
			B2	1.48	2.83	1.97
		2"	A	N/A	6.00	5.91
			B0		2.36	1.89
			B1		2.36	1.89
			B2		2.86	1.89
		3"	A		N/A	7.50
			B0			2.55
			B1			2.55
			B2			3.05
	Class 300#	½"	A	3.74	N/A	5.91
			B0	1.55		2.21
			B1	1.55		2.21
			B2	1.70		2.21
		1"	A	4.92	N/A	5.91
			B0	1.33		2.05
			B1	1.33		2.05
			B2	1.48		2.05
		1-1/2"	A	6.12	6.10	6.10
			B0	1.48	2.45	2.21
			B1	1.48	2.45	2.21
			B2	1.63	2.95	2.21
		2"	A	N/A	N/A	6.50
			B0			2.49
			B1			2.49
			B2			2.99
		3"	A			8.25
			B0			2.74
			B1			2.74
			B2			3.24
	Class 600#	½"	A	3.74	N/A	5.91
			B0	1.71		2.36
			B1	1.71		2.35
			B2	1.87		2.35
		1"	A	4.88	N/A	5.91
			B0	2.36		2.26
			B1	2.36		2.26
			B2	2.86		2.26
		1-1/2"	A	6.12	6.12	6.10
			B0	1.33	2.55	2.21
			B1	1.33	2.55	2.21
			B2	1.48	3.05	2.21
		2"	A	N/A	N/A	6.50
			B0			2.68
			B1			2.68
			B2			3.18
		3"	A			8.25
			B0			2.93
			B1			2.93
			B2			3.43

B0 Without Flush
B1 B Dimension with1/4 NPT Flushing Connection
B2 B Dimension with 1/2 NPT Flushing Connection

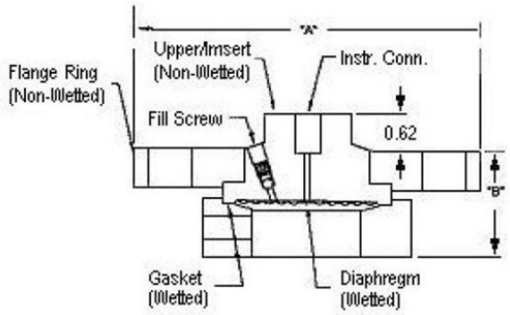

Flush Flanged Seal with Lower

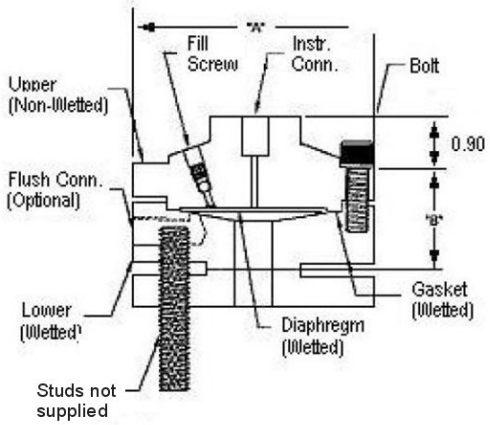

Flush Flanged Seal with Lower

Note: 0.90 dimension is 0.70 for 4.1" Dia Diaphragm

Figure 10 - Seal Dimension (Flush Flanged)

Reference Dimensions (cont'd)

Flanged Seal with Extended Diaphragm

Type	ANSI/DIN Rating	Dimension	2.8" Diaphragm Dia. (in.)	3.5" Diaphragm Dia. (in.)
Flanged Seal with Extended Diaphragm	3" Class 150#	A	7.50	-
		B	0.94	-
		C	2.80	-
	3" Class 300#	A	8.25	-
		B	1.12	-
		C	2.80	-
	DIN DN80-PN40	A	7.87	-
		B	0.94	-
		C	2.80	-
	4" Class 150#	A	-	9.00
		B	-	0.94
		C	-	3.70
	4" Class 300#	A	-	10.00
		B	-	1.25
		C	-	3.70
	DIN DN100-PN40	A	-	9.25
		B	-	0.94
		C	-	3.70

Designed to meet with schedule 40 pipe

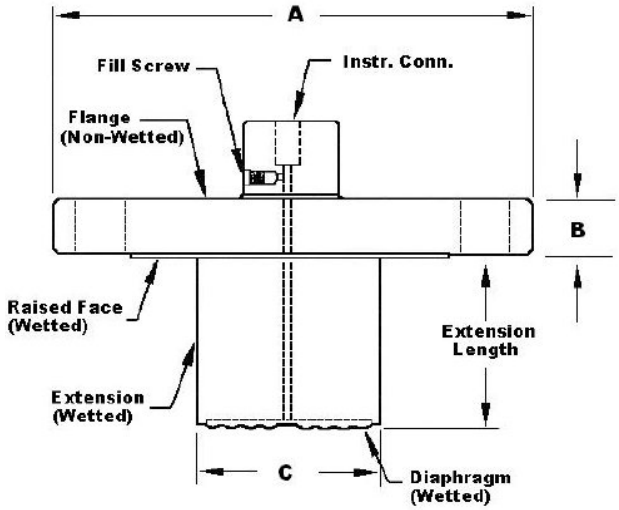


Figure 11 - Seal Dimensions (Extended Diaphragms)

Pancake Seal

Type	ANSI/DIN	Dimension	3.5" Diaph. (in.)
Pancake Seal	Class 150#, 300#, 600# DN80-PN40	A	5.00
		B	1.08

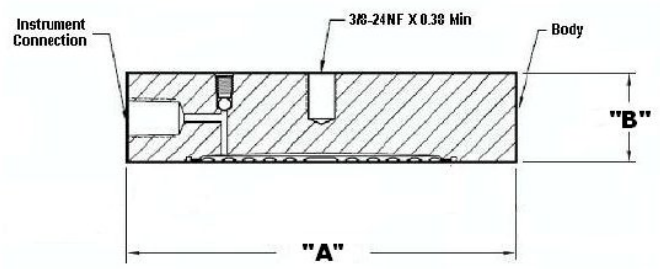


Figure 12 - Seal Dimensions (Pancake)

Chemical Tee "Taylor Wedge" Seal

Type	Size	Dimension	3.5" Diaph. (in.)
Chemical Tee "Taylor Wedge" Seal	750 psi	A	5.00
		B	0.50

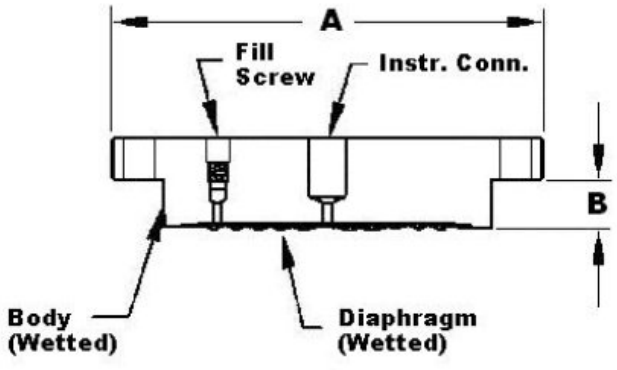


Figure 13 - Seal Dimensions (Chemical TEE "Taylor Wedge" Seals

Seal with Threaded Process Connection

Type	Size	Dimensions	2.4" Diaphragm (52 mm effective)	4.1" Diaphragm (35 mm effective)
Threaded Process Conn. Seal	1/4" and 1/2"	A B0 B1 B2	3.74 2.20 2.20 3.50	5.90 2.50 2.50 2.75
	3/4" and 1"	A B0 B1 B2	3.74 2.40 2.40 3.70	5.90 2.80 2.80 3.05

B0 Without Flush
B1 B Dimension with ¼ NPT Flushing Connection
B2 B Dimension with ½ NPT Flushing Connection

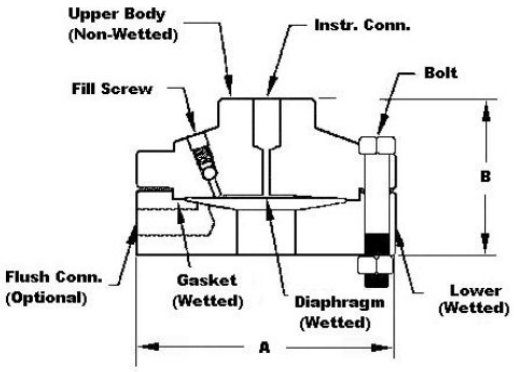


Figure 14 - Seal Dimensions (Threaded Process Connection Seals)

Sanitary Seal

Type	Size	Dimension	1.9" Diaphragm Dia. (in.)	2.4" Diaphragm Dia. (in.)	2.9" Diaphragm Dia. (in.)	4.1" Diaphragm Dia. (in.)
Sanitery Seal	2"	A	2.50	-	-	-
		B	1.42	-	-	-
	2- 1/2"	A	-	3.00	-	-
		B	-	1.28	-	-
	3"	A	-	-	3.57	-
		B	-	-	1.38	-
	4"	A	-	-	-	4.68
		B	-	-	-	1.60

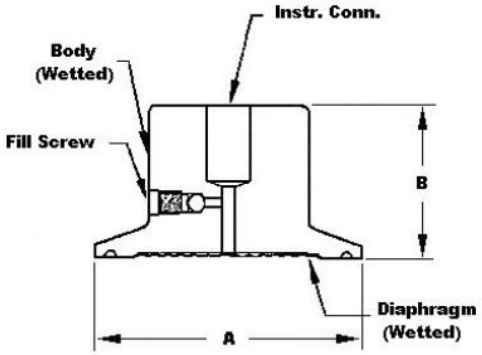


Figure 15- Seal Dimensions (Sanitary Seals)

Saddle Seal

Type	Size	Dimensions	2.4" Diaphragm (52 mm effective)
Saddle Seal	3"	A B	3.50 1.90
	4" or larger	A B	3.50 1.90

Note: Specify 6 or 8 bolt pattern

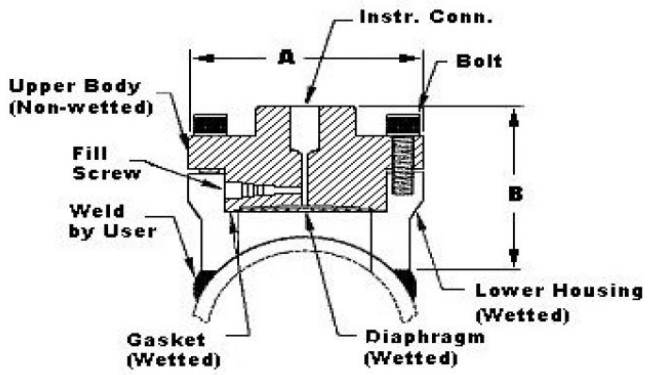


Figure 16 - Seal Dimensions (3" Saddle Seal)

Calibration Ring

Type	Size	Rating	Dimension	1/4 NPT	1/2 NPT
Calibration Ring	3"	150# / 600#	A B C	5.00 1.00 3.00	5.00 1.50 3.00

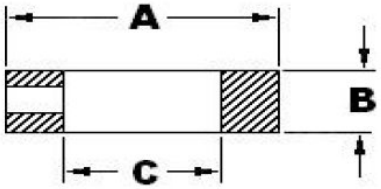


Figure 17 - Calibration Ring

Communications Protocols & Diagnostics

HART Protocol

Version: HART 7

Foundation Fieldbus (FF)

Available Function Blocks

Block Type	Qty	Execution Time
Resource	1	n/a
Transducer	1	n/a
Diagnostic	1	n/a
Analog Input	1*	30 ms
PID w/Autotune	1	45 ms
Integrator	1	30 ms
Signal Char (SC)	1	30 ms
LCD Display	1	n/a
Flow Block	1	30 ms
Input Selector	1	30 ms
Arithmetic	1	30 ms

* AI block may have two (2) additional instantiations.

All available function blocks adhere to FOUNDATION Fieldbus standards. PID blocks support ideal & robust PID algorithms with full implementation of Auto-tuning.

Link Active Scheduler

Transmitters can perform as a backup Link Active Scheduler and take over when the host is disconnected. Acting as a LAS, the device ensures scheduled data transfers typically used for the regular, cyclic transfer of control loop data between devices on the Fieldbus.

Number of Devices/Segment

Entity IS model: 6 devices/segment

Schedule Entries

18 maximum schedule entries

Number of VCR's: 24 max

Compliance Testing: Tested according to ITK 6.0.1

Software Download

Utilizes Class-3 of the Common Software Download procedure as per FF-883 which allows the field devices of any manufacturer to receive software upgrades from any host.

Honeywell Digitally Enhanced (DE)

DE is a Honeywell proprietary protocol which provides digital communications between Honeywell DE enabled field devices and Hosts.

Standard Diagnostics

ST 800 top level diagnostics are reported as either critical or non-critical and are readable via the DD/DTM/FDI tools or integral display. All critical diagnostics will appear on the Advanced and Standard integral displays, and some non-critical diagnostics will also appear on the Advanced integral display. Some of the diagnostics are listed below.

Critical Diagnostics

- Electronics Module Fault.
- Meter body Memory Corruption.
- Config Data Corruption.
- Electronics Module Diagnostics Failure.
- Meter body Critical Failure.
- Sensor Communication Timeout.

Non-Critical Diagnostics

- Electronics Module Fault.
- Display Failure.
- Electronics Module Comm Failure.
- Meter body Excess Correct.
- Sensor Over Temperature.
- Fixed Current Mode.
- PV Out of Range.
- No DAC Compensation.
- Tamper Attempt Alarm.

Refer to the product user manual for comprehensive list of diagnostics and details.

Other Certification Options

Materials

- NACE MRO175, MRO103, ISO15156

Hazardous Areal Certification

MSG CODE	AGENCY	TYPE OF PROTECTION	COMM. OPTION	ELECTRICAL PARAMETERS	AMBIENT TEMP (Ta)
A	FM Approvals™ USA	**Explosionproof:** Class I, Division 1, Groups A, B, C, D; Dust Ignition Proof: Class II, III, Division 1, Groups E, F, G; T6..T5 Class I, Zone 0/1, AEx db IIC T6..T5 Ga/Gb Class II, Zone 21, AEx tb IIIC T95° Db	All	Note 1	T5: -50 ºC to 85ºC T6: -50 ºC to 65ºC
		Intrinsically Safe: Class I, II, III, Division 1, Groups A, B, C, D, E, F, G: T4 Class I, Zone 0, AEx ia IIC T4 Ga FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	4-20 mA / DE/ HART	Note 2a	-50 ºC to 70ºC
			Foundation Fieldbus	Note 2b	-50 ºC to 70ºC
		Nonincendive: Class I, Division 2, Groups A, B, C, D locations, T4 Class I, Zone 2, AEx nA IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50 ºC to 85ºC
		Enclosure: Type 4X/ IP66/ IP67	All	All	-
		STANDARDS: FM Class 3600:2011; FM Class 3610: 2010; FM Class 3611: 2004; FM Class 3615: 2006; FM Class 3616: 2011; FM Class 3810: 2005; ANSI/ISA 60079-0: 2013; ANSI/UL 60079-1: 2015; ANSI/UL 60079-11: 2014; ANSI/ISA 60079-15: 2012; ANSI/UL 60079-26: 2017; ANSI/UL 60079-31: 2015; ANSI/NEMA 250: 2003; ANSI/ IEC 60529: 2004			
B	Canadian Standards Association (CSA) USA and Canada	**Explosion Proof:** Class I, Division 1, Groups A, B, C, D; Class II, Division 1, Groups E, F, G; Class III, Division 1, T6..T5 Class I Zone 1 AEx db IIC T6..T5 Ga/Gb Ex db IIC T6..T5 Ga/Gb Zone 22 AEx tb IIIC T95° Db Ex tb IIIC T95° Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: Class I, II, III, Division 1, Groups A, B, C, D; Class II, Division 1, Groups E, F, G; Class III, Division 1, T4 Class I Zone 0, AEx ia IIC T4 Ga Class I Zone 2, AEx ic IIC T4 Gc Ex ia IIC T4 Ga Ex ic IIC T4 Gc FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		Nonincendive: Class I, Division 2, Groups A, B, C, D; Class II, Division 2, Groups F, G; Class III, Division 2, T4 Class I Zone 2 AEx nA IIC T4 Gc Ex nA IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50°C to 85°C
		Enclosure: Type 4X/ IP66/ IP67	All	All	-

MSG CODE	AGENCY	TYPE OF PROTECTION	COMM. OPTION	ELECTRICAL PARAMETERS	AMBIENT TEMP (Ta)
		STANDARDS: CSA C22.2 No. 0-10; CSA C22.2 No. 94-M91; CSA C22.2 No. 25-1966; CSA C22.2 No. 30-M1986; CSA C22.2 No. 142-M1987; CSA C22.2 No. 157-92; CSA C22.2 No. 213-M1987; CSA-C22.2 No. 60529:05; CSA-C22.2 No. 60079-0:11; CSA-C22.2 No. 60079-1:11; CSA-C22.2 No. 60079-11:11; CSA-C22.2 No. 60079-15:12; CSA-C22.2 No. 60079-31:12; ISA 12.12.01-2010; ISA 60079-0: 2009; ISA 60079-11: 2011; ISA 60079-15: 2009; ISA 60079-26: 2008; ISA-60079-27:2007 (12.02.04)-2006 (R2011); UL 913 Ed. 6; UL 916:1998; ANSI/ISA-12.27.01-2011			
C	**ATEX**	**Flameproof: SIRA 12ATEX2233X**  II 1/2 G Ex db IIC T6..T5 Ga/Gb II 2 D Ex tb IIIC T95°C…T120°C Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: SIRA 12ATEX2233X  II 1 G Ex ia IIC T4 Ga II 2 D Ex ia IIIC T125°C Db FISCO Field Device (Only for FF Option) II 1 G Ex ia IIC T4 Ga	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		Zone 2, Increase Safety: SIRA 12ATEX4234X  II 3 G Ex ec IIC T4 Gc	4-20 mA / DE/ HART/	Note 1	-50°C TO 85°C
		Zone 2, Intrinsically Safe: SIRA 12ATEX4234X  II 3 G Ex ic IIC T4 Gc FISCO Field Device (Only for FF Option) II 3 G Ex ic IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 2	-50°C TO 85°C
		Enclosure: IP66/ IP67	All	All	-
		STANDARDS: EN 60079-0: 2018; EN 60079-1: 2014; EN 60079-7: 2015; EN 60079-11: 2012; EN 60079-26: 2015; EN 60079-31: 2014			
	UKEX	**Flameproof: CSAE 22UKEX1021X**  II 1/2 G Ex db IIC T6..T5 Ga/Gb II 2 D Ex tb IIIC T95°C…T120°C Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: CSAE 22UKEX1021X  II 1 G Ex ia IIC T4 Ga II 2 D Ex ia IIIC T125°C Db FISCO Field Device (Only for FF Option) II 1 G Ex ia IIC T4 Ga	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		Zone 2, Increase Safety: CSAE 22UKEX1008X  II 3 G Ex ec IIC T4 Gc	4-20 mA / DE/ HART/	Note 1	-50°C TO 85°C
		Zone 2, Intrinsically Safe: CSAE 22UKEX1008X  II 3 G Ex ic IIC T4 Gc FISCO Field Device (Only for FF Option) II 3 G Ex ic IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 2	-50°C TO 85°C
		Enclosure: IP66/ IP67	All	All	-

MSG CODE	AGENCY	TYPE OF PROTECTION	COMM. OPTION	ELECTRICAL PARAMETERS	AMBIENT TEMP (Ta)
		STANDARDS: EN 60079-0: 2018; EN 60079-1: 2014; EN 60079-7: 2015; EN 60079-11: 2012; EN 60079-26: 2015; EN 60079-31: 2014			
D	**IECEx World**	**Flameproof: IECEx SIR 12.0100X** Ex db IIC T6..T5 Ga/Gb Ex tb IIIC T95°C…T120°C Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: IECEx SIR 12.0100X Ex ia IIC T4 Ga Ex ia IIIC T125°C Db FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		Zone 2, Increase Safety: IECEx SIR 12.0100X Ex ec IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50°C TO 85°C
		Zone 2, Intrinsically Safe: IECEx SIR 12.0100X Ex ic IIC T4 Gc FISCO Field Device (Only for FF Option) Ex ic IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 2	-50°C TO 85°C
		Enclosure: IP66/ IP67	All	All	-
		STANDARDS: IEC 60079-0: 2017; IEC 60079-1: 2014; IEC 60079-7: 2017; IEC 60079-11: 2011; IEC 60079-26: 2014; IEC 60079-31: 2013			

E	**SAEx South Africa**	**Flameproof :** Ex d IIC T6…T5 Ga/Gb Ex tb IIIC T95°C…T120°C Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: Ex ia IIC Ga T4 FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		Zone 2, Increase Safety: II 3 G Ex ec IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50°C TO 85°C
		Zone 2, Intrinsically Safe: Ex ic IIC T4 Gc FISCO Field Device (Only for FF Option) Ex ic IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 2	-50°C TO 85°C
		Enclosure: IP66/ IP67	All	All	-
F	**INMETRO Brazil**	**Flameproof:** Ex db IIC T6..T5 Ga/Gb Ex tb IIIC T95°C…T120°C Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: Ex ia IIC T4 Ga FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	4-20 mA / DE/ HART	Note 2a	-50°C TO 70°C
			Foundation Fieldbus	Note 2b	-50°C TO 70°C
		Zone 2, Increase Safety: II 3 G Ex ec IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50°C TO 85°C
		Zone 2, Intrinsically Safe: Ex ic IIC T4 Gc FISCO Field Device (Only for FF Option) Ex ic IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 2	-50°C TO 85°C
		Enclosure : IP 66/67	All	All	-
G	**NEPSI CHINA**	**Flameproof:** Ex db IIC T6..T5 Ga/Gb Ex tb IIIC T 95°C Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: Ex ia IIC T4 Ga FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		Zone 2, Increase Safety: II 3 G Ex ec IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50°C TO 85°C
		Zone 2, Intrinsically Safe: Ex ic IIC T4 Gc FISCO Field Device (Only for FF Option) Ex ic IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 2	-50°C TO 85°C
		Enclosure : IP 66/67	All	All	-
H	**KOSHA**	**Flameproof :**	All	Note 1	T4: -50°C TO 85°C

	Korea	Ex d IIC T4, T5, T6 Ex tD A21 IP66/IP67 T95°C…T120 °C			T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: Ex ia IIC T4	4-20 mA / DE/ HART	Note 2	Ta= -50 ºC to 70ºC
			Foundation Fieldbus	Note 2	Ta= -50 ºC to 70ºC
		Enclosure: IP66/ IP67	All	All	-
I	**EAC Russia, Belarus and Kazakhstan**	**Flameproof:** Ga/Gb Ex d IIC T6..T5 Ex tb IIIC Db T 85°C	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: Ga Ex ia IIC T4 X FISCO Field Device (Only for FF Option) Ga Ex ia IIC T4 X	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		Zone 2, Non Sparking: 2 Ex nA IIC T4 Gc X	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50°C TO 85°C
		Zone 2, Intrinsically Safe: Ga Ex ic IIC T4 X FISCO Field Device (Only for FF Option) 2 Ex ic IIC T4 Gc X	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 2	-50°C TO 85°C
		Enclosure : IP 66/67	All	All	
J	**CCoE INDIA**	**Flameproof:** Ex d IIC T6..T5 Ga/Gb	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: Ex ia IIC T4 Ga FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		Non Sparking Ex nA IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50°C TO 85°C
		Enclosure: IP66/ IP67	All	All	-
K	**UATR UKRAINE**	**Flameproof:** II 1/2 G Ex db IIC T6..T5 Ga/Gb II 2 D Ex tb IIIC T95°C…T120°C Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: II 1 G Ex ia IIC T4 Ga FISCO Field Device (Only for FF Option) II 1 G Ex ia IIC T4 Ga	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		Enclosure: IP66/ IP67	All	All	-

Notes:

1. Operating Parameters:

   Voltage = 11 to 42 VDC Current = 4-20 mA Normal

   = 9 to 32 V (FF) = 30 mA (FF)

2. Intrinsically Safe Entity Parameters
   a. Analog / DE/ HART Entity Values:

Vmax = Ui = 30V Imax = Ii = 105mA Ci = 4.2nF Li = 984 uH Pi = 0.9W

Transmitter with Terminal Block Revision E or Later

Vmax = Ui = 30V Imax = Ii = 225mA Ci = 4.2nF Li = 0 Pi = 0.9W

Note : Transmitter with Terminal Block Revision E or later
The revision is on the label that is on the module. There will be two lines of text on the label:

- First is the Module Part #: 50049839-001 or 50049839-002
- Second line has the supplier information, along with the REVISION:

XXXXXXX-EXXXX, THE "X" is production related; THE POSITION of the "E" IS THE REVISION.

b. Foundation Fieldbus- Entity Values

Vmax = Ui = 30V Imax = Ii = 180mA Ci = 0nF Li = 984 uH Pi = 1W

Transmitter with Terminal Block Revision F or Later

Vmax = Ui = 30V Imax = Ii = 225mA Ci = 0nF Li = 0 Pi = 1 W

FISCO Field Device Imax = Ii = 380 mA Ci = 0nF Li = 0 Pi = 5.32 W

Vmax = Ui = 17.5V

Note : Transmitter with Terminal Block Revision F or later
The revision is on the label that is on the module. There will be two lines of text on the label:

- First is the Module Part #: 50049839-003 or 50049839-004
- Second line has the supplier information, along with the REVISION:

XXXXXXX-EXXXX, THE "X" is production related, THE POSITION of the "E" IS THE REVISION

Approval Certifications

<table>
<tr><td rowspan="6">Marine Certificates</td><td>This certificate defines the certifications covered for the SmartLine Pressure Transmitter family of products, including the SMV SmartLine Multivariable Transmitter. It represents the compilation of the five certificates Honeywell currently has covering the certification of these products into marine applications</td></tr>
<tr><td>American Bureau of Shipping (ABS) - 2009 Steel Vessel Rules 1-1-4/3.7, 4-6-2/5.15, 4-8-3/13 & 13.5, 4-8-4/27.5.1, 4-9-7/13. Certificate number: 04-HS417416-PDA</td></tr>
<tr><td>Bureau Veritas (BV) - Product Code: 389:1H. Certificate number: 12660/B0 BV</td></tr>
<tr><td>Det Norske Veritas (DNV) - Location Classes: Temperature D, Humidity B, Vibration A, EMC B, Enclosure C. For salt spray exposure; enclosure of 316 SST or 2-part epoxy protection with 316 SST bolts to be applied. Certificate number: A-11476</td></tr>
<tr><td>Korean Register of Shipping (KR) - Certificate number: LOX17743-AE001</td></tr>
<tr><td>Lloyd's Register (LR) - Certificate number: 02/60001(E1) & (E2)</td></tr>
<tr><td>SIL 2/3 Certification</td><td>IEC 61508 SIL 2 for non-redundant use and SIL 3 for redundant use according to EXIDA and TÜV Nord Sys Tec GmbH & Co. KG under the following standards: IEC61508-1: 2010; IEC 61508-2: 2010; IEC61508-3: 2010</td></tr>
<tr><td>MEASUREMENT INTRUMENTS DIRECTIVE (MID) 2004/ 22/ EC</td><td>Certificate Issued by NMI Certin B.V.
Mechanical Class: M3 Electromagnetic Environment: E3
Ambient Temperature Range: -25 °C to + 55 °C
<table>
<tr><th>Unit</th><th>Custom Calibration</th></tr>
<tr><td>STD820</td><td>0 to 1000 mBar</td></tr>
<tr><td>STD830</td><td>0 to 7 Bar</td></tr>
<tr><td>STA84L</td><td>0 to 35 Bar A</td></tr>
<tr><td>STG84L</td><td>0 to 35 Bar</td></tr>
<tr><td>STD870</td><td>0 to 100 Bar</td></tr>
<tr><td>STA87L</td><td>0 to 100 Bar A</td></tr>
<tr><td>STG87L</td><td>0 to 100 Bar</td></tr>
</table></td></tr>
</table>

Application Data

Liquid Level: Closed Tank

Determine the minimum and maximum pressure differentials to be measured (**Figure 18**).

PMin = (SGp x a) - (SGf x d)
= LRV when HP at bottom of tank
= –URV when LP at bottom of tank

PMax = (SGp x b) - (SGf x d)
= URV when HP at bottom of tank
= –LRV when LP at bottom of tank

Where:

minimum level at 4mA
maximum level at 20 mA

a = distance between bottom tap and minimum level

b = distance between bottom tap and maximum level

d = distance between taps

SG_f = Specific Gravity of capillary fill fluid (See Page 6 “Material Specifications” for values.)

SG_p = Specific Gravity of process fluid

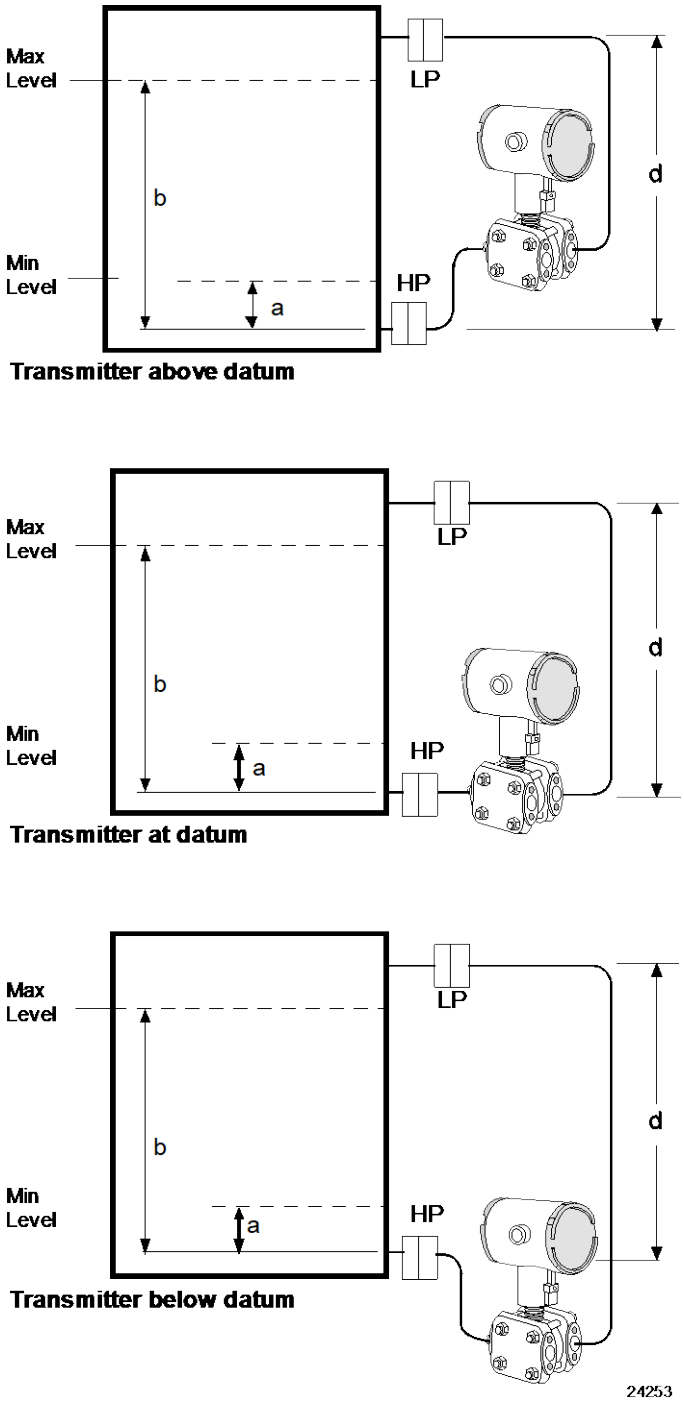


Figure 18 - Closed tank liquid level measurement distance

Application Data (Cont'd)

Density or Interface*

Calculate the minimum and maximum pressure differentials to be measured (**Figure 19**).

$P_{min} = (SG_{min} – SG_f) \times (d)$;
minimum density, 4mA output

$P_{max} = (SG_{max} – SG_f) \times (d)$;
maximum density, 20mA output

Where:

d = distance between the taps

SG_{max} = maximum Specific Gravity

SG_{min} = minimum Specific Gravity

SG_f = Specific Gravity of capillary fill fluid (See Page 6 "Material Specifications" for values.)

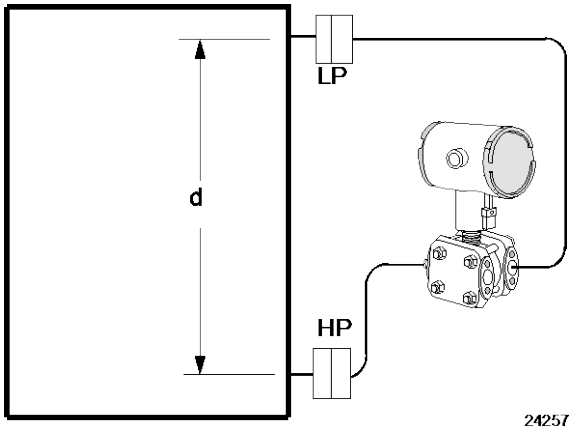


Figure 19 - Density, direct acting transmitter configuration

Seal Configurations

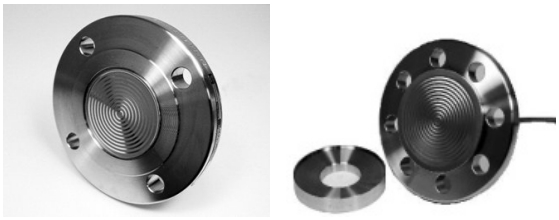


Figure 20 - Flush Flange Seals and with left lower

Flush Flange Seals can be used with differential, gauge and absolute pressure transmitters and are available with 3" ANSI Class 150, ANSI Class 300 and DIN DN80-PN40 process connections. Flush flange seals can also be provided with Lowers. Lowers are essentially calibration rings, which allow flushing connections if needed



Figure 21 - Flange Seal with Extended Diaphragm

Flange Seal with Extended Diaphragm can be used with differential, gauge and absolute pressure transmitters and are available with 3" and 4" ANSI Class 150, ANSI Class 300, DIN DN80-PN40 and DIN DN100-PN40 process connections. 2", 4" and 6" extension lengths are available

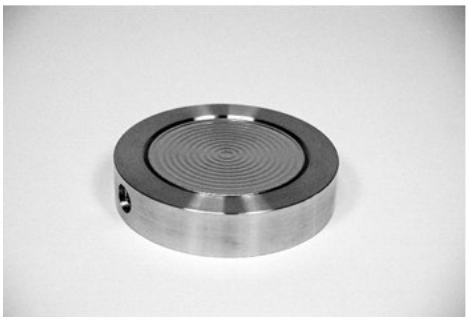


Figure 22 - Pancake Seals

Pancake Seals can be used with differential, gauge and absolute pressure transmitters and are available with 3" ANSI Class 150, 300 and 600 process connections



Figure 23 - Chemical Tee "Taylor" Wedge

Chemical Tee "Taylor" Wedge can be used with differential pressure transmitters and are available with Taylor Wedge 5" O.D. process connection

Seal Configurations (cont'd)



Figure 24 - Seals with Threaded Process Connections

Seals with Threaded Process Connections can be used with differential, gauge and absolute pressure transmitters and are available with ½", ¾" and 1" NPT Female process connections



Figure 25 - Sanitary Seals

Sanitary Seals can be used with differential, gauge and absolute pressure transmitters and are available with 3" and 4" Tri-Clover-Tri-Clamp process connections



Figure 26 - Saddle Seals

Saddle Seals can be used with differential, gauge and absolute pressure transmitters and are available with 3" and 4" (6 bolt or 8 bolt designs) process connections



Figure 27 - Calibration Rings

Calibration Rings are available with Flush Flange Seals and Pancake Seals. Flushing ports (1/4" or ½") are available with calibration rings



Figure 28 - Stainless Steel Armor and PVC Coated Stainless Steel Armor Capillaries

Stainless Steel Armor and PVC Coated Stainless Steel Armor Capillaries are available with Honeywell Remote Seal Solutions



Figure 29 - 2" Stainless Steel Nipples

2" Stainless Steel Nipples are available for Close-Coupled remote seal solutions



Figure 30 - Welded Meter Body for All-Welded Remote Seal Solution

Welded Meter Body for All-Welded Remote Seal Solution. The welded ST 800 meter body is an important part of an All-Welded Remote Seal Solution, which is commonly used in Vacuum applications

Model Selection Guide

Model Selection Guides are subject to change and are inserted into the specifications as guidance only.

Honeywell

Model STR800

(DP, GP & AP) Remote Seals

Model Selection Guide
34-ST-16-88, Isuue 37

Section 13
Page: STR8-1

Honeywell Proprietary



Instructions

- Select the desired Key Number. The arrow to the right marks the selection available.
- Make selections from each Table (I, II and IX) using the column below the proper arrow.
- A (●) denotes unrestricted availability. A letter denotes restricted availability.
- Restrictions follow Table IX.

Key Number	I	II	III	IV	V	VI	VII	VIII	IX
STR _ _ _	- _ _ _ _ _ _ _	- _ _ _ _ _ _ _ _ _	- _	- _ _ _	- _ _ _	- _	- _ _ _ _	_ _ ' _	+ 0 0 0 0

List Price equals the sum of all selections made.

KEY NUMBER	URL	LRL	Max Span	Min Span	Units	Selection	Availability	
Measurement Range Std Accuracy	400 (1000)	-400 (-1000)	400 (1000)	4 (10)	" H_2O (mbar)	STR82D	↓	
	100 (7)	-100 (-7)	100 (7)	1 (0.07)	psi (bar)	STR83D	↓	
	500 (35)	5.7 (0.39)	500 (35)	5 (0.35)	psia (bar A)	STR84A		↓
	500 (35)	-14.7 (-1.0)	500 (35)	5 (0.35)	psi (bar)	STR84G		↓
	3000 (210)	14.7 (-1.0)	3000 (210)	30 (2.1)	psi (bar)	STR87G		↓


Note: Remote seal system pressure rating is body rating or seal rating, whichever is less.

TABLE I	Description					Selection		
Meter Body & Capillaries	a. Number of Seals	1 Remote Seal (High Side)				1 _ _ _ _ _ _	●	●
		2 Remote Seals				2 _ _ _ _ _ _	●	
		1 Remote Seal (Low Side)				3 _ _ _ _ _ _	●	
	b. Primary Fill Fluid (Meter body)	Silicone Oil 200				_ 1 _ _ _ _ _	●	●
		Fluorinated Oil CTFE				_ 2 _ _ _ _ _	**2**	**2**
		Silicone Oil 704				_ 3 _ _ _ _ _	●	●
		NEOBEE® M-20 [11]				_ 4 _ _ _ _ _	●	●
	c. Construction	**Non-Wetted Adapter Head Materials**						
	In-Line Gauge/ Absolute	316 SS Bonnet				_ _ A _ _ _ _		●
		316 SS Bonnet for Close-Couple				_ _ B _ _ _ _		**3**
	Dual Head DP	316 SS (bolt-on heads)				_ _ C _ _ _ _	●	
		316 SS for Close-Couple				_ _ D _ _ _ _	**3**	
		316 SS with all-welded meter body				_ _ E _ _ _ _	**4**	
	d. Bolts and Nuts for Transmitter Heads	None				_ _ _ 0 _ _ _	**22**	●
		Carbon Steel Bolts and Nuts				_ _ _ C _ _ _	●	
		316 SS Bolts and Nuts				_ _ _ S _ _ _	●	
		A286 SS (NACE) Bolts and 304 SS (NACE) Nuts				_ _ _ N _ _ _	●	
		B7M (NACE) Bolts and 7M (NACE) Nuts				_ _ _ B _ _ _	●	
	e. Secondary Fill Fluid (capillary & seal)**	No Fill Fluid				_ _ _ _ 0 _ _	**5**	**5**
		Silicone Oil 200				_ _ _ _ 1 _ _	●	●
		Fluorinated Oil CTFE				_ _ _ _ 2 _ _	●	●
		Silicone Oil 704				_ _ _ _ 3 _ _	●	●
		Neobee® M20 [11]				_ _ _ _ 4 _ _	●	●
		Syltherm® 800 [12]				_ _ _ _ 5 _ _	●	●
	f. Connection of Remote Seal to Meter Body** 	No Capillary, No Nipple (Specify for VAM Unit Only)				_ _ _ _ _ _ 0 _	**5**	**5**
		Capillary Length	5 feet	1.5 m	SS Armor	_ _ _ _ _ _ A _	●	●
			10 feet	3.0 m		_ _ _ _ _ _ B _	●	●
			15 feet	4.5 m		_ _ _ _ _ _ C _	●	●
			20 feet	6.1 m		_ _ _ _ _ _ D _	●	●
			25 feet	7.5 m		_ _ _ _ _ _ E _	●	●
			35 feet	10.7 m		_ _ _ _ _ _ F _	●	●
			5 feet	1.5 m	PVC Coated SS Armor	_ _ _ _ _ _ G _	●	●
			10 feet	3.0 m		_ _ _ _ _ _ H _	●	●
			15 feet	4.5 m		_ _ _ _ _ _ J _	●	●
			20 feet	6.1 m		_ _ _ _ _ _ K _	●	●
			25 feet	7.5 m		_ _ _ _ _ _ L _	●	●
			35 feet	10.7 m		_ _ _ _ _ _ M _	●	●
		2 inch long SS nipple close-coupled				_ _ _ _ _ _ 2 _	**6**	**6**
	g. Seal Option**	None				_ _ _ _ _ _ 0	●	●
		Std Gold Plated Seal Diaph. = 50 µin				_ _ _ _ _ _ 1	**7**	**7**
		Teflon Coated Seal Diaphragm - only for anti-sticking				_ _ _ _ _ _ 4	**7**	**7**

** Refer to 34-ST-00-128 for additional options, consult factory

[11] Limited vacuum availability.

[12] Minimum static pressure requirement. No vacuum allowed. See Specifications 34-ST-03-88 Figure 15



In-Line Guage



Dual Head DP



All welded

						STR84G & 87G & 84A	STR82D & 83D
	Note: When selecting required seal, you must specify only the 9 selections within the required seal type.				**Selection**		
TABLE II	**Description**						
Seals	No Seal Attached to Core Transmitter (Specify for VAM Unit Only)				0 0 0 0 0 0 0 0 0	**21**	**21**
	Seal Type	**Diaphragm Diameter**	**Flange Size**	**Flange Pressure Rating** [1]	**Selection**		
	Flush Flanged Seal** 	3.5"	3"	ANSI Class 150	AFA _ _ _ _ _ _	•	•
				ANSI Class 300	AFC _ _ _ _ _ _	•	•
			80mm	DIN DN80-PN40	AFM _ _ _ _ _ _	•	•
		Wetted Material		**Diaphragm** / **Upper Insert**	**Selection**		
				316L SS / 316L SS	_ _ _ AA _ _ _ _	•	•
				Hastelloy® C-276 / 316L SS	_ _ _ AB _ _ _ _	•	•
				Hastelloy® C-276 / Hastelloy® C-276	_ _ _ AC _ _ _ _	•	•
				Monel 400® / Monel 400®	_ _ _ AE _ _ _ _	**8**	**8**
				Tantalum [5] / 316L SS	_ _ _ AF _ _ _ _	**8**	**8**
		Non-Wetted Material (upper)		CS (Nickel Plated)	_ _ _ _ _ 1 _ _ _	•	•
				316L SS	_ _ _ _ _ 2 _ _ _	•	•
		Seal-Capillary Connection		Center Seal	_ _ _ _ _ _ 1 _ _	•	•
				Side Seal	_ _ _ _ _ _ 2 _ _	**9**	**9**
		Calibration Rings 		None	_ _ _ _ _ _ _ A _	•	•
				316L SS	_ _ _ _ _ _ _ B _	**10**	**10**
				Hastelloy® C-276	_ _ _ _ _ _ _ C _	**10**	**10**
				Monel 400®	_ _ _ _ _ _ _ D _	**10**	**10**
		Flushing Connections and Plugs [4] (Metal plug material will be the same as Cal. ring material if metal plug is chosen)		None	_ _ _ _ _ _ _ _ 0	•	•
				One 1/4" with plastic plug	_ _ _ _ _ _ _ _ H	**11**	**11**
				One 1/4" with metal plug	_ _ _ _ _ _ _ _ J	**11**	**11**
				Two 1/4" with plastic plugs	_ _ _ _ _ _ _ _ M	**11**	**11**
				Two 1/4" with metal plugs	_ _ _ _ _ _ _ _ N	**11**	**11**
				One 1/2" with plastic plug	_ _ _ _ _ _ _ _ P	**11**	**11**
				One 1/2" with metal plug	_ _ _ _ _ _ _ _ Q	**11**	**11**
				Two 1/2" with plastic plugs	_ _ _ _ _ _ _ _ R	**11**	**11**
				Two 1/2" with metal plugs	_ _ _ _ _ _ _ _ S	**11**	**11**

Table II continued next page

** Refer to 34-ST-00-128 for additional options, consult factory

[1] Standard facing 125-250 AARH RF (raised face) serrated surface finish.

[4] Plastic Plugs are TEMPORARY ONLY to protect threads and MUST be REMOVED before installation

[5] Tantalum Upper insert has Tantalum wetted parts and 316 SS or CS non-wetted parts

Note: Remote seal system pressure rating is body rating or seal rating, whichever is less.

TABLE II	Descripton					Selection	STR82D & 83D	
	Seal Type	Diaphragm Diameter	Flange Size	Flange Pressure Rating [1]	Const. - See Spec. Figure 34-ST-03-88	Construction - See Spec. Figure 34-ST-03-88		
Seals (continued)	Flush Flanged Seal with Lower** 	2.4"	1"	ANSI 150	22	BCA_ _ _ _ _ _	12	•
				ANSI 300	22	BCC_ _ _ _ _ _	12	•
			1-1/2"	ANSI 150	22	BGA_ _ _ _ _ _	12	•
				ANSI 300	22	BGC_ _ _ _ _ _	12	•
		2.9"	1-1/2"	ANSI 150	22	CGA_ _ _ _ _ _	•	•
				ANSI 300	22	CGC_ _ _ _ _ _	•	•
			2"	ANSI 150	22	CDA_ _ _ _ _ _	•	•
		4.1"	1/2"	ANSI 150	22	DAA_ _ _ _ _ _	•	•
			1"	ANSI 150	23	DCA_ _ _ _ _ _	•	•
				ANSI 300	23	DCC_ _ _ _ _ _	•	•
			1-1/2"	ANSI 150	23	DGA_ _ _ _ _ _	•	•
				ANSI 300	23	DGC_ _ _ _ _ _	•	•
			2"	ANSI 150	23	DDA_ _ _ _ _ _	•	•
				ANSI 300	22	DDC_ _ _ _ _ _	•	•
			3"	ANSI 150	22	DFA_ _ _ _ _ _	•	•
				ANSI 300	22	DFC_ _ _ _ _ _	•	•
		Wetted Material		**Diaphragm**	**Lower**	**Selection**		
				316L SS	316L SS	_ _ _BA_ _ _ _	•	•
				Hastelloy® C-276	316L SS	_ _ _BB_ _ _ _	•	•
				Hastelloy® C-276	Hastelloy® C-276	_ _ _BC_ _ _ _	•	•
				Monel 400®	Monel 400®	_ _ _BE_ _ _ _	8	8
				Tantalum	316L SS	_ _ _BF_ _ _ _	8	8
				Tantalum	Hastelloy® C-276	_ _ _BG_ _ _ _	8	8
				Tantalum	Tantalum Clad	_ _ _BH_ _ _ _	13	13
		Non-Wetted Material (upper, upper insert)		**Upper**	**Upper Insert**	**Selection**		
				316L SS	316L SS	_ _ _ _ _4_ _ _	•	•
				Carbon Steel	316L SS	_ _ _ _ _5_ _ _	•	•
		Bolts [6]		No Selection		_ _ _ _ _ _0_ _	•	•
		Flushing		None		_ _ _ _ _ _ _0_	•	•
		Connections and Plugs [4] (Metal plug material will be the same as Lower material, if metal plug is chosen - (SS Plug for CS Lower and Tantalum Clad)		One 1/4" with plastic plug		_ _ _ _ _ _ _H_	•	•
				One 1/4" with metal plug		_ _ _ _ _ _ _J_	•	•
				Two 1/4" with plastic plugs		_ _ _ _ _ _ _M_	•	•
				Two 1/4" with metal plugs		_ _ _ _ _ _ _N_	•	•
				One 1/2" with plastic plug		_ _ _ _ _ _ _P_	•	•
				One 1/2" with metal plug		_ _ _ _ _ _ _Q_	•	•
				Two 1/2" with plastic plugs		_ _ _ _ _ _ _R_	•	•
				Two 1/2" with metal plugs		_ _ _ _ _ _ _S_	•	•
		Gasket		Viton		_ _ _ _ _ _ _ _V	•	•
				Graphite		_ _ _ _ _ _ _ _G	•	•
				Teflon®		_ _ _ _ _ _ _ _T	•	•

Table II continued next page

** Refer to 34-ST-00-128 for additional options, consult factory

[1] Standard facing 125-250 AARH RF (raised face) serrated surface finish.

[6] Bolt material will be same as Upper Material. However, if Table I bolts/nuts material is NACE or B7M, seal bolt material will be 304 SS NACE.

[4] Plastic Plugs are TEMPORARY ONLY to protect threads and MUST be REMOVED before installation

TABLE II	Descripton					STR84G & 87G & 84A / STR82D & 83D		
	Seal Type	Diaphragm Diameter	Flange Size	Flange Pressure Rating [1]		Selection		
Seals (continued)	 Flange Seal with Extended Diaphragm**	2.8"	3" (2.8" OD extension)	ANSI Class 150		EFA_ _ _ _ _ _	•	•
				ANSI Class 300		EFC _ _ _ _ _ _	•	•
				DIN DN80-PN40		EFM_ _ _ _ _ _	•	•
		3.5"	4" (3.70" OD extension	ANSI Class 150		FGA_ _ _ _ _ _	•	•
				ANSI Class 300		FGC _ _ _ _ _ _	•	•
				DIN DN100-PN40		FGP_ _ _ _ _ _	•	•
		Wetted Material		Diaphragm	Ext. Tube	Selection		
				316L SS	316L SS	_ _ _EA_ _ _ _	•	•
				Hastelloy® C-276	316L SS	_ _ _EB_ _ _ _	•	•
				Hastelloy® C-276	Hastelloy® C-276	_ _ _EC_ _ _ _	•	•
		Non-Wetted Material (flange)		CS (Nickel Plated)		_ _ _ _ _7_ _ _	•	•
				316L SS		_ _ _ _ _8_ _ _	•	•
		Bolts		No Selection		_ _ _ _ _ _0_ _	•	•
		Extension Length		2"		_ _ _ _ _ _ _2 _	•	•
				4"		_ _ _ _ _ _ _4 _	•	•
				6"		_ _ _ _ _ _ _6 _	•	•
	No Selection	No Selection		No Selection		_ _ _ _ _ _ _0	•	•

Table II continued below


TABLE II	Descripton					STR84G & 87G & 84A / STR82D & 83D		
	Seal Type	Diaphragm Diameter	Flange Size	Flange Pressure Rating Dependent on Customer Flange [1]		Selection		
Seals (continued)	 Pancake Seal	3.5"	3"	ANSI Class 150/300/600		GFA_ _ _ _ _ _	•	•
		Wetted Material		Diaphragm	Body			
				316L SS	316L SS	_ _ _GA_ _ _ _	•	•
				Hastelloy® C-276	316L SS	_ _ _GB_ _ _ _	•	•
				Hastelloy® C-276	Hastelloy® C-276	_ _ _GC_ _ _ _	•	•
				Monel 400®	Monel 400®	_ _ _GE_ _ _ _	8	8
				Tantalum	Tantalum [7]	_ _ _GG_ _ _ _	8	8
		Non-Wetted Material		No Selection		_ _ _ _ _0_ _ _	•	•
		Bolts		No Selection		_ _ _ _ _ _0_ _	•	•
		Calibration Rings 		None		_ _ _ _ _ _ _A_	•	•
				316L SS		_ _ _ _ _ _ _B_	10	10
				Hastelloy® C-276		_ _ _ _ _ _ _C_	10	10
				Monel 400®		_ _ _ _ _ _ _D_	10	10
		Flushing Connections and Plugs[4] (Metal plug material will be the same as Cal. Ring material, if metal plug is chosen)		None		_ _ _ _ _ _ _ _0	•	•
				One 1/4" with plastic plug		_ _ _ _ _ _ _ _H	11	11
				One 1/4" with metal plug		_ _ _ _ _ _ _ _J	11	11
				Two 1/4" with plastic plugs		_ _ _ _ _ _ _ _M	11	11
				Two 1/4" with metal plugs		_ _ _ _ _ _ _ _N	11	11
				One 1/2" with plastic plug		_ _ _ _ _ _ _ _P	11	11
				One 1/2" with metal plug		_ _ _ _ _ _ _ _Q	11	11
				Two 1/2" with plastic plugs		_ _ _ _ _ _ _ _R	11	11
				Two 1/2" with metal plugs		_ _ _ _ _ _ _ _S	11	11

Table II continued next page

** Refer to 34-ST-00-128 for additional options, consult factory
[1] Standard facing 125-250 AARH RF (raised face) serrated surface finish.
[4] Plastic Plugs are TEMPORARY ONLY to protect threads and MUST be REMOVED before installation
[7] Tantalum Body has Tantalum w etted parts and 316 SS non-w etted parts

Note: Remote seal system pressure rating is body rating or seal rating, w hichever is less.

TABLE II	Descripton						STR84G & 87G & 84A	STR82D & 83D
	Seal Type	Diaphragm Diameter	Flange Size	Flange Pressure Rating [1]		Selection		
Seals (continued)	 Chemical Tee "Taylor" Wedge	3.5"	Taylor Wedge 5" O.D.	750 psi		HM0 _ _ _ _ _ _	16	
		Wetted Material		Diaphragm	Body	Selection		
				316L SS	316L SS	_ _ _ HA _ _ _ _	•	
				Hastelloy® C-276	316L SS	_ _ _ HB _ _ _ _	•	
				Hastelloy® C-276	Hastelloy® C-276	_ _ _ HC _ _ _ _	•	
		Non-Wetted Material		No Selection		_ _ _ _ _ 0 _ _ _	•	
		Bolts		No Selection		_ _ _ _ _ 0 _ _	•	
		Styles		No Selection		_ _ _ _ _ _ 0 _	•	
		No Selection		No Selection		_ _ _ _ _ _ _ 0	•	

Table II continued below

TABLE II	Descripton						STR84G & 87G & 84A	STR82D &83D
	Seal Type	Diaphragm Diameter	Threaded Process Connection Size (NPT Female)	Pressure Rating		Selection		
				CS Bolts	304 SS Bolts			
Seals (continued)	 Seal with Threaded Process Connection	2.4"	1/2 NPT 3/4 NPT 1 NPT	2,500 psi	1,250 psi	JJG _ _ _ _ _ _ JKG _ _ _ _ _ _ JLG _ _ _ _ _ _	12 12 12	• • •
		4.1"	1/2 NPT 3/4 NPT 1 NPT	1,500 psi	750 psi	LJG _ _ _ _ _ _ LKG _ _ _ _ _ _ LLG _ _ _ _ _ _	• • •	• • •
		Wetted Material		Diaphragm	Lower	Selection		
				316L SS	Carbon Steel	_ _ _ JA _ _ _ _	•	•
				316L SS	316L SS	_ _ _ JB _ _ _ _	•	•
				Hastelloy® C-276	316L SS	_ _ _ JC _ _ _ _	•	•
				Hastelloy® C-276	Hastelloy® C-276	_ _ _ JD _ _ _ _	•	•
				Monel 400®	Monel 400®	_ _ _ JE _ _ _ _	8	8
				Tantalum	316L SS	_ _ _ JF _ _ _ _	8	8
				Tantalum	Hastelloy® C-276	_ _ _ JG _ _ _ _	8	8
		Non-Wetted Material (upper)		CS (Nickel Plated)		_ _ _ _ _ A _ _ _	•	•
				316 Stainless Steel		_ _ _ _ _ C _ _ _	17	17
		Bolts [8]		Carbon Steel		_ _ _ _ _ _ C _ _	•	•
				304 SS		_ _ _ _ _ _ D _ _	•	•
		Flushing Connections and Plugs [4] (Metal plug material will be the same as Lower material, if metal plug is chosen - (SS Plug for CS Lower and Tantalum Clad)		None		_ _ _ _ _ _ _ 0 _	•	•
				One 1/4" with plastic plug		_ _ _ _ _ _ _ H _	•	•
				One 1/4" with metal plug		_ _ _ _ _ _ _ J _	•	•
				Two 1/4" with plastic plugs		_ _ _ _ _ _ _ M _	•	•
				Two 1/4" with metal plugs		_ _ _ _ _ _ _ N _	•	•
				One 1/2" with plastic plug		_ _ _ _ _ _ _ P _	18	18
				One 1/2" with metal plug		_ _ _ _ _ _ _ Q _	18	18
				Two 1/2" with plastic plugs		_ _ _ _ _ _ _ R _	18	18
				Two 1/2" with metal plugs		_ _ _ _ _ _ _ S _	18	18
		Gasket		Viton		_ _ _ _ _ _ _ _ V	•	•
				Graphite		_ _ _ _ _ _ _ _ G	•	•
				Teflon®		_ _ _ _ _ _ _ _ T	•	•

Table II continued next page

[1] Standard facing 125-250 AARH RF (raised face) serrated surface finish.

[4] Plastic Plugs are TEMPORARY ONLY to protect threads and MUST be REMOVED before installation

[8] If Table I Bolts and Nuts material option is NACE, Bolts and Nuts will ship with Alloy Steel NACE and MAWP may change.

Note: Remote seal system pressure rating is body rating or seal rating, whichever is less.

TABLE II	Descripton						STR84G & 87G & 84A	STR82D & 83D
	Seal Type	Diaphragm Diameter	Flange Size	Pressure Rating		Selection		
Seals (continued)	 Sanitary Seal [9]	1.9"	2"	Customer clamp rating or 600 psi, whichever is less		MD0 _ _ _ _ _ _		19
		2.4"	2-1/2"			NE0 _ _ _ _ _ _	20	19
		2.9"	3"			PF0 _ _ _ _ _ _	19	19
		4.1"	4"			QG0 _ _ _ _ _ _	19	19
		Wetted Material		Diaphragm	Body	Selection		
				316L SS	316L SS	_ _ _ N A _ _ _ _	•	•
		Non-Wetted Material		No Selection		_ _ _ _ _ 0 _ _ _	•	•
		Bolts		No Selection		_ _ _ _ _ _ 0 _ _	•	•
		Styles		Tri-Clover Tri-Clamp®		_ _ _ _ _ _ _ 8 _	•	•
		Gasket		No Selection		_ _ _ _ _ _ _ 0	•	•

Table II continued below

TABLE II	Descripton						STR84G & 87G & 84A	STR82D & 83D
	Seal Type	Diaphragm Diameter	Size and Bolt Pattern	Seal Pressure Rating		Selection		
				C.S. Bolts	316 SS Bolts			
Seals (continued)	 Saddle Seal	2.4" **8-Bolt** Design	for 3" Pipe ≥ 4" pipe	2,500 psi	1,250 psi	RFK _ _ _ _ _ _	12	•
						RGK _ _ _ _ _ _	12	•
		2.4" **6-Bolt** Design	for 3" Pipe ≥ 4" pipe	2,000 psi	1,000 psi	RPK _ _ _ _ _ _	12	•
						RQK _ _ _ _ _ _	12	•
		Wetted Material		Diaphragm	Lower Housing	Selection		
				316L SS	Carbon Steel	_ _ _ RA _ _ _ _	•	•
				316L SS	316L SS	_ _ _ RB _ _ _ _	•	•
				Hastelloy® C-276	316L SS	_ _ _ RC _ _ _ _	•	•
				Hastelloy® C-276	Hastelloy® C-276	_ _ _ RD _ _ _ _	•	•
				316L SS	N/A-Body Only [10]	_ _ _ SB _ _ _ _	•	•
				Hastelloy® C-276	N/A-Body Only [10]	_ _ _ SC _ _ _ _	•	•
		Non-Wetted Material		Body	Bolts [10,11]	Selection		
				Carbon Steel	Carbon Steel	_ _ _ _ _ B _ _ _	8	8
				316L SS	316 SS	_ _ _ _ _ C _ _ _	•	•
		Bolts		No Selection		_ _ _ _ _ _ 0 _ _	•	•
		Styles		No Selection		_ _ _ _ _ _ _ 0 _	•	•
		Gasket		Viton		_ _ _ _ _ _ _ _ V	•	•
				Graphite		_ _ _ _ _ _ _ _ G	•	•
				Teflon®		_ _ _ _ _ _ _ _ T	•	•

[9] All sanitary seals have dairy grade 3A approval.
[10] Bolts are not included with "body only" selection.
[11] If Table I Bolts and Nuts material option is NACE, seal bolt material will be 304 SS NACE.

Note: Remote seal system pressure rating is body rating or seal rating, whichever is less.

TABLE III	Agency Approvals (see data sheet for Approval Code Details)	STR84G & 87G & 87G & 84A	STR82D & 83D
Approvals	No Approvals Required	0	• •
	FM Explosion proof, Intrinsically Safe, Non-incendive, & Dustproof	A	• •
	CSA Explosion proof, Intrinsically Safe, Non-incendive, & Dustproof	B	• •
	ATEX Explosion proof, Intrinsically Safe & Non-incendive	C	• •
	IECEx Explosion proof, Intrinsically Safe & Non-incendive	D	• •
	SAEx Explosion proof, Intrinsically Safe & Non-incendive	E	• •
	INMETRO Explosion proof, Intrinsically Safe & Non-incendive	F	• •
	NEPSI Explosion proof, Intrinsically Safe & Non-incendive	G	• •
	KOSHA Explosion proof, Intrinsically Safe & Non-incendive	H	• •
	EAC Customs Union(Russia,Belarus,Kazakhstan) Ex Approval,Flameproof, Intrinsically Safe	I	• •
	CCoE Explosion proof, Intrinsically Safe & Non-incendive	J	• •
	UATR Flameproof, Intrinsically Safe & Dustproof	K	• •

TABLE IV	TRANSMITTER ELECTRONIC SELECTIONS				
a. Electronic Housing Material & Connection Type	Material	Connection	Lightning Protection		
	Polyester Powder Coated Aluminum	1/2 NPT	None	A _ _	• •
	Polyester Powder Coated Aluminum	M20	None	B _ _	• •
	Polyester Powder Coated Aluminum	1/2 NPT	Yes	C _ _	• •
	Polyester Powder Coated Aluminum	M20	Yes	D _ _	• •
	Dual Certified SS 316/316L (CF8M/CF3M)	1/2 NPT	None	E _ _	• •
	Dual Certified SS 316/316L (CF8M/CF3M)	M20	None	F _ _	• •
	Dual Certified SS 316/316L (CF8M/CF3M)	1/2 NPT	Yes	G _ _	• •
	Dual Certified SS 316/316L (CF8M/CF3M)	M20	Yes	H _ _	• •
b. Output/ Protocol	Analog Output		Digital Protocol		
	4-20mA dc		HART Protocol	_ H _	• •
	4-20mA dc		DE Protocol	_ D _	• •
	none		Foundation Fieldbus	_ F _	• •
c. Customer Interface Selections	Indicator	Buttons	Languages		
	None	None	None	_ _ 0	• •
	None	Yes (Zero/Span Only)	None	_ _ A	f f
	Advanced	None	EN,GR,IT, FR,SP,RU, TU	_ _ D	• •
	Advanced	Yes	EN,GR,IT, FR,SP,RU, TU	_ _ E	• •
	Advanced	None	EN, CH, JP	_ _ H	• •
	Advanced	Yes	EN, CH, JP	_ _ J	• •
	Standard (w/internal Zero, Span & Conf	None	EN, RU	_ _ S	q q
	Standard (w/internal Zero, Span & Conf	Yes	EN, RU	_ _ T	q q

TABLE V	CONFIGURATION SELECTIONS				
a. Application Software	Diagnostics				
	Standard Diagnostics			1 _ _	• •
b. Output Limit, Failsafe & Write Protect Settings	Write Protect	Fail Mode	High & Low Output Limits[3]		
	Disabled	High> 21.0mAdc	Honeywell Std (3.8 - 20.8 mAdc)	_ 1 _	f f
	Disabled	Low< 3.6mAdc	Honeywell Std (3.8 - 20.8 mAdc)	_ 2 _	f f
	Enabled	High> 21.0mAdc	Honeywell Std (3.8 - 20.8 mAdc)	_ 3 _	f f
	Enabled	Low< 3.6mAdc	Honeywell Std (3.8 - 20.8 mAdc)	_ 4 _	f f
	Enabled	N/A	N/A Fieldbus or Profibus	_ 5 _	g g
	Disabled	N/A	N/A Fieldbus or Profibus	_ 6 _	g g
c. General Configuration	Factory Standard			_ _ S	• •
	Custom Configuration (Unit Data Required from customer)			_ _ C	• •

TABLE VI	CALIBRATION & ACCURACY SELECTIONS				
Accuracy and Calibration	Accuracy	Calibrated Range	Calibration Qty		
	NA	None	None	0	21 21
	Standard	Factory Std	Single Calibration	A	23 23
	Standard	Custom (Unit Data Required)	Single Calibration	B	23 23

[3] NAMUR Output Limits 3.8 - 20.5mAdc can be configured by the customer or select custom configuration Table Vc

TABLE VII	ACCESSORY SELECTIONS		STR84G & 87G & 84A	STR82D & 83D
	Bracket Type	**Material**		
a. Mounting Bracket	None	None	0 _ _ _	● ●
	Angle Bracket	Carbon Steel	1 _ _ _	● ●
	Angle Bracket	304 SS	2 _ _ _	● ●
	Angle Bracket	316 SS	3 _ _ _	● ●
	Marine Approved Bracket	Carbon Steel	8 _ _ _	y
	Marine Approved Bracket (In Line)	Carbon Steel	9 _ _ _	●
	Marine Approved Bracket	304 SS	4 _ _ _	y
	Marine Approved Bracket (In Line)	304 SS	A _ _ _	●
	Flat Bracket	Carbon Steel	5 _ _ _	● ●
	Flat Bracket	304 SS	6 _ _ _	● ●
	Flat Bracket	316 SS	7 _ _ _	● ●
b. Customer Tag	**Customer Tag Type**			
	No customer tag		_ 0 _ _	● ●
	One Wired Stainless Steel Tag (Up to 4 lines 26 char/line)		_ 1 _ _	● ●
	Two Wired Stainless Steel Tag (Up to 4 lines 26 char/line)		_ 2 _ _	● ●
c. Unassembled Conduit Plugs & Adapters	**Unassembled Conduit Plugs & Adapters**			
	No Conduit Plugs or Adapters Required		_ _ A0	● ●
	1/2 NPT Male to 3/4 NPT Female 316 SS Certified Conduit Adapter		_ _ A2	n n
	1/2 NPT 316 SS Certified Conduit Plug		_ _ A6	n n
	M20 316 SS Certified Conduit Plug		_ _ A7	m m
	Minifast® 4 pin (1/2 NPT)		_ _ A8	n n
	Minifast® 4 pin (M20)		_ _ A9	m m

TABLE VIII	OTHER Certifications & Options : (String in sequence comma delimited (XX, XX, XX,....)				
Certifications & Warranty	None - No additional options	00	*	*	
	NACE MR0175; MR0103; ISO15156 (FC33338) Process wetted parts only	FG	*	*	b
	NACE MR0175; MR0103; ISO15156 (FC33339) wetted and non-wetted parts	F7	c	c	
	Marine (DNV,ABS,BV,KR,LR)	MT	d	d	
	EN10204 Type 3.1 Material Traceability (FC33341)	FX	●	●	
	Certificate of Conformance (F3391)	F3	●	●	b
	Calibration Test Report & Certificate of Conformance (F3399)	F1	●	●	
	Certificate of Origin (F0195)	F5	●	●	
	FMEDA (SIL 2/3) Certification (FC33337)	FE	j	j	
	Over-Pressure Leak Test Certificate (1.5X MAWP) (F3392)	TP	●	●	
	Cert Clean for O_2 or CL_2 service per ASTM G93	OX	e	e	
	Extended Warranty Additional 1 year	01	●	●	
	Extended Warranty Additional 2 years	02	●	●	
	Extended Warranty Additional 3 years	03	●	●	b
	Extended Warranty Additional 4 years	04	●	●	
	Extended Warranty "LifeTime" Additional 15 years	15	●	●	

TABLE IX	Manufacturing Specials			
Factory	**Factory Identification**	0 0 0 0	●	●

MODEL RESTRICTIONS

Restriction Letter	Available Only With		Not Available With	
	Table	Selection(s)	Table	Selection(s)
b	Select only one option from this group			
d	IVa	C, D,G,H _ _	VIIa	1,2,3,5,6,7 _ _ _
c	Id	_ _ _ 0, N, B _ _ _		
e	Ib	_ 2 _ _ 2 _ _		
f			IVb	_ F _
g			IVb	_ H, D _
j	IVb	_ H _	Vb	_ 1,2,6 _
m	IVa	B, D, F, H _ _		
n	IVa	A, C, E, G _ _		
q	IVb	_ H _		
y			Ic	_ _ E _ _ _ _
2	Ie	_ _ _ _ 0 _ _ _ _ _ _ 2 _ _ _ _ _ _ 4 _ _		
3	If	_ _ _ _ _ 2 _	Ia	2 _ _ _ _ _ _
4	I	2 _ _ 0 _ _ _		
5	II	000000000	VIII	FG, F7, FX, OX,TP,MT,F1
6	Ic	_ _ B,D _ _ _ _	Ia	2 _ _ _ _ _ _
7			II	_ _ _ AF _ _ _ _ _ _ _ BF _ _ _ _ _ _ _ BG _ _ _ _ _ _ _ BH _ _ _ _ _ _ _ GG _ _ _ _ _ _ _ JF _ _ _ _ _ _ _ JG _ _ _ _
8			VIII	FG, F7
9	II	_ _ _ AA2 _ _ _ _ _ _ AB2 _ _ _		
10			II	_ _ _ _ _ _ _ 0
11			II	_ _ _ _ _ _ _ A _
12	If	_ _ _ _ _ A, G, 2 _		
13	II	_ _ _ _ _ _ _ 0 _	II VIII	_ _ _ _ _ _ _ T FG, F7
16	I	2 _ _ _ _ _ _		
17			II	_ _ _ JA _ _ _ _
18			II	JJG _ _ _ _ _ _ JKG _ _ _ _ _ _ JLG _ _ _ _ _ _
19			If	_ _ _ _ _ 2 _
20	If	_ _ _ _ _ A,G _		
21	I	_ _ _ _ 000		
22	Ic	_ _ E _ _ _ _		
23			II	000000000

FM Approvals[SM] is a service mark of FM Global
Hastelloy® is a registered trademark of Haynes International
Monel 400® is a registered trademark of Special Metals Corporation.
HART® is a registered trademark of HART Communication Foundation.
FOUNDATION™ Fieldbus is a registered trademark of Fieldbus Foundation.
Teflon® is a registered trademark of DuPont.
Neobee® is a registered trademark of Stepan Company.
Syltherm® 800 is a Trademark of Dow Corning Corporation
Klinger® C-4401 is a registered trademark of THERMOSEAL, INC
GRAFOIL® is a registered trademarks of GrafTech International Holdings Inc
Gylon® 3510 is registered trademark of Garlock Sealing Technologies
Tri-Clover Tri-Clamp® is a registered trademark of Alfa-Laval
DC® 200 and DC® 704 are registered trademarks of Dow Corning

FIELD INSTALLABLE REPLACEMENT PARTS

Description	Kit Number	Price
Integrally Mounted Advanced Indicator Kit (Compatible with all Electronic Modules)	50049846-501	Note P
Standard Display Module	50126003-501	Note P
Terminal Strip w/ Lightning Protection Kit for HART or DE Modules	50075472-532	Note P
Terminal Strip w/ Lightning Protection Kit for FFB Module	50075472-534	Note P
Terminal Strip w/o Lightning Protection for HART or DE Modules	50075472-531	Note P
Terminal Strip w/o Lightning Protection FFB Module	50075472-533	Note P
HART Electronics Module	50049849-501	Note P
HART Electronics Module w/ connection for external configuration buttons	50049849-502	Note P
DE Electronics Module	50049849-503	Note P
DE Electronics Module w/ connection for external configuration buttons	50049849-504	Note P
FFB Electronics Module Kit	50049849-507	Note P
FFB Electronics Module w/ connection for external configuration buttons	50049849-508	Note P

Note P - For part number pricing please refer to WEB Channel

PRODUCT MANUALS

Description	Part Number
Paper Manual ST 800 Smart Transmitter User Manual - English	34-ST-25-35
Paper Manual ST 800 Smart Transmitter HART/DE Communications Manual - English	34-ST-25-38
Paper Manual ST 800 Smart Transmitter Safety Manual - English	34-ST-25-37
Paper Manual ST 800 Smart Transmitter Foundation Fieldbus Manual - English	34-ST-25-39
Paper Manual ST 800 Smart Transmitter Function Block Manual - English	34-ST-25-42

Sales and Service

For application assistance, current specifications, ordering, pricing, and name of the nearest Authorized Distributor, contact one of the offices below.

ASIA PACIFIC
Honeywell Process Solutions,
Phone: + 800 12026455 or
+44 (0) 1202645583
(TAC) hfs-tac-support@honeywell.com

Australia
Honeywell Limited
Phone: +(61) 7-3846 1255
FAX: +(61) 7-3840 6481
Toll Free 1300-36-39-36
Toll Free Fax:
1300-36-04-70

China – PRC - Shanghai
Honeywell China Inc.
Phone: (86-21) 5257-4568
Fax: (86-21) 6237-2826

Singapore
Honeywell Pte Ltd.
Phone: +(65) 6580 3278
Fax: +(65) 6445-3033

South Korea
Honeywell Korea Co Ltd
Phone: +(822) 799 6114
Fax: +(822) 792 9015

EMEA
Honeywell Process Solutions,
Phone: + 800 12026455 or
+44 (0) 1202645583

Email: (Sales)
FP-Sales-Apps@Honeywell.com
or
(TAC)
hfs-tac-support@honeywell.com

Web
Knowledge Base search
engine http://bit.ly/2N5VIdi

AMERICAS
Honeywell Process Solutions,
Phone: (TAC) (800) 423-9883
or (215) 641-3610
(Sales) 1-800-343-0228

Email: (Sales)
FP-Sales-Apps@Honeywell.com
or
(TAC)
hfs-tac-support@honeywell.com

Web
Knowledge Base search
engine http://bit.ly/2N5VIdi

Specifications are subject to change without notice.

For more information
To learn more about SmartLine Pressure Transmitters, visit
www.process.honeywell.comOr contact
your Honeywell Account Manager

Process Solutions
Honeywell
1250 W Sam Houston Pkwy S
Houston, TX 77042

Honeywell Control Systems Ltd
Honeywell House, Skimped Hill Lane
Bracknell, England, RG12 1EB

Shanghai City Centre, 100 Jungi Road
Shanghai, China 20061

www.process.honeywell.com

Honeywell

34-ST-03-88
February 2025
©2025 Honeywell International Inc.

Artisan Technology Group is an independent supplier of quality pre-owned equipment

Gold-standard solutions

Extend the life of your critical industrial, commercial, and military systems with our superior service and support.

We buy equipment

Planning to upgrade your current equipment? Have surplus equipment taking up shelf space? We'll give it a new home.

Learn more!

Visit us at **artisantg.com** for more info on price quotes, drivers, technical specifications, manuals, and documentation.

Artisan Scientific Corporation dba Artisan Technology Group is not an affiliate, representative, or authorized distributor for any manufacturer listed herein.

We're here to make your life easier. How can we help you today?

(217) 352-9330 | sales@artisantg.com | artisantg.com

ARTISAN® TECHNOLOGY GROUP