

ARTISAN®
TECHNOLOGY GROUP

Your **definitive** source for quality pre-owned equipment.

Artisan Technology Group
(217) 352-9330 | sales@artisantg.com | artisantg.com

Full-service, independent repair center
with experienced engineers and technicians on staff.

We buy your excess, underutilized, and idle equipment
along with credit for buybacks and trade-ins.

Custom engineering
so your equipment works exactly as you specify.

- Critical and expedited services
- In stock / Ready-to-ship
- Leasing / Rentals / Demos
- ITAR-certified secure asset solutions

Expert team | Trust guarantee | 100% satisfaction

All trademarks, brand names, and brands appearing herein are the property of their respective owners.

Visit our website - *Click HERE*

GT3A Series — Analog Timers

Key features of the GT3A series include:

- 4 selectable operation modes on each model
- External start, reset, and pause inputs
- Panel mount or socket mount
- Large variety of timing functions
- Power and output status indicating LEDs



UL, c-UL Listed
File No. E55996

Specifications

	GT3A-1	GT3A-2	GT3A-3	GT3A-4,-5,-6
Operation	Multi-mode			Multi-mode with inputs (11 pins)
Time Range	0.1s to 180 hours			
Rated Voltage	100 to 240V AC, 50/60Hz 12V DC 24V AC, 50/60Hz / 24V DC			
Contact Ratings	125V AC/250V AC, 3A; 30V DC, 1A (resistive load)		125V AC/250V AC, 5A; 30V DC, 5A (resistive load)	
Minimum Applicable Load	5V, 10mA (reference value)			
Voltage Tolerance	AF20 (100V AC): 85 to 264V AC AD24: 20.4 to 26.4V AC/21.6 to 26.4V DC D12: 10.8 to 13.2V DC			
Error	±0.2%, ±10 msec (repeat, voltage, temperature)			
Setting Error	±10% maximum			
Reset Time	60msec maximum			
Insulation Resistance	100MW minimum			
Dielectric Strength	Between power and output terminals: 2,000V AC, 1 minute Between contacts of different poles: 2,000V AC, 1 minute Between contacts of the same pole: 750V AC, 1 minute			
Power Consumption (approximate)	Delayed SPDT	Delayed SPDT + instantaneous SPDT	Delayed DPDT	Delayed DPDT
	10.8VA (200V AC, 60Hz)	13.5VA (200V AC, 60Hz)	14.4VA (200V AC, 60Hz)	4.7VA (100V AC, 60Hz), 14.4VA (200V AC, 60Hz)
	—	12VDC/1W 24VDC/0.7W 24VAC/1.2VA	12VDC/1.1W 24VDC/0.6W 24VAC/1.3VA	12VDC/0.8W 24VDC/0.6W 24VAC/1.3VA
Mechanical Life	10,000,000 operations minimum		5,000,000 operations minimum	
Electrical LIfe	50,000 operations minimum (rated load)		100,000 operations minimum (rated load)	
Weight (approximate)	63g	73g	79g	80g
Vibration Resistance	100m/sec^2 (approximate 10G)			
Shock Resistance	Operating extremes: 100m/sec^2 (approximate 10G) Damage limits: 500m/sec^2 (approximate 50G)			
Operating Temperature	–10 to +50°C			
Operating Humidity	45 to 85% RH			
Storage Temperature	–30 to +80°C			
Housing Color	Gray			

Part Numbers

GT3A-1, -2, -3

Mode Of Operation	Rated Voltage Code	Time Range	Output	Contact	Complete Part No.	
					8-Pin	11-Pin
A: ON-delay 1 B: Interval 1 C: Cycle 1 D: Cycle 3	AF20: 100 to 240V AC (50/60Hz)	0.1 seconds to 180 hours	250V AC, 3A, 30V DC, 1A (resistive load)	Delayed SPDT	GT3A-1AF20	GT3A-1EAF20
	AF20: 100 to 240V AC (50/60Hz) D12: 12V DC AD24: 24V AC (50/60Hz)/24V DC			Delayed SPDT + Instantaneous SPDT	GT3A-2AF20	GT3A-2EAF20
					GT3A-2D12	GT3A-2ED12
					GT3A-2AD24	GT3A-2EAD24
			240V AC, 5A, 24V DC, 5A (resistive load)	Delayed DPDT	GT3A-3AF20	GT3A-3EAF20
					GT3A-3D12	GT3A-3ED12
					GT3A-3AD24	GT3A-3EAD24

1. For wiring schematics and timing diagrams for GT3A-1, -2, -3, see pages 807 and 808 respectively.
2. For more details about time ranges, see instructions on page 812.
3. For socket and accessory part numbers, see page 838.

GT3A-4, -5, -6


Mode of Operation	Rated Voltage Code	Time Range	Output	Contact	Input	Complete Part No.	
						A (11-pin)	B (11-pin)
A: ON-Delay 2 B: Cycle 2 C: Signal ON/OFF-Delay 1 D: Signal OFF-Delay 1	AF20: 100 to 240V AC (50/60Hz) D12: 12V DC AD24: 24V AC (50/60Hz)/24V DC	0.1 seconds to 180 hours	250V AC, 5A, 24V DC, 5A (resistive load)	Delayed DPDT	Start Reset Gate	GT3A-4AF20	GT3A-4EAF20
						GT3A-4D12	GT3A-4ED12
						GT3A-4AD24	GT3A-4EAD24
A: Interval 2 B: One-Shot Cycle C: Signal ON/OFF-Delay 2 D: Signal OFF-Delay 2	AF20: 100 to 240V AC (50/60Hz) AD24: 24V AC (50/60Hz)/24V DC					GT3A-5AF20	GT3A-5EAF20
						GT3A-5AD24	GT3A-5EAD24
A: One-Shot B: One-Shot ON-Delay C: One-Shot 2 D: Signal ON/OFF-Delay 3						GT3A-6AF20	GT3A-6EAF20
						GT3A-6AD24	GT3A-6EAD24

4. For wiring schematics and timing diagrams GT3A-4,-5,-6, see pages 809, 810, and 811 respectively.
5. For more details about time ranges, see instructions on page 812.
6. A (11-pin) and B (11-pin) differ in the way inputs are wired.
7. For socket and accessory part numbers, see page 838.
8. For the timing diagrams overview, see page 794.

Timing Diagrams/Schematics

GT3A-1 Timing Diagrams
Delayed SPDT


Operation Mode Selection

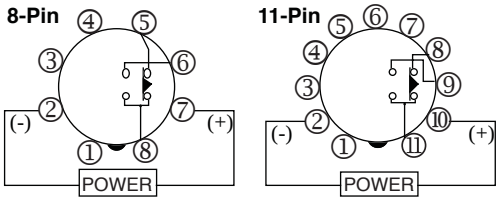

ON-Delay 1

MODE **A**




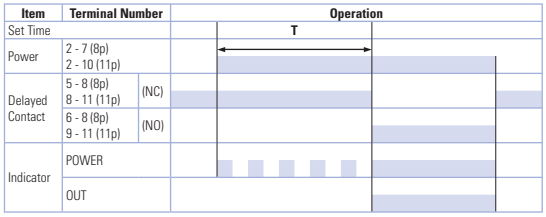

Interval 1

MODE **B**




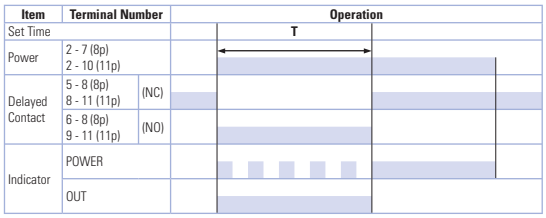

Cycle 1
(OFF first)

MODE **C**




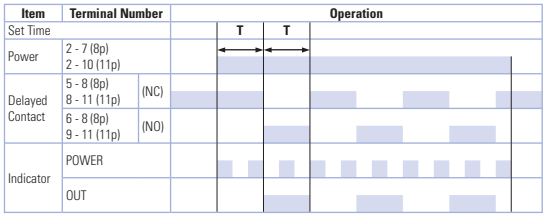

Cycle 3
(ON first)


MODE **D**



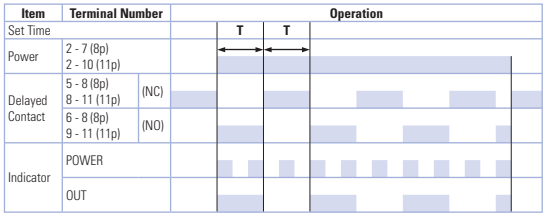

GT3A-2 Timing Diagrams
Delayed SPDT + Instantaneous SPDT

Operation Mode Selection

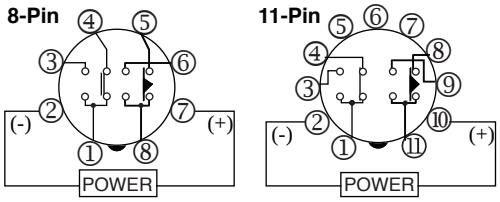

ON-Delay 1

MODE **A**



Item	Terminal Number		Operation
Set Time			T
Power	2 - 7 (8p) 2 - 10 (11p)		
Delayed Contact	5 - 8 (8p) 8 - 11 (11p)	(NC)	
	6 - 8 (8p) 9 - 11 (11p)	(NO)	
Instantaneous Contact	1 - 4	(NC)	
	1 - 3	(NO)	
Indicator	POWER		
	OUT		

Interval 1

MODE **B**



Item	Terminal Number		Operation
Set Time			T
Power	2 - 7 (8p) 2 - 10 (11p)		
Delayed Contact	5 - 8 (8p) 8 - 11 (11p)	(NC)	
	6 - 8 (8p) 9 - 11 (11p)	(NO)	
Instantaneous Contact	1 - 4	(NC)	
	1 - 3	(NO)	
Indicator	POWER		
	OUT		

Cycle 1
(OFF first)


MODE **C**



Item	Terminal Number		Operation
Set Time			T T
Power	2 - 7 (8p) 2 - 10 (11p)		
Delayed Contact	5 - 8 (8p) 8 - 11 (11p)	(NC)	
	6 - 8 (8p) 9 - 11 (11p)	(NO)	
Instantaneous Contact	1 - 4	(NC)	
	1 - 3	(NO)	
Indicator	POWER		
	OUT		

GT3A-3 Timing Diagrams
Delayed DPDT

Operation Mode Selection

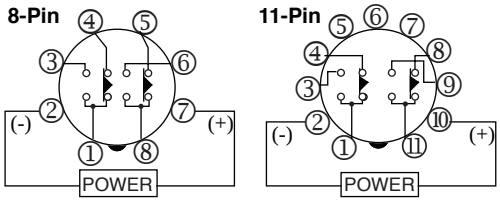

ON-Delay 1

MODE **A**



Item	Terminal Number		Operation
Set Time			T
Power	2 - 7 (8p) 2 - 10 (11p)		
Delayed Contact	1 -4, 5 - 8 (8p) 1 -4, 8 - 11 (11p)	(NC)	
	1 -3, 6 - 8 (8p) 1 -3, 9 - 11 (11p)	(NO)	
Indicator	POWER		
	OUT		

Interval 1

MODE **B**



Item	Terminal Number		Operation
Set Time			T
Power	2 - 7 (8p) 2 - 10 (11p)		
Delayed Contact	1 -4, 5 - 8 (8p) 1 -4, 8 - 11 (11p)	(NC)	
	1 -3, 6 - 8 (8p) 1 -3, 9 - 11 (11p)	(NO)	
Indicator	POWER		
	OUT		

Cycle 1
(OFF first)

MODE **C**



Item	Terminal Number		Operation
Set Time			T T
Power	2 - 7 (8p) 2 - 10 (11p)		
Delayed Contact	1 -4, 5 - 8 (8p) 1 -4, 8 - 11 (11p)	(NC)	
	1 -3, 6 - 8 (8p) 1 -3, 9 - 11 (11p)	(NO)	
Indicator	POWER		
	OUT		

Cycle 3
(ON first)


MODE **D**



Item	Terminal Number		Operation
Set Time			T T
Power	2 - 7 (8p) 2 - 10 (11p)		
Delayed Contact	1 -4, 5 - 8 (8p) 1 -4, 8 - 11 (11p)	(NC)	
	1 -3, 6 - 8 (8p) 1 -3, 9 - 11 (11p)	(NO)	
Indicator	POWER		
	OUT		

GT3A-4 Timing Diagrams
Delayed DPDT

Operation
Mode Selection

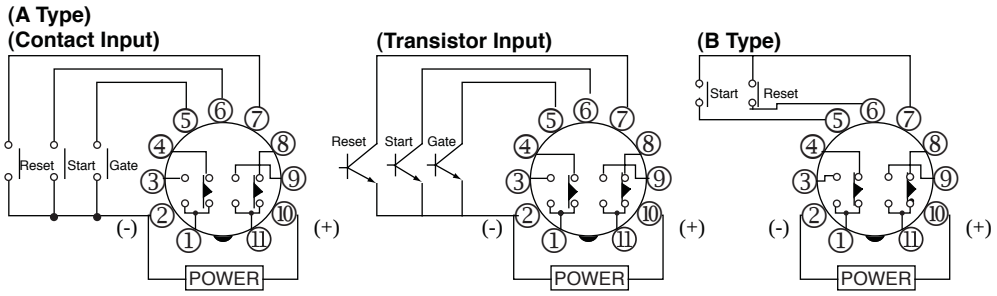


ON-Delay 2

MODE **A**



Item	Terminal Number		
Power	2 - 10 POWER		
Input	Start	2 - 6 (A) 5 - 7 (B)	ON or L
	Reset	2 - 7 (A) 6 - 7 (B)	ON or L
	Gate	2 - 5 (A)	ON or L
Delayed Contact	1 - 4 8 - 11		(NC)
	1 - 3 9 - 11		(NO)
Indicator	POWER		
	OUT		
Set Time			

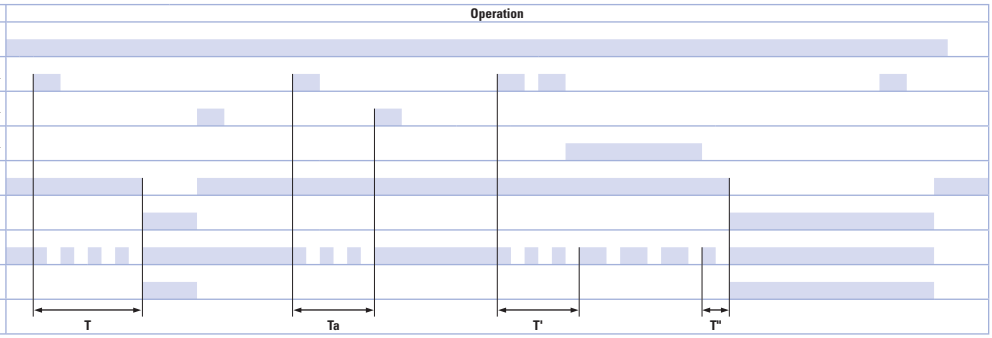


Cycle 2

MODE **B**



Item	Terminal Number		
Power	2 - 10 POWER		
Input	Start	2 - 6 (A) 5 - 7 (B)	ON or L
	Reset	2 - 7 (A) 6 - 7 (B)	ON or L
	Gate	2 - 5 (A)	ON or L
Delayed Contact	1 - 4 8 - 11		(NC)
	1 - 3 9 - 11		(NO)
Indicator	POWER		
	OUT		
Set Time			

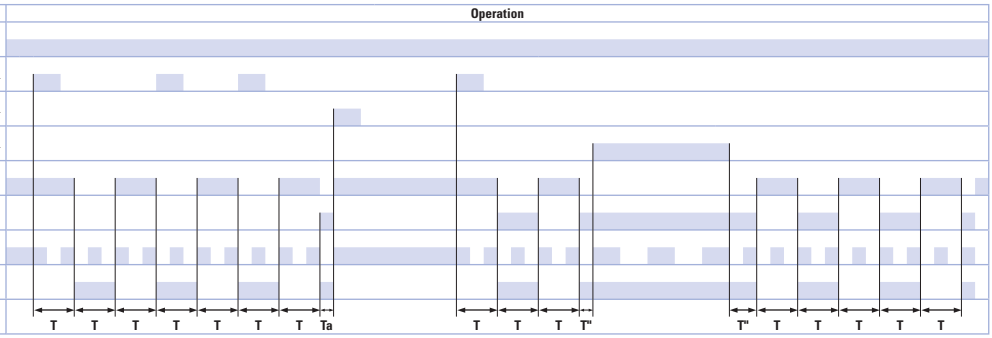


Signal ON/OFF-Delay 1

MODE **C**



Item	Terminal Number		
Power	2 - 10 POWER		
Input	Start	2 - 6 (A) 5 - 7 (B)	ON or L
	Reset	2 - 7 (A) 6 - 7 (B)	ON or L
	Gate	2 - 5 (A)	ON or L
Delayed Contact	1 - 4 8 - 11		(NC)
	1 - 3 9 - 11		(NO)
Indicator	POWER		
	OUT		
Set Time			

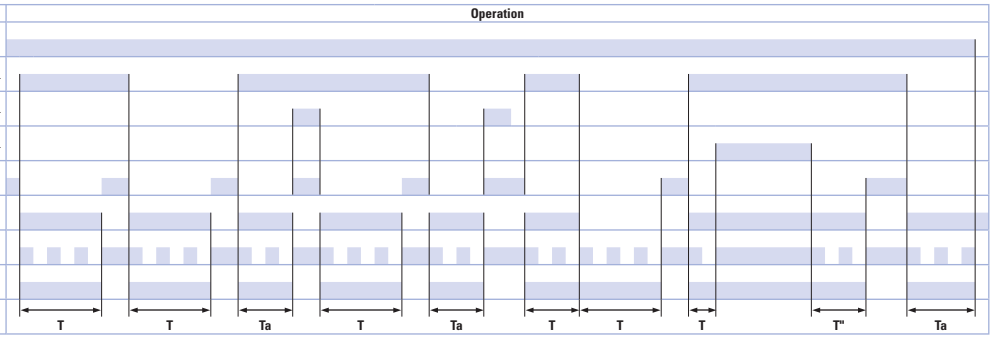


Signal OFF-Delay 1

MODE **D**




Item	Terminal Number		
Power	2 - 10 POWER		
Input	Start	2 - 6 (A) 5 - 7 (B)	ON or L
	Reset	2 - 7 (A) 6 - 7 (B)	ON or L
	Gate	2 - 5 (A)	ON or L
Delayed Contact	1 - 4 8 - 11		(NC)
	1 - 3 9 - 11		(NO)
Indicator	POWER		
	OUT		
Set Time			

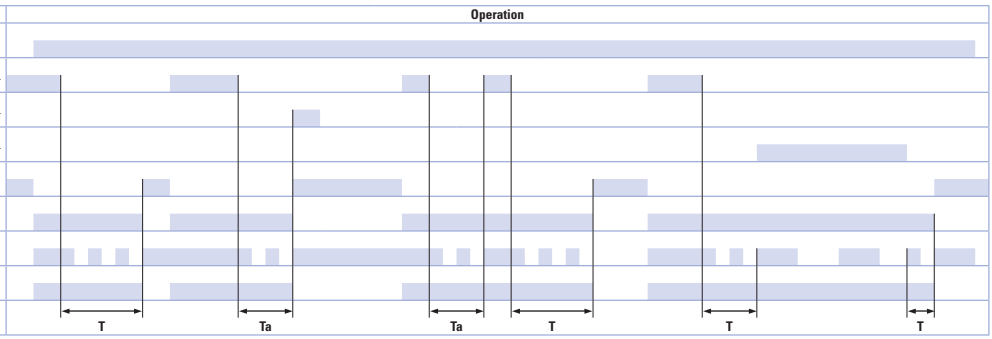

T = Set time Ta = Shorter than set time
T = T' + T"

GT3A-5 Timing Diagrams
Delayed DPDT

Operation Mode Selection

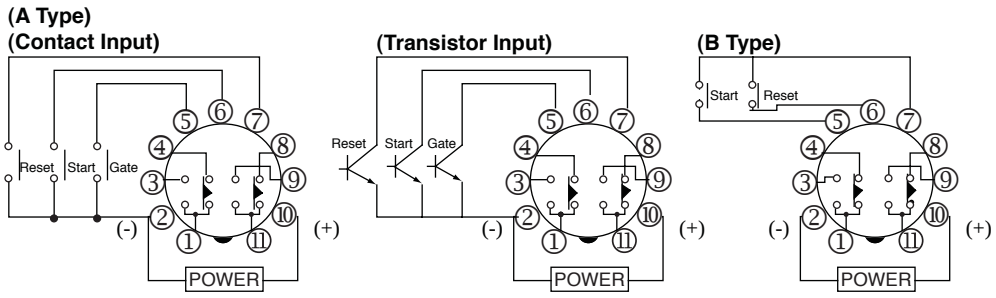


Interval 2

MODE **A**



Item	Terminal Number		
Power	2 - 10 POWER		
Input	Start	2 - 6 (A) 5 - 7 (B)	ON or L
	Reset	2 - 7 (A) 6 - 7 (B)	ON or L
	Gate	2 - 5 (A)	ON or L
Delayed Contact	1 - 4 8 - 11		(NC)
	1 - 3 9 - 11		(NO)
Indicator	POWER		
	OUT		
Set Time			

Operation

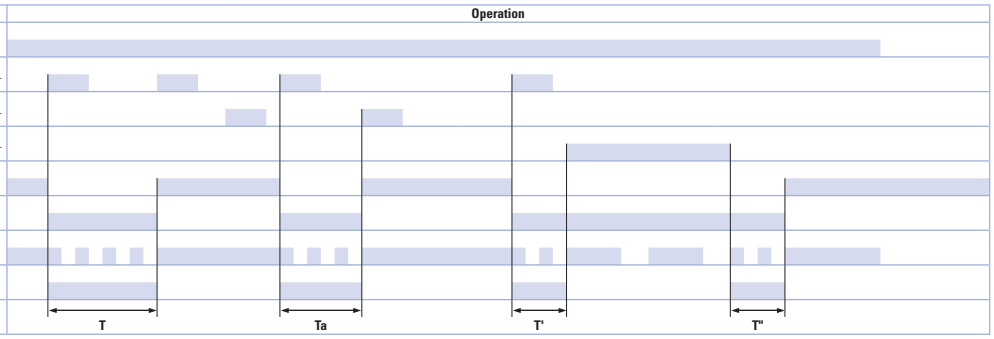


One-Shot Cycle

MODE **B**



Item	Terminal Number		
Power	2 - 10 POWER		
Input	Start	2 - 6 (A) 5 - 7 (B)	ON or L
	Reset	2 - 7 (A) 6 - 7 (B)	ON or L
	Gate	2 - 5 (A)	ON or L
Delayed Contact	1 - 4 8 - 11		(NC)
	1 - 3 9 - 11		(NO)
Indicator	POWER		
	OUT		
Set Time			

Operation

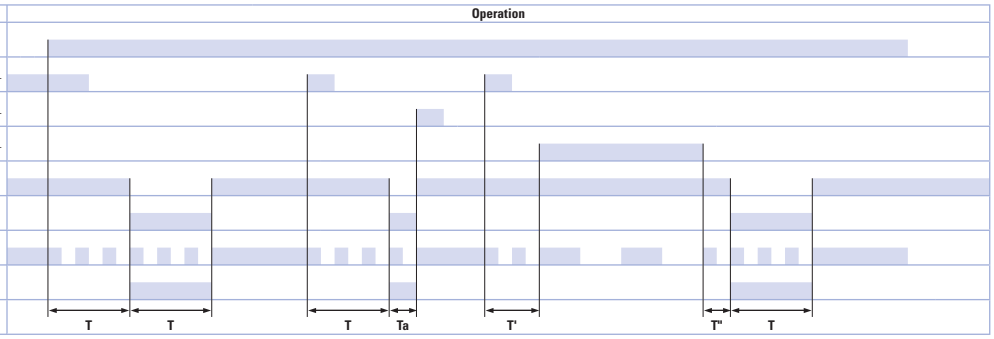


Signal ON/OFF-Delay 2

MODE **C**



Item	Terminal Number		
Power	2 - 10 POWER		
Input	Start	2 - 6 (A) 5 - 7 (B)	ON or L
	Reset	2 - 7 (A) 6 - 7 (B)	ON or L
	Gate	2 - 5 (A)	ON or L
Delayed Contact	1 - 4 8 - 11		(NC)
	1 - 3 9 - 11		(NO)
Indicator	POWER		
	OUT		
Set Time			

Operation

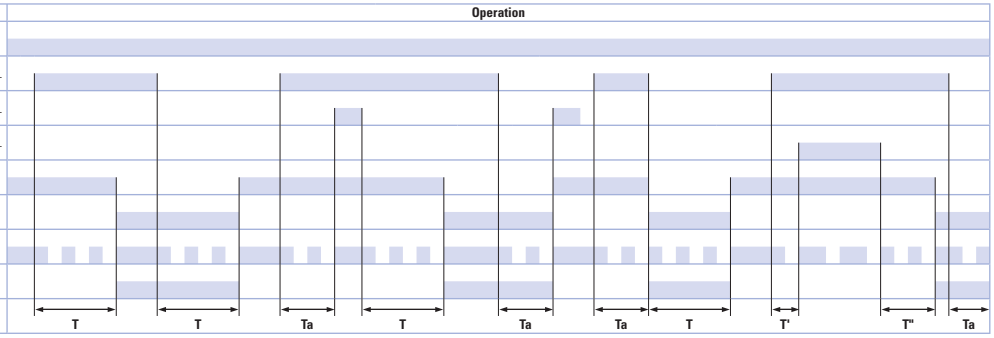


Signal OFF-Delay 2

MODE **D**



Item	Terminal Number		
Power	2 - 10 POWER		
Input	Start	2 - 6 (A) 5 - 7 (B)	ON or L
	Reset	2 - 7 (A) 6 - 7 (B)	ON or L
	Gate	2 - 5 (A)	ON or L
Delayed Contact	1 - 4 8 - 11		(NC)
	1 - 3 9 - 11		(NO)
Indicator	POWER		
	OUT		
Set Time			


Operation

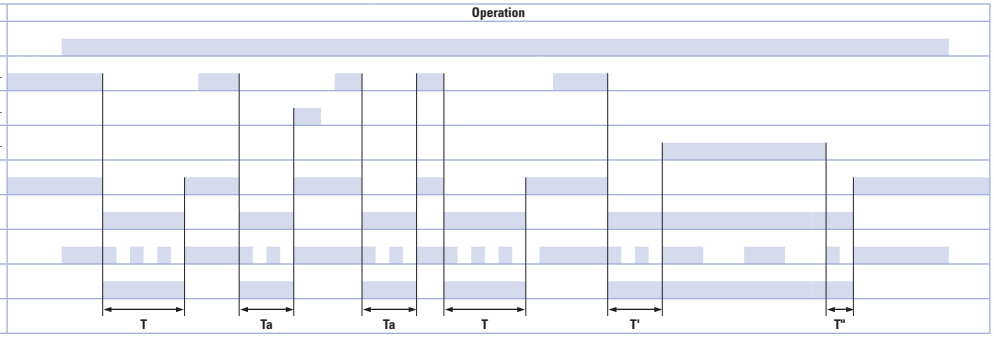

T = Set time Ta = Shorter than set time
T = T' + T"

GT3A-6 Timing Diagrams
Delayed DPDT

Operation Mode Selection

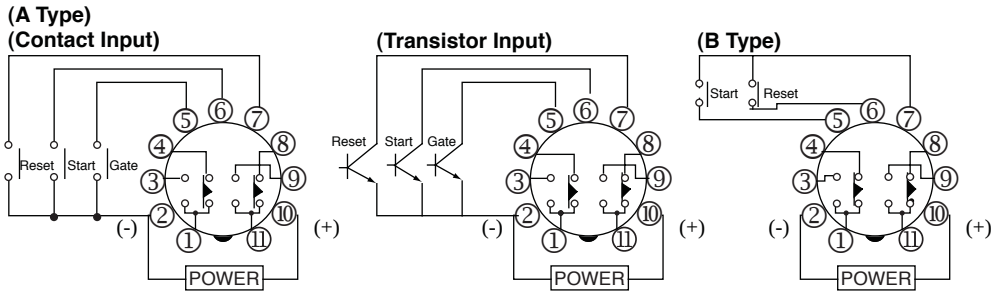


One-Shot 1

MODE **A**



Item	Terminal Number		
Power	2 - 10 POWER		
Input	Start	2 - 6 (A) 5 - 7 (B)	ON or L
	Reset	2 - 7 (A) 6 - 7 (B)	ON or L
	Gate	2 - 5 (A)	ON or L
Delayed Contact	1 - 4 8 - 11		(NC)
	1 - 3 9 - 11		(NO)
Indicator	POWER		
	OUT		
Set Time			

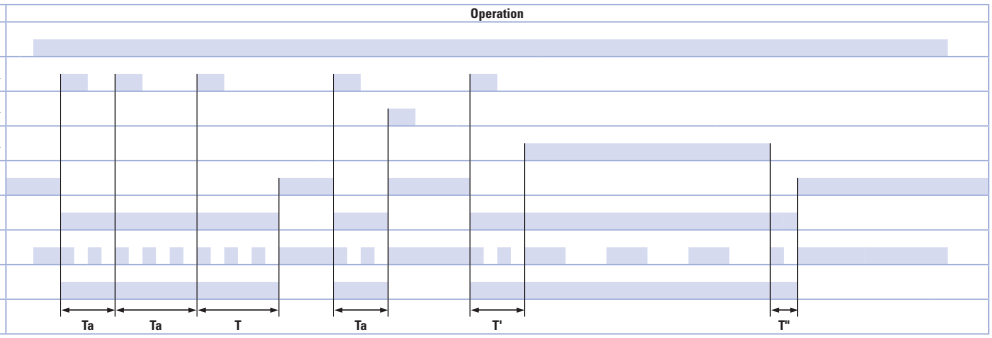


One-Shot ON-Delay

MODE **B**



Item	Terminal Number		
Power	2 - 10 POWER		
Input	Start	2 - 6 (A) 5 - 7 (B)	ON or L
	Reset	2 - 7 (A) 6 - 7 (B)	ON or L
	Gate	2 - 5 (A)	ON or L
Delayed Contact	1 - 4 8 - 11		(NC)
	1 - 3 9 - 11		(NO)
Indicator	POWER		
	OUT		
Set Time			

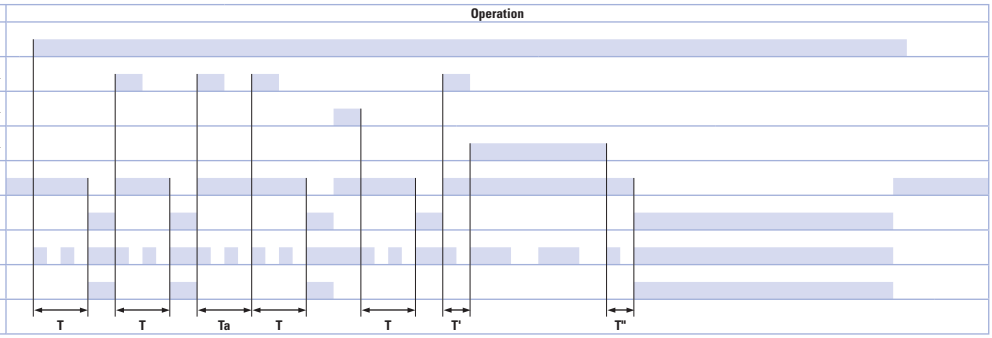


One-Shot 2

MODE **C**



Item	Terminal Number		
Power	2 - 10 POWER		
Input	Start	2 - 6 (A) 5 - 7 (B)	ON or L
	Reset	2 - 7 (A) 6 - 7 (B)	ON or L
	Gate	2 - 5 (A)	ON or L
Delayed Contact	1 - 4 8 - 11		(NC)
	1 - 3 9 - 11		(NO)
Indicator	POWER		
	OUT		
Set Time			

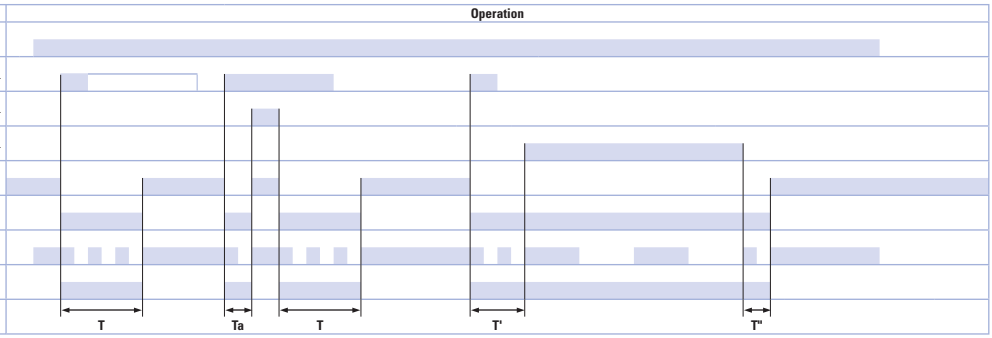


Signal ON/OFF-Delay 3

MODE **D**




Item	Terminal Number		
Power	2 - 10 POWER		
Input	Start	2 - 6 (A) 5 - 7 (B)	ON or L
	Reset	2 - 7 (A) 6 - 7 (B)	ON or L
	Gate	2 - 5 (A)	ON or L
Delayed Contact	1 - 4 8 - 11		(NC)
	1 - 3 9 - 11		(NO)
Indicator	POWER		
	OUT		
Set Time			

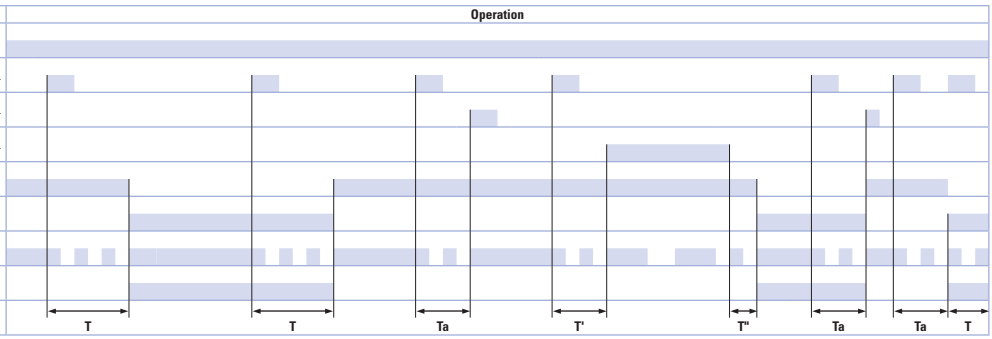

T = Set time Ta = Shorter than set time
T = T' + T"

Instructions: Setting GT3A Series Timers

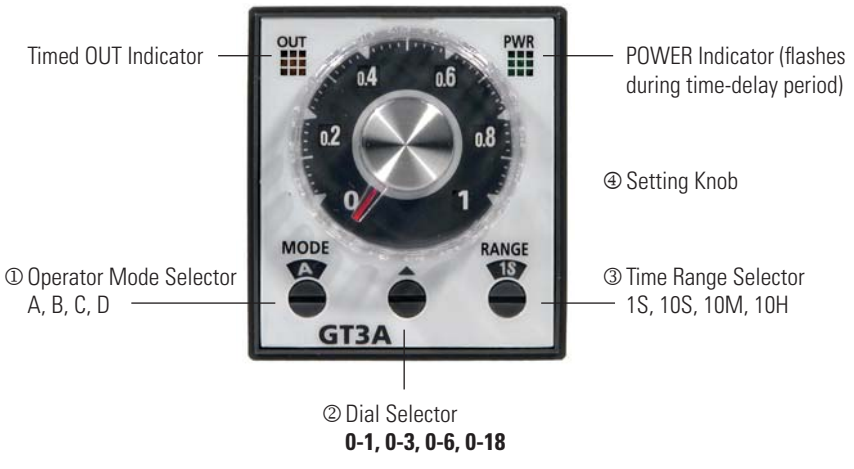

Step 1.	Desired Mode of Operation		Selection	Remarks
	For Timers	Mode of Operation	① Operation Mode Selector	
Select the desired mode of operation.	GT3A-1 GT3A-2 GT3A-3	ON-delay 1	A	The desired operation mode can be selected from the A, B, C, and D modes using the Operation Mode Selector. Change the operation mode from A to B, C, and D in turn by turning the operation mode selector clockwise using a flat screwdriver which is a maximum of 0.156" (4mm) wide. The selected mode is displayed in the window.
		Interval 1	B	
		Cycle 1	C	
		Cycle 3	D	
	GT3A-4	ON-delay 2	A	
		Cycle 2	B	
		Signal ON/OFF-delay 1	C	
		Signal OFF-delay 1	D	
	GT3A-5	Interval 2	A	
		One-shot cycle	B	
		Signal ON/OFF-delay 2	C	
		Signal OFF-delay 2	D	
	GT3A-6	One-shot 1	A	
		One-shot ON-delay	B	
		One-shot 2	C	
		Signal ON/OFF-delay 3	D	

Step 2.	Desired Time Range	Selection		Remarks
	Time Ranges	② Dial Selector	③ Time Range Selector	
Select the time range that contains the desired time period.	0.05 seconds to 1 second	0-1	1S	The desired time range is selected by setting both ② Dial Selector and ③ Time Range Selector.
	0.1 seconds to 3 seconds	0-3		
	0.1 seconds to 6 seconds	0-6		
	0.15 seconds to 18 seconds	0-18		
	0.1 seconds to 10 seconds	0-1	10S	
	0.3 seconds to 30 seconds	0-3		
	0.6 seconds to 60 seconds	0-6		
	1.8 seconds to 180 seconds	0-18		
	6 seconds to 10 minutes	0-1	10M	
	18 seconds to 30 minutes	0-3		
	36 seconds to 60 minutes	0-6		
	108 seconds to 180 minutes	0-18		
	6 minutes to 10 hours	0-1	10H	
	18 minutes to 30 hours	0-3		
	36 minutes to 60 hours	0-6		
	108 minutes to 180 hours	0-18		

Step 3.	Selection
Set the precise period of time desired by using the ④ Setting Knob.	

GT3D — Digital Timers

Key features of the GT3D series include:

- Precise time setting using digital thumbwheel switches
- Elapsed or time remaining LCD display
- 6 time ranges, 16 timing functions
- Time delays up to 99.9 hours



UL Recognized
File No. E55996

CSA Certified
File No. LR58183
File No. LR96764
File No. LR83814

Cert. No. BL9801133323911 (LVD)
Cert. No. E9971113332388 (EMC)

Specifications

		GT3D-2	GT3D-3	GT3D-4	GT3D-8
Operation System		Solid state CMOS circuitry			
Operation		Multi-mode			Multi-mode one-shot output
Time Range		0.01s to 99.9 hours			
Rated Voltage		100 to 240V AC (50/60Hz), 24V AC (50/60Hz)/24V DC			
Contact Ratings		125V AC/250V AC, 3A; 30V DC/1A (resistive load)	125V AC/250V AC, 5A; 30V DC/5A (resistive load)		
Contact Form		Delayed SPDT + instantaneous SPDT	Delayed DPDT	Delayed DPDT	Delayed DPDT
Minimum Applicable Load		5V, 10mA (reference value)			
Voltage Tolerance		AF20 (100–240V AC): 85 to 264V AC AD24 (AC): 20.4 to 26.4V AC AD24 (DC): 21.6 to 26.4V DC			
Error		±0.3% ±50ms (voltage, repeat, and temperature)			
Setting Error		±0.5% ±50ms			
Reset Time		60ms maximum			
Insulation Resistance		100MΩ minimum			
Dielectric Strength		Between power and output terminals: 2,000V AC, 1 minute Between contacts of different poles: 2,000V AC, 1 minute Between contacts of the same pole: 750V AC, 1 minute			
Power Consumption (approximate)	**AF20**	11.8VA	11.6VA	3.7VA (100V AC, 60Hz) 11.6VA (200V AC, 60Hz)	
	AD24 AC/DC	1VA/0.8W	2.1VA/0.9W	2.1VA /0.9W	
Mechanical Life		10,000,000 operations minimum	5,000,000 operations minimum		
Electrical Life (at rated load)		50,000 operations minimum	100,000 operations minimum		
Outputs	**Relay**	250V AC, 3A, 30V DC, 1A (resistive load)	240V AC/, 24V DC, 5A (resistive load)		
Vibration Resistance		100N (approximate 10G)			
Shock Resistance		Operating extremes: 100N (approximate 10G) Damage limits: 500N (approximate 50G)			
Operating Temperature		–10 to +50°C			
Storage Temperature		–30 to +80°C			
Operating Humidity		45 to 85% RH			
Weight (approximate)		70g	75g	76g	
Housing Color		Gray			

Part Number List

Part Numbers: GT3D-1/GT3D-2/GT3D-3

Mode of Operation	Time Range	Output	Contact	Rated Voltage Code	Complete Part No.	
					8-Pin	11-Pin
1-A: ON-delay 1 1-B: Interval 1 first 1-C: Cycle 1 (OFF first) 1-D: Cycle 3 (ON first)	0.01s to 99.9 hours	250V AC, 3A, 30V DC, 1A (resistive load)	Delayed SPDT + instantaneous SPDT	100 to 240V AC (50/60Hz)	GT3D-2AF20	GT3D-2EAF20
				24V AC/DC	GT3D-2AD24	—
		240V AC, 24V DC, 5A (resistive load)	Delayed DPDT	100 to 240V AC (50/60Hz)	GT3D-3AF20	GT3D-3EAF20
				24V AC/DC	GT3D-3AD24	—

Part Numbers: GT3D-4

Mode of Operation	Time Range	Output	Contact	Rated Voltage Code	Complete Part No.	
					A (11-Pin)	B (11-Pin)
1-A: ON-delay 1 1-B: Interval 1 first 1-C: Cycle 1 (OFF first) 1-D: Cycle 3 (ON first) 2-A: ON-delay 2 2-B: Cycle 2 2-C: Signal ON/OFF-delay 1 2-D: Signal OFF-delay 1 2-E: Interval 2 2-F: One-shot cycle 3-A: Signal ON/OFF-delay 2 3-B: Signal OFF-delay 2 3-C: One-shot 1 3-D: One-shot ON-delay 3-E: One-shot 2 3-F: Signal ON/OFF-delay 3	0.01s to 99.9 hours	240V AC/24V DC, 5A (resistive load)	Delayed DPDT	100 to 240V AC (50/60Hz)	GT3D-4AF20	GT3D-4EAF20
				24V AC/DC	GT3D-4AD24	—

Part Numbers: GT3D-8


Mode of Operation	Time Range	Output	Contact	Rated Voltage Code	Complete Part No. (11-Pin)
1: ON-delay one-shot 1 2: Cycle one-shot 3: ON-delay one-shot 2	0.01s to 99.9 hours	240V AC/24V DC, 5A (resistive load)	Delayed DPDT	100 to 240V AC (50/60Hz)	GT3D-8AF20
				24V AC/DC	GT3D-8AD24

1. For wiring schematics and timing diagrams GT3D, see pages 815 to 822.
2. For more details about time ranges, see instructions on page 823.
3. A (11-pin) and B (11-pin) differ in the way inputs are wired.
4. For socket and accessory part numbers, see page 838.
5. For timing diagrams overview, see page 794.

Timing Diagrams/Schematics

GT3D-2 Timing Diagrams
Delayed SPDT + Instantaneous SPDT


Operation Mode Selection

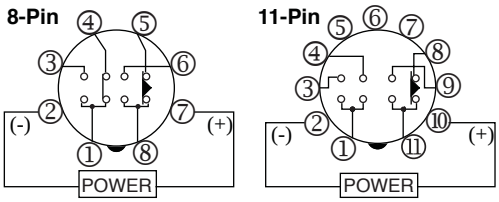

ON-Delay 1

Time Remaining: 1 — A


Time Elapsed: 1 — A

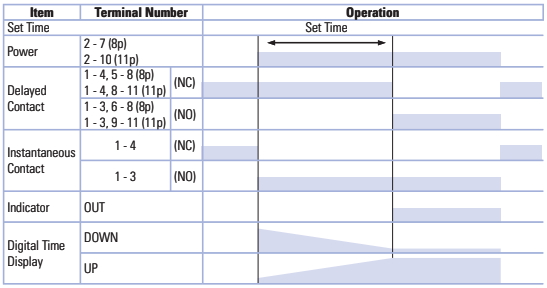

Interval 1

Time Remaining: 1 — B


Time Elapsed: 1 — B

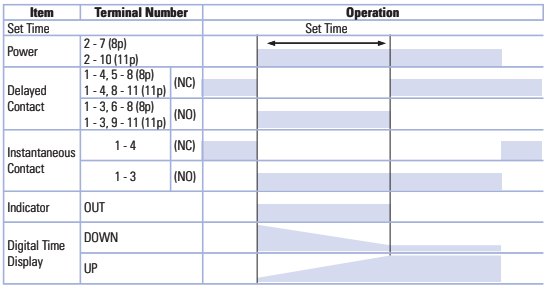

Cycle 1
(OFF first)

Time Remaining: 1 — C


Time Elapsed: 1 — C

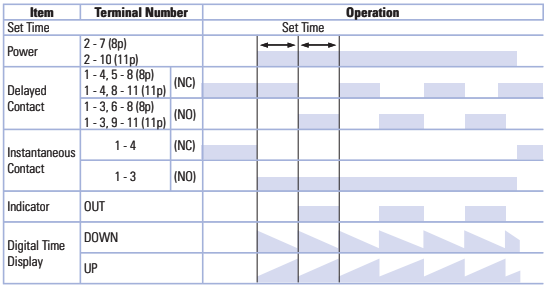

Cycle 3
(ON first)


Time Remaining: 1 — D

Time Elapsed: 1 — D

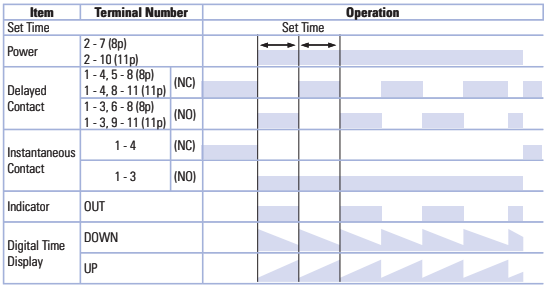

GT3D-3 Timing Diagrams
Delayed DPDT

Operation Mode Selection

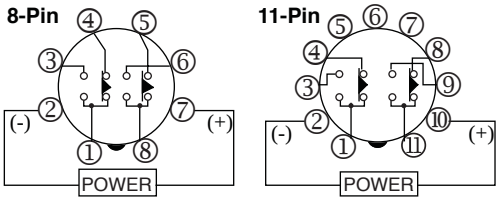

ON-Delay 1

Time Remaining: 1 — A

Time Elapsed: 1 — A

Item	Terminal Number		Operation
Set Time			Set Time
Power	2 - 7 (8p) 2 - 10 (11p)		
Delayed Contact	1 - 4, 5 - 8 (8p) 1 - 4, 8 - 11 (11p)	(NC)	
	1 - 3, 6 - 8 (8p) 1 - 3, 9 - 11 (11p)	(NO)	
Indicator	OUT		
Digital Time Display	DOWN		
	UP		

Interval 1

Time Remaining: 1 — B

Time Elapsed: 1 — B

Item	Terminal Number		Operation
Set Time			Set Time
Power	2 - 7 (8p) 2 - 10 (11p)		
Delayed Contact	1 - 4, 5 - 8 (8p) 1 - 4, 8 - 11 (11p)	(NC)	
	1 - 3, 6 - 8 (8p) 1 - 3, 9 - 11 (11p)	(NO)	
Indicator	OUT		
Digital Time Display	DOWN		
	UP		

Cycle 1
(OFF first)

Time Remaining: 1 — C

Time Elapsed: 1 — C

Item	Terminal Number		Operation
Set Time			Set Time
Power	2 - 7 (8p) 2 - 10 (11p)		
Delayed Contact	1 - 4, 5 - 8 (8p) 1 - 4, 8 - 11 (11p)	(NC)	
	1 - 3, 6 - 8 (8p) 1 - 3, 9 - 11 (11p)	(NO)	
Indicator	OUT		
Digital Time Display	DOWN		
	UP		

Cycle 3
(ON first)

Time Remaining: 1 — D

Time Elapsed: 1 — D


Item	Terminal Number		Operation
Set Time			Set Time
Power	2 - 7 (8p) 2 - 10 (11p)		
Delayed Contact	1 - 4, 5 - 8 (8p) 1 - 4, 8 - 11 (11p)	(NC)	
	1 - 3, 6 - 8 (8p) 1 - 3, 9 - 11 (11p)	(NO)	
Indicator	OUT		
Digital Time Display	DOWN		
	UP		

GT3D-4 Timing Diagrams

These timers require a start input. A gate and reset input are optional. Inputs are controlled by external pushbuttons. Reset occurs when the power is removed or when the reset input is supplied. The gate signal can be used to interrupt (freeze) timer functions. Timer functions resume when the gate input is removed. B style timers are not equipped for gate input.

Delayed DPDT

Operation Mode Selection

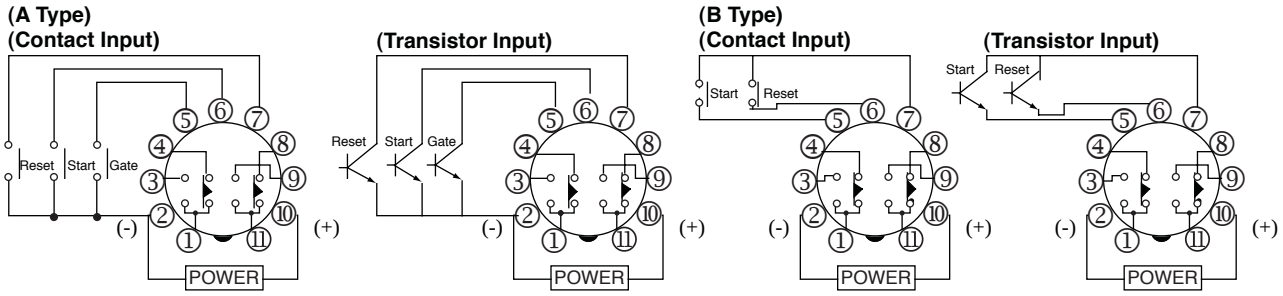


ON-Delay 1

Time Remaining



Time Elapsed



Item	Terminal Number			Operation
Power	2 - 10			
Delayed Contact	(NC)	1 - 4 8 - 11	8 - 11	
	(NO)	1 - 3 9 - 11	9 - 11	
Indicator	OUT			
Digital Time Display	DOWN			
	UP			
Set Time				T

Interval 1

Time Remaining



Time Elapsed



Item	Terminal Number			Operation
Power	2 - 10			
Delayed Contact	(NC)	1 - 4 8 - 11	8 - 11	
	(NO)	1 - 3 9 - 11	9 - 11	
Indicator	OUT			
Digital Time Display	DOWN			
	UP			
Set Time				T

GT3D-4 Timing Diagrams

Cycle 1
(OFF first)

Time Remaining



Time Elapsed




Item	Terminal Number			Operation
Power	2 - 10			
Delayed Contact	(NC)	1 - 4 8 - 11	8 - 11	
	(NO)	1 - 3 9 - 11	9 - 11	
Indicator	OUT			
Digital Time Display	DOWN			
	UP			
Set Time				

Cycle 3
(ON first)

Time Remaining



Time Elapsed




Item	Terminal Number			Operation
Power	2 - 10			
Delayed Contact	(NC)	1 - 4 8 - 11	8 - 11	
	(NO)	1 - 3 9 - 11	9 - 11	
Indicator	OUT			
Digital Time Display	DOWN			
	UP			
Set Time				

ON-Delay 2

Time Remaining



Time Elapsed



Item	Terminal Number			Operation
Power	2 - 10			
Input	Start ON or L	2 - 6 (A) 5 - 7 (B)	3 - 6	
	Reset ON or L	2 - 7 (A) 6 - 7 (B)	3 - 7	
	Gate ON or L	2 - 5 (A)	3 - 5	
Delayed Contact	(NC)	1 - 4 8 - 11	8 - 11	
	(NO)	1 - 3 9 - 11	9 - 11	
Indicator	OUT			
Digital Time Display	DOWN			
	UP			
Set Time				

GT3D-4 Timing Diagrams

Cycle 2

Time Remaining

2 — B

Time Elapsed

2 — B

Item	Terminal Number			Operation
Power	2 - 10			
Input	Start ON or L	2 - 6 (A) 5 - 7 (B)	3 - 6	
	Reset ON or L	2 - 7 (A) 6 - 7 (B)	3 - 7	
	Gate ON or L	2 - 5 (A)	3 - 5	
Delayed Contact	(NC)	1 - 4 8 - 11	8 - 11	
	(NO)	1 - 3 9 - 11	9 - 11	
Indicator	OUT			
Digital Time Display	DOWN			
	UP			
Set Time				

Signal ON/OFF-Delay 1

Time Remaining

2 — C

Time Elapsed

2 — C

Item	Terminal Number			Operation
Power	2 - 10			
Input	Start ON or L	2 - 6 (A) 5 - 7 (B)	3 - 6	
	Reset ON or L	2 - 7 (A) 6 - 7 (B)	3 - 7	
	Gate ON or L	2 - 5 (A)	3 - 5	
Delayed Contact	(NC)	1 - 4 8 - 11	8 - 11	
	(NO)	1 - 3 9 - 11	9 - 11	
Indicator	OUT			
Digital Time Display	DOWN			
	UP			
Set Time				

Singal OFF-Delay 1

Time Remaining

2 — D

Time Elapsed

2 — D

Item	Terminal Number			Operation
Power	2 - 10			
Input	Start ON or L	2 - 6 (A) 5 - 7 (B)	3 - 6	
	Reset ON or L	2 - 7 (A) 6 - 7 (B)	3 - 7	
	Gate ON or L	2 - 5 (A)	3 - 5	
Delayed Contact	(NC)	1 - 4 8 - 11	8 - 11	
	(NO)	1 - 3 9 - 11	9 - 11	
Indicator	OUT			
Digital Time Display	DOWN			
	UP			
Set Time				

Interval 2

Time Remaining

2 — E

Time Elapsed

2 — E

Item	Terminal Number			Operation
Power	2 - 10			
Input	Start ON or L	2 - 6 (A) 5 - 7 (B)	3 - 6	
	Reset ON or L	2 - 7 (A) 6 - 7 (B)	3 - 7	
	Gate ON or L	2 - 5 (A)	3 - 5	
Delayed Contact	(NC)	1 - 4 8 - 11	8 - 11	
	(NO)	1 - 3 9 - 11	9 - 11	
Indicator	OUT			
Digital Time Display	DOWN			
	UP			
Set Time				


GT3D-4 Timing Diagrams

One-Shot Cycle

Time Remaining **2** — **F**

Time Elapsed **2** — **F**

Item	Terminal Number		
Power	2 - 10		
Input	Start ON or L	2 - 6 (A) 5 - 7 (B)	3 - 6
	Reset ON or L	2 - 7 (A) 6 - 7 (B)	3 - 7
	Gate ON or L	2 - 5 (A)	3 - 5
Delayed Contact	(NC)	1 - 4 8 - 11	8 - 11
	(NO)	1 - 3 9 - 11	9 - 11
Indicator	OUT		
Digital Time Display	DOWN		
	UP		
Set Time			

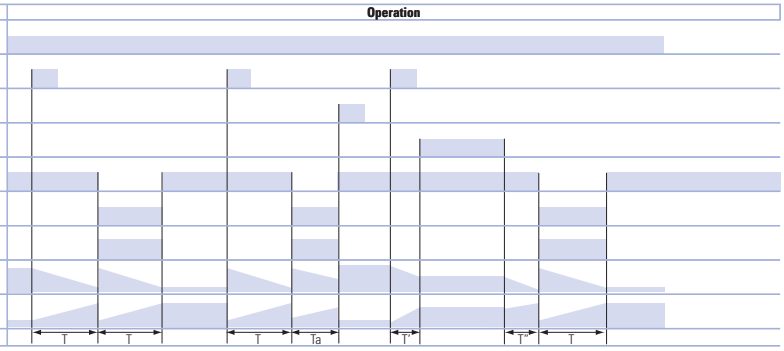


Signal ON/OFF-Delay 2

Time Remaining **3** — **A**

Time Elapsed **3** — **A**

Item	Terminal Number		
Power	2 - 10		
Input	Start ON or L	2 - 6 (A) 5 - 7 (B)	3 - 6
	Reset ON or L	2 - 7 (A) 6 - 7 (B)	3 - 7
	Gate ON or L	2 - 5 (A)	3 - 5
Delayed Contact	(NC)	1 - 4 8 - 11	8 - 11
	(NO)	1 - 3 9 - 11	9 - 11
Indicator	OUT		
Digital Time Display	DOWN		
	UP		
Set Time			

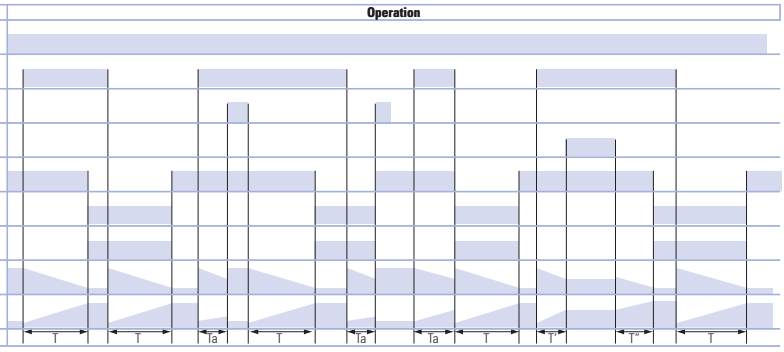


Singal OFF-Delay 2

Time Remaining **3** — **B**

Time Elapsed **3** — **B**

Item	Terminal Number		
Power	2 - 10		
Input	Start ON or L	2 - 6 (A) 5 - 7 (B)	3 - 6
	Reset ON or L	2 - 7 (A) 6 - 7 (B)	3 - 7
	Gate ON or L	2 - 5 (A)	3 - 5
Delayed Contact	(NC)	1 - 4 8 - 11	8 - 11
	(NO)	1 - 3 9 - 11	9 - 11
Indicator	OUT		
Digital Time Display	DOWN		
	UP		
Set Time			

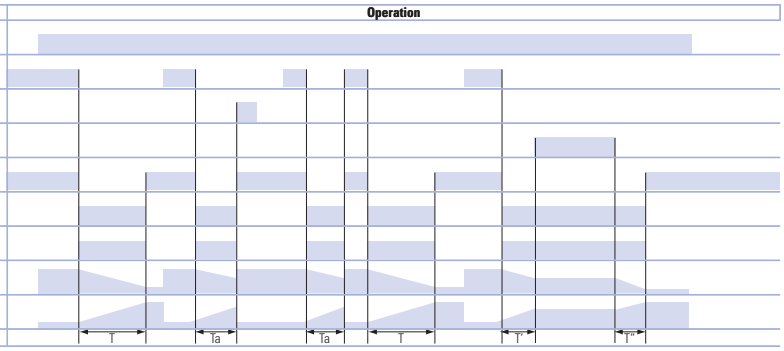


One-Shot 1

Time Remaining **3** — **C**

Time Elapsed **3** — **C**

Item	Terminal Number		
Power	2 - 10		
Input	Start ON or L	2 - 6 (A) 5 - 7 (B)	3 - 6
	Reset ON or L	2 - 7 (A) 6 - 7 (B)	3 - 7
	Gate ON or L	2 - 5 (A)	3 - 5
Delayed Contact	(NC)	1 - 4 8 - 11	8 - 11
	(NO)	1 - 3 9 - 11	9 - 11
Indicator	OUT		
Digital Time Display	DOWN		
	UP		
Set Time			

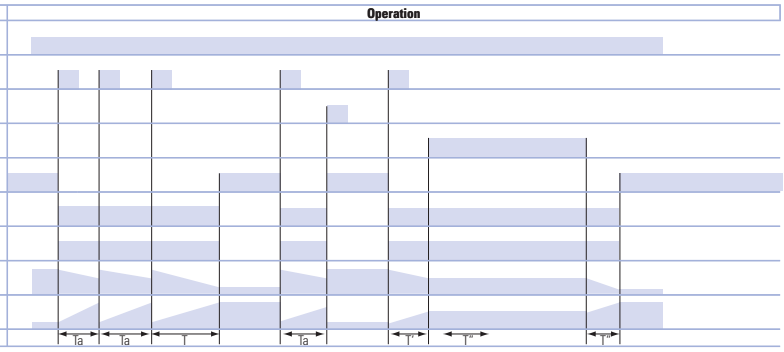


GT3D-4 Timing Diagrams

One-Shot ON-Delay

Time Remaining



Time Elapsed



Item	Terminal Number			Operation
Power	2 - 10			
Input	Start ON or L	2 - 6 (A) 5 - 7 (B)	3 - 6	
	Reset ON or L	2 - 7 (A) 6 - 7 (B)	3 - 7	
	Gate ON or L	2 - 5 (A)	3 - 5	
Delayed Contact	(NC)	1 - 4 8 - 11	8 - 11	
	(NO)	1 - 3 9 - 11	9 - 11	
Indicator	OUT			
Digital Time Display	DOWN			
	UP			
Set Time				

One-Shot 2

Time Remaining



Time Elapsed




Item	Terminal Number			Operation
Power	2 - 10			
Input	Start ON or L	2 - 6 (A) 5 - 7 (B)	3 - 6	
	Reset ON or L	2 - 7 (A) 6 - 7 (B)	3 - 7	
	Gate ON or L	2 - 5 (A)	3 - 5	
Delayed Contact	(NC)	1 - 4 8 - 11	8 - 11	
	(NO)	1 - 3 9 - 11	9 - 11	
Indicator	OUT			
Digital Time Display	DOWN			
	UP			
Set Time				

Signal ON/OFF-Delay 3

Time Remaining




Time Elapsed



Item	Terminal Number			Operation
Power	2 - 10			
Input	Start ON or L	2 - 6 (A) 5 - 7 (B)	3 - 6	
	Reset ON or L	2 - 7 (A) 6 - 7 (B)	3 - 7	
	Gate ON or L	2 - 5 (A)	3 - 5	
Delayed Contact	(NC)	1 - 4 8 - 11	8 - 11	
	(NO)	1 - 3 9 - 11	9 - 11	
Indicator	OUT			
Digital Time Display	DOWN			
	UP			
Set Time				

GT3D-8 Timing Diagrams
Delayed DPDT

Operation Mode Selection

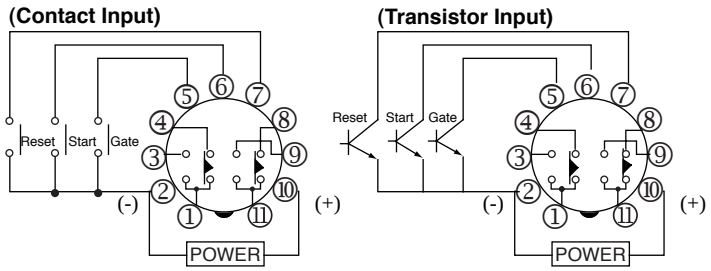

ON-Delay One-Shot 1

Time Remaining **1**

Time Elapsed **1**

Item	Terminal Number		Operation
Power	2 - 10		
Input	Start ON or L	2 - 6	
	Reset ON or L	2 - 7	
	Gate ON or L	2 - 5	
Delayed Contact	(NC)	1 - 4 8 - 11	
	(NO)	1 - 3 9 - 11	
Indicator	OUT		
Digital Time Display	DOWN		
	UP		
Set Time			

Cycle One-Shot

Time Remaining **2**

Time Elapsed **2**

Item	Terminal Number		Operation
Power	2 - 10		
Input	Start ON or L	2 - 6	
	Reset ON or L	2 - 7	
	Gate ON or L	2 - 5	
Delayed Contact	(NC)	1 - 4 8 - 11	
	(NO)	1 - 3 9 - 11	
Indicator	OUT		
Digital Time Display	DOWN		
	UP		
Set Time			

ON-Delay One-Shot 2


Time Remaining **3**

Time Elapsed **3**

Item	Terminal Number		Operation
Power	2 - 10		
Input	Start ON or L	2 - 6	
	Reset ON or L	2 - 7	
	Gate ON or L	2 - 5	
Delayed Contact	(NC)	1 - 4 8 - 11	
	(NO)	1 - 3 9 - 11	
Indicator	OUT		
Digital Time Display	DOWN		
	UP		
Set Time			

T = Set time
Ta = Shorter than set time
Tb = Shorter than single-shot output time
T = T' + T"
T0 = Single-shot output time (selected from A, B, C, D, E or F)

Instructions: Setting GT3D-2, GT3D-3 Timers

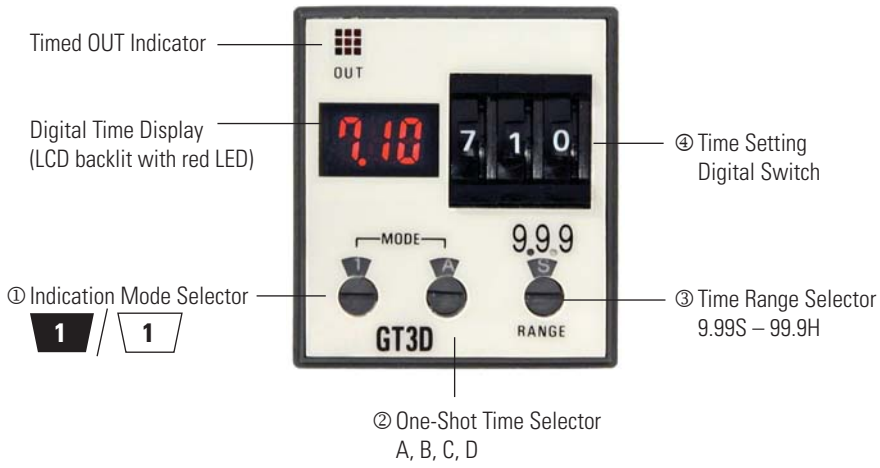


Step 1	Desired Mode/Selection				Remarks
	Time Display Mode	① Indicator Mode Selector	Operation Mode	② Operation Mode Selector	
Select the desired time display and operation modes.	Time elapsed	1	ON-delay 1	A	1. Use the flat screwdriver to set the selectors. Since selectors do not turn all the way around, both clockwise and counterclockwise rotation may be necessary. 2. The ① Indicator Mode Selector determines whether the Digital Time Display shows the time elapsed or time remaining. The ② Operation Mode Selector determines the desired operation mode. Decide which display and mode is desired, then use these two selectors ①② to set the operation mode. 3. The ① Operation Mode Selector has two blank modes which are not intended for use. Always have this selector set to A, B, C, or D.
	Time remaining	1		A	
	Time elapsed	1	Interval	B	
	Time remaining	1		B	
	Time elapsed	1	Cycle 1	C	
	Time remaining	1		C	
	Time elapsed	1	Cycle 3	D	
	Time remaining	1		D	

Step 2	Desired Operation	Selection		Remarks
	Base Time Ranges	③ Time Range Selector		
		Decimal Point Indicator	Time Increment Indicator	
Select a time range that contains the desired period of time.	0.01 seconds to 9.99 seconds	9.99	S	1. The ③ Time Range Selector controls both the decimal point indicator (9.99, 99.9, 999) and the time increment indicators S (seconds), M (minutes), and H (hours). 2. Chose which base time range contains the targeted timer setting. Then use the ③ Time Range Selector to set the decimal point indicator and time increment indicator to its corresponding pair of settings. 3. Since these configurations offer a complete range of settings from 0.01 seconds to 99.9 hours, the setting of 9.99 for minutes and the 9.99 and 999 settings for hours are not listed and should not be used.
	0.1 seconds to 99.9 seconds	99.9	S	
	1 second to 999 seconds	999	S	
	0.1 minutes to 99.9 minutes	99.9	M	
	1 minute to 999 minutes	999	M	
	0.1 hours to 99.9 hours	99.9	H	

Step 3	Desired Operation	Selection	Remarks
Set the precise period of time desired by using the ④ Time Setting Digital Switch.			Use the ④ Time Setting Digital Switch to set the desired period of time. It is important to remember that the setting of the ③ Time Range Selector determines the units of time measurement as well as the implied decimal point location.

It is important to remember that the ③ Time Range Selector not only selects the time range but also influences the interpretation of the Digital Time Display. Changing the ③ Time Range Selector setting changes the units of time measurement (seconds, minutes, hours) as well as the decimal point location.

Instructions: Setting GT3D-4 Timers

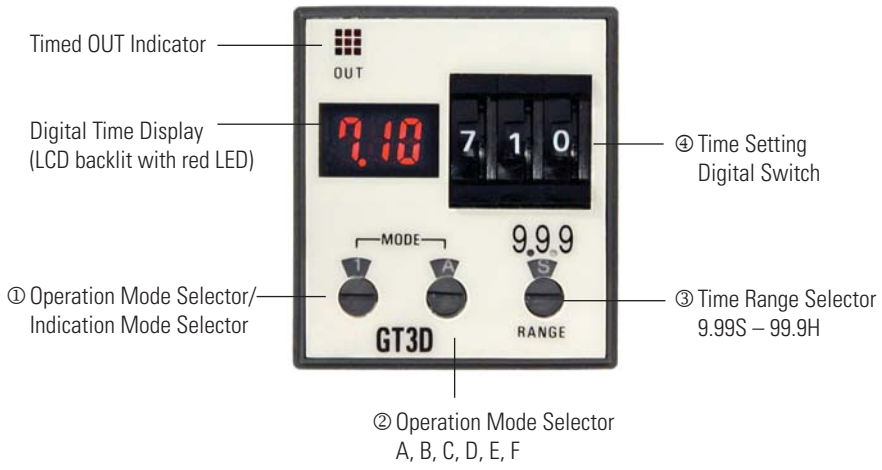


Step 1	Desired Mode/Selection				Remarks
	Time Display Mode	① Indicator Mode Selector	Operation Mode	② Operation Mode Selector	1. Use a flat screwdriver to set the selectors. Since selectors do not turn all the way around, both clockwise and counterclockwise rotation is necessary. 2. The ① Indicator Mode Selector determines whether the Digital Time Display shows the time elapsed or time remaining. The ② Operation Mode Selector determines the desired operation mode. Decide which display and mode is desired; then use these two selectors①② to set the operation mode. 3. When using the indicator mode setting "1," the ② Operation Mode Selector has two blank modes which are not intended for use. When using mode setting "1," always have the operation mode selector set to A, B, C, or D.
Select the desired time display and operation modes.	Time elapsed	1	ON-delay 1 Interval 1 Cycle 1 D: Cycle 3	A B C D	
	Time remaining	1			
	Time elapsed	2	ON-delay 2 Cycle 2 Signal ON/OFF-delay 2 Signal OFF-delay 1 Interval 2 One-shot cycle	A B C D E F	
	Time remaining	2			
	Time elapsed	3	Signal ON/OFF-delay 2 Signal OFF-delay 2 One-shot 1 One-shot ON-delay One-shot 2 Signal ON/OFF-delay 3	A B C D E F	
	Time remaining	3			

Step 2	Desired Operation	Selection		Remarks
	Base Time Ranges	③ Time Range Selector		1. The ③ Time Range Selector controls both the decimal point indicator (9.99, 99.9, 999) and the time increment indicators S (seconds), M (minutes), and H (hours). 2. Chose which base time range contains the targeted timer setting. Then use the ③ Time Range Selector to set the decimal point indicator and time increment indicator to its corresponding pair of settings. 3. Since these configurations offer a complete range of settings from 0.01 seconds to 99.9 hours, the setting of 9.99 for minutes and the 9.99 and 999 settings for hours are not listed and should not be used.
		Decimal Point Indicator	Time Increment Indicator	
Select a time range that contains the desired period of time.	0.01 seconds to 9.99 seconds	9.99	S	
	0.1 seconds to 99.9 seconds	99.9		
	1 second to 999 seconds	999		
	0.1 minutes to 99.9 minutes	99.9	M	
	1 minute to 999 minutes	999		
	0.1 hours to 99.9 hours	99.9	H	

Step 3	Desired Operation	Selection	Remarks
Set the precise period of time desired by using the ④ Time Setting Digital Switch.			Use the ④ Time Setting Digital Switch to set the desired period of time. It is important to remember that the setting of the ③ Time Range Selector determines the units of time measurement as well as the implied decimal point location.

It is important to remember that the ③ Time Range Selector not only selects the time range but also influences the interpretation of the Digital Time Display. Changing the ③ Time Range Selector setting changes the units of time measurement (seconds, minutes, hours) as well as the decimal point location.

Instructions: Setting GT3D-8 Timers

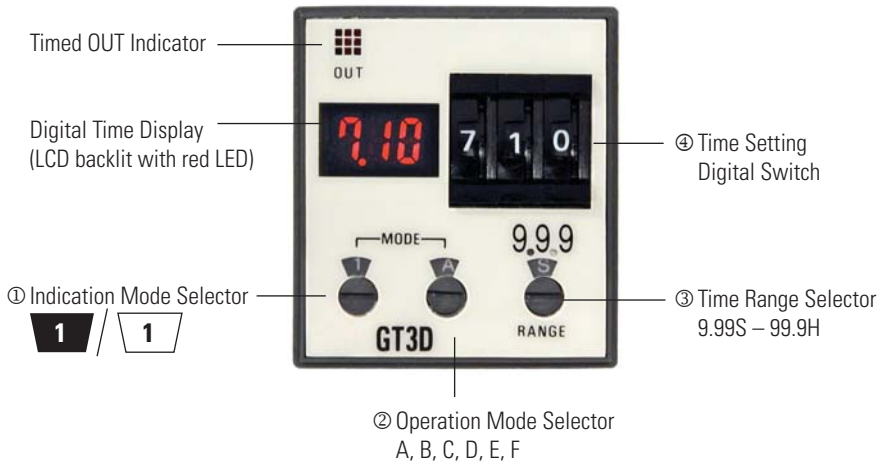

Step 1	Desired Mode of Operation		Selection	Remarks
	Operation Mode	Time Display Mode	① Indicator Mode Selector	
Select the time display and operation modes.	ON-Delay One-Shot	Time elapsed	1	1. Use a flat screwdriver to set the selectors. Since selectors do not turn all the way around, both clockwise and counterclockwise rotation is necessary. 2. The GT3D-8 ① Indicator Mode Selector selects both whether the Digital Time Display displays the time elapsed or time remaining and also the mode of operation. Decide which display and mode is desired. Then use this selector to set the operation mode.
		Time remaining	1	
	Cycle One-Shot	Time elapsed	2	
		Time remaining	2	
	ON-Delay One-Shot 2	Time elapsed	3	
		Time remaining	3	

Step 2	Desired Mode of Operation	Selection	Remarks
	Desired Single-Shot Output Time	② Single-Shot Output Time Selector	
Select the single shot output time.	0.1 seconds	A	On the GT3D-8 timers, the desired single-shot output time can be selected from the A, B, C, D, E, and F modes using the ② One-Shot Output Time Selector.
	0.5 seconds	B	
	1 second	C	
	5 seconds	D	
	10 seconds	E	
	50 seconds	F	

Step 3	Desired Operation	Selection		Remarks
	Base Time Ranges	③ Time Range Selector		
		Decimal Point Indicator	Time Increment Indicator	
Select a time range that contains the desired period of time.	0.01 seconds to 9.99 seconds	9.99	S	1. The ③ Time Range Selector controls both the decimal point indicator (9.99, 99.9, 999) and the time increment indicators S (seconds), M (minutes), and H (hours). 2. Chose which base time range contains the targeted timer setting. Then use the ③ Time Range Selector to set the decimal point indicator and time increment indicator to its corresponding pair of settings. 3. Since these configurations offer a complete range of settings from 0.01 seconds to 99.9 hours, the setting of 9.99 for minutes and the 9.99 and 999 settings for hours are not listed and should not be used.
	0.1 seconds to 99.9 seconds	99.9		
	1 second to 999 seconds	999		
	0.1 minutes to 99.9 minutes	99.9	M	
	1 minute to 999 minutes	999		
	0.1 hours to 99.9 hours	99.9	H	

Step 4	Desired Operation	Selection	Remarks
Set the precise period of time desired by using the ④ Time Setting Digital Switch.			Use the ④ Time Setting Digital Switch to set the desired period of time. It is important to remember that the setting of the ③ Time Range Selector determines the units of time measurement as well as the implied decimal point location.

It is important to remember that the ③ Time Range Selector not only selects the time range but also influences the interpretation of the Digital Time Display. Changing the ③ Time Range Selector setting changes the units of time measurement (seconds, minutes, hours) as well as the decimal point location.

GT3F Series — True OFF Delay Timers

Key features of the GT3F series include:

- "True" power OFF-delay up to 10 minutes
- No external control switch necessary
- Available with reset inputs
- Mountable in sockets or flush panel



c UL us UL, c-UL Listed
File No. E55996

CE

Specifications

	GT3F-1	GT3F-2
Operation	True power OFF-delay	
Time Range	0.1 seconds to 600 seconds	
Rated Voltage	100 to 240V AC, 50/60Hz 24V AC/DC	
Contact Rating	250V AC/30V DC, 5A (resistive load)	250V AC/30V DC, 3A (resistive load)
Contact Form	SPDT	DPDT
Minimum Power Application Time	1 second	
Voltage Tolerance	AF20: 100 to 240V AC AD24: 21.6 to 26.4VDC, 20.4 to 26.4VAC	
Repeat Error	±0.2%, ±10 msec	
Voltage Error	±0.2%, ±10 msec	
Temperature Error	±0.2%, ±10 msec	
Setting Error	±10% maximum	
Insulation Resistance	100MW minimum	
Dielectric Strength	Between power and output terminals: 2,000V AC, 1 minute (SPDT) 1,500V AC, 1 minute (DPDT) Between contacts on different poles: 1,000V AC, 1 minute (DPDT) Between contacts of the same pole: 750V AC, 1 minute	
Power Consumption	AF20: 3.7VA (200V AC, 60Hz) AD24: 0.8W (DC), 1.2VA (AC)	
Mechanical Life	20,000,000 operations minimum	
Electrical Life	100,000 operations minimum	
Vibration Resistance	100m/sec^2 (approximate 10G)	
Shock Resistance	Operating extremes: 100 m/sec^2 (approximate 10G) Damage limits: 500 m/sec^2 (approximate 50G)	
Operating Temperature	–10 to +50°C	
Storage Temperature	–30 to +80°C	
Operating Humidity	45 to 85% RH	
Weight (approximate)	77g	79g

1. An inrush current flows during the minimum power application time. AF20: approximate 0.4A, AD24: approximate 1.2A
2. GT3F does not read the preset time range shown on the knob after power is turned off. Note that minimizing the preset time, by turning the knob to zero, does not shorten the delay time after power is removed.

Part Numbering List

GT3F

Mode of Operation	Rated Voltage Code	Time Range	Output	Contact	Optional Input	Complete Part Number	
						8-Pin	11-Pin
Power OFF-delay	AF20: 100 to 240VAC (50/60Hz)	0.1 seconds to 600 seconds	250V AC, 5A,	Delayed SPDT	Reset	GT3F-1AF20	GT3F-1EAF20
			30V DC, 5A (resistive load)			GT3F-1AD24	GT3F-1EAD24
	AD24: 24V AC/DC		250V AC, 3A,	Delayed DPDT	None (8p) Reset (11p)	GT3F-2AF20	GT3F-2EAF20
			30V DC, 3A (resistive load)			GT3F-2AD24	GT3F-2EAD24


Optional reset input resets the contact to the OFF state before time out.

Timing Diagrams/Schematics


GT3F-1 Timing Diagrams

GT3F-1 (8-pin)	GT3F-1E (11-pin)

Delayed SPDT Output, with Reset Input

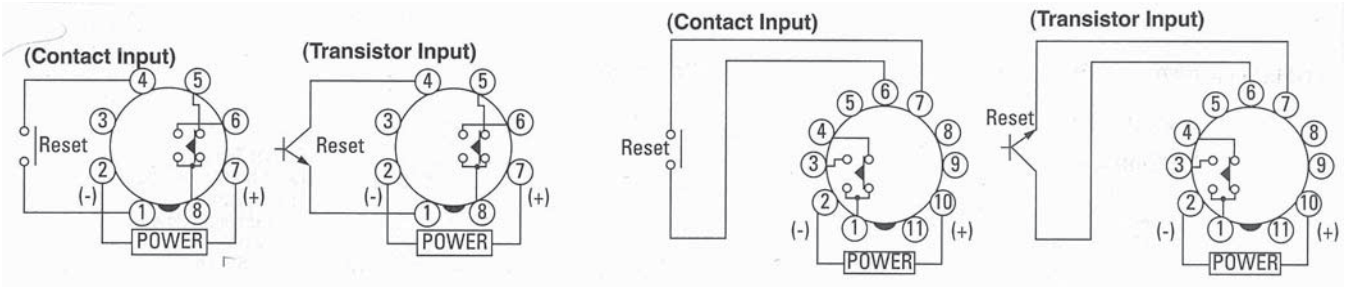

Item	Terminal Number		Operation
Power	2 - 7 (8p) 2 - 10 (11p)		
Reset Input	1 - 4 (8p) 6 - 7 (11p)	ON or L	
Delayed Contact	5 - 8 (8p) 1 - 4 (11p)	(NC)	
	6 - 8 (8p) 1 - 3 (11p)	(NO)	
Indicator	POWER		
Set Time			

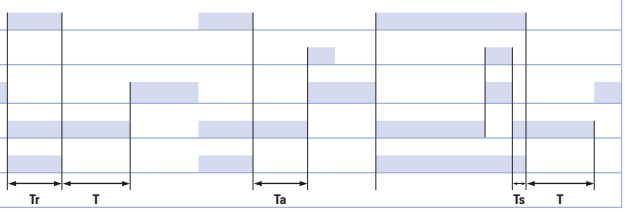


T = Set time
Ta = Shorter than set time
Ts = 1 Second
Tr = Minimum Power Application Time
GT3F-1: 1 Second

1. For time ranges, see page 829.
2. For sockets and accessory part numbers, see page 838.
3. When power is applied, the NO output contact closes. When power is removed, the timing period begins. When time has elapsed, the NO contact opens.
4. For the timing diagram overview, see page 794.

GT3F-2 Timing Diagrams

GT3F-2 (8-pin)	GT3F-2E (11-pin)

Delayed DPDT Output

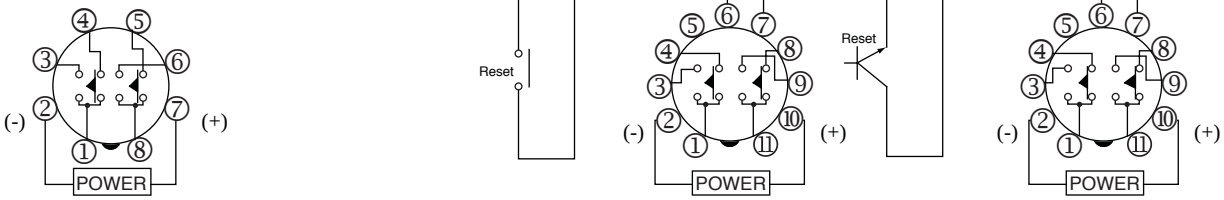

8-Pin Type

Item	Terminal Number		Operation
Power	2 - 7		
Delayed Contact	1 - 4 5 - 8	(NC)	
	1 - 3 6 - 8	(NO)	
Indicator	POWER		
Set Time			T, Tr, T

11-Pin Type

Item	Terminal Number		Operation
Power	2 - 10		
Reset Input	6 - 7 (11p)	ON or L	
Delayed Contact	1 - 4 8 - 11	(NC)	
	1 - 3 9 - 11	(NO)	
Indicator	POWER		
Set Time			Tr, T, Ta, Ts, T

When power is applied, the NO contact closes. When power is removed, the timing period begins. When time has elapsed, the NO contact opens. Optional reset input will return contacts to original state before time elapses.

T = Set time
Ta = Shorter than set time
Ts = 1 Second
Tr = Minimum Power Application Time
GT3F-1: 1 Second

Item	Terminal Number		Operation
Power	2 - 10		
Reset Input	6 - 7 (11p)	ON or L	
Delayed Contact	1 - 4 8 - 11	(NC)	
	1 - 3 9 - 11	(NO)	
Indicator	POWER		
Set Time			Tr, T, Ta, Ts, T

Instructions: Setting GT3F Series Timers




Step 1	Desired Operation	Selection		Remarks
Select a time range that contains the desired period of time.	**Base Time Ranges**	**① Dial Selector**	**② Time Range Selector**	Time range can be selected from 1S and 10S using a flat screwdriver and five different dials of 0 to 1, 0 to 3, 0 to 6, 0 to 18, and 0 to 60 are displayed in the six windows by turning the Dial Selector, allowing for selecting the best suited scale. Note that the switch does not turn infinitely.
	0.1s to 1s	0 to 1	1s	
	0.1s to 3s	0 to 3		
	0.1s to 6s	0 to 6		
	0.1s to 10s	0 to 1	10s	
	0.3s to 30	0 to 3		
	0.6s to 60	0 to 6		
	1.8s to 180s	0 to 18		
	6s to 600s	0 to 60		

Step 2	Remarks
The set time is selected by turning the ③ Setting Knob.	Setting Examples: 1. When the Setting Knob ③ is set at 2.5, with Dial Selector ① 0 to 3 and Time Range Selector ② 1S selected, then the set time is 2.5 seconds. 2. When the Setting Knob ③ is set at 5.0, with Dial Selector ① 0 to 60 and Time Range Selector ② 10S selected, then the set time is 500 seconds.


Instructions: Wiring Inputs

Inputs of GT3F

To avoid electric shock, do not touch the input signal terminal during power voltage application.
Never apply the input signals to two or more GT3F timers using the same contact or transistor.

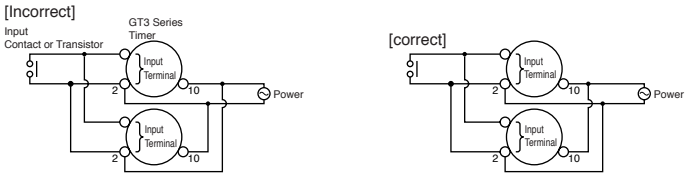

In a transistor circuit for controlling input signals, with its primary and secondary power circuits isolated, do not ground the secondary circuit.

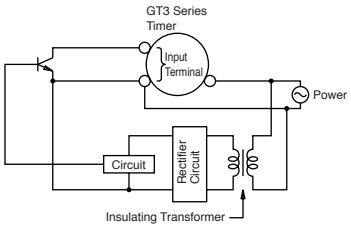

On the GT3F timers, connect the input signals to terminal No.1 and 4 only on the 8-pin type; connect the input signals to terminal No. 6 and 7 only on the 11-pin type. Never apply voltage to other terminals; otherwise, the internal circuit may be damaged.

Input signal lines must be made as short as possible and installed away from power cables and power lines. Use shielded wires or a separate conduit for input wiring.

The GT3F, consisting of a high-impedance circuit, may not be reset due to the influence of an inductive voltage or residual voltage caused by a leakage current. If not reset, connect an RC filter or bleeder resistor between power terminals so that the voltage between power terminals can be reduced to less than 15% of the rated voltage.

GT3S (Star-Delta) Timers

Star-Delta



UL, c-UL Listed
File No. E55996



Operation Mode	Rated Input Voltage	Time Range	Output	Contact	Part No.
					8-pin Type
Star-Delta	AF20: 100 to 240V AC (50/60Hz)	Star: 0.05 to 100 sec Star-Delta switching time: 0.05 sec 0.1 sec 0.25 sec 0.5 sec	250V AC/30V DC, 5A (resistive load)	Star: Delayed SPST-NO Delta: Delayed SPST-NO	GT3S-1AF20
				Star: Delayed SPST-NO Delta: Delayed SPST-NO Instantaneous: SPST-NO	GT3S-2AF20

Time Ranges

① Star Dial Selector		② Star-Delta Switching Time Selector
Dial	Time Range	Time
0-5	0.05 sec - 5 sec	0.05 sec
0-10	0.1 sec - 10 sec	0.1 sec
0-50	0.5 sec - 50 sec	0.25 sec
0-100	1 sec - 100 sec	0.5 sec

Contact Ratings

Contact Ratings		250V AC/30V DC, 5A (resistive load)
Life	Mechanical	20,000,000 operations minimum
	Electrical	100,000 operations minimum (rated load)


General Specifications


Operation System		Solid state CMOS circuitry
Operation Type		Star-delta
Time Range		Star side: 0.05 to 100 sec Star-delta switching time: 0.05, 0.1, 0.25, 0.5 sec
Rated Operational Voltage		100 to 240V AC (50/60Hz)
Operating Temperature		-10 to +50˚C
Storage Temperature		-30 to +80˚C
Operating Humidity		45 to 85% RH
Voltage Tolerance		85 to 264V AC
Repeat Error		±0.2%, ±10 msec
Voltage Error		±0.2%, ±10 msec
Temperature Error		±0.2%, ±10 msec
Setting Error		±10% maximum
Reset Time		500 msec maximum
Insulation Resistance		100MΩ minimum
Dielectric Strength		Between power and output terminals: 2,000V AC, 1 minute Between contacts of different poles: 2,000V AC, 1 minute Between contacts of the same pole: 750V AC, 1 minute
Vibration Resistance		100 m/sec^2 (Approx. 10G)
Shock Resistance		Operating extremes: 100m/sec^2 (Approx. 10G) Damage limits: 500m/sec^2 (Approx. 50G)
Power Consumption (Approx.)	**Type GT3S-1**	2.3VA (100V AC, 60Hz), 4.0VA (200V AC, 60Hz)
	Type GT3S-2	2.3VA (100V AC, 60Hz), 3.8VA (200V AC, 60Hz)

Operation Charts

Product Series	Internal Connection and Terminal Arrangement	Operation Chart


GT3S-1
Star: Delayed SPST-NO
Delta: Delayed SPST-NO




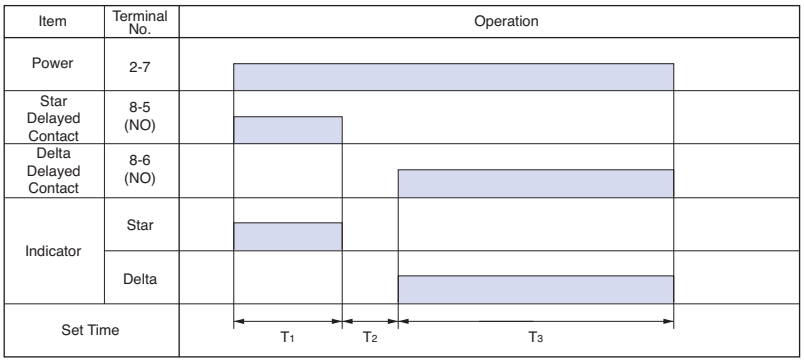

The star delayed contact goes on when power is turned on and goes off after a set time for the start contact (T_1). The delta delayed contact goes on after star-delta switching time (T_2) and goes off when power is turned off.
T_1 = Star ON time (Set Time), T_2 = Star-delta switching time, T_3 = Delta ON time

GT3S-2
Star: Delayed SPST-NO
Delta: Delayed SPST-NO
Instantaneous: SPST-NO



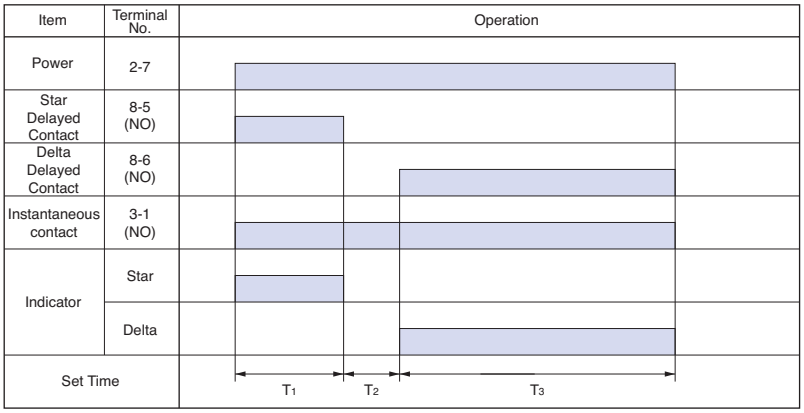

The star delayed contact goes on when power is turned on and goes off after a set time for the star contact (T_1). The delta delayed contact goes on after star-delta switching time (T_2) and goes off when power is turned off.
The instantaneous contact goes on when power is turned on and goes off when power is turned off.
T_1 = Star ON time (Set Time), T_2 = Star-delta switching time, T_3 = Delta ON time

GT3W Series — Dual Time Range Timers

Key features of the GT3W series include:

- Sequential start, sequential interval, on-delay, recycler, and interval ON timing functions
- 2 time settings in one timer
- 8 selectable operation modes on each model
- Mountable in sockets or flush panel
- Power and output status indicating LEDs
- Time ranges up to 300 hours



c UL us UL, c-UL Listed
File No. E55996

CE

General Specifications

Operation System			Solid state CMOS Circuit
Operation Type			Multi-Mode
Time Range			1: 0.1sec to 6 hours, 3: 0.1sec to 300 hours
Pollution Degree			2 (IE60664-1)
Over Voltage Category			III (IE60664-1)
Rated Operational Voltage		AF20	100-240V AC(50/60Hz)
		AD24	24V AC(50/60Hz)/24V DC
		D12	12V DC
Voltage Tolerance		AF20	85-264V AC(50/60Hz)
		AD24	20.4-26.4V AC(50/60Hz)/21.6-26.4V DC
		D12	10.8-13.2V DC
Disengaging Value of Input Voltage			Rated Voltage x10% minimum
Range of Ambient Operating Temperature			-10 to +50°C (without freezing)
Range of Ambient Storage and Transport Temperature			-30 to +75°C (without freezing)
Range of Relative Humidity			35 to 85%RH (without condensation)
Atmospheric Pressure			80kPa to 110kPa (Operating), 70kPa to 110kPa (Transport)
Reset Time			60msec maximum
Repeat Error			±0.2%, ±10msec*
Voltage Error			±0.2%, ±10msec*
Temperature Error			±0.6%, ±10msec*
Setting Error			±10% maximum
Insulation Resistance			100MΩ minimum (500V DC)
Dielectric Strength			Between power and output terminals: 2000V AC, 1 minute Between contacts of different poles: 2000V AC, 1 minute Between contacts of the same pole:750V AC, 1 minute
Vibration Resistance			10 to 55Hz amplitude 0.75mm² hours in each of 3 axes
Shock Resistance			Operating extremes: 98m/sec² (approx.10G) Damage limits: 490m/sec² (approx. 50G) 3 times in each of 3 axes
Degree of Protection			IP40 (enclosure), IP20 (socket) (IEC60529)
Power Consumption (Approx.)	AF20	100V AC/60Hz	2.3VA
		200V AC/60Hz	4.6VA
	AD24 (AC/DC)		1.8VA/0.9W
Mounting Position			Free
Dimensions			40Hx 36W x 70 mm
Weight (Approx.)			72g

Contact Ratings

Allowable Contact Power		960VA/120W
Allowable Voltage		250V AC/150V DC
Allowable Current		5A
Maximum permissible operating frequency		1800 cycles per hour
Rated Load		1/8HP, 240V AC
		3A, 240V AC (Resistive)
		5A, 120V AC/30V DC (Resistive)
Conditional Short Circuit		Fuse 5A, 250V
Life	Electrical	100,000 op. minimum (Resistive)
	Mechanical	20,000,000 op. minimum

* For the value of the error against a preset time, whichever the largest applies.

Part Number List

Part Numbers


Mode of Operation	Output	Contact	Time Range*	Rated Voltage	Pin Configuration	New Part Numbers
A: Sequential Start B: On-delay with course and fine C: Recycler and instaneous D: Recycler outputs (OFF Start) E: Recycler outputs (ON Start) F: Interval ON G: Interval ON Delay H: Sequential Interval	3A, 240V AC 5A, 120V AC/30V DC (Resistive Load)	Delayed SPDT + Delayed SPDT	1: 0.1sec - 6 hours *(See Time Range Settings for details.)	100 to 240V AC (50/60Hz)	8 pin	GT3W-A11AF20N
					11 pin	GT3W-A11EAF20N
				24V AC/DC	8 pin	GT3W-A11AD24N
					11 pin	GT3W-A11EAD24N
				12V DC	8 pin	GT3W-A11D12N
					11 pin	GT3W-A11ED12N
			3: 0.1sec - 300 hours	100 to 240V AC (50/60Hz)	8 pin	GT3W-A33AF20N
				24V AC/DC		GT3W-A33AD24N

1. For timing diagrams and schematics, see page 836.
2. For socket and accessory part number information, see page 838.
3. 8- and 11-pin models differ only in the number of pins (extra pins are not used).
4. For the timing diagram overview, see page 794.
5. *For details on setting time ranges, see the instructions on page 837.

Time Range Table

Time Range Code: 1			Time Range Code: 3		
Time Range Selector	Scale	Time Range	Time Range Selector	Scale	Time Range
1S	0-1	0.1 sec - 1 sec	1S	0 - 3	0.1 sec - 3 sec
10S		0.3 sec - 10 sec	1M		3 sec - 3 min
10M		15 sec - 10 min	1H		3 min - 3 hours
1S	0 - 6	0.1 sec - 6 sec	1S	0 - 30	0.6 sec - 30 sec
10S		1 sec - 60 sec	1M		36 sec - 30 min
1M		6 sec - 6 min	1H		36min - 30 hours
10M		1 min - 60 min	10H		6 hours - 300 hours
1H		6 min - 6 hours			

Timing Diagrams/Schematics

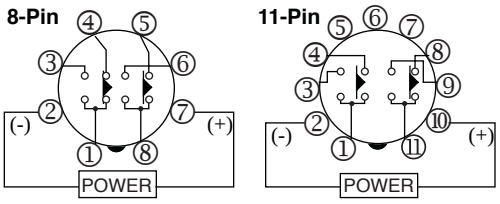

A: Sequential Start

Item	Terminal No.	Operation	Description
Power	2-7		
Delayed Contact Ry1	1-4 (NC)		ON after T1
	1-3 (NO)		
Delayed Contact Ry2	5-8 (NC)		ON after T1 + T2
	6-8 (NO)		
Indicator	OUT1		
	OUT2		
Set Time		T1 T2	

B: On-delay with course and fine

Item	Terminal No.	Operation	Description
Power	2-7		
Delayed Contact Ry1	1-4 (NC)		ON after T1 + T2
	1-3 (NO)		
Delayed Contact Ry2	5-8 (NC)		ON after T1 + T2
	6-8 (NO)		
Indicator	OUT1		
	OUT2		
Set Time		T1 T2	

C: Recycler and instantaneous

Item	Terminal No.	Operation	Description
Power	2-7		
Delayed Contact Ry1	1-4 (NC)		Instantaneous ON
	1-3 (NO)		
Delayed Contact Ry2	5-8 (NC)		OFF during T1 ON during T2
	6-8 (NO)		
Indicator	OUT1		
	OUT2		
Set Time		T1 T2	

D: Recycler outputs (OFF Start)

Item	Terminal No.	Operation	Description
Power	2-7		
Delayed Contact Ry1	1-4 (NC)		OFF during T1 ON during T2
	1-3 (NO)		
Delayed Contact Ry2	5-8 (NC)		OFF during T1 ON during T2
	6-8 (NO)		
Indicator	OUT1		
	OUT2		
Set Time		T1 T2	

E: Recycler outputs (ON Start)

Item	Terminal No.	Operation	Description
Power	2-7		
Delayed Contact Ry1	1-4 (NC)		ON during T1 OFF during T2
	1-3 (NO)		
Delayed Contact Ry2	5-8 (NC)		ON during T1 OFF during T2
	6-8 (NO)		
Indicator	OUT1		
	OUT2		
Set Time		T1 T2	

F: Interval ON

Item	Terminal No.	Operation	Description
Power	2-7		
Delayed Contact Ry1	1-4 (NC)		ON during T1
	1-3 (NO)		
Delayed Contact Ry2	5-8 (NC)		ON after T1, during T2
	6-8 (NO)		
Indicator	OUT1		
	OUT2		
Set Time		T1 T2	


G: Interval ON Delay

Item	Terminal No.	Operation	Description
Power	2-7		
Delayed Contact Ry1	1-4 (NC)		ON during T1
	1-3 (NO)		
Delayed Contact Ry2	5-8 (NC)		ON after T1 + T2
	6-8 (NO)		
Indicator	OUT1		
	OUT2		
Set Time		T1 T2	

H: Sequential Interval

Item	Terminal No.	Operation	Description
Power	2-7		
Delayed Contact Ry1	1-4 (NC)		ON during T1 + T2
	1-3 (NO)		
Delayed Contact Ry2	5-8 (NC)		ON after T1, during T2
	6-8 (NO)		
Indicator	OUT1		
	OUT2		
Set Time		T1 T2	

Instructions: Setting GT3W Timer

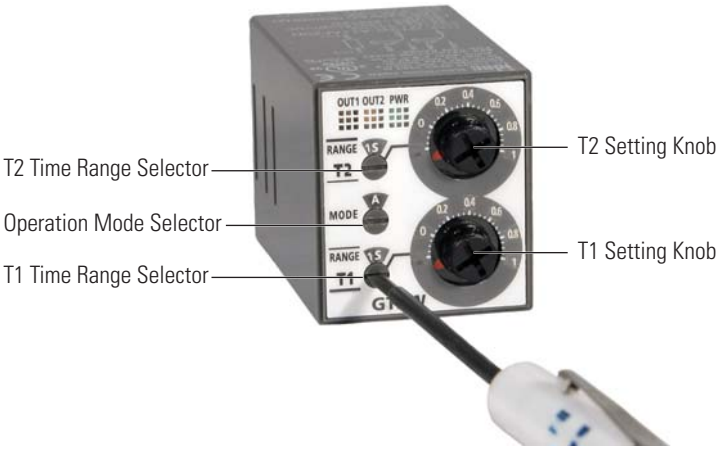

1. The switches should be securely turned using a flat screwdriver 4mm wide (maximum). Note that incorrect setting may cause malfunction. The switches, which do not turn infinitely, should not be turned beyond their limits.
2. Since changing the setting during timer operation my cause malfunction, turn power off before changing.

Safety Precautions

Special expertise is required to use Electronic Timers.

- All Electronic Timer modules are manufactured under IDEC's rigorous quality control system, but users must add a backup or fail safe provision to the control system when using the Electronic Timer in applications where heavy damage or personal injury may occur should the Electronic Timer fail.
- Install the Electronic Timer according to instructions described in this catalog.
- Make sure that the operating conditions are as described in the specifications. If you are uncertain about the specifications, contact IDEC in advance.
- In these directions, safety precautions are categorized in order of importance to Warning and Caution.

Warning

Warning notices are used to emphasize that improper operation may cause sever personal injury or death.

- Turn power off to the Electronic timer before starting installation, removal, Wiring, maintenance, and inspection on the Electronic Timer.
- Failure to turn power off may cause electrical shocks or fire hazard.
- Emergency stop and interlocking circuits must be configured outside the Electronic timer. If such a circuit is configured inside the Electronic Timer, failure of the Electronic timer may cause malfunction of the control system, or an accident.

Caution

Caution notices are used where inattention might cause personal injury or damage to equipment.

- The Electronic Timer is designed for installation in equipment. Do not install the Electronic Timer outside equipment.
- Install the Electronic Timer in environments described in the specifications. If the Electronic Timer is used in places where it will be subjected to high-temperature, high-humidity, condensation, corrosive gases, excessive vibrations, or excessive shocks, then electrical shocks, fire hazard, or malfunction could result.
- Use an IEC60127-approved fuse and circuit breaker on the power and output line outside the Electronic Timer.
- Do not disassemble, repair, or modify the Electronic Timer.
- When disposing of the Electronic Timer, do so as industrial waste.

GT3 Series

Accessories


DIN Rail Mounting Accessories


DIN Rail/Surface Mount Sockets and Hold-Down Springs

DIN Rail Mount Socket				Applicable Hold-Down Springs	
Style	Appearance	Use with Timers	Part No.	Appearance	Part No.
8-Pin Screw Terminal (dual tier)		GT3A-1, 2, 3 (8-pin) GT3D-1, 2, 3 (8-pin) GT3F-1, 2 (8-pin) GT3W (8-pin) GT3S	SR2P-05		SFA-203
11-Pin Screw Terminal (dual tier)		GT3A-1, 2, 3 (11-pin) GT3A-4, 5, 6 GT3D-1, 2, 3 (11-pin) GT3D-4, 8 GT3F-1, 2 (11-pin) GT3W (11-pin)	SR3P-05		
8-Pin Fingersafe Socket		GT3A-1, 2, 3 (8-pin) GT3D-1, 2, 3 (8-pin) GT3F-1, 2 (8-pin) GT3W (8-pin) GT3S	SR2P-05C		
11-Pin Fingersafe Socket		GT3A-1, 2, 3 (11-pin) GT3A-4, 5, 6 GT3D-1, 2, 3 (11-pin) GT3D-4, 8 GT3F-1, 2 (11-pin) GT3W (11-pin)	SR3P-05C		
8-Pin Screw Terminal		GT3A-1, 2, 3 (8-pin) GT3D-1, 2, 3 (8-pin) GT3F-1, 2 (8-pin) GT3W (8-pin) GT3S	SR2P-06		SFA-202
11-Pin Screw Terminal		GT3A-1, 2, 3 (11-pin) GT3A-4, 5, 6 GT3D-1, 2, 3 (11-pin) GT3D-4, 8 GT3F-1, 2 (11-pin) GT3W (11-pin)	SR3P-06		
DIN Mounting Rail Length 1000mm		—	BNDN1000		


Installation of Hold-Down Springs

DIN Rail Mount Socket

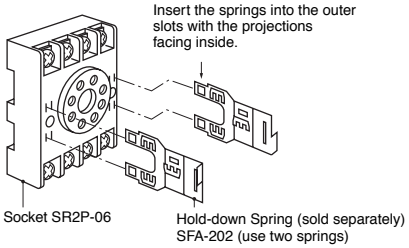

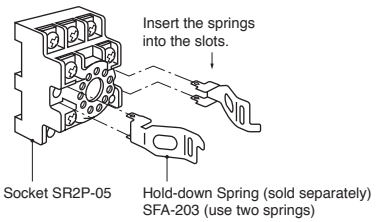

Panel Mount Socket



Panel Mounting Accessories

Panel Mount Sockets and Hold-Down Springs

Panel Mount Socket				Applicable HD Springs	
Style	Appearance	Use with Timers	Part No.	Appearance	Part No.
8-Pin Solder Terminal		GT3A- (8-pin) GT3D- (8-pin) GT3W- (8-pin) GT3F- (8-pin) GT3S	SR2P-51		SFA-402
11-Pin Solder Terminal		GT3A- (11-pin) GT3D- (11-pin) GT3W- (11-pin) GT3F- (11-pin)	SR3P-51		

For information on installing the hold-down springs, see page 838.

Flush Panel Mount Adapter and Sockets that use an Adapter

Accessory	Description	Appearance	Use with Timers	Part No.
Panel Mount Adapter	Adaptor for flush panel mounting GT3 timers		All GT3 timers	RTB-G01
Sockets for use with Panel Mount Adapter	8-pin screw terminal	 (Shown: SR6P-M08G for Wiring Socket Adapter)	All 8-pin timers	SR6P-M08G
	11-pin screw terminal		All 11-pin timers	SR6P-M11G
	8-pin solder terminal		All 8-pin timers	SR6P-S08
	11-pin solder terminal		All 11-pin timers	SR6P-S11


No hold down springs are available for flush panel mounting.

Instructions: Wiring Inputs for GT3 Series


Inputs Inputs

To avoid electric shock, do not touch the input signal terminal during power voltage application.


When connecting the input signal terminals of two or more GT3A timers to the same contact or transistor, the input terminals of the same number should be connected. (Connect Terminals No.2 in common.)

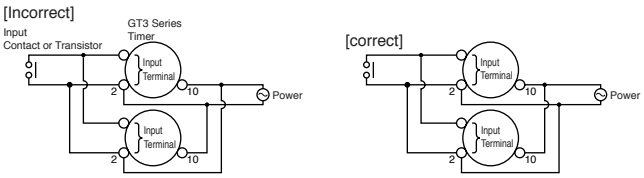

In a transistor circuit for controlling input signals, with its primary and secondary power circuits isolated, do not ground the secondary circuit.

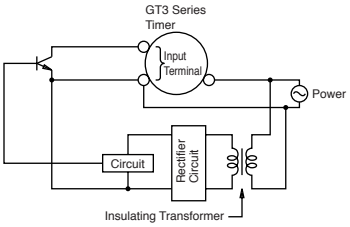


Connect the input signal terminals of the GT3A timers to Terminal No.2 only. Never apply voltage to other terminals; otherwise, the internal circuit may be damaged.

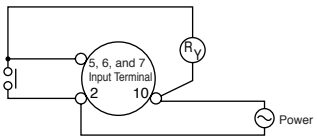


Input signal lines must be made as short as possible and installed away from power cables and power lines. Use shielded wires or a separate conduit for input wiring.

Inputs Instructions, continued

For contact input, use gold-plated contacts to make sure that the residual voltage is less than 1V when the contacts are closed.




For transistor input, use transistors with the following specifications; VCE = 40V, VCES = 1V or less, IC = 50 mA or more, and ICBO = 50µA or less. The resistance should be less than 1kΩ when the transistor is on. When the output transistor switches on, a signal is input to the timer.



Inputs: GT3A-1, -2, -3


Transistor output equipment such as proximity switches and photoelectric switches can input signals if they are voltage/current output type, with power voltage ranges from 18 to 30V and have1V. When the signal voltage switches from H to L, a signal is input to the timer



Inputs: GT3A-4, -5, -6


Start Input	The start input initiates a time-delay operation and controls output status.	No-voltage contact inputs and NPN open collector transistor inputs are applicable. 24V DC, 1mA maximum Input response time: 50msec maximum
Reset Input	When the reset input is activated, the time is reset, and contacts return to original state.	
Gate Input	The time-delay operation is suspended while the gate input is on (pause).	

Dimensions

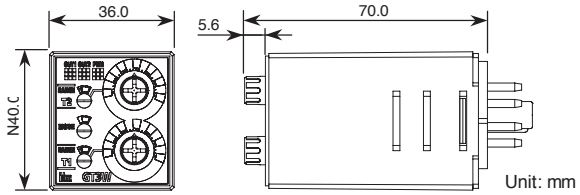


NOTE: GT3W series are UL Listed when used in combination with following IDEC's sockets:
GT3W-A11, A33: SR2P-06* pin type socket.
GT3W-A11E: SR3P-05* pin type socket.
(*-May be followed by A,B,C or U)
The socket to be used with these timers are rated:
-Conductor Temperature Rating 60°C min.
-Use 14AWG max.(2mm²max.) Copper conductors only
-Terminal Torque 1.0 to 1.3 N-m


Analog GT3 Timer, 8-Pin with SR2P-06

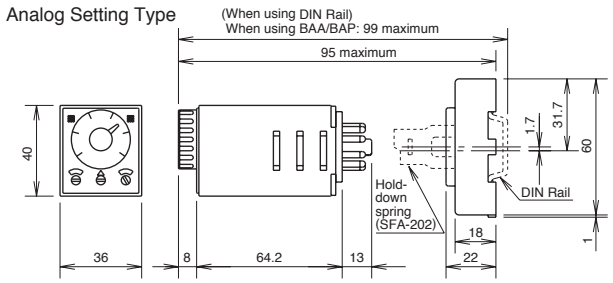


Analog GT3 Timer, 11-Pin with SR3P-06

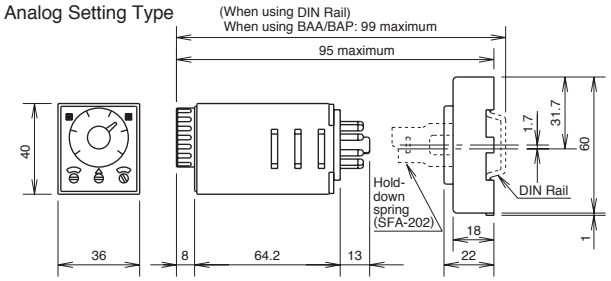


Digital GT3 Timer, 8-Pin with SR2P-06

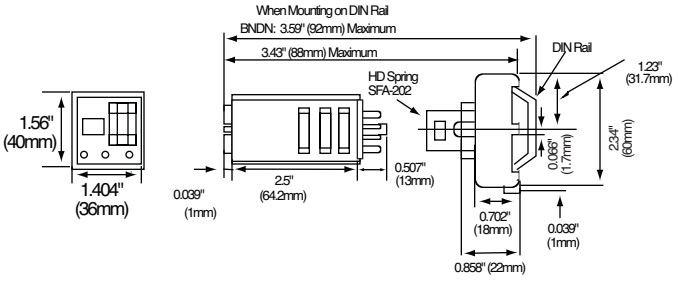


Digital GT3 Timer, 11-Pin with SR3P-06

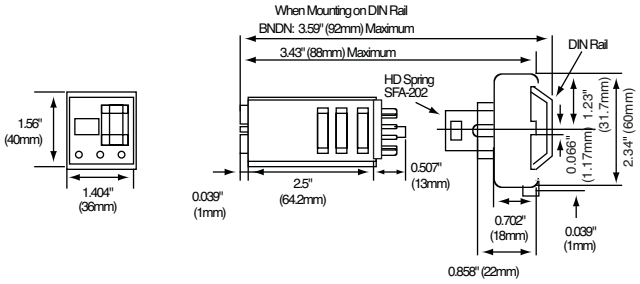

Analog GT3 Timer, 11-Pin with SR3P-05

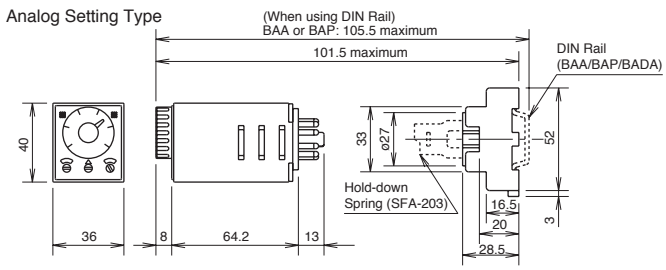


Digital GT3 Timer, 11-Pin with SR3P-05

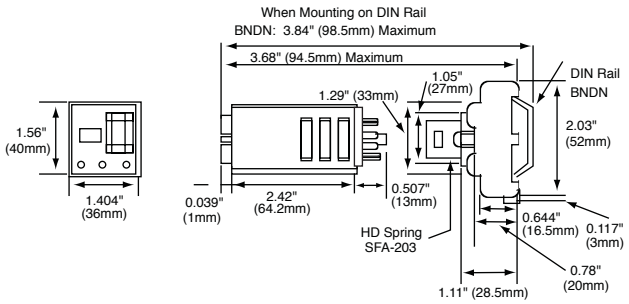


Panel Mount Adapter


Analog GT3 Timer, 8-Pin and 11-Pin with SR6P-S08 or SR6P-S11

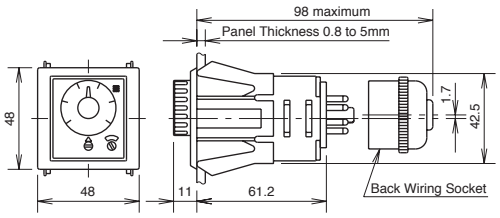

Digital GT3 Timer, 8-Pin and 11-Pin with SR6P-S08 or SR6P-S11

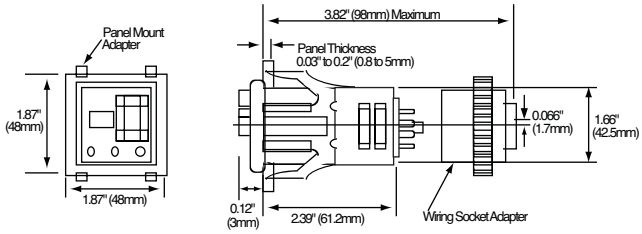


Mounting Hole Layout

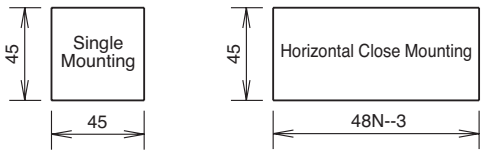


Tolerance: +0.5 to 0
N: No. of timers mounted

Analog and Digital GT3 Timer, 8-Pin with SR6P-M08G

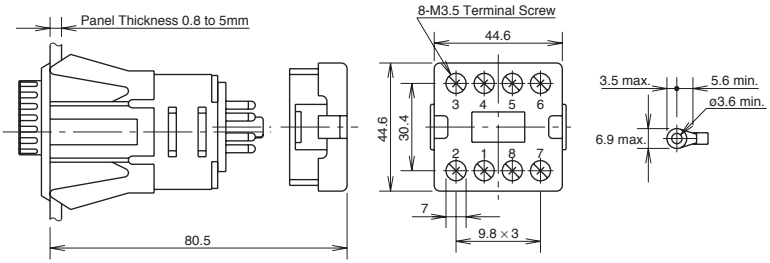

Analog and Digital GT3 Timer, 11-Pin with SR6P-M11G

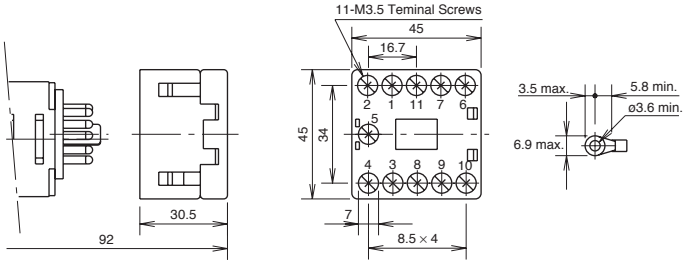

General Instructions for All Timer Series

Load Current

With inductive, capacitive, and incandescent lamp loads, inrush current more than 10 times the rated current may cause welded contacts and other undesired effects. The inrush current and steady-state current must be taken into consideration when specifying a timer.

Contact Protection

Switching an inductive load generates a counter-electromotive force (back EMF) in the coil. The back EMF will cause arcing, which may shorten the contact life and cause imperfect contact. Application of a protection circuit is recommended to safeguard the contacts.

Temperature and Humidity

Use the timer within the operating temperature and operating humidity ranges and prevent freezing or condensation. After the timer has been stored below its operating temperature, leave the timer at room temperature for a sufficient period of time to allow it to return to operating temperatures before use.

Environment

Avoid contact between the timer and sulfurous or ammonia gases, organic solvents (alcohol, benzine, thinner, etc.), strong alkaline substances, or strong acids. Do not use the timer in an environment where such substances are prevalent. Do not allow water to run or splash on the timer.

Vibration and Shock

Excessive vibration or shocks can cause the output contacts to bounce, the timer should be used only within the operating extremes for vibration and shock resistance. In applications with significant vibration or shock, use of hold down springs or clips is recommended to secure a timer to its socket.

Time Setting

The time range is calibrated at its maximum time scale; so it is desirable to use the timer at a setting as close to its maximum time scale as possible. For a more accurate time delay, adjust the control knob by measuring the operating time with a watch before application.

Input Contacts

Use mechanical contact switch or relay to supply power to the timer. When driving the timer with a solid-state output device (such as a two-wire proximity switch, photoelectric switch, or solid-state relay), malfunction may be caused by leakage current from the solid-state device. Since AC types comprise a capacitive load, the SSR dielectric strength should be two or more times the power voltage when switching the timer power using an SSR.

Generally, it is desirable to use mechanical contacts whenever possible to apply power to a timer or its signal inputs. When using solid state devices, be cautious of inrushes and back-EMF that may exceed the ratings on such devices. Some timers are specially designed so that signal inputs switch at a lower voltage than is used to power the timer (models designated as “B” type).

Timing Accuracy Formulas

Timing accuracies are calculated from the following formulas:

Repeat Error

$$= \pm \frac{1 \times \text{Maximum Measured Value} - \text{Minimum Measured Value}}{2 \text{ Maximum Scale Value}} \times 100\%$$

Voltage Error

$$= \pm \frac{Tv - Tr}{Tr} \times 100\%$$

Tv: Average of measured values at voltage V
Tr: Average of measured values at the rated voltage

Temperature Error

$$= \pm \frac{Tt - T20}{T20} \times 100\%$$

Tt: Average of measured values at °C
T20: Average of measured values at 20°C

Setting Error

$$= \pm \frac{\text{Average of Measured Values} - \text{Set Value}}{\text{Maximum Scale Value}} \times 100\%$$

Artisan Technology Group is an independent supplier of quality pre-owned equipment

Gold-standard solutions

Extend the life of your critical industrial, commercial, and military systems with our superior service and support.

We buy equipment

Planning to upgrade your current equipment? Have surplus equipment taking up shelf space? We'll give it a new home.

Learn more!

Visit us at **artisantg.com** for more info on price quotes, drivers, technical specifications, manuals, and documentation.

Artisan Scientific Corporation dba Artisan Technology Group is not an affiliate, representative, or authorized distributor for any manufacturer listed herein.

We're here to make your life easier. How can we help you today?

(217) 352-9330 | sales@artisantg.com | artisantg.com

ARTISAN® TECHNOLOGY GROUP