

ARTISAN®
TECHNOLOGY GROUP

Your **definitive** source for quality pre-owned equipment.

Artisan Technology Group
(217) 352-9330 | sales@artisantg.com | artisantg.com

Full-service, independent repair center
with experienced engineers and technicians on staff.

We buy your excess, underutilized, and idle equipment
along with credit for buybacks and trade-ins.

Custom engineering
so your equipment works exactly as you specify.

- Critical and expedited services
- In stock / Ready-to-ship
- Leasing / Rentals / Demos
- ITAR-certified secure asset solutions

Expert team | Trust guarantee | 100% satisfaction

All trademarks, brand names, and brands appearing herein are the property of their respective owners.

Find the *Medar MedWeld 3001* at our website: ***Click HERE***

MedWeld 3000 Series Welding Controls

Technical Reference Catalog



Medar is a brand name for welding controls belonging to the Welding Technology Corporation – the world's largest supplier of resistance welding controls and innovator for resistance welding technologies.

http://www.weldtechcorp.com

wtc
welding technology corp

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Table of Content

MedWeld 3000 Series Welding Controls 1
Table of Content 2
Resistance Welding Application 5
Part and Model Numbers 6
Configurations and Packages 8
Other available platforms for integrators: 8
What type of package to order? 8
Kit Format 8
Remote Enclosures 8
Integrated Welding Systems 8
MedWeld 3005 Kits 9
Single Phase Circuit Boards 9
Cascade Circuit Boards 9
Note on Current Monitoring for AC and 3-Phase to DC Controls: 9
Single Phase Power Module 10
Tripack Multi-Phase Power Modules 11
Multi Timer and Cascade Modules 12
Interface Cables 13
Door Port Kits 14
Integrator's Documentation Kits 14
Circuit Breaker with Operator Handle Kits 15
Isolation Contactor Kits 15
Power Bus Bar Kits 15
Remote Power Enclosure Solutions 16
Note on Current Monitoring for AC and 3-Phase to DC Controls: 16
Single and Dual Remote Cabinet 17
Tripack Remote Cabinet 18
Six-Pack Remote Cabinet 19
Integrated Single-Phase Weld Control Enclosure Solution 20
Note on Current Monitoring for AC and 3-Phase to DC Controls: 20
MedWeld 3015 21
MedWeld 3025 22
MedWeld 3035 23
MedWeld 3045 24
MedWeld 3055 25
MedWeld 3065 26
MedWeld 3075 27
MedWeld 3095 28
Options and Accessories for Integrated Solutions 29
Circuit Breakers with Operating Handles 29
Isolation Contactors 29
SCR Upgrades 30
Power Transformers 30
Special Multitap Power Transformers 30
DC Power Supplies 30
Power Bus Bars 31
Multi-pin Connectors and Terminal Strips 31
Door Port Access Kit 31
Water Flow Switches and Valves 31
Secondary Current Monitoring Kits 31

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Allen-Bradley ™ Components 32
Fixed I/O Configuration 32
Flexible I/O Configurations 32
Chassis and Interconnect Cables 33
Power Supplies 33
Modular Processors 34
Memory Modules 34
Input and Output Modules 35
Remote I/O and Device Net Modules 36
Analog and Encoder Modules 36
Cascade Weld Control Solutions 37
Single Timer - Multiple SCR Systems 38
Multiple Timers - Multiple SCR Systems 38
Model Number Review for Cascade Systems 39
Mid-Frequency to DC (MFDC) Weld Control Solutions 40
Benefits of MFDC Welding Systems 41
MF600 Inverter for all Steel Caliber Range 42
MF600 Inverter Kit 42
MF1200 Inverter for Aluminum Welding Caliber Range 43
MF1200 Inverter Kit 43
Milli-Second Interface Option 44
Medar MFDC System with Millisecond Interface 45
MedWeld 3005 3-Phase to DC Weld Controls 46
Single MedWeld 3-Phase System 46
Multiple MedWeld 3-Phase Systems 47
Model Numbers for 3-Phase Systems 48
Note on Current Monitoring for AC and 3-Phase to DC Controls: 48
MedWeld 3035-WTP 49
MedWeld 3065-WTP 50
MedWeld 3075-WTP 51
MedWeld 3095-WTP 52
Model Number Review for 3-Phase Systems 53
Safety Ground Fault Systems for Manually Operated Transguns 54
2-Level Detection System 55
2-Level Manual Gun Safety Protection System Option Installed 55
"Touchsafe" Switch & Power Supply Installed 55
3-Level Detection System 56
3-level Manual Gun Safety Protection System Installed 56
Programming Devices for MedWeld Controls 57
DEP100s 57
DP200s 58
Network Power Pack 59
Brad Harrison Cable for Network Power Pack 59
Medar Networking Products 60
Weld Support Systems 60
WebVIEW 60
Medar WebVIEW (Phase 1) 61
WebVIEW Phase 1 Features: 61
Sample page of WebVIEW 61
WebVIEW – Phase 2 62
WebVIEW Phase 2 Additional Features: 62
Weld Support Systems (Bank System Software) 63

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Sizing Circuit Breaker and Isolation Contactors 64
RULES FOR SELECTING CIRCUIT BREAKER FRAME SIZES 64
DISCLAIMER: 64
ASSUMPTIONS: 64
PART 1: CIRCUIT BREAKER MINIMUM FRAME SIZE SELECTION GUIDE 65
PART 2: MAGNETIC TRIP RANGE SELECTION. 66
RULES FOR SIZING ISOLATION CONTACTORS 67
DISCLAIMER: 67
ASSUMPTIONS: 67
PART 1:CALCULATION OF AVERAGE CURRENT DRAW PER WELDING TRANSFORMER 68
PART 2: ISOLATION CONTACTOR CURRENT RATING SELECTION BASED ON TRANSFORMER CONNECTION. 69
Directory of Resources 71
WTC - Corporate Office 71
WTC Automotive 71
WTC Canada 71
Technitron Industrial Division 71
Industrial Technical Services Division 71
Quality 72
QS 9000 with TE Supplement 72
Acknowledgements 72


Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Resistance Welding Application

WTC provides control systems for resistance welding applications such as spot, projection, seam, butt, flash, and upset welding. The MedWeld controls that are shown in this catalog can also be used for other applications requiring the control of electrical current such as brazing, annealing, forging, and tempering applications amongst others.

The hardware solutions that are presented within this catalog have been designed to operate in harsh environments and have been validated to acceptance tests to perform reliably in industrial plants all over the world. The software solutions that are embedded within the product line in this catalog have been esteemed as some of the most advanced yet simple to use.

Please ask your Medar distributor how these WTC controls can provide answers to some of your most difficult application problems.

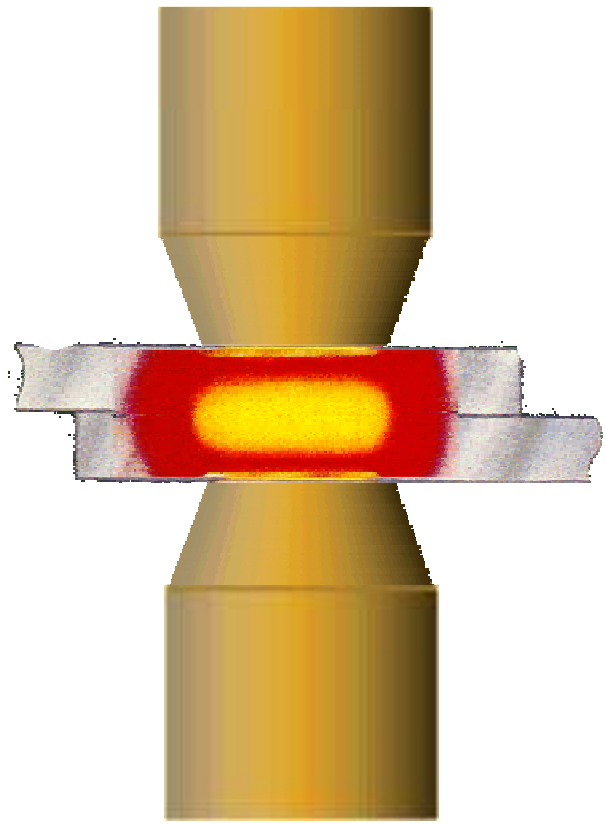

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Part and Model Numbers

There are various numbers that can identify a Medar welding control. The part number is referenced on the serial tag. This number appears such as 952-1196 as an example, which identifies item specific designs with distinct bills of materials. Please use the part number if you wish to re-order an identical control.

As a general guide to the composition of a welding control, a model number is also provided. It is normal however for various controls of differing part numbers to share a common model number. The following describes the model number scheme.

3095-12=1200-4003-1=#5-4806

- The first four digits signify a weld processor and enclosure model. The 30xx means that it is an integration control. The xx9x signifies a specific enclosure (see MedWeld 3095 in table of content). The xxx5 signifies that the weld processor is integrated in the Allen-Bradley SLC 500 rack.

- The next set of digits (12=1200) signifies the power switches and their configurations. As shown, the 12=1200 signifies that there are twelve welding processors each with their own 1200 amperes SCRs.

A model numbers that indicates 12C=1200 would mean that there is one welding processor being shared by twelve 1200 amp SCRs in cascading fashion.

A model number that indicates 4W12C=1200 would mean that there is four welding processors being shared by twelve 1200 amp SCRs in cascading fashion.

A model number that indicates WTP=1750 would mean that there is a welding processor controlling a 3-Phase to DC power distribution where the SCRs are rated at 1750 amperes.

A model number that indicates 4WTP=3300 would mean that there is four welding processors each controlling a 3-Phase to DC power distribution where the SCRs are rated at 3300 amperes.

A model number that indicates 2W4TP=3300 would mean that there are two welding processors controlling four 3-Phase to DC power distribution where the SCRs are rated at 3300 amperes.

A model number that indicates 1=MF300 would mean that one welding processor is controlling a 300 ampere mid frequency inverter.



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

- The next set of digits (400-3) signifies the breaker size and the number of poles.

- The next set of digits (1=#5) signifies the number of isolation contactors and their size.

- The last set of digits (4806) signifies the voltage and frequency. The first three is the voltage where 480 mean that the control is wired to accept 480 Volts, and the last number 6 means that components are rated for 60 Hz operations.

Enclosure & Model		No. of SCRs		SCR or Inverter Rating		Circuit Breaker	No. of Poles		No of Contactors		Rating of Contactors		Primary Voltage	Line Frequency
3003	-	1	=	1200	-	000	2	-	1	=	#3	-	240	5 (50 Hz)
3004	-	2	=	1750	-	150	3	-	2	=	#4	-	380	6 (60 Hz)
3006	-	3	=	2500	-	250			...	=	#5	-	480	
3005	-	4	=	3300	-	400			nn	=		-	600	
3015	-	5	=		-	600								
3025	-	6	=	MF300	-	800								
3035	-	7	=	MF600	-	1200								
3045	-	8	=	MF1200	-	2000								
3055	-	...	=											
3065	-	12	=	Multiple - 12 resistance-welding processors each with an SCR										
3075	-	12C	=	Cascade - 1 resistance-welding processor with 12 SCRs										
3095	-	15C	=	Cascade - 1 resistance-welding processor with 15 SCRs										
		4W12C	=	Multiple with Cascade - 4 resistance-welding processors with 12 SCRs total										
3015F	-	1WTP	=	Three Phase - 1 resistance-welding processor with one 3-Phase switch										
3025F	-	4WTP	=	Multiple Three Phase - 4 resistance-welding processors each with a 3-Phase switch										
3035F	-	2W4TP	=	Multiple with Cascade Three Phase - 2 resistance-welding processors with 4 3-Phase switches total										

More details of model numbering scheme in each section – Check Table of Content

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Configurations and Packages

The MedWeld 3000 Series resistance welding controls have welding processor boards that integrate into the hardware platform of machine or robotic controllers. This eliminates redundant hardware such as input and output modules, multi-conductor cables, terminal points, and rack assemblies. This makes the overall system more reliable in its production environment.

- MedWeld 3003 – integrates with Nachi Robotics Systems – AR & AW Robots
- MedWeld 3004 – integrates with Fanuc Robotics Systems – RJ3 Robot
- MedWeld 3005 – integrates with Allen-Bradley – 1747 SLC 500
- MedWeld 3006 – integrates with Motoman Robotics Systems – XRC Robot

Other available platforms for integrators:

- *IBM PC ISA Half slot bus*
- *VME bus in 6U form factor*
- *Compact PCI 6U form factor*
- *PC104 bus compatible*

What type of package to order?

There are three types of packages that can be obtained: kit format, remote enclosure format, and the fully integrated system format. The MedWeld 3003, 3004 and 3006 come only in the remote enclosure format whereas the MedWeld 3005 comes in all types of packages.

Kit Format

The MedWeld 3005 can be purchased in kit format. Kits are for integrators who assemble their own control enclosures and want to add Medar modules within these enclosures to provide resistance-welding capabilities. Please call should another type of kit not listed in this publication suit your needs better. An integrator who purchased a MedWeld 3005 Tripack integrator's kit shown has assembled the control system that is shown on the cover. The circuit breaker with its operating handle, the isolation contactor, and the power bus bars are also available in kits.

Remote Enclosures

All MedWeld 3000 Series controls can be purchased in remote enclosure packages. This package allows the separation of high voltages present in welding controls from the controls system. A full description of the remote enclosure concept is described on pages 16 and 18.

Integrated Welding Systems

OEMs and users can acquire a fully integrated resistance welding system from Medar. There are various standard configurations that are shown in this catalog. Please call should you need a customized system that is not shown in this publication.



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

MedWeld 3005 Kits



Single Phase Circuit Boards

Part No 830-0147 - software: T93300

Please refer to the section on programming devices for editing and reviewing data and parameters stored in the MedWeld 3005 module.
Please refer to the Interface Cables table.

The MedWeld 3005 Welding Control kit comprises of a resistance-welding processor module that resides in the Allen-Bradley ™ SLC 500 rack, a firing card to interface to customer's own SCR, and a current monitoring coil.

Each kit requires an interface cable (Part No. 205-1212Vx) that links the welding processor to the firing card. The kit is completed with user manuals and drawings. Software T93300

First time integrators must register the kit by purchasing the "Integrator's Documentation Kit" (Part No. 830-0152) in order to facilitate quick ladder software instructions.

- The CE mark applies only to the MedWeld 3005 Resistance Welding Processor Module (917-0050)

Cascade Circuit Boards

Description
Cascade Card with 3 load resistors

This product is to be used with the kit above.

Two versions available – Please specify
24 VDC SCR Select Inputs – Part Number 830-0485V24
120 VAC SCR Select Inputs – Part Number 830-0485V120

This will cascade up to three SCRs. SCRs are not included.

Note on Current Monitoring for AC and 3-Phase to DC Controls:

The current transformer coil shown above and throughout this catalog is used on AC and 3-Phase to DC controls. This device is suited for currents above 50 amperes. For applications below this level, please consult with WTC and request for the document entitled *"Guidelines to Select a Sensor to Measure Welding Current".*

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Single Phase Power Module

Part No 830-0209 – software: T93300
Part No 830-0210 – software: T93301
Part No 830-0409 – software: T93308



The single power module viewed from the bottom. The current monitoring coil that surrounds the SCR's tang provides welding data information to the welding processor shown on the left. Choose an appropriate length of interface cable listed in the table on following pages.

Please refer to the section on programming devices for editing and reviewing data and parameters stored in the MedWeld 3005 module.
Please refer to the Interface Cables table.

The MedWeld 3005 resistance welding processor module is a welding processor that fits into the Allen-Bradley ™ SLC500 rack system.

The power module (dimensions 8 D x 12 W x 5 H (203mm x 305mm x 127mm)) is equipped with a 1200 amp SCR, a firing module and a current monitoring sensor. Each kit requires an interface cable (Part No. 205-1212Vx) that links the welding processor to the power module. The kit is completed with user manuals and drawings. Software T93300

First time integrators must register the kit by purchasing the "Integrator's Documentation Kit" (Part No. 830-0152) in order to facilitate quick ladder software instructions.

The CE mark applies only to the MedWeld 3005 Resistance Welding Processor Module (917-0050)

WTC welding controls provide a load resistor across the welding transformer. This resistor assures proper SCR firing and transient voltage suppression under all operating conditions.


The load resistor supplied as standard equipment is designed for spot welding or short duration seam welding use with a maximum weld time of 5 seconds and a maximum duty cycle of 33%. If your welding application involves weld times longer than 5 seconds per weld or an overall duty cycle exceeding 33%, a larger load resistor is required. Please contact the factory or your sales representative to obtain the correct load resistor for your application.

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Tripack Multi-Phase Power Modules

Part No. 830-0168V2 (distributed over three phases)
Part No. 830-0168 (distributed over one phase)
Software T93300

- *Please refer to the section on programming devices for editing and reviewing data and parameters stored in the MedWeld 3005 module.*
- *Please refer to the Interface Cables table.*

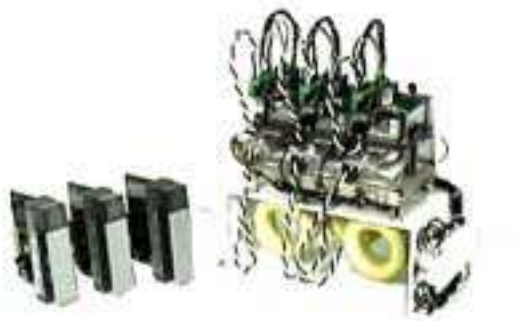

Tripack power module viewed from the bottom. The return line from the weld transformer must go through the appropriate current monitoring coil that is found beneath the SCRs.

The Tripack power module (dimension 15 D x 14 W x 9 H (380mm x 356mm x 230mm)) is recommended for welding stations that require multiple controls in limited space. The power module has three sets of 1200 amp SCRs, firing boards and current monitoring sensors. Three intelligent MedWeld 3005 resistance-welding processor modules are included for installation in the Allen-Bradley ™ SLC 500 rack. This kit requires three interface cables (Part No. 205-1212Vx) purchased separately. The kit is completed with user manuals and drawings. Software T93300

First time integrators must register the kit by purchasing the "Integrator's Documentation Kit" (Part No. 830-0152) in order to facilitate quick ladder software instructions.

- The CE mark applies only to the MedWeld 3005 Resistance Welding Processor Module (917-0050)

WTC welding controls provide a load resistor across the welding transformer. This resistor assures proper SCR firing and transient voltage suppression under all operating conditions.

The load resistor supplied as standard equipment is designed for spot welding or short duration seam welding use with a maximum weld time of 5 seconds and a maximum duty cycle of 33%. If your welding application involves weld times longer than 5 seconds per weld or an overall duty cycle exceeding 33%, a larger load resistor is required. Please contact the factory or your sales representative to obtain the correct load resistor for your application.

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Multi Timer and Cascade Modules

Description	Part or Model Numbers	
Multi - 3 Timer & 3 SCR	830-0168V2	
Multi - 2 Timer & 2 SCR	830-0478	
Multi - 1 Timer & 1 SCR	830-0471	
Multi - 1 Timer & 2 SCR	830-0555	
Multi - 1 Timer & 3 SCR	830-0556	
Multi - 2 Timer & 3 SCR	830-0557	
Cascades	120 VAC input switch	24 VAC or DC input switch
Cascade - 1 Timer & 3 SCR	830-0481V120	830-0481V24
Cascade - 1 Timer & 2 SCR	830-0480V120	830-0480V24
Cascade - 1 Timer & 1 SCR	830-0479V120	830-0479V24
Cascade - 0 Timer & 3 SCR	830-0484V120	830-0484V24
Cascade - 0 Timer & 2 SCR	830-0483V120	830-0483V24
Cascade - 0 Timer & 1 SCR	830-0482V120	830-0482V24

Examples: **Software: T93300**

- You want to configure a 6 SCR cascade system using 1 weld module. You would acquire a Cascade 1 Timer & 3 SCR unit and a Cascade 0 Timer & 3 SCR unit.

- You need two timers with each their own SCR but you think that in the future that you may need to expand to a three timer system. You can acquire the Multi 2 Timer & 3 SCR unit and when you expand, the third power SCR unit will be in place and you will only need to install a third timer in the AB SLC 500 rack.

The MedWeld 3005 cascade system coupled with the modularity of the SLC 500 rack makes these systems the most flexible solutions for the variations of welding equipment in use today.

You can configure multi-timer controls that are not multiples of three by using dual and single packaging formats. The dual and singles use the same water-cooling manifold as the Tripack.

You will need one interface cable (205-1212Vx) for each timer. For more information on the cascade system, please refer to the section "Cascade Weld Control Solutions.

Special Notice for Integrators of Cascade Systems:

The Cascade Selector Unit is available in two versions; one is 120 VAC and the other is for 24 Volts, AC or DC. Depending on the supply voltage used, the cascade board draws the following current:

- Maximum inrush current draw @120VAC is 0.84 A peak for a maximum of 0.75 seconds. This drops off rapidly to a steady-state value of 27mA.
- Current draw @ 24VAC is 17.7mA maximum. There is no inrush current.
- Current draw @ 24VDC is 12.5mA maximum. There is no inrush current.

Voltage signal supply is provided either through a dry contact or solid-state relay. For a solid-state relay, the maximum allowable off-state leakage current is 2mA.



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Interface Cables

Firing Cables	Length (ft)
205-1212V2	2
205-1212V4	4
205-1212V6	6
205-1212V8	8
205-1212V10	10
205-1212V12	12
205-1212V16	16
205-1212V25	25
205-1212V50	50
205-1212V75	75
205-1212V100	100

These cables are used to interface the MedWeld 3005 module that resides in the Allen-Bradley ™ SLC 500 rack and the firing card that is mounted on the SCR. Please use the proper length of cable for the application. Medar recommends that the installation not be equipped with excess length of cable that are left coiled up in the enclosures.

Facilitate your installation of longer cables by fishing it through conduit with the use of a Cable Saddle Guide Tool.

Part No.600-0328:
Cable Saddle Guide 1.25" diameter (31.75mm) x 1.5" H (38mm):



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Door Port Kits

Part No 830-0350V10

The HHT door port kit is used for providing environmentally protected access to the MedWeld 3005 resistance-welding processor module to the exterior of the cabinet. The cable plugs into the weld board and extends to the connector board that mounts on a plate to be mounted on the main enclosure.



Going clockwise from the bottom, the kit comprises of various bags of hardware, hinged door, gasket, cable, connector board, and mounting plate with access hole. An installation instructions set is also included.

Integrator's Documentation Kits

Part No 830-0152

This documentation kit is for qualified integrators who intend on using the advanced features of the MedWeld 3005i systems with the Allen-Bradley ™ SLC 500 features. It includes ladder logic for the SLC processor and two manuals. One manual details the relevant information that is accessible to and from the SLC 500 back plane. The second manual details the intelligent tools and instructions sets that are pertinent to the resistance welding process.



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Circuit Breaker with Operator Handle Kits

Circuit Breakers with Operating Handles	Kit Part Number	Handle
100 amp 3 pole breaker	830-0530	Rotary
100 amp 3 pole breaker	830-0531	Flange
250 amp 2 pole breaker	830-0532	Flange
250 amp 3 pole breaker	830-0533	Flange
400 amp 2 pole breaker	830-0534	Flange
400 amp 3 pole breaker	830-0535	Flange
600 amp 2 pole breaker	830-0536	Flange
600 amp 3 pole breaker	830-0537	Flange



Isolation Contactor Kits

Isolation Contactors	Kit Part Number	
	24 VDC Kit	120 VAC Kit
Size #3 isolation contactor - 3 pole	830-0550V24D	830-0550V120
Size #4 isolation contactor - 2 pole	830-0551V24D	830-0551V120
Size #4 isolation contactor - 3 pole	830-0552V24D	830-0552V120
Size #5 isolation contactor - 2 pole	830-0553V24D	830-0553V120
Size #5 isolation contactor - 3 pole	830-0554V24D	830-0554V120



Power Bus Bar Kits

Power Bus Bars	Kit Part Number
Med3045 Bars - one Tripack wide	830-0422
Med3055-Med3095 Bars - two Tripack wide	830-0423

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Remote Power Enclosure Solutions

Available in AC or MFDC models!

The remote power enclosures are suitable for integrated welding control solutions such as the MedWeld 3005 (Allen-Bradley ™ SLC500 System), the MedWeld 3003 (Nachi Robotics ™ System), the MedWeld 3004 (Fanuc Robotics ™ System) and the MedWeld 3006 (Motoman Robotics). It is selected where the user requires a separation of the higher welding bus voltages from the control circuits. The remote enclosure incorporates single or multiple SCRs and welding current sensors. It is also available with optional circuit breakers and isolation contactors. The intelligent resistance-welding processor module(s) is shipped with the enclosure to be installed in the main processor rack within the robot or SLC control. Each SCR firing module requires an interface cable to link it to the welding processor.

Please refer to the cable reference table.

First Time users of the MedWeld 3005 system should register by purchasing the "Integrator's Documentation Kit" (Part No. 830-0152) in order to facilitate quick ladder software instructions.

Note on Current Monitoring for AC and 3-Phase to DC Controls:

The current transformer coil shown above and throughout this catalog is used on AC and 3-Phase to DC controls. This device is suited for currents above 50 amperes. For applications below this level, please consult with WTC and request for the document entitled *"Guidelines to Select a Sensor to Measure Welding Current".*



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com


Single and Dual Remote Cabinet

Model No. 3003-x=1200-xxxx-…. (Nachi ® Robotics)
Model No. 3004-x=1200-xxxx-…. (Fanuc ® Robotics)

Model No. 3005-x=1200-xxxx-…. (Allen-Bradley ® SLC 500)
Model No. 3006-x=1200-xxxx-…. (Motoman ® Robotics)

Base includes

- Nema 12, Type 5 Enclosure
- One MedWeld 3005 WCU module
- One 1200 amp SCR, Firing Card, & Current Monitoring Coil

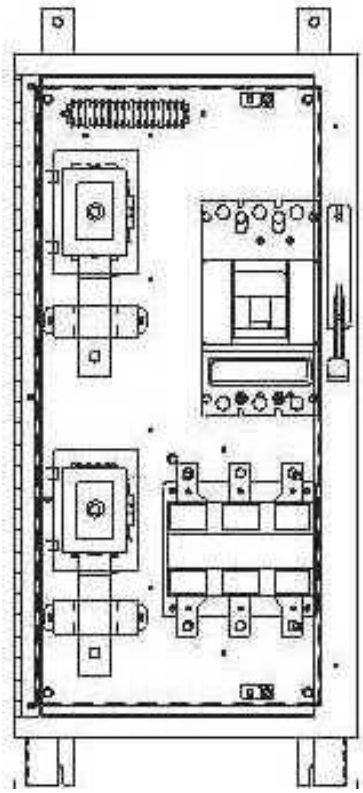

Options:

- Maximum: 2 SCRs – Cascade or Multi-timer
- Power lugs or Circuit Breaker (250/400 amp)
- Isolation Contactor (sizes 4 or 5)

This package suits only as a remote enclosure system. Robot or PLC must control internal inputs and outputs.

Seam Welding with Remote Enclosures

WTC welding controls provide a load resistor across the welding transformer. This resistor assures proper SCR firing and transient voltage suppression under all operating conditions.


The load resistor supplied as standard equipment is designed for spot welding or short duration seam welding use with a maximum weld time of 5 seconds and a maximum duty cycle of 33%. If your welding application involves weld times longer than 5 seconds per weld or an overall duty cycle exceeding 33%, a larger load resistor is required. Please contact the factory or your sales representative to obtain the correct load resistor for your application.


MedWeld 3003/3004/3005	*English*	*Metric*
Approximate Weight	*115 lbs*	*52 Kg*
Dimensions	*32H x 16W x 10.5D (in)*	*813H x 406W x 267D (mm)*
Mounting Centers	*12W x 35H (in)*	*305W x 889H (mm)*
Mounting Holes Diameter	*7/16th (in)*	*10 (mm)*

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Tripack Remote Cabinet

The Tripack distribution remote enclosure measures 43.5 H x 28 W x 16 D (1105mm x 711 x 406). It is a NEMA 12 enclosure and is equipped with up to three 1200 amp SCRs, three firing modules and three current monitoring sensors. The distribution remote enclosure provides a three-phase bus bar for convenient weld transformer hookup. The resistance-welding processor modules are shipped with the enclosure to be installed in the main processor rack.

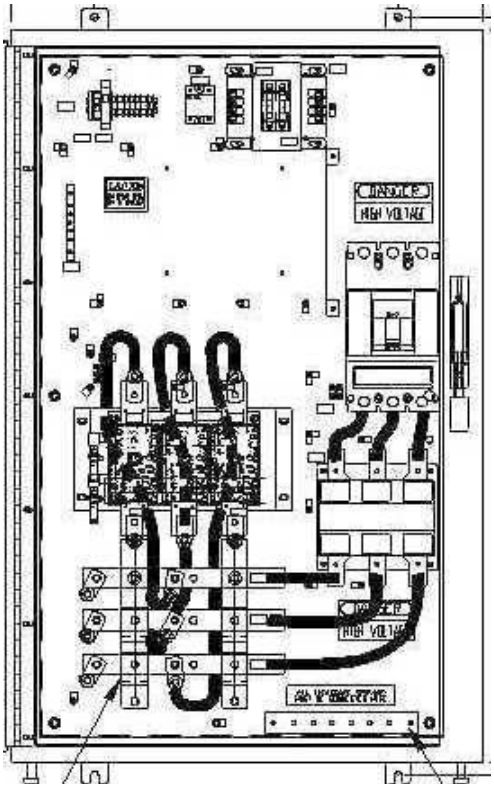

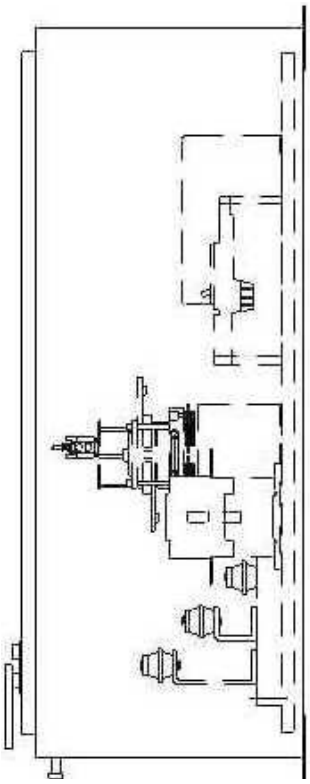



MedWeld 3045	English	Metric
Approximate Weight	235 lbs	107 Kg
Dimensions	43.5H x 28W x 16D (in)	1105H x 711W x 406D (mm)
Mounting Centers	18W x 45H (in)	457W x 1143H (mm)
Mounting Holes Diameter	7/16th (in)	10 (mm)

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Six-Pack Remote Cabinet

The six-pack distribution remote enclosure measures 43.5 H x 40 W x 16 D (1105mm x 1016 x 406). It is a NEMA 12 enclosure and is equipped with up to six 1200 amp SCRs, six firing modules and six current monitoring sensors. The distribution remote enclosure provides a three-phase bus bar for convenient weld transformer hookup. The resistance-welding processor modules are shipped with the enclosure to be installed in the main processor rack.

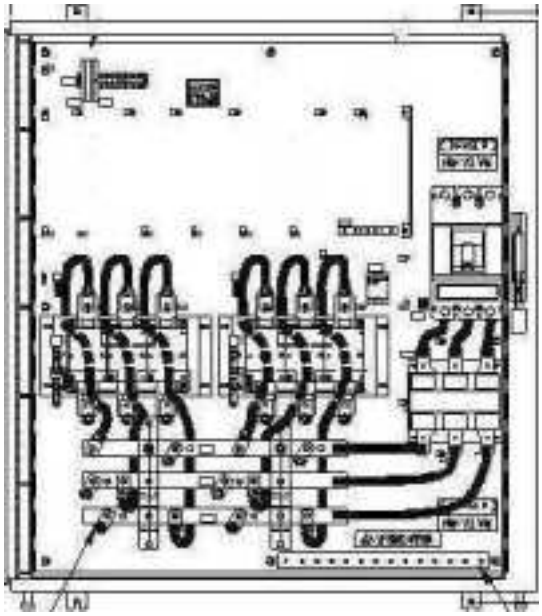

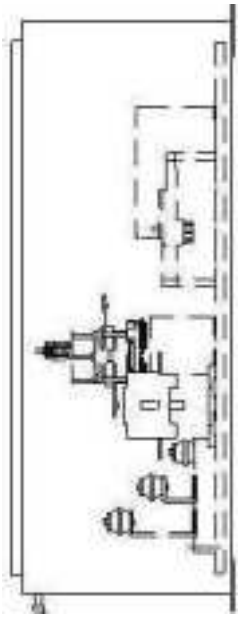

MedWeld 3055	***English***	***Metric***
Approximate Weight	*265 lbs*	*120 Kg*
Dimensions	*43.5H x 40W x 16D (in)*	*1105H x 1016W x 406D (mm)*
Mounting Centers	*30W x 45H (in)*	*762W x 1143H (mm)*
Mounting Holes Diameter	*7/16th (in)*	*10 (mm)*

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Integrated Single-Phase Weld Control Enclosure Solution

The MedWeld 3005 system can be fully configured Welding Control Units (WCU) that is immediately ready for use. It is available in several enclosures in various configurations. There are various standard packages as shown from pages 12 to 16. Should their need to be other customized integrated control packages, please call Medar or its distributor.

Seam Welding with Integrated Enclosures

WTC welding controls provide a load resistor across the welding transformer. This resistor assures proper SCR firing and transient voltage suppression under all operating conditions.

The load resistor supplied as standard equipment is designed for spot welding or short duration seam welding use with a maximum weld time of 5 seconds and a maximum duty cycle of 33%. If your welding application involves weld times longer than 5 seconds per weld or an overall duty cycle exceeding 33%, a larger load resistor is required. Please contact the factory or your sales representative to obtain the correct load resistor for your application.

Note on Current Monitoring for AC and 3-Phase to DC Controls:

The current transformer coil shown above and throughout this catalog is used on AC and 3-Phase to DC controls. This device is suited for currents above 50 amperes. For applications below this level, please consult with WTC and request for the document entitled *"Guidelines to Select a Sensor to Measure Welding Current".*




Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Model No. 3015-1=1200-xxxx-…. (Allen-Bradley ® SLC 500)

Base includes

- ***Nema 12, Type 5 Enclosure***
- ***One MedWeld 3005 WCU module***
- ***One 1200 amp SCR***
- ***One Firing Card***
- ***One Current Monitoring Coil***

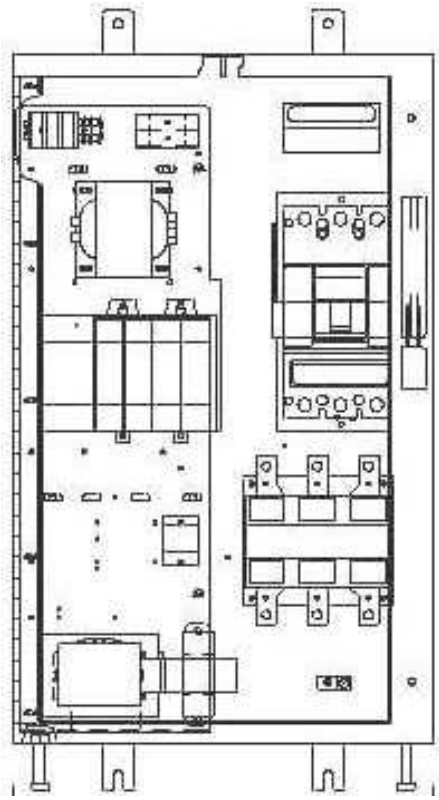

Options:

- Maximum: One 4-slot rack with AB modules.
- 250 / 500 VA Valve Power Supply & Fusing
- Power lugs or Circuit Breaker (250/400 amp)
- Isolation Contactor (sizes 4 or 5)
- HHT Port Kit & I/O Connectors Installed


MedWeld 3015	***English***	***Metric***
Approximate Weight	*155 lbs*	*70 Kg*
Dimensions	*33H x 20W x 10.25D (in)*	*838H x 508W x 260D (mm)*
Mounting Centers	*10W x 36H (in)*	*254W x 914H (mm)*
Mounting Holes Diameter	*7/16th (in)*	*10 (mm)*

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Model No. 3025-1=1200-xxxx-….(Allen-Bradley ® SLC 500)

Base includes

- ***Nema 12, Type 5 Enclosure***
- ***One MedWeld 3005 WCU module***
- ***One 1200 amp SCR***
- ***One Firing Card***
- ***One Current Monitoring Coil***

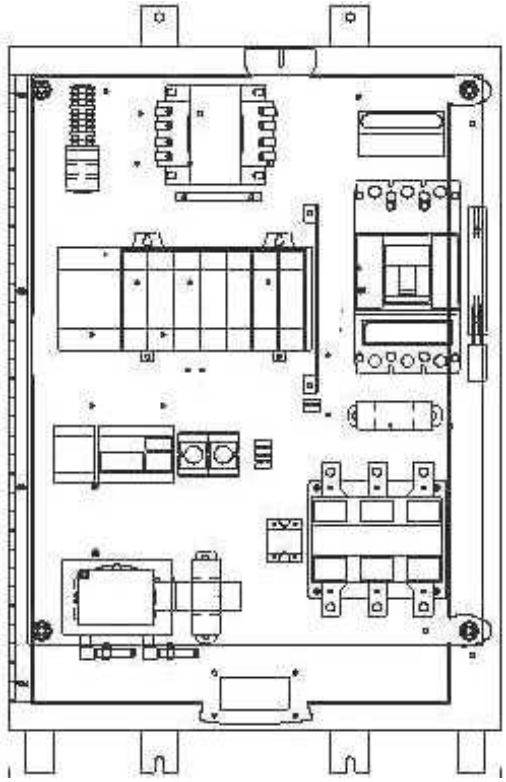

Options:

- Maximum: One 7-slot rack with AB modules
- 250 / 500 VA Valve Power Supply & Fusing
- Power lugs or Circuit Breaker (250/400/600/800 amp) *
- Isolation Contactor (sizes 4 or 5)
- SCR options: 1200 / 1750 / 2500 / 3300 amp
- HHT Port Kit & I/O Connectors Installed
- The maximum rack size stated assumes the assumes the use of a 400 amp Circuit Breaker


MedWeld 3025	***English***	***Metric***
Approximate Weight	*170 lbs*	*77 Kg*
Dimensions	*36H x 26W x 14D (in)*	*914H x 660W x 356D (mm)*
Mounting Centers	*10W x 39.25H (in)*	*254W x 997H (mm)*
Mounting Holes Diameter	*7/16th (in)*	*10 (mm)*

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Model No. 3035-x=1200-xxxx-…. (Allen-Bradley ® SLC 500)

Base includes

- ***Nema 12, Type 5 Enclosure***
- ***One MedWeld 3005 WCU module***
- ***One 1200 amp SCRs***
- ***One Firing Card***
- ***One Current Monitoring Coil***

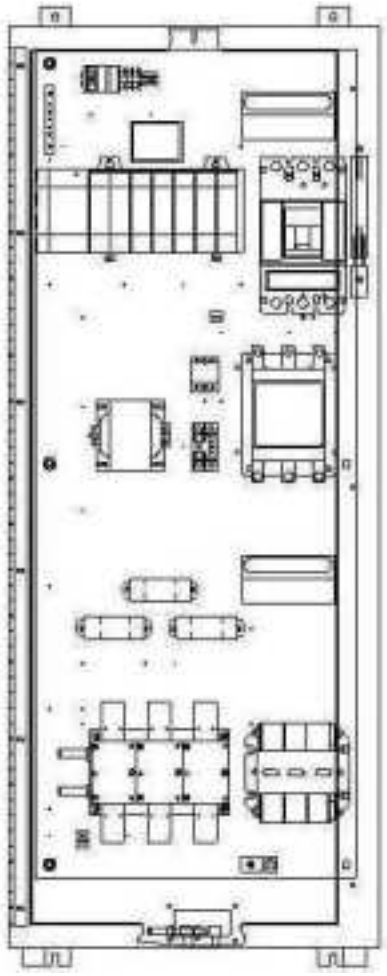

Options:

- Maximum: 3 SCRs – Cascade or Multi-timer
- Maximum: One 7-slot rack with AB modules
- 250 / 500 / 1000 VA Valve Power Supply & Fusing
- Power lugs or Circuit Breaker (250/400/600/800 amp) *
- Isolation Contactor (sizes 4 or 5)
- SCR options: 1200 / 1750 / 2500 / 3300 amp
- HHT Port Kit(s) & I/O Connectors Installed
- The maximum rack size stated assumes the assumes the use of a 400 amp Circuit Breaker


MedWeld 3035	***English***	***Metric***
Approximate Weight	*265 lbs*	*120 Kg*
Dimensions	*60H x 24W x 12D (in)*	*1524H x 610W x 305D (mm)*
Mounting Centers	*18W x 61.25 (in)*	*457W x 1556H (mm)*
Mounting Holes Diameter	*7/16th (in)*	*10 (mm)*

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Model No. 3045-x=1200-xxxx-…. (Allen-Bradley ® SLC 500)

Base includes

- ***Nema 12, Type 5 Enclosure***
- ***One MedWeld 3005 WCU module***
- ***One 1200 amp SCR***
- ***One Firing Card***
- ***One Current Monitoring Coil***

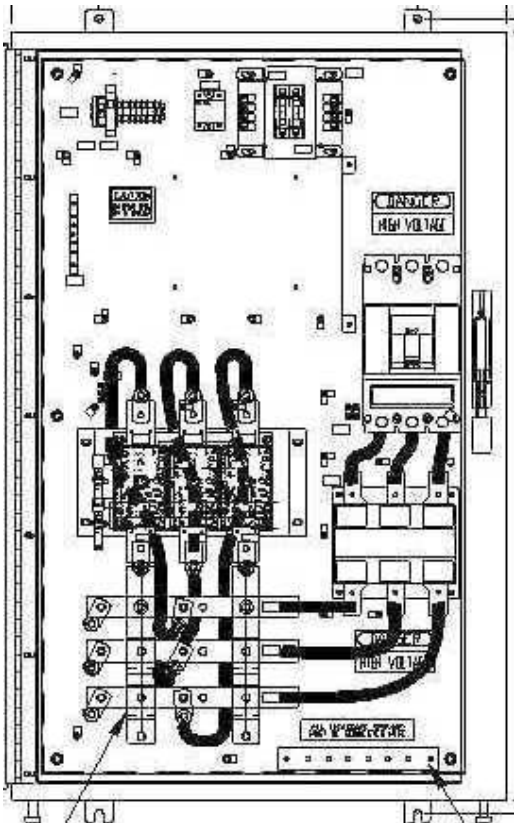

Options:

- Maximum: 3 SCRs – Cascade or Multi-timer
- Maximum: One 7-slot rack with AB modules
- 250 / 500 / 1000 VA Valve Power Supply & Fusing
- Power lugs or Circuit Breaker (250/400/600/800 amp) *
- Isolation Contactor (sizes 4 or 5)
- SCR options: 1200 / 1750 / 2500 / 3300 amp
- Welding Transformer Power Bus Bars
- Options: HHT Port Kit & I/O Connectors Installed
- The maximum rack size stated assumes the assumes the use of a 400 amp Circuit Breaker


MedWeld 3045	English	Metric
Approximate Weight	235 lbs	107 Kg
Dimensions	43.5H x 28W x 16D (in)	1105H x 711W x 406D (mm)
Mounting Centers	18W x 45H (in)	457W x 1143H (mm)
Mounting Holes Diameter	7/16th (in)	10 (mm)

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Model No. 3055-x=1200-xxxx-….(Allen-Bradley ® SLC 500)

Base includes

- ***Nema 12, Type 5 Enclosure***
- ***One MedWeld 3005 WCU module***
- ***One 1200 amp SCR***
- ***One Firing Card***
- ***One Current Monitoring Coil***

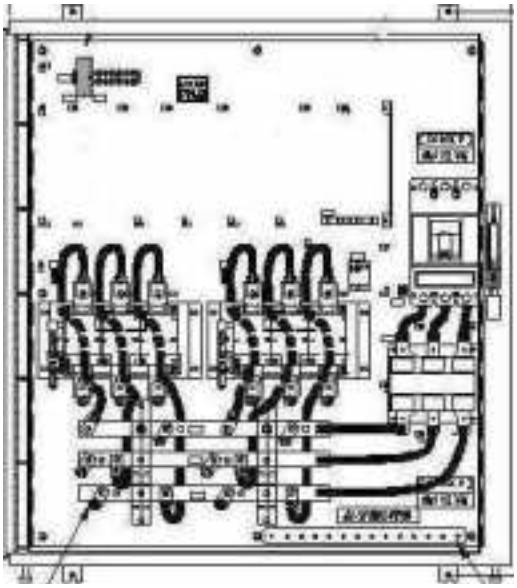

Options:

- Maximum: 6 SCRs – Cascade or Multi-timer
- Maximum: One 13-slot rack with AB modules
- 250 / 500 / 1000 VA Valve Power Supply & Fusing
- Power lugs or Circuit Breaker (250/400/600/800 amp) *
- Isolation Contactor (sizes 4 or 5)
- SCR options: 1200 / 1750 / 2500 / 3300 amp
- Welding Transformer Power Bus Bars
- Options: HHT Port Kit & I/O Connectors Installed
- The maximum rack size stated assumes the assumes the use of a 400 amp Circuit Breaker


MedWeld 3055	***English***	***Metric***
Approximate Weight	*265 lbs*	*120 Kg*
Dimensions	*43.5H x 40W x 16D (in)*	*1105H x 1016W x 406D (mm)*
Mounting Centers	*30W x 45H (in)*	*762W x 1143H (mm)*
Mounting Holes Diameter	*7/16th (in)*	*10 (mm)*

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Model No. 3065-x=1200-xxxx-…. (Allen-Bradley ® SLC 500)

Base includes

- ***Nema 12, Type 5 Enclosure***
- ***One MedWeld 3005 WCU module***
- ***One 1200 amp SCR***
- ***One Firing Card***
- ***One Current Monitoring Coil***

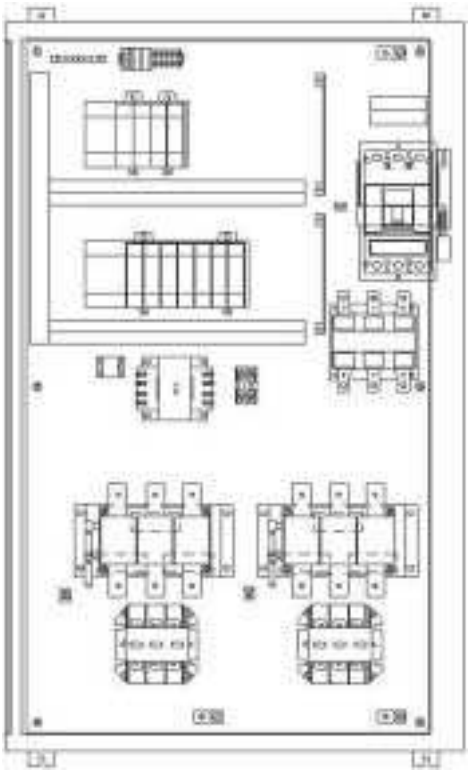

Options:

- Maximum: 6 SCRs – Cascade or Multi-timer
- Maximum:
  Two 13-slot racks with AB modules (non-interconnected)
  Two 10-slot racks with AB modules (interconnected)
- 250 / 500 / 1000 VA Valve Power Supply & Fusing
- Power lugs or Circuit Breaker
  (250/400/600/800/1200/1600/2000 amp) *
- Isolation Contactor (sizes 4 or 5)
- SCR options: 1200 / 1750 / 2500 / 3300 amp
- Options: HHT Port Kit & I/O Connectors Installed
- The maximum rack size stated assumes the assumes the use of a 400 amp Circuit Breaker


MedWeld 3065	*English*	*Metric*
Approximate Weight	*300 lbs*	*135 Kg*
Dimensions	*60H x 37.38W x 16D (in)*	*1524H x 950W x 406D (mm)*
Mounting Centers	*31.38W x 61.12H (in)*	*797W x 1553H (mm)*
Mounting Holes Diameter	*7/16th (in)*	*10 (mm)*

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Model No. 3075-x=1200-xxxx-….(Allen-Bradley ® SLC 500)

Base includes

- Nema 12, Type 5 Enclosure
- One MedWeld 3005 WCU module
- One 1200 amp SCR
- One Firing Card
- One Current Monitoring Coil

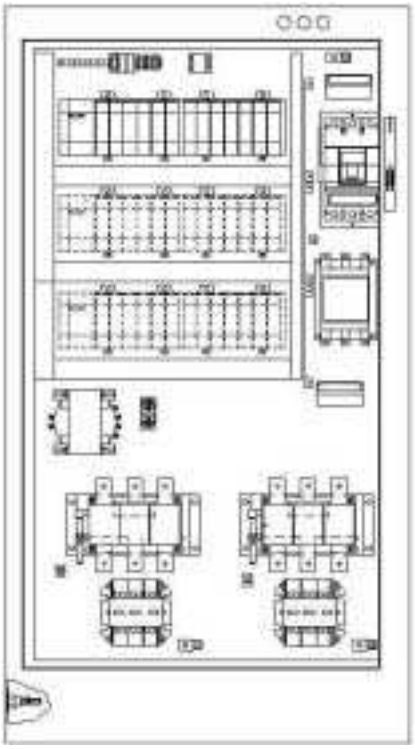

Options:

- Maximum: 6 SCRs – Cascade or Multi-timer
- Maximum:
  Three 13-slot racks with AB modules (non-interconnected)
  Three 10-slot racks with AB modules (interconnected)
- 250 / 500 / 1000 VA Valve Power Supply & Fusing
- Power lugs or Circuit Breaker
  (250/400/600/800/1200/1600/2000 amp) *
- Isolation Contactor (sizes 4 or 5)
- SCR options: 1200 / 1750 / 2500 / 3300 amp
- Options: HHT Port Kit & I/O Connectors Installed


MedWeld 3075	***English***	***Metric***
Approximate Weight	*350 lbs*	*160 Kg*
Dimensions	*72.12H x 39.5W x 18.13D (in)*	*1832H x 1000W x 460D (mm)*
Mounting Centers	*Floor Mount*	*Floor Mount*

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Model No. 3095-x=1200-xxxx-….(Allen-Bradley ® SLC 500)

Base includes

- Nema 12, Type 5 Enclosure
- One MedWeld 3005 WCU module
- One 1200 amp SCR
- One Firing Card
- One Current Monitoring Coil

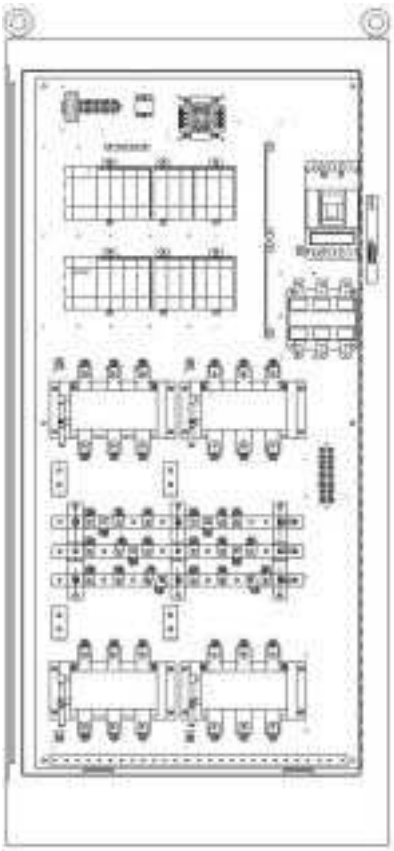

Options:

- Maximum:
  12 SCRs – Cascade or Multi-timer with AB racks
  15 SCRs – Cascade without AB racks (remote enclosure)
- Maximum:
  Two 13-slot racks with AB modules (non-interconnected)
  Two 10-slot racks with AB modules (interconnected)
- 250 / 500 / 1000 VA Valve Power Supply & Fusing
- Power lugs or Circuit Breaker
  (250/400/600/800/1200/1600/2000 amp) *
- Isolation Contactor (sizes 4 or 5)
- Welding Transformer Power Bus Bars
- SCR options: 1200 / 1750 / 2500 / 3300 amp
- Options: HHT Port Kit(s) & I/O Connectors Installed

MedWeld 3095	***English***	***Metric***
Approximate Weight	*550 lbs*	*250 Kg*
Dimensions	*84.13H x 39.5W x 18.13D (in)*	*2137H x 1000W x 460D (mm)*
Mounting Centers	*Floor Mount*	*Floor Mount*

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Options and Accessories for Integrated Solutions

Circuit Breakers with Operating Handles

Circuit Breakers with Operating Handles
100 amp 3 pole breaker
100 amp 3 pole breaker
250 amp 2 pole breaker
250 amp 3 pole breaker
400 amp 2 pole breaker
400 amp 3 pole breaker
600 amp 2 pole breaker
600 amp 3 pole breaker
800 amp 3 pole breaker
1200 amp 3 pole breaker
1600 amp 3 pole breaker
2000 amp 3 pole breaker



Note: Maximum rack size stated in MedWeld 3015, 3025, 3035, 3045, 3055, 3065, 3075, and 3095 are given with the use of 400 amp circuit breakers or smaller. Go one rack size smaller if acquiring a 600 or 800 amp circuit breaker. Please call for allowance of rack sizes for circuit breakers larger than 800 amps.

Isolation Contactors

Isolation Contactors
Size #3 isolation contactor - 3 pole
Size #4 isolation contactor - 2 pole
Size #4 isolation contactor - 3 pole
Size #5 isolation contactor - 2 pole
Size #5 isolation contactor - 3 pole



ABB is WTC's partner in supplying circuit breakers and isolation contactors.


Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

SCR Upgrades

Additional MedWeld 3005 Controls & SCRs
Additional MedWeld 3005 module & 1200 amp SCR
Additional 1200 amp SCR cascade
Upgrade to 1750 amp SCR from 1200 amp (per SCR)
Upgrade to 2500 amp SCR from 1200 amp (per SCR)
Upgrade to 3300 amp SCR from 1200 amp (per SCR)

Power Transformers

Power Transformers (120V: 220/480/600V) & Fusing
250 VA
500 VA
1000 VA
1500VA
2000 VA
3000 VA
5000 VA

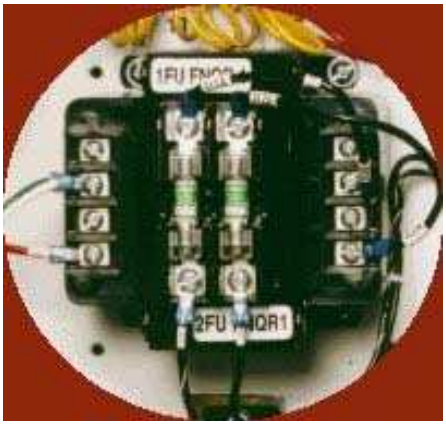

250 VA Transformer

Special Multitap Power Transformers

Power Transformers 14Pri Taps/10Sec Taps & Fusing
500 VA
3000 VA
600/575/550/500/480/460/440/416/400/380/240/230/220/208 V 130/125/120/115/110/100/99/95/91/85 V

DC Power Supplies

24 VDC Fused Power Supplies
1.2A @24Vdc (303-0407)
2.4A @ 24Vdc (303-0624)
16.7A @ 24Vdc (303-0608F)

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Power Bus Bars

Power Bus Bars
Med3045 Bars - one Tripack wide
Med3055-Med3095 Bars - two Tripack wide
3-Terminal Power Distribution Block

Multi-pin Connectors and Terminal Strips

Installed Multi-pin Connectors or Terminals
11 pos. Sine A
16 pos. Sine A
21 pos. Sine A
31 pos. Sine A
41 pos. Sine A
10 pos. Harting
16 pos. Harting
24 pos. Harting
32 pos. Harting
CLACK Gripper (for firing cable)
terminals on strip

Door Port Access Kit

Door Port Kit
HHT Door Port Kit

Water Flow Switches and Valves

Water Valves & Flow Switches
Water Saver Kit (830-0001) - Program Driven
Water Flow Switch (830-0002)

Secondary Current Monitoring Kits

Secondary Current Monitor
Secondary Current Feature with Coil
Secondary Current Feature - No Coil



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Allen-Bradley ™ Components

Please refer to Allen-Bradley ™ Publication: **1746-PL001D-EN-P -November 2001** for description and specifications of these versatile products. Please reference descriptions below as a guide sheet for most common parts used in the MedWeld 3005 Integrated System. These prices are subject to change since Rockwell Automation controls them.

Fixed I/O Configuration

The fixed I/O configuration will provide the basic necessary I/O control engine to complete a standard welding control. There are 12 inputs and 8 outputs available with the fixed I/O block configuration. The MedWeld 3005 welding processor is interfaced to the module by means of a 2-slot expansion module.

You have two options for this configuration; the first with a factory locked ladder and the second with a factory open ladder. The locked ladder is stored on a UV Prom and is meant for users who will not change the I/O configuration of their control. The open ladder is stored on an EE Prom and is meant for users who may want to reconfigure the I/O of their welders.

Fixed I/O Module (12 DC In / 8 Relay Out)	1747-L20C
2-Slot Expansion for Fixed I/O	1746-A2
Medar UVProm L20C, 5/01 & 5/02 1K	904-0038
Fixed configuration with factory locked ladder:	

Fixed I/O Module (12 DC In / 8 Relay Out)	1747-L20C
2-Slot Expansion for Fixed I/O	1746-A2
EEPROM Mem-5/01 & 5/02 -1k	1747-M1
Fixed configuration with factory open ladder:	

Flexible I/O Configurations

The flexible I/O configuration will provide from the basic necessary I/O control engine to complete a standard welding control to that of a more complex machine controller with various input, output and specialty modules. There are several rack configurations, AB Processors of varied capabilities, and numerous specialty modules. The MedWeld 3005 welding processor is interfaced to the A-B rack by inserting it in an appropriate slot. You can insert up to six MedWeld 3005 modules in a single rack powered by the 1746-P2-power supply. For configurations requiring more than six MedWeld 3005 controls, you would use multiple racks with interconnect cables.



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Chassis and Interconnect Cables

The first slot of the first chassis is always reserved for the processor module or the 1747-ASB modules. The chassis houses the processor and the I/O modules. The power supply mounts on the left side of the chassis. Chassis do not include interconnect cables. If an interconnect cable is required, refer to the chassis interconnect cable price table.

2-Slot Expansion for Fixed I/O	1746-A2
4-Slot Chassis	1746-A4
7-Slot Chassis	1746-A7
10-Slot Chassis	1746-A10
13-Slot Chassis	1746-A13
Interconnect - up to 6"	1746-C7
Interconnect - 6" to 36"	1746-C9

Power Supplies

The power supply does not require a slot in the chassis. It mounts on the left side of the chassis with two screws. To provide power to the processor and each I/O slot, select a power supply from the table.

P1 Power Supply	1746-P1
P2 Power Supply	1746-P2
P3 Power Supply	1746-P3
P4 Power Supply	1746-P4
P5 Power Supply	1746-P5



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Modular Processors

The processor is to be inserted in the first slot in the first chassis. There are various processors available that come with varying capabilities. Some welding applications will require some minimal configuration. For example, the full protection level-3 manual transgun system with advanced redundancies described on later pages requires a 5/03 processor as a minimum due to speed and timing requirements.

5/01 Processor - 1K memory	1747-L511
5/01 Processor - 4K memory	1747-L514
5/02 Processor - 4K memory	1747-L524
5/03 Processor - 8K memory	1747-L531
5/03 Processor - 16K memory	1747-L532
5/04 Processor - 16K memory	1747-L541
5/04 Processor - 32K memory	1747-L542
5/04P Processor - 32K memory	1747-L542P
5/04 Processor - 64K memory	1747-L543
5/04P Processor - 64K memory	1747-L543P
5/05 Processor - 16K memory	1747-L551
5/05 Processor - 32K memory	1747-L552
5/05 Processor - 64K memory	1747-L553
5/05P Processor - 64K memory	1747-L553P

Memory Modules

The ladder program that runs the Allen-Bradley ™ SLC500 System can be saved in a memory module.

EEPROM Mem-5/01 & 5/02 -1k	1747-M1
EEPROM Mem-5/01 & 5/02 -4k	1747-M2
EEPROM Mem Mod- 5/03,5/04,5/05 -32k	1747-M11
EEPROM Mem Mod- 5/03,5/04,5/05 -64k	1747-M12
UVProm L20C, 5/01 & 5/02 1K	904-0038
UVProm L20C, 5/01 & 5/02 4K	904-0039



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Input and Output Modules

A wide variety of discrete I/O modules are available. The table is a partial listing of the most popular modules that have been used for a MedWeld 3005 system. Please refer to the Allen-Bradley ™ publication for detailed specifications of each module.

120Vac Input Module -4	1746-IA4
120Vac Input Module -8	1746-IA8
120Vac Input Module -16	1746-IA16
120/240Vac Output Module -8	1746-OA8
120/240Vac Output Module -16	1746-OA16
120/240Vac Output Module -16	1746-OAP12
Current Sink - 24Vdc Input -8	1746-IB8
Current Sink - 24Vdc Input -16	1746-IB16
Current Sink - 24Vdc Input -32	1746-IB32
Current Sourcing - 24Vdc Input -8	1746-IV8
Current Sourcing - 24Vdc Input -16	1746-IV16
Current Sourcing - 24Vdc Input -32	1746-IV32
Current Sourcing - 24Vdc Output -8	1746-OB8
Current Sourcing - 24Vdc Output -16	1746-OB16
Current Sourcing - 24Vdc Output -32	1746-OB32
Current Sinking - 24Vdc Output -8	1746-OV8
Current Sinking - 24Vdc Output -16	1746-OV16
Current Sinking - 24Vdc Output -32	1746-OV32
AC/DC Relay Output -4	1746-OW4
AC/DC Relay Output -8	1746-OW8
AC/DC Relay Output -16	1746-OW16
AC/DC Isolated Relay Output -8	1746-OX8
120Vac In (2) - AC/DC Relay Out (2)	1746-IO4
120Vac In (4) - AC/DC Relay Out (4)	1746-IO8
120Vac In (6) - AC/DC Relay Out (6)	1746-IO12
24 Vdc In (6) - AC/DC Relay Out (6)	1746-IO12DC



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Remote I/O and Device Net Modules

Rather than cabling a multi-wire discrete I/O interface between a host PLC ™ and a MedWeld 3005 control, a remote I/O or device net module can be used in place. This configuration will facilitate installation.

RIO	Medar-RIO
Device Net Scanner	1747-SDN
Device Net Interface	1761-NET-DNI
Control Net Scanner	1747-SCNR

Analog and Encoder Modules

Allen-Bradley ™ provides several options for analog I/O interfaces that can be used for varying resistance-welding applications.

High Resolution Analog In 4	1746-NI4
High Resolution Analog In 8	1746-NI8
High Resolution Analog In 2 / Out 2	1746-NIO4I
High Resolution Analog In 2 / Out 2	1746-NIO4V
Fast Analog In 2 / Out 2	1746-FIO4I
Fast Analog In 2 / Out 2	1746-FIO4V
Analog Output 4	1746-NO4I
Analog Output 4	1746-NO4V
High Speed Encoder	1746-HSCE



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Cascade Weld Control Solutions

The MedWeld 3005 Cascade system is available in kit, remote enclosures or fully integrated formats.

In the remote enclosure format, a NEMA 12 enclosure is equipped with multiple 1200 amp SCRs, the cascade cards, one firing module, one current monitoring sensor, and the optional circuit breaker and isolation contactor. One MedWeld 3005 resistance-welding processor module is shipped with the enclosure to be installed in the main processor rack. There are four different remote enclosure models; MedWeld 3005 (2-SCRs), MedWeld 3045 (3-SCRs), MedWeld 3055 (6-SCRs) and MedWeld 3095 (12-SCRs with bus bars or 15 SCRs in a vertical stack-up).

In the fully integrated scheme, a NEMA 12 enclosure is equipped with all the material of the remote enclosure system described above. It also accommodates the Allen-Bradley ™ SLC 500 hardware for full machine and welding control requirements.

A function in the MedWeld 3005 resistance-welding processor "TURN ON CONTACTOR SELECT #nn" is used for selecting the proper SCR to fire. The value "nn" is programmable from 01 to 15. The output for the contactor select can either be 24VAC, 24VDC or 120VAC. The cascade card automatically detects the voltage of the output point.

Each cascade card can interface with 3 SCRs. Up to 5 cascade cards can be daisy-chained together for the selection of up to 15 SCRs. There is on-board hardware protection that ensures that only 1 SCR is selected even if more than one output is turned on. There are diagnostic LEDs to visually signify which SCR is addressed.




Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com


Single Timer - Multiple SCR Systems

The MedWeld 3005 control can be shared amongst multiple SCRs in a cascade circuit. This system allows for individual control for each welding application by time-sharing the welding processor.

- ***Simple SCR selection scheme***
- ***Full-featured welding functions of the MedWeld 3005 are standard.***
- ***Available in kit formats.***
- ***Available in remote enclosures.***
- ***Available in integrated systems.***

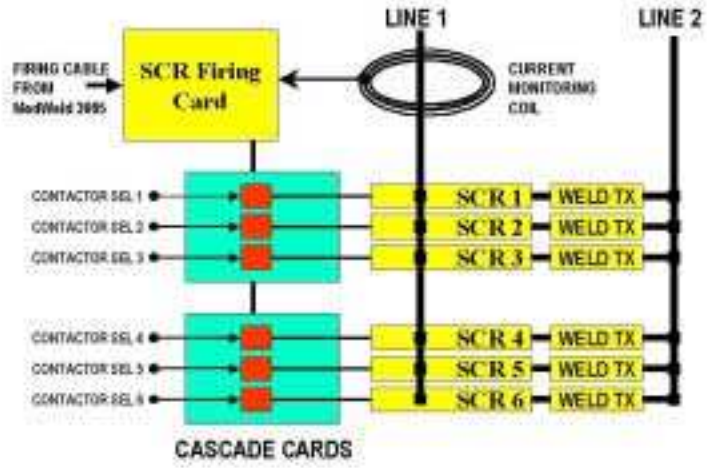

Multiple Timers - Multiple SCR Systems

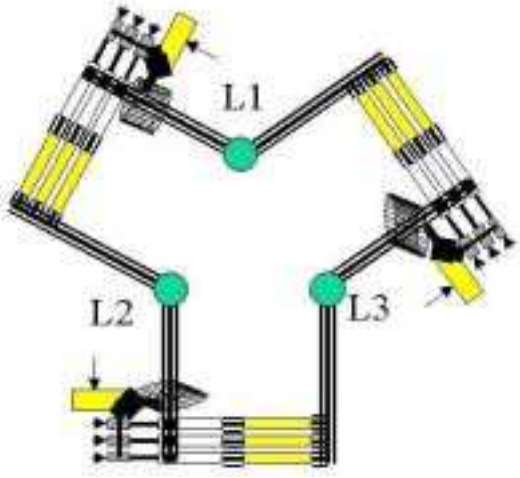

Rather than sequencing 9 SCRs in cascade fashion, the user in this case has equipped his control with 3 timers that cascade 3 SCRs each for a total of 9 SCRs. This enables the user to balance the loads over three phases and also reduce machine cycle time.

The MedWeld 3005 can be configured to take advantage of both the lower cost cascade system and the rapid advantage of the multi control system. The drawing above shows three separate cascades integrated together over three phases. These cascade systems are distributed across Phase A (L1-L2), Phase B (L2-L3) and Phase C (L3-L1).

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Model Number Review for Cascade Systems

The model of the above configuration can be as follows:

3095-3W9C=1200-xxxx-…..

This means that this cascade system has 3 resistance-welding processor modules (-3W) and 9 SCRs in total (9C=1200).

Part numbers are used to classify a product in a detailed manner. There are distinct bills of materials that are associated to a part number hence if you want to reorder an identical system to one that has been purchased before; you would specify a "Part Number".

Model numbers are descriptive numbers of a general nature. It is used to classify a product at a glance. Let's discuss the differences between Integrated Multi Controls, Integrated Remote Single Phase Cascade, and Integrated Multi Controls with Cascade.

Integrated Multi Control: 3075-6=1200-4003-1=#5-4806
This is a multi welder equipped with 6 resistance-welding modules, 6 SCRs (1200 amps), a 400 amp 3 pole breaker, and a size #5 isolation contactor wired for 480 volts 60 Hz. 3-phase

Integrated or Remote Single Phase Cascade: 3055-6C=1200-4002-1=#5-4806
This can be a remote enclosure equipped with one resistance-welding module (shipped loose for installation in AB rack), or an integrated system that has one resistance-welding module in a rack within the enclosure. There are also 6 SCRs (1200 amps), a 400 amp 2-pole breaker, and a size #5 isolation contactor wired for 480 volts 60 Hz. Single phase.

Integrated Multi Control with Cascade: 3075-3W6C=1200-4003-1=#5-4806
This is a multi welder equipped with 3 resistance-welding modules, 6 SCRs (1200 amps), a 400 amp 3-pole breaker, a size #5 isolation contactor wired for 480 volts 60 Hz. 3-phase.



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Mid-Frequency to DC (MFDC) Weld Control Solutions



The MedWeld MFDC 600 Amp Inverter shown here is available to systems integrators for use with the MedWeld 3005 interface module or can be interfaced to your own proprietary analog output control systems.

The MedWeld MFDC 1200 Amp and MFDC 300 Amp inverters are also available for your integration requirements.

- ***All Medar Inverters (MF300, MF600, and MF1200) can be interfaced to other control systems. The units shown in this catalogue are interfaced to the MedWeld 3005 welding processor. With this interface, you can use all the programmability features that are inherent with that welding processor. Features such as C-factor, Current Regulation, Automatic Voltage Compensation and much more are included. The MedWeld 3005 welding processor can also be programmed in half cycle increments.***

- ***Other special interfaces are available for the Medar inverter. For rapid synchronized firing, a milli-second triggering and control is available.***

- ***For using a welding processor other than a Medar resistance-welding processor module, a Euro interface is available for the MedWeld Inverter. Please call Medar to discuss your welding application.***

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Benefits of MFDC Welding Systems

There are applications and situations where the MFDC resistance welding is the best choice available. Although there are significantly higher initial prices, the overall cost of using MFDC over single and three-phase SCR control may actually be significantly lower. Consider these advantages:

- ***Significant Energy Savings***: - for plants that cannot purchase more electrical power, the MFDC approach may allow you to do more projects with less energy.
- ***Improved and Consistent Power Factor***: - the MFDC load appears to have unity power factor, which would then reduce penalties assessed by the power company.
- ***Automatic Load Distribution:*** - the MFDC load is evenly distributed across all three phases. The bank of capacitors that are found on the MFDC system allows for current to draw from the bank as well as from the line thus reducing peak line currents.
- ***Welding is Tolerant of Electrical Line Disturbances:*** - the energy reserve of the capacitor banks will smooth out line notches and line spikes even while welding is taking place.
- ***Eliminates Need and Maintenance of Expensive Kickless Cables:*** - because of the higher operating frequencies (400 to 1600Hz), the welding transformer can be as much as 74% smaller than the traditional line frequency (50 / 60 Hz). This allows the user to locate the transformer much closer to the welding gun thus eliminating the use of expensive Kickless cables that need to be maintained and monitored.
- ***Precise Welding Current Control:*** - the MFDC utilizes IGBTs for switching. These are turned on and off at the rate of 400 to 2000 times per second. By controlling both the turn on and turn off, the MFDC can determine the current to control. Conventional controls utilize SCRs for switching. These are turned on by the weld control but then remain conducting until the line voltage crosses the zero point during the base frequency line cycle. Because of this, conventional controls must use a predictive algorithm rather than a deterministic approach. Also, if an under or over compensation occurs on one of the cycles, the conventional will have to wait until the next period of the base frequency whereas the MFDC need only wait a fraction (1/20th nominal) of that time.
- ***Attains Target Current Immediately:*** - DC systems of the SCR type have a rise time prior to its steady state. Since the MFDC is so responsive, it is possible to create full phase firing during the natural rise time to lessen that period of time.
- ***More Process Friendly:*** - the MFDC eliminates undesired inter-cycle cooling periods that exist in AC resistance welding processes. Welding therefore can occur faster which would then reduce heat waste and the problems associated to eliminating that waste.



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

MF600 Inverter for all Steel Caliber Range


Model No. 3005-1=MF600-xxxx-…. (Allen-Bradley ® SLC 500)

Base includes

- Nema 12, Type 5 Enclosure
- One MedWeld 3005 WCU module
- MFDC 600 amp inverter – Duty Cycle 20%
- Charging circuit

Options:

- Maximum: One 7-slot rack with AB modules
- 250 / 500 VA Valve Power Supply & Fusing
- Power lugs or Circuit Breaker (100/250 amp 3 pole)
- Isolation Contactor (size 4)
- HHT Port Kit & I/O Connectors installed

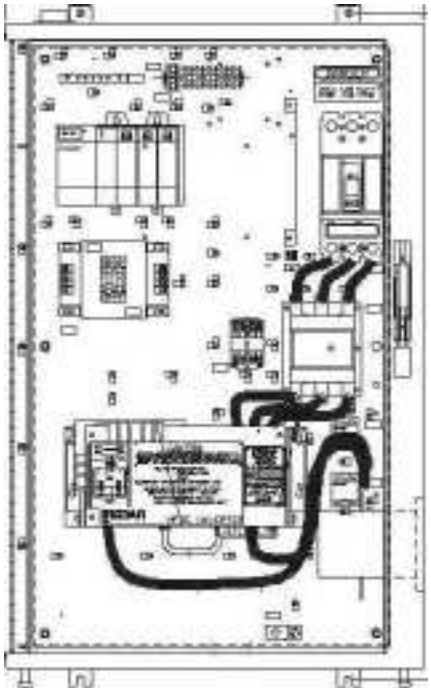

- *Please refer to the section on programming devices for editing and reviewing data and parameters stored in the MedWeld 3005 welding*

Duty Rating Curves are the only way of estimating proper sizing requirements for resistance welding applications. Please consult with a WTC representative to obtain clear understanding of the size ratings of inverters.

MedWeld MF600	***English***	***Metric***
Approximate Weight	*265 lbs*	*120 Kg*
Dimensions	*43.5H x 28W x 16D (in)*	*1105H x 711W x 406D (mm)*
Mounting Centers	*18W x 45H (in)*	*457W x 1143H (mm)*
Mounting Holes Diameter	*7/16th (in)*	*10 (mm)*

MF600 Inverter Kit

MF600 KIT
Inverter with charging circuit (830-0506)

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

MF1200 Inverter for Aluminum Welding Caliber Range


Model No. 3005-1=MF1200-xxxx-…. (Allen-Bradley ® SLC 500)

Base includes

- Nema 12, Type 5 Enclosure
- One MedWeld 3005 WCU module
- MFDC 1200 amp inverter – Duty Cycle 20%
- Charging circuit

Options:

- Maximum: One 7-slot rack with AB modules
- 250 / 500 VA Valve Power Supply & Fusing
- Power lugs or Circuit Breaker (100/250/400 amp 3 pole)
- Isolation Contactor (size 4)
- HHT Port Kit & I/O Connectors installed

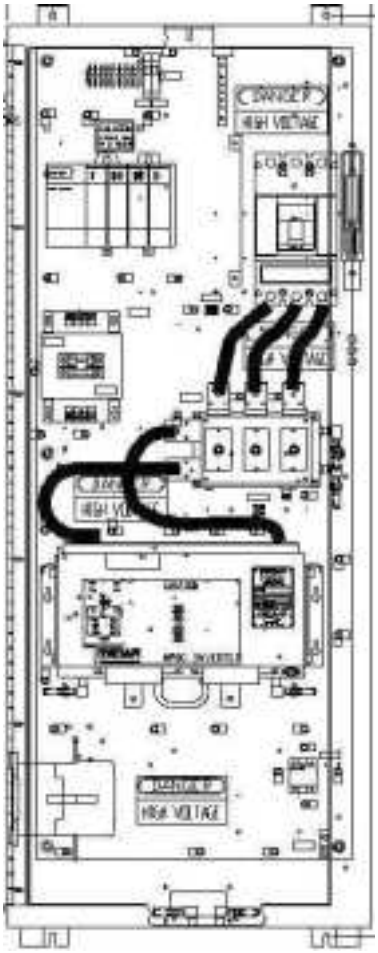

- *Please refer to the section on programming devices for editing and reviewing data and parameters stored in the MedWeld 3005 welding module.*


MedWeld MF1200	***English***	***Metric***
Approximate Weight	*300 lbs*	*135 Kg*
Dimensions	*60H x 24W x 14D (in)*	*1524H x 610W x 356D (mm)*
Mounting Centers	*18W x 61.25 (in)*	*457W x 1556H (mm)*
Mounting Holes Diameter	*7/16th (in)*	*10 (mm)*

MF1200 Inverter Kit

MF1200 KIT
Inverter with charging circuit (830-0512)

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Milli-Second Interface Option

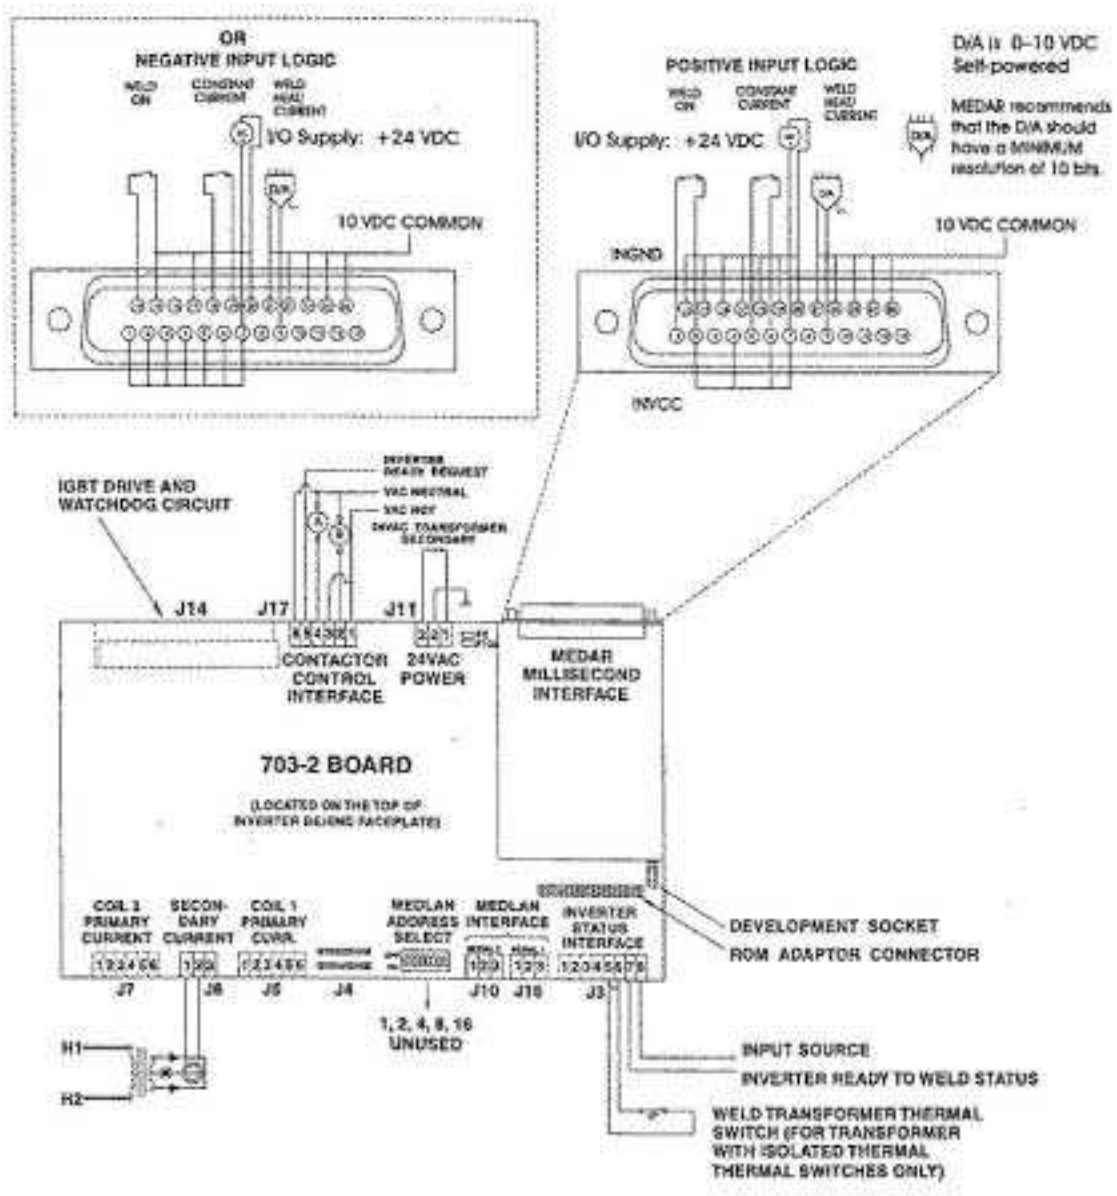

This illustration shows the interface to a millisecond control that is required for high-speed welding machines that are found for the assembly of specialized cross wire applications, electrical contacts, and other very high-speed applications. Please consult with a WTC representative for the latest interface specifications that are subject to change.

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Medar MFDC System with Millisecond Interface

The millisecond interface is equipped with a 25-pin female D-Sub connector. The table below defines the required pin-outs. The interface consists of three digital and four analog inputs and the figure to the left illustrate the interface connections.

PIN #	Description
1	IN 0
2	IN VCC
3	IN 1
4	IN VCC
5	IN 2
6	IN VCC
7	IN VCC
8	ANALOG VCC
9	ANALOG 0
10	ANALOG 1
11	ANALOG 2
12	ANALOG 3
13	N/C
14	(IN 0)
15	IN GND
16	(IN 1)
17	IN GND
18	(IN 2)
19	IN GND
20	IN GND
21	ANALOG GND
22	ANALOG GND
23	ANALOG GND
24	ANALOG GND
25	ANALOG GND

The integrator supplies the voltage to operate the digital inputs. The integrator can select whether the inputs are active HIGH or active LOW. IN0 is connected to the anode side of opto-coupler input while (IN0) is connected to the cathode side.

To make the inputs active HIGH, connect the IN GND signal to (IN0), (IN1) and (IN2). The IN0, IN1, and IN2 are connected through switches to IN_VCC to provide the digital input. To make the inputs active LOW, connect the IN_VCC to IN0, IN1, and IN2 and apply switches between the IN GND and (IN0), (IN1), and (IN2).

The nominal input voltage is 24Vdc - ranging from 10 to 28 Vdc. The maximum current draw of the inputs is 50 mA.

- *IN0 / (IN0) is defined as WELD. When this signal is active, the inverter will fire at the voltage / current setting defined by the ANALOG 0.*
- *IN2 / (IN2) is defined as Constant Current Mode. If this signal is inactive, the inverter will operate in Constant Voltage Mode.*

The millisecond interface card supplies the voltage for the analog inputs via the lead ANALOG VCC. The reference point is compared to ANALOG GND input.

Please call WTC's representative for assistance in configuring your requirements and estimating costing.




Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

MedWeld 3005 3-Phase to DC Weld Controls



The MedWeld 3005 can be configured for Three-Phase to DC applications. The flexibility of the Allen-Bradley SLC 500 system permits some unique and innovative solutions for welding. Analog interface solutions are readily available. Even more unique is the possibility of configuring cascade three phase systems.

Single MedWeld 3-Phase System

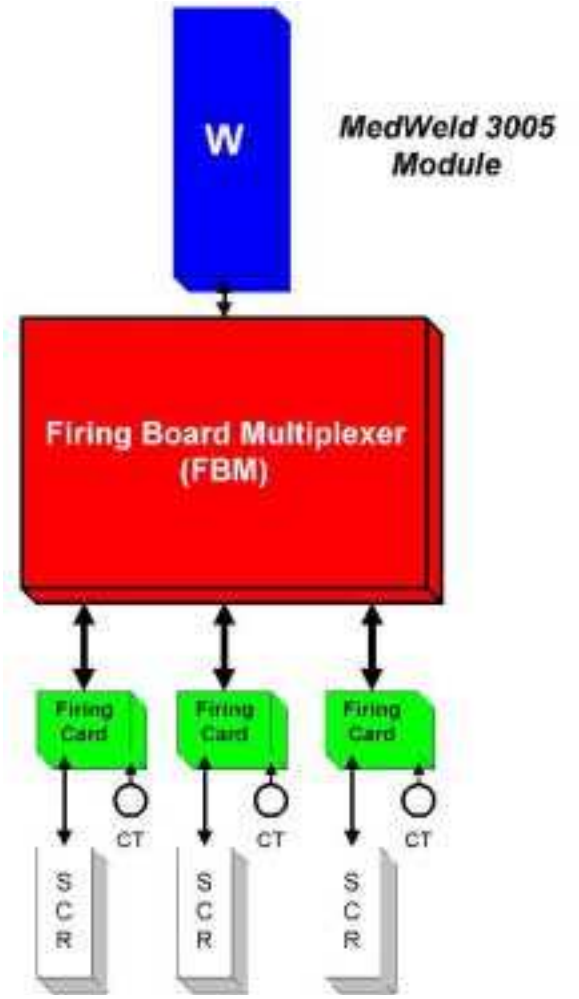

WTP – Single MedWeld Three-Phase

The MedWeld processor resides in the Allen-Bradley SLC 500 rack. It is interfaced to three sets of inversed parallel SCRs for controlling three phases to DC welding transformer.

A single MedWeld 3005 weld processor utilizes a firing board multiplexer to sequence the firing of the SCRs in proper rotation and order.


"W" signifies that there will be one MedWeld module.

"TP" signifies that there will be one Three-Phase assembly that comprises of one FBM, three firing cards, three SCRs, and three current monitoring coils.

WTP=2500 means that the SCRs are rated at 2500 amperes – 50% duty cycle.

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com


Multiple MedWeld 3-Phase Systems

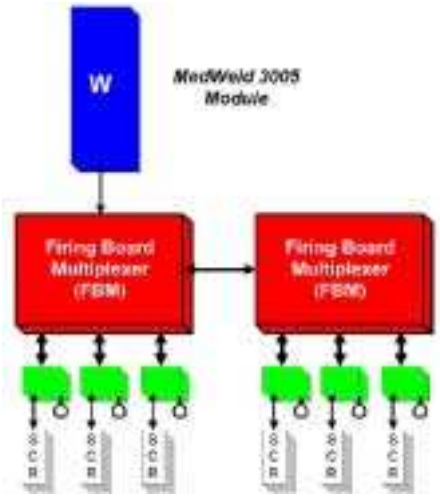

W2TP – Cascade Three-Phase Control


A single MedWeld module (W) can interface to multiple Three-Phase assemblies (TP). In this drawing, we are showing one MedWeld module controlling in cascade, two Three-Phase assemblies hence "W2TP".

The cascade configuration time-shares one MedWeld 3005 control for each three-phase assembly.

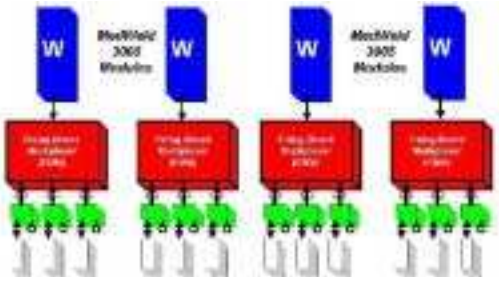

4WTP – Multiple Three-Phase Control

A single enclosure can host multiple MedWeld modules each controlling one Three-Phase assembly. The illustration shows a multiple of four hence "4WTP". You may select multiples of two and three as well.

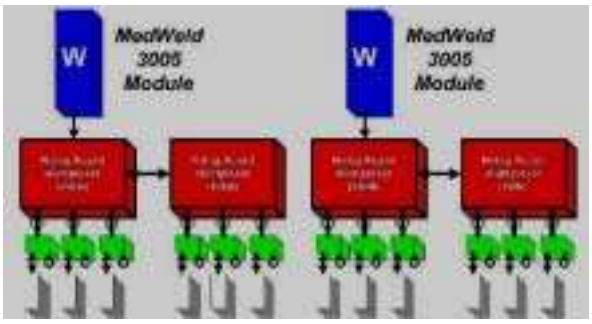

2W4TP – Multiple Cascade Three-Phase

This illustration shows two MedWeld modules each interfaced to two Three-Phase assemblies for a total of four TP hence "2W4TP".

Four TP add up to twelve SCRs. This configuration is available in the MedWeld 3095 enclosure in the 1200-ampere range only.

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Model Numbers for 3-Phase Systems

MedWeld 3005 Three Phase to DC
MedWeld 3035 -WTP=1200
MedWeld 3035 -WTP=1750
MedWeld 3035 -WTP=2500
MedWeld 3035 -WTP=3300
MedWeld 3065 -WTP=1200
MedWeld 3065 -WTP=1750
MedWeld 3065 -WTP=2500
MedWeld 3065 -WTP=3300
MedWeld 3075 -WTP=1200
MedWeld 3075 -WTP=1750
MedWeld 3075 -WTP=2500
MedWeld 3075 -WTP=3300
MedWeld 3095 -WTP=1200
MedWeld 3095 -WTP=1750
MedWeld 3095 -WTP=2500
MedWeld 3095 -WTP=3300

Additional Three Phase to DC
additonal WTP=1200
additonal TP=1200
additonal WTP=1750
additonal TP=1750
additonal WTP=2500
additonal TP=2500
additonal WTP=3300
additonal TP=3300

Note on Current Monitoring for AC and 3-Phase to DC Controls:

The current transformer coil shown above and throughout this catalog is used on AC and 3-Phase to DC controls. This device is suited for currents above 50 amperes. For applications below this level, please consult with WTC and request for the document entitled *"Guidelines to Select a Sensor to Measure Welding Current".*

Seam Welding with 3-Phase Welding Controls

WTC welding controls provide a load resistor across the welding transformer. This resistor assures proper SCR firing and transient voltage suppression under all operating conditions.

The load resistor supplied as standard equipment is designed for spot welding or short duration seam welding use with a maximum weld time of 5 seconds and a maximum duty cycle of 33%. If your welding application involves weld times longer than 5 seconds per weld or an overall duty cycle exceeding 33%, a larger load resistor is required. Please contact the factory or your sales representative to obtain the correct load resistor for your application.



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com


Model No. 3035-WTP=1200-xxxx -…. (Allen-Bradley ® SLC 500)

Base includes

- ***Nema 12, Type 5 Enclosure***
- ***One MedWeld 3005 WCU module***
- ***One FBM***
- ***Three sets 1200 amp SCRs***
- ***Firing Cards***
- ***Current Monitoring Coils***

Options:

- Maximum: 1 WTP (1200/1750/2500/3300 amp)
- Maximum: One 7-slot rack with AB modules
- 250 / 500 / 1000 VA Valve Power Supply & Fusing
- Power lugs or Circuit Breaker (250/400/600 amp 3 pole)
- Isolation Contactor (size #5)
- HHT Port Kit & I/O Connector Installed

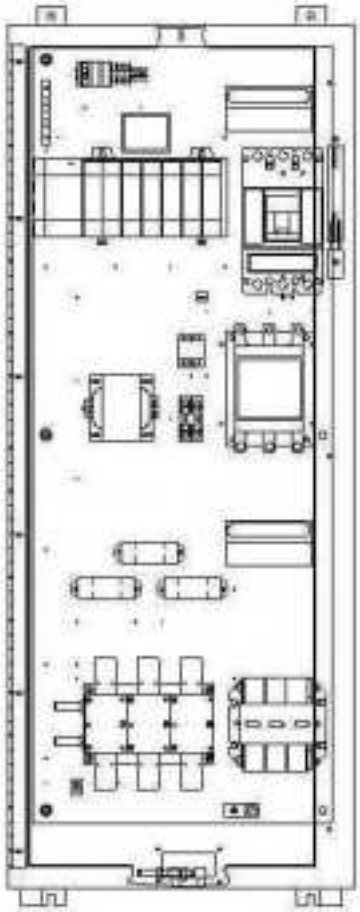


MedWeld 3035-WTP	***English***	***Metric***
Approximate Weight	*265 lbs*	*120 Kg*
Dimensions	*60H x 24W x 12D (in)*	*1524H x 610W x 305D (mm)*
Mounting Centers	*18W x 61.25 (in)*	*457W x 1556H (mm)*
Mounting Holes Diameter	*7/16th (in)*	*10 (mm)*

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Model No. 3065-xWxTP=1200-xxxx -…. (Allen-Bradley ® SLC 500)

Base includes

- ***Nema 12, Type 5 Enclosure***
- ***One MedWeld 3005 WCU module***
- ***One FBM***
- ***Three sets 1200 amp SCRs***
- ***Firing Cards***
- ***Current Monitoring Coils***

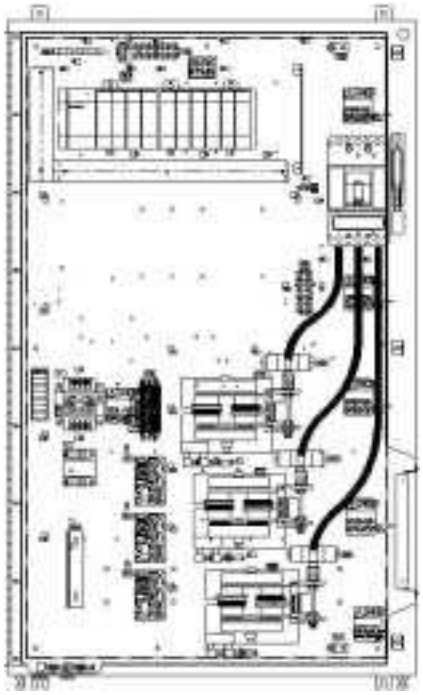

Options:

- Maximum:
  2 WTP (1200/1750/2500/3300 amp)
- Maximum: One 13-slot rack with AB modules
- 250 / 500 / 1000 VA Valve Power Supply & Fusing
- Power lugs or Circuit Breaker
  (250/400/600/800/1200/1600/2000 amp 3 pole)
- Isolation Contactor (size #5)
- HHT Port Kit s& I/O Connector Installed


2MedWeld 3065-WTP	*English*	*Metric*
Approximate Weight	*300 lbs*	*135 Kg*
Dimensions	*60H x 37.38W x 16D (in)*	*1524H x 950W x 406D (mm)*
Mounting Centers	*31.38W x 61.12H (in)*	*797W x 1553H (mm)*
Mounting Holes Diameter	*7/16th (in)*	*10 (mm)*

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Model No. 3075-xWxTP=1200-xxxx -…. (Allen-Bradley ® SLC 500)

Base includes

- ***Nema 12, Type 5 Enclosure***
- ***One MedWeld 3005 WCU module***
- ***One FBM***
- ***Three sets 1200 amp SCRs***
- ***Firing Cards***
- ***Current Monitoring Coils***

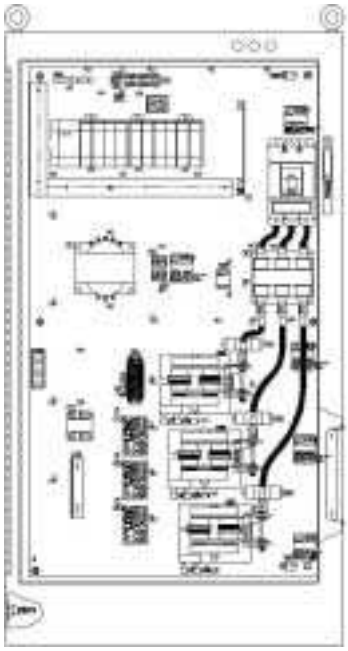

Options:

- Maximum:
  2 WTP (1200/1750/2500/3300 amp)
- Maximum:
  Two 13-slot racks with AB modules (non-interconnected)
  Two 10-slot racks with AB modules (interconnected)
- 250 / 500 / 1000 VA Valve Power Supply & Fusing
- Power lugs or Circuit Breaker
  (250/400/600/800/1200/1600/2000 amp 3 pole)
- Isolation Contactor (size #5)
- HHT Port Kit s& I/O Connector Installed


MedWeld 3075-WTP	***English***	***Metric***
Approximate Weight	*350 lbs*	*160 Kg*
Dimensions	*72.12H x 39.5W x 18.13D (in)*	*1832H x 1000W x 460D (mm)*
Mounting Centers	*Floor Mount*	*Floor Mount*

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Model No. 3095-xWxTP=1200-xxxx -…. (Allen-Bradley ® SLC 500)

Base includes

- ***Nema 12, Type 5 Enclosure***
- ***One MedWeld 3005 WCU module***
- ***One FBM***
- ***Three sets 1200 amp SCRs***
- ***Firing Cards***
- ***Current Monitoring Coils***

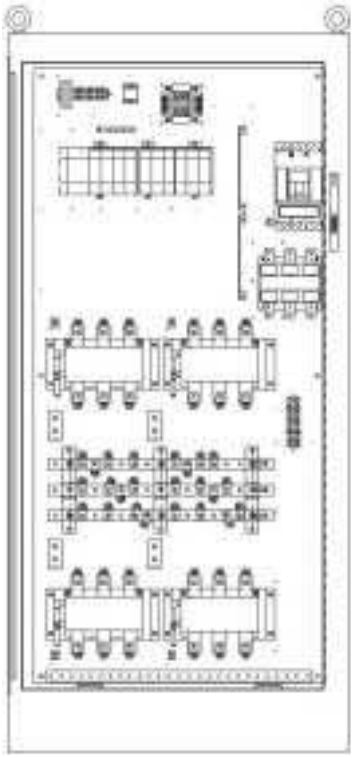

Options:

- Maximum:
  - 4 WTP (1200 amp)
  - 2 WTP (1750/2500/3300 amp)
- Maximum: One 13-slot rack with AB modules
- 250 / 500 / 1000 VA Valve Power Supply & Fusing
- Power lugs or Circuit Breaker (250/400/600/800/1200/1600/2000 amp 3 pole)
- Isolation Contactor (size #5)
- HHT Port Kit s& I/O Connector Installed

MedWeld 3095-WTP	***English***	***Metric***
Approximate Weight	*550 lbs*	*250 Kg*
Dimensions	*84.13H x 39.5W x 18.13D (in)*	*2137H x 1000W x 460D (mm)*
Mounting Centers	*Floor Mount*	*Floor Mount*

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Model Number Review for 3-Phase Systems

The model numbering scheme is the same for 3-Phase systems as they are for single-phase systems and cascades with the difference being that the second grouping of alpha-numeric characters calls out for "WTP" for "Welding Three Phase".

3065-1W2TP=1750-xxxx-…..

Part numbers are used to classify a product in a detailed manner. There are distinct bills of materials that are associated to a part number hence if you want to reorder an identical system to one that has been purchased before; you would specify a "Part Number".

Model numbers are descriptive numbers of a general nature. It is used to classify a product at a glance. The preceding pages describe how to group the WTPs together.

Select appropriate WTP enclosure model (3035, 3065, 3075, or 3095).
Additional number of MedWeld 3005 "WTP" resistance-welding processors.
Additional number of "TP" power switches.
Add options and accessories required.
Add Allen-Bradley ™ components required.



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Safety Ground Fault Systems for Manually Operated Transguns

Monitoring and control circuits are required for ensuring the safety of human beings who operate a welding gun that is integrated with a welding transformer. There is high voltage cables that come in close proximity to the person who manipulates the "transgun" hence several designs need to be incorporated into the tool to make sure that the person does not become the easy path to ground for a primary electrical short circuits. At a minimum, the following three requirements must be included:

- The integrity of the ground cable between the control and the welding transformer needs to be monitored at all times to assure that the cable would be capable of grounding out the primary short in the event of occurrence.

- Imbalances of current between the control and transformer need to be monitored at all times. Should the current to the transformer exceed the current returning from the transformer by 10 mA or greater, it would be presumed that primary current is finding its way to ground. The control must then isolate the welding gun from the power lines.

- A grounded metallic shield must surround the power cables between the welding transformer and the welding control. The shield is grounded in the control and not at the welding gun.

There are additional monitoring and control functions that can be implemented to ensure safety. Some of these are listed as follows:

- An isolation contactor can be included to remove the power line from the transformer during equipment idle time.

- Periodic measuring and verification that the insulation covering the primary cables is adequate.

- Automatic control testing and validation can be incorporated into the design to ensure that all the safety-monitoring circuits are functioning.



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

2-Level Detection System

The simpler design is available with the MedWeld 3005 control. This design incorporates the use an independent safety monitoring system to supervise the integrity of the ground cable and monitors for primary current imbalance. If a fault is detected, the safety system will isolate the welding gun from the power lines by tripping the circuit breaker. An under-voltage trip breaker is used for failsafe condition.

The power to sustain the breaker operation must come from an external source or from the line side of the circuit breaker. When taking power from the line side of the breaker, the use of special ***"Touchsafe"*** fuse holders is required.

2-Level Manual Gun Safety Protection System Option Installed

For use with the ***MedWeld 3005 Series Controls***
This includes a GFI monitor and a current imbalance-monitoring coil with push to test button & indicator.

"Touchsafe" Switch & Power Supply Installed

This option is required for use with the manual gun safety system for under-voltage trip breaker if external power is not provided. The power is taken from the line side of the circuit breaker and can be disconnected safely. The power supply is to energize the GFI Monitor System and the UV mechanism of the circuit breaker.



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

3-Level Detection System

A more advanced safety design is available with the MedWeld 3005. This design incorporates the monitoring of the ground integrity, imbalance of current and also monitors the resistance of the insulation covering the primary cables to verify that it is greater than 250 K ohms to 2 M ohms. The verification of adequate primary insulation is accomplished with the use an independent monitoring system. This verification takes place during idle time where an isolation contactor removes the manual transformer-gun from the power lines. If the insulation resistance is too low, the control will generate a fault and prevent the isolation contactor from pulling in.


This design uses the advanced programming capability of the Allen-Bradley ™ 5/03 processor to build in a redundancy that assures full protection. On power-up and each time the welding control remains idle for more than 30 minutes, the system will automatically execute a verification test to ensure that the monitoring circuits are functioning. If the safety monitoring system does not detect the simulated faults, the Medar processor will generate a fault and prevent an unsafe condition from taking place.

A standard shunt trip for the circuit breaker is used since the power to trip the breaker is also the power to pull in the isolation contactor.

3-level Manual Gun Safety Protection System Installed

Minimal Requirements:

- Circuit breaker with shunt trip
- Isolation contactor
- AB 5/03 – 8K processor (1747-L531)
- AB output card for shunt trip – OA or OB type

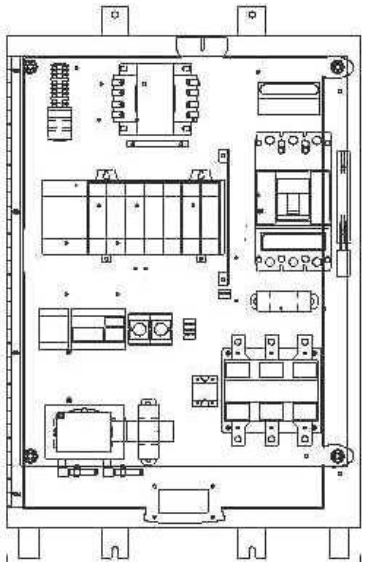

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Programming Devices for MedWeld Controls

DEP100s

Part No. 937-0009 (as shown)
937-0009V2 (with mounting tabs for panel mount)



Equipped with a 10ft (3.05 meter) cable
Part No. 205-1086

- User-friendly programming for MedWeld controls
- Graphical display for viewing data
- 5 x 6 matrix sealed keys with positive touch response
- Industrialized metal enclosure for plant environment
- Convenient metal handle for hanging on NPP bracket
- Address programming feature for network setup
- Insert / Delete function capability
- Review Welding / Fault Data for diagnostics
- Plugs into local port or network power pack

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

DP200s

DP200A – Annunciator
DP200 – Data Programmer



Part No. 937-0010 – Data Programmer – rear port
Part No. 937-0010V1 – Data Programmer – bottom port
Part No. 937-0010V2 – Annunciator – bottom port
Part No. 937-0010V3 – Annunciator – rear port

Equipped with a 10ft (3.05 meter) cable
Part No. 205-1086

- User-friendly review & editing for MedWeld controls
- Six sealed keys & four LEDs for status conditions
- Printed flowchart for user orientation
- Clear illuminated display
- Four threaded inserts on back for panel mounting
- Light and slim construction for hand held use
- One-on-one use to local MedWeld port only
- Insert / Delete function removed
- Reviewing Welding /Fault Data for diagnostics
- MedWeld file reading / writing with battery storage

Data Programmer: Allows editing of schedules but cannot insert or delete neither functions nor access setup parameters.
Annunciator: Can view but not edit any parameters. Also used for Fault Reset and Stepper Reset/Advance.
Bottom Port: Ideal for hand held use.
Rear Port: Ideal for mounting on panel or enclosure door via access hole.

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Network Power Pack

Part No. 907-0020V1 – for MedWeld 3000s –3 pin



Network Power Pack
(Photo of 907-0014V1)

- Allows networking up to 30 WCU modules to central
- 120 V_{AC} Brad Harrison Connector
- Plug in port for DEP100s (HHT) Cable
- Phoenix connector for network cable
- Strain Relief for network cable
- Convenient suspension bracket for the DEP100s

Brad Harrison Cable for Network Power Pack

Part No. 205-1004 - 12 ft (3.65 meters)

Part No. 205-1005 - 20 ft (6.10 meters)


- The cable has the appropriate mating plug for supplying power to the top of the network power pack
- The network power pack requires 120VAC, 200 milli-amp source power. There are two power leads and one ground wire.

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Medar Networking Products

Weld Support Systems

WebVIEW

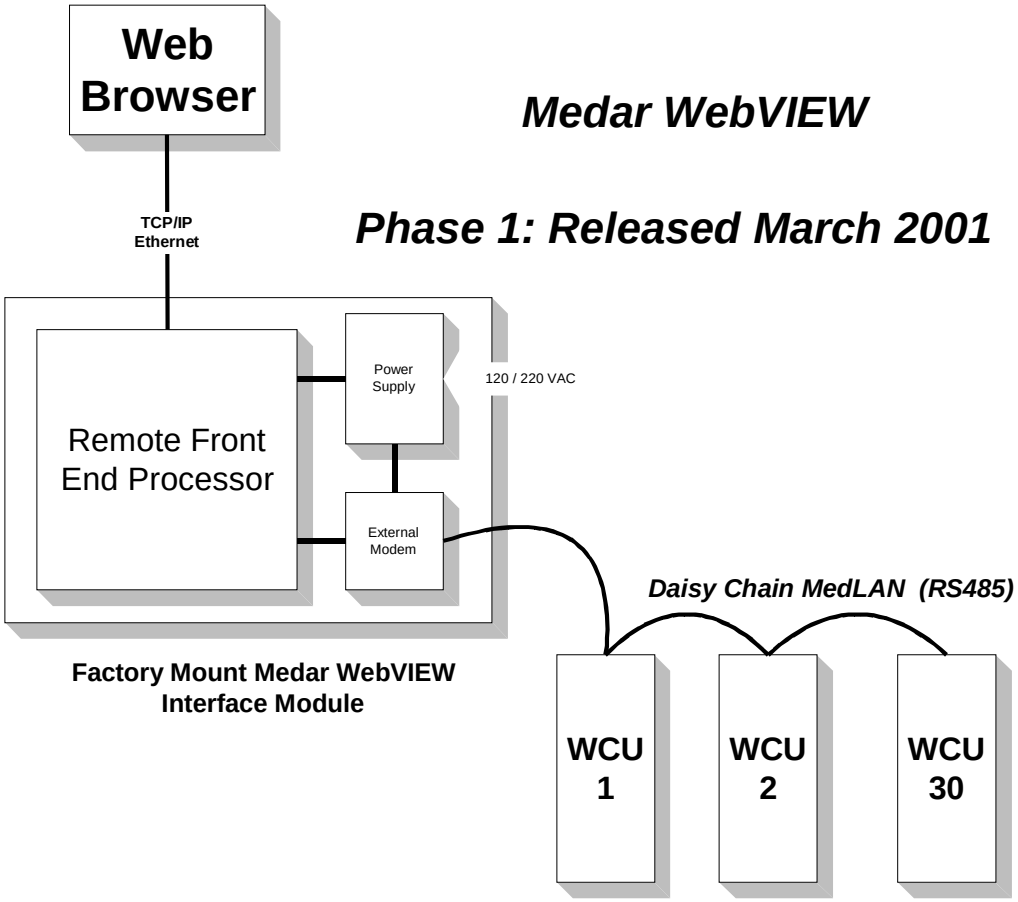

The daisy chain MedLAN network now will remain at the tool. The tools would be equipped with an industrial module that acts as "front end processing". This module is complete and with few connecting ports. There is no requirement by the user to program or configure the module hence the need for IT personnel is nil.

The module is referred as the Medar WebVIEW. It comes already pre-configured to generate reports as a web page to any web browser.

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Medar WebVIEW (Phase 1)

WebVIEW consists of a remote front-end processor unit in a small industrial enclosure that is to be mounted near the welding tools. The FEP is a microprocessor-based device that has memory and communications channels. WebVIEW has complete software functionality in its first phase to behave as a stand-alone unit. Included below are some of these features.

WebVIEW Phase 1 Features:

- Interface on MedLAN network (RS485) optically isolated up to 30 MedWeld controls.
- Program / View sequences, setup and steppers.
- Program / Edit sequences, setup and steppers.
- Status / View all and individual steppers with print option.
- Status / Edit all and individual steppers with reset function.
- Information Status: Device ID of weld controls on line.
- Archiving (Saving) sequences, setup and steppers to computer.
- Archiving (Uploading) sequences, setup and steppers from computer.
- Log Welding Data, Faults, Events and Notices (100 items per weld control)
- View / Print / Save all log data


With the phase 1 WebVIEW, the user simply plugs in any computer having a web browser into the Ethernet port. Immediately, a user interface screen will appear with prompting buttons that will allow navigation in the collection of welding information.

Sample page of WebVIEW



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

WebVIEW – Phase 2

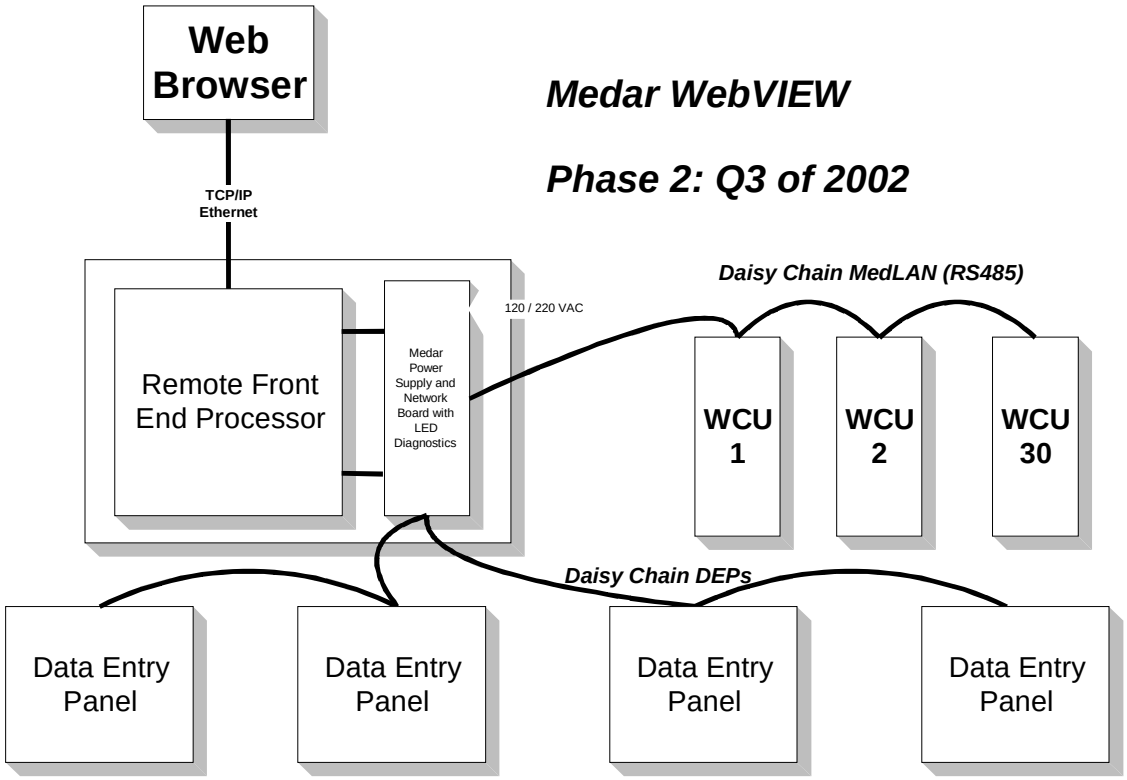

WTC is planning to release Phase 2 WebVIEW in Q3 of Year 2002. This generation of WebVIEW has all the features of the first generation product however it will have the following additional features.

WebVIEW Phase 2 Additional Features:

- Data Entry Panel network port will allow up to 6 DEPs to communicate with weld controls.
- Enhanced power supply will provide power to up to 4 remote DEPS. For more than 4 DEPs, please use Network Power Pack.
- Available as Single, Dual, and Quad Channel MedLAN units.

Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Weld Support Systems (Bank System Software)

The Medar WebVIEW product is a product that can stand by itself. Users would simply use the WebVIEW with a computer or other device that has web-browsing software. The user interacts with the MedWeld controls as the user navigates through the various screens of the WebVIEW.

For users who want to automate the interaction above the remote FEP device, WTC has available WSS NT System Software to automate interfaces with user interface and the welding controls networked via the WebVIEW or other network interfaces.



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Sizing Circuit Breaker and Isolation Contactors

RULES FOR SELECTING CIRCUIT BREAKER FRAME SIZES

By Jack Farrow, WTC R&D Center July 7, 1993 rev. 11/3/95, 8/6/97 and 2/7/01
For WTC Resistance Welding Controls

DISCLAIMER:

The purpose of this document is to assist in selecting the proper size circuit breaker for a given welding application. This document does not constitute any recommendation, warranty or obligation on the part of WTC or any of its employees. The user of this information assumes all responsibility for proper use of the information. The information in this document is presented as-is; no warranty of correctness or suitability for any application is given or implied.

ASSUMPTIONS:

The first part of this selection guide relates to the computation of the minimum required circuit breaker frame size based upon the considerations of average current. The second part relates to the computation of the required magnetic trip current range. The circuit breaker can then be selected so that it meets both requirements.

This selection guide assumes the following things:

The circuit breakers are magnetic-trip only (no thermal trip) and the magnetic trip current range is adjustable from at least 4 times nominal circuit breaker rating up to at least 8 times nominal circuit breaker rating. For a 250-amp circuit breaker, this means a magnetic trip adjustment range of 1000 to 2000 amps.

The KVA ratings on the nameplates of the welding transformers are in accordance with the RWMA standards for resistance welding transformers.

The power line voltage is between 440 and 500 VAC nominal.

When two or more welding transformers are connected to the same welding control and are fired simultaneously, the effective transformer KVA is the sum of all the transformers that are fired simultaneously.

In multiple-transformer cascading applications, the effective transformer KVA is the KVA rating of the largest transformer, NOT the sum of all of them.

All calculations here apply to SINGLE-PHASE welding controls only.



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

PART 1: CIRCUIT BREAKER MINIMUM FRAME SIZE SELECTION GUIDE

There are three classes of duty cycle to consider:

A HIGH duty cycle application is seam welding. For HIGH DUTY CYCLE applications, the circuit breaker size should be:

CIRCUIT BREAKER SIZE (amps) = TRANSFORMER NAMEPLATE KVA x 2

A MEDIUM duty cycle application is defined as 7 spot welds or more in any 30-second time interval. This corresponds to a duty cycle of more than 5%. Robot applications, manually operated welders, or multi-transformer cascading controls usually fall into this category. For MEDIUM DUTY CYCLE applications, the circuit breaker size should be:

CIRCUIT BREAKER SIZE (amps) = TRANSFORMER NAMEPLATE KVA X 1.6

A LOW duty cycle application is defined as 6 or fewer spot-welds in any 30-second time interval. This corresponds to a duty cycle of 5% or less. Welders on fixtures or hard automation usually fall into this category. For LOW DUTY CYCLE applications, the circuit breaker size should be:

CIRCUIT BREAKER SIZE (amps) = TRANSFORMER NAMEPLATE KVA X 1.3

The result of the calculation of PART 1 sets the MINIMUM acceptable circuit breaker frame size, based on average current considerations. Depending upon the results of the computation for the required magnetic trip setting (PART 2), a larger circuit breaker may be required.



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

PART 2: MAGNETIC TRIP RANGE SELECTION.

The selection of magnetic trip range is determined by maximum peak current draw, not duty cycle or average current. In order to compute maximum peak current draw, maximum welding current, type of welding machine, and number of welds made simultaneously need to be known. The following generalizations are biased toward worst-case; they will usually indicate a need for a higher magnetic trip range than what is actually needed. These generalizations should be used ONLY if better data is not available.

The basic formula for selecting the required magnetic trip setting is:

MTS = WC * NSW * MF

Where:

- MTS = Magnetic trip setting
- WC = Welding current per weld; assume 18,000 amps for steel, and 40,000 amps for aluminum
- NSW = Number of simultaneous weld loops. Usually, this is equal to the number of weld spots. Where series welding is used, each pair of weld spots counts as one.
- MF = Machine factor; 0.084 for a hanging gun station, 0.042 for a machine or fixture welder, 0.021 for an integral transformer welding gun.

EXAMPLE:

Assume that four welds on a steel automobile body are made simultaneously in a fixture-type welding machine. Using these assumptions:

WC = 18,000 amps (for steel)
NSW = 4 (4 welds made simultaneously)
MF = 0.042 (for a fixture welder)

The required magnetic trip setting would be:

MTS = 18,000 * 4 * 0.042 = 3042 amps

If the required magnetic trip setting is higher than what is available on a circuit breaker frame size selected according to the first part of this write-up, a larger circuit breaker is required. The circuit breaker size should be selected according to EITHER average current or peak current considerations, whichever is higher.



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

RULES FOR SIZING ISOLATION CONTACTORS

By Jack Farrow, WTC R&D Center, February 7, 2001 Copyright, 2001 by WTC
FOR WTC RESISTANCE WELDING CONTROLS

DISCLAIMER:

The purpose of this document is to assist in selecting the proper size isolation contactor for a given welding application. This document does not constitute any recommendation, warranty or obligation on the part of Welding Technology Corporation or any of its employees, representatives or distributors. The user of this information assumes all responsibility for proper use of the information. The information in this document is presented as-is; no warranty of correctness or suitability for any application is given or implied.

The calculations in this document have been simplified and are designed for the most common situations. If the application is very unusual, for example a system with large welding transformers above 400 KVA, a system with more than six welding transformers, or a system with a very low welding duty cycle (below 1%), competent engineering help should be sought to size the isolation contactor.

ASSUMPTIONS:

The process to select the correct size of an isolation contactor consists of two parts. Part 1 calculates the average primary current draw of each welding transformer in the system. Given the average primary current draw of each welding transformer in the system and how they are connected, Part 2 selects the appropriate size isolation contactor.

This selection guide assumes the following things:

The isolation contactors are rated in amperes by UL general purpose current, which is a continuous-duty current.

The isolation contactors are not opened or closed while weld current is flowing.

The KVA ratings on the nameplates of the welding transformers are in accordance with the RWMA standards for resistance welding transformers.

The power line voltage is between 420 and 500 VAC nominal.

All calculations here apply to SINGLE-PHASE AC welding transformers only.



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

PART 1:CALCULATION OF AVERAGE CURRENT DRAW PER WELDING TRANSFORMER

There are three classes of duty cycle to consider:

A HIGH duty cycle application is seam welding. For HIGH DUTY CYCLE applications, the average primary current draw per transformer is:

AVERAGE CURRENT DRAW (amps) = TRANSFORMER NAMEPLATE KVA x 2

A MEDIUM duty cycle application is defined as 7 or more spot-welds in any 30-second time interval. This corresponds to a duty cycle of more than 5%. Robot applications, portable gun welders, or systems, which use multiple welding guns on each transformer usually, fall into this category. For MEDIUM DUTY CYCLE applications, the average primary current draw per transformer is:

AVERAGE CURRENT DRAW (amps) = TRANSFORMER NAMEPLATE KVA X 1.6

A LOW duty cycle application is defined as 6 or fewer spot-welds in any 30-second time interval. This corresponds to a duty cycle of 5% or less. Manually operated pedestal welders, welders on fixtures or hard automation welders usually fall into this category. For LOW DUTY CYCLE applications, the average primary current draw per transformer is:

AVERAGE CURRENT DRAW (amps) = TRANSFORMER NAMEPLATE KVA X 1.3

The result of the calculation of PART 1 determines the average current per welding transformer. Depending on how the transformer(s) are connected to the isolation contactor, PART 2 selects the appropriate isolation contactor rating in amperes.



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

PART 2: ISOLATION CONTACTOR CURRENT RATING SELECTION BASED ON TRANSFORMER CONNECTION.

CASE 1: (simplest)

If just one single-phase transformer is connected to an isolation contactor, the required isolation contactor current rating is the value of average current calculated for that transformer from Part 1.

CASE 2:

If two or more transformers are connected in parallel on the same two poles of an isolation contactor and are welding simultaneously, the required isolation contactor current rating is simply the sum of the average currents calculated for each transformer (from Part 1).

For example if three 50 KVA welding transformers, welding simultaneously in a fixture application are connected to the same two poles of an isolation contactor, the required current rating for the isolation contactor is:
65 + 65 + 65 = 195 amperes.

CASE 3:

If two or more transformers are connected in parallel on the same two poles of an isolation contactor and ARE NOT welding simultaneously (cascade operation), the required isolation contactor current rating is equal to the average current for the largest transformer (from Part 1) times the square root of the number of transformers.

For example, if a 100 KVA and a 75 KVA transformer are connected in parallel to the same two poles of an isolation contactor and are operated in cascade in a fixture welding application, the required current rating for the isolation contactor is:
130 * sqrt(2) = 184 amperes.



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

CASE 4:

If two or more transformers are connected to different poles of the isolation contactor (three-phase operation), whether the transformers are welding simultaneously or not, the required isolation contactor current rating is the highest sum of average currents for the all the transformers on one phase, times 1.7 (the approximate square root of 3).

For example, four 75 KVA fixture welding transformers are connected to all three poles of an isolation contactor. Two transformers are connected to poles 1 and 2, one transformer is connected to poles 2 and 3, and the last transformer is connected to poles 1 and 3. All transformers weld simultaneously:

The largest load is the two 75 KVA transformers on poles 1 and 2. The computed average current (from Part 1) for these two transformers is 98 + 98 = 196 amperes.

The required current rating for the isolation contactor is:
196 * 1.7 = 333 amperes

Once the required current rating is computed, select the isolation contactor with the next-higher current rating value. The circuit breaker above the isolation contactor(s) and any upstream fuses must be sized appropriately to handle the required current ratings computed above. The magnetic trip of the circuit breaker should be set no higher than ten times the current rating of the smallest isolation contactor below it.



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Directory of Resources

WTC - Corporate Office



150 St. Charles Road
Carol Stream IL 60188-2083
Tel: 630-462-8250
Fax: 630-462-8259
Email: corporate@weldtechcorp.com
Web: www.weldtechcorp.com

WTC Automotive

MEDAR

Weltronic

24775 Crestview Court
Farmington Hills, MI 48335-1563
Tel: +1 248-477-3900
Fax: +1 248-477-8897
Email: welding@weldtechcorp.com
Web: www.weldtechcorp.com

WTC Canada

wtc canada

240 Cordova Road
P.O. Box 858
Oshawa, Ontario L1H 7N1
Tel: +1 905-433-1230
Fax: +1 905-433-1257
Email: sales@wtc.ca

Technitron Industrial Division

technitron

710 Cahaba Valley Circle
Pelham, Alabama 35124
Tel: +1 205-989-5700
Fax: +1 205-989-5719
Email: sales@technitron-wtc.com

Industrial Technical Services Division



24775 Crestview Court
Farmington Hills, MI 48335-1563
Tel: +1 877-982-7378 (toll free)
Fax: +1 248-477-5263
Email: sales@its-wtc.com



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Quality

QS 9000 with TE Supplement

Medar and other WTC brand welding controls are manufactured in WTC's Farmington Hills, Michigan facility. BSI registers this facility along with the WTC Canada facility and ITS in Farmington Hills Michigan under certificate FM52727 for QS9000 with TE Supplement.

Acknowledgements



Allen-Bradley, PLC, SLC500 are registered trademarks of Rockwell Automation
Fanuc is a registered trademark of Fanuc Robotics
Medar, MedWeld and WebVIEW are trademarks of Welding Technology Corporation.
Motoman is a registered trademark of Yaskawa Electric.
Nachi is a registered trademark of Nachi Robotics Systems, Inc.

The symbol  is a registered trademark of CSA International

The CE mark certifies conformity with all applicable European Community requirements.



Artisan Technology Group - Quality Instrumentation ... Guaranteed | (888) 88-SOURCE | www.artisantg.com

Artisan Technology Group is an independent supplier of quality pre-owned equipment

Gold-standard solutions

Extend the life of your critical industrial, commercial, and military systems with our superior service and support.

We buy equipment

Planning to upgrade your current equipment? Have surplus equipment taking up shelf space? We'll give it a new home.

Learn more!

Visit us at **artisantg.com** for more info on price quotes, drivers, technical specifications, manuals, and documentation.

Artisan Scientific Corporation dba Artisan Technology Group is not an affiliate, representative, or authorized distributor for any manufacturer listed herein.

We're here to make your life easier. How can we help you today?

(217) 352-9330 | sales@artisantg.com | artisantg.com

ARTISAN® TECHNOLOGY GROUP